

AMBIT ENGINEERING, INC. CIVIL ENGINEERS AND LAND SURVEYORS

200 Griffin Road, Unit 3, Portsmouth, NH 03801
Phone (603) 430-9282 Fax 436-2315

29 April 2020

Dexter Legg, Planning Board Chair
City of Portsmouth
1 Junkins Avenue
Portsmouth, NH 03801

RE: Request for TAC Site Plan Approval at 41 Salem Street, Tax Map 144 / Lot 31

Dear Chair Legg and Planning Board members:

On behalf of Bonza Builders, LLC we hereby submit the attached and enclosed Site Plans for Planning Board Approval for a Residential Development at 41 Salem Street. The project proposes the construction of three new single family homes with the associated and required site improvements. The site is currently a single family home which will be demolished.

The following plans are included in our submission:

- Cover Sheet – This shows the Development Team, Legend, Site Location, and Site Zoning.
- Standard Boundary Survey – This plans show the property boundary lines and areas.
- Existing Conditions Plan C1 – This plan shows the existing features on the property.
- Site Layout Plan C2 – This plan shows the proposed site layout.
- Utility Plan C3 – This plan shows the proposed utilities including individual service connections.
- Grading and Erosion Control Plan C4 – This plan shows the proposed grading and erosion control. The project proposes off-site drainage improvements as project mitigation.
- Landscape Plan C5 – This plan shows the proposed landscaping at the site.
- Demolition Plan C6 – This plan shows site demolition. The existing single family residence will be removed from the property.
- Plan and Profile P1 – This shows the off-site drainage improvements.
- Detail Sheets D1 to D3 – These plans show the associated construction details.

Also included herewith is the following Supplemental Information to assist in the review of the project: Site Plan Application Checklist, Trip Generation, Drainage Analysis, and Architectural Plans. We look forward to the Planning Board review of this submission. If there are any questions or comments please feel free to reach out to me.

The project received a Technical Advisory Committee recommendation of approval at the April 13, 2020 Technical Advisory Committee Meeting subject to stipulations. The stipulations, as well as our responses to the stipulations, are listed below:

1. Plans shall be updated as follows:
 - a. Show existing sewer service on Existing Conditions plan and reuse as directed by DPW; **The sewer service is shown on Sheets C1 and C3.**
 - b. Revise water service line sizes to be 1"; **This is shown on Sheet C3.**
 - c. Provide individual water and fire services for unit 2 ~~–4" main with services from the main as discussed at TAC~~; **This is shown on Sheet C3.**
 - d. Provide water service for unit 3 as discussed at TAC; **This is shown on Sheet C3.**
 - e. Move proposed catch basin out of new driveway downhill so that it is in the curbed area, make 45 degree bend on underdrain to do this; **This is shown on Sheet C4.**
 - f. Make sure drip edge is at least 12" wide than edge of eave; **Yes; eave is only 12 inches.**
 - g. Add note to plans that street to be milled and paved to repair the disturbed areas of Salem Street one year after utilities are completed; **This is shown on Sheet C2 as Note 11.**
 - h. Add required note for existing water service to be capped at the main; **This is shown on Sheet C3 (if not re-used).**
 - i. Add note to plans that any damage to existing sidewalks to be repaired to DPW satisfaction; **This is shown on Sheet C2 as Note 12.**
 - j. Replace drain pipe from CB2 to CB3 with new 15" PE pipe at intersection of McDonough and Salem; **This is shown on Sheet P1.**
 - k. New drain pipe in Salem Street should be sized at 12"; **This is shown on Sheet P1.**
 - l. Crushed stone bedding for drain pipes shall have soil separation fabric between stone and sand blanket; **This is shown on Sheet D2, Detail I.**
 - m. Use NH standard frame and grate for basins; **This is shown on Sheet D2, Detail H.**
 - n. Use Ergo XL hinged cover marked "Drain" for DMH(s); **This is shown on Sheet D2, Detail J.**
 - o. Provide sewer service details showing 6" PVC services with wyes cut into main and patched back in with pvc repair couplings (no rubber 'Fernco' couplings allowed); **This is shown on Sheet C3, Detail 1.**
 - p. On profile view: a) Raise proposed drain main in Salem Street so it is not in conflict with sewer; b) Existing 6" DI water is likely shallower than depicted; c) Gas main is likely shallower than depicted, to be confirmed with DPW. **This is shown on Sheet P1.**

2. Landscape Plan to be updated as described to TAC to make sure any plantings at corner of driveway are less than 3.5 feet tall so that they do not block sight lines of drivers exiting onto Salem Street. **The three plantings potentially in conflict are as follows:**
 - a. **SDW – Lilac: The Landscape Architect has recommended that we substitute a TM (Taxus x media Tautonii) for the Lilac. This plant is a**

evergreen, b) low growing/spreading, c) well suited to this location, and d) already included in the project's plant list.

- b. **CP – Sweet Fern: this will not grow to that height.**
 - c. **MA – Amur Meechia: this species was picked by the Trees and Greenery Committee. At planting the specific specimen can be chosen to be more upright with a higher branching structure. Lower limbs will need to be pruned for the sidewalk, which is along the sight line. All changes are shown on Sheet C5.**
3. Landscape Plan to be updated to match site plan for building footprint and style. **This is shown on Sheet C5.**
 4. Proposed building designs to be reviewed with Planning Department for further guidance on architectural design and abutter concerns regarding building height. **Guidance was received in an email from Planning Staff dated April 27. Plans revised to try to address the suggestions.**

We look forward to your review of this submission, and request approval of the site plan as submitted.

Sincerely,

John Chagnon

John R. Chagnon, PE
CC: Bonza Builders, LLC


PROPOSED RESIDENTIAL DEVELOPMENT 41 SALEM STREET PORTSMOUTH, NEW HAMPSHIRE PERMIT PLANS

OWNER:
BONZA BUILDERS, LLC.
79 EXETER ROAD
NORTH HAMPTON, N.H. 03862
TEL. (603) 770-5630


CIVIL ENGINEER & LAND SURVEYOR:
AMBIT ENGINEERING, INC.
200 GRIFFIN ROAD, UNIT 3
PORTSMOUTH, N.H. 03801
TEL. (603) 430-9282
FAX (603) 436-2315

ARCHITECT:
ART FORM ARCHITECTURE
44 LAFAYETTE ROAD
NORTH HAMPTON, N.H. 03862
TEL. (603) 431-9559


PORTSMOUTH ZONING MAP

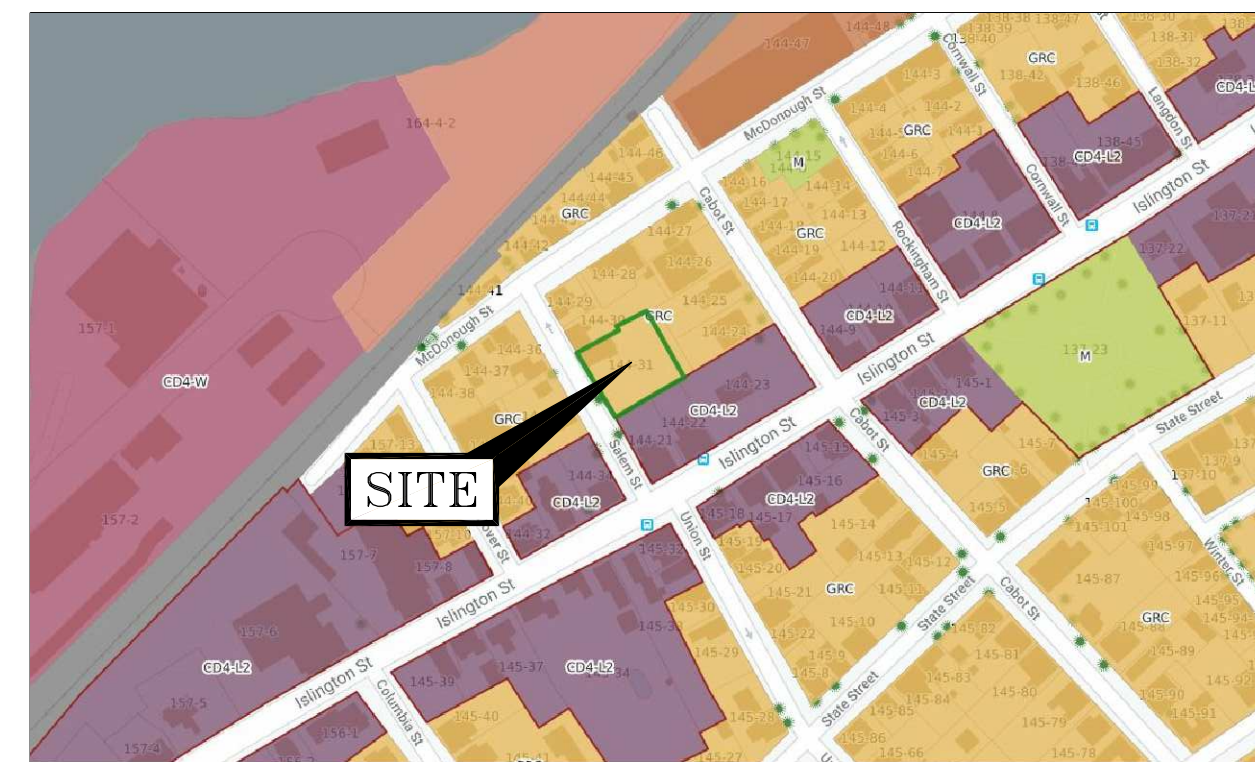

Residential Districts	
R	Rural
SRA	Single Residence A
SRB	Single Residence B
GRA	General Residence A
GRB	General Residence B
GRC	General Residence C
GA/MH	Garden Apartment/Mobile Home Park
Mixed Residential Districts	
MRO	Mixed Residential Office
MRS	Mixed Residential Business
GC	Gateway Corridor
GC2	Gateway Center
Business Districts	
GB	General Business
B	Business
WB	Waterfront Business
Industrial Districts	
OR	Office Research
I	Industrial
WI	Waterfront Industrial
Airport Districts	
AIR	Airport
AI	Airport Industrial
PI	Passive Industrial
ABC	Airport Business Commercial
Conservation Districts	
M	Municipal
NRP	Natural Resource Protection

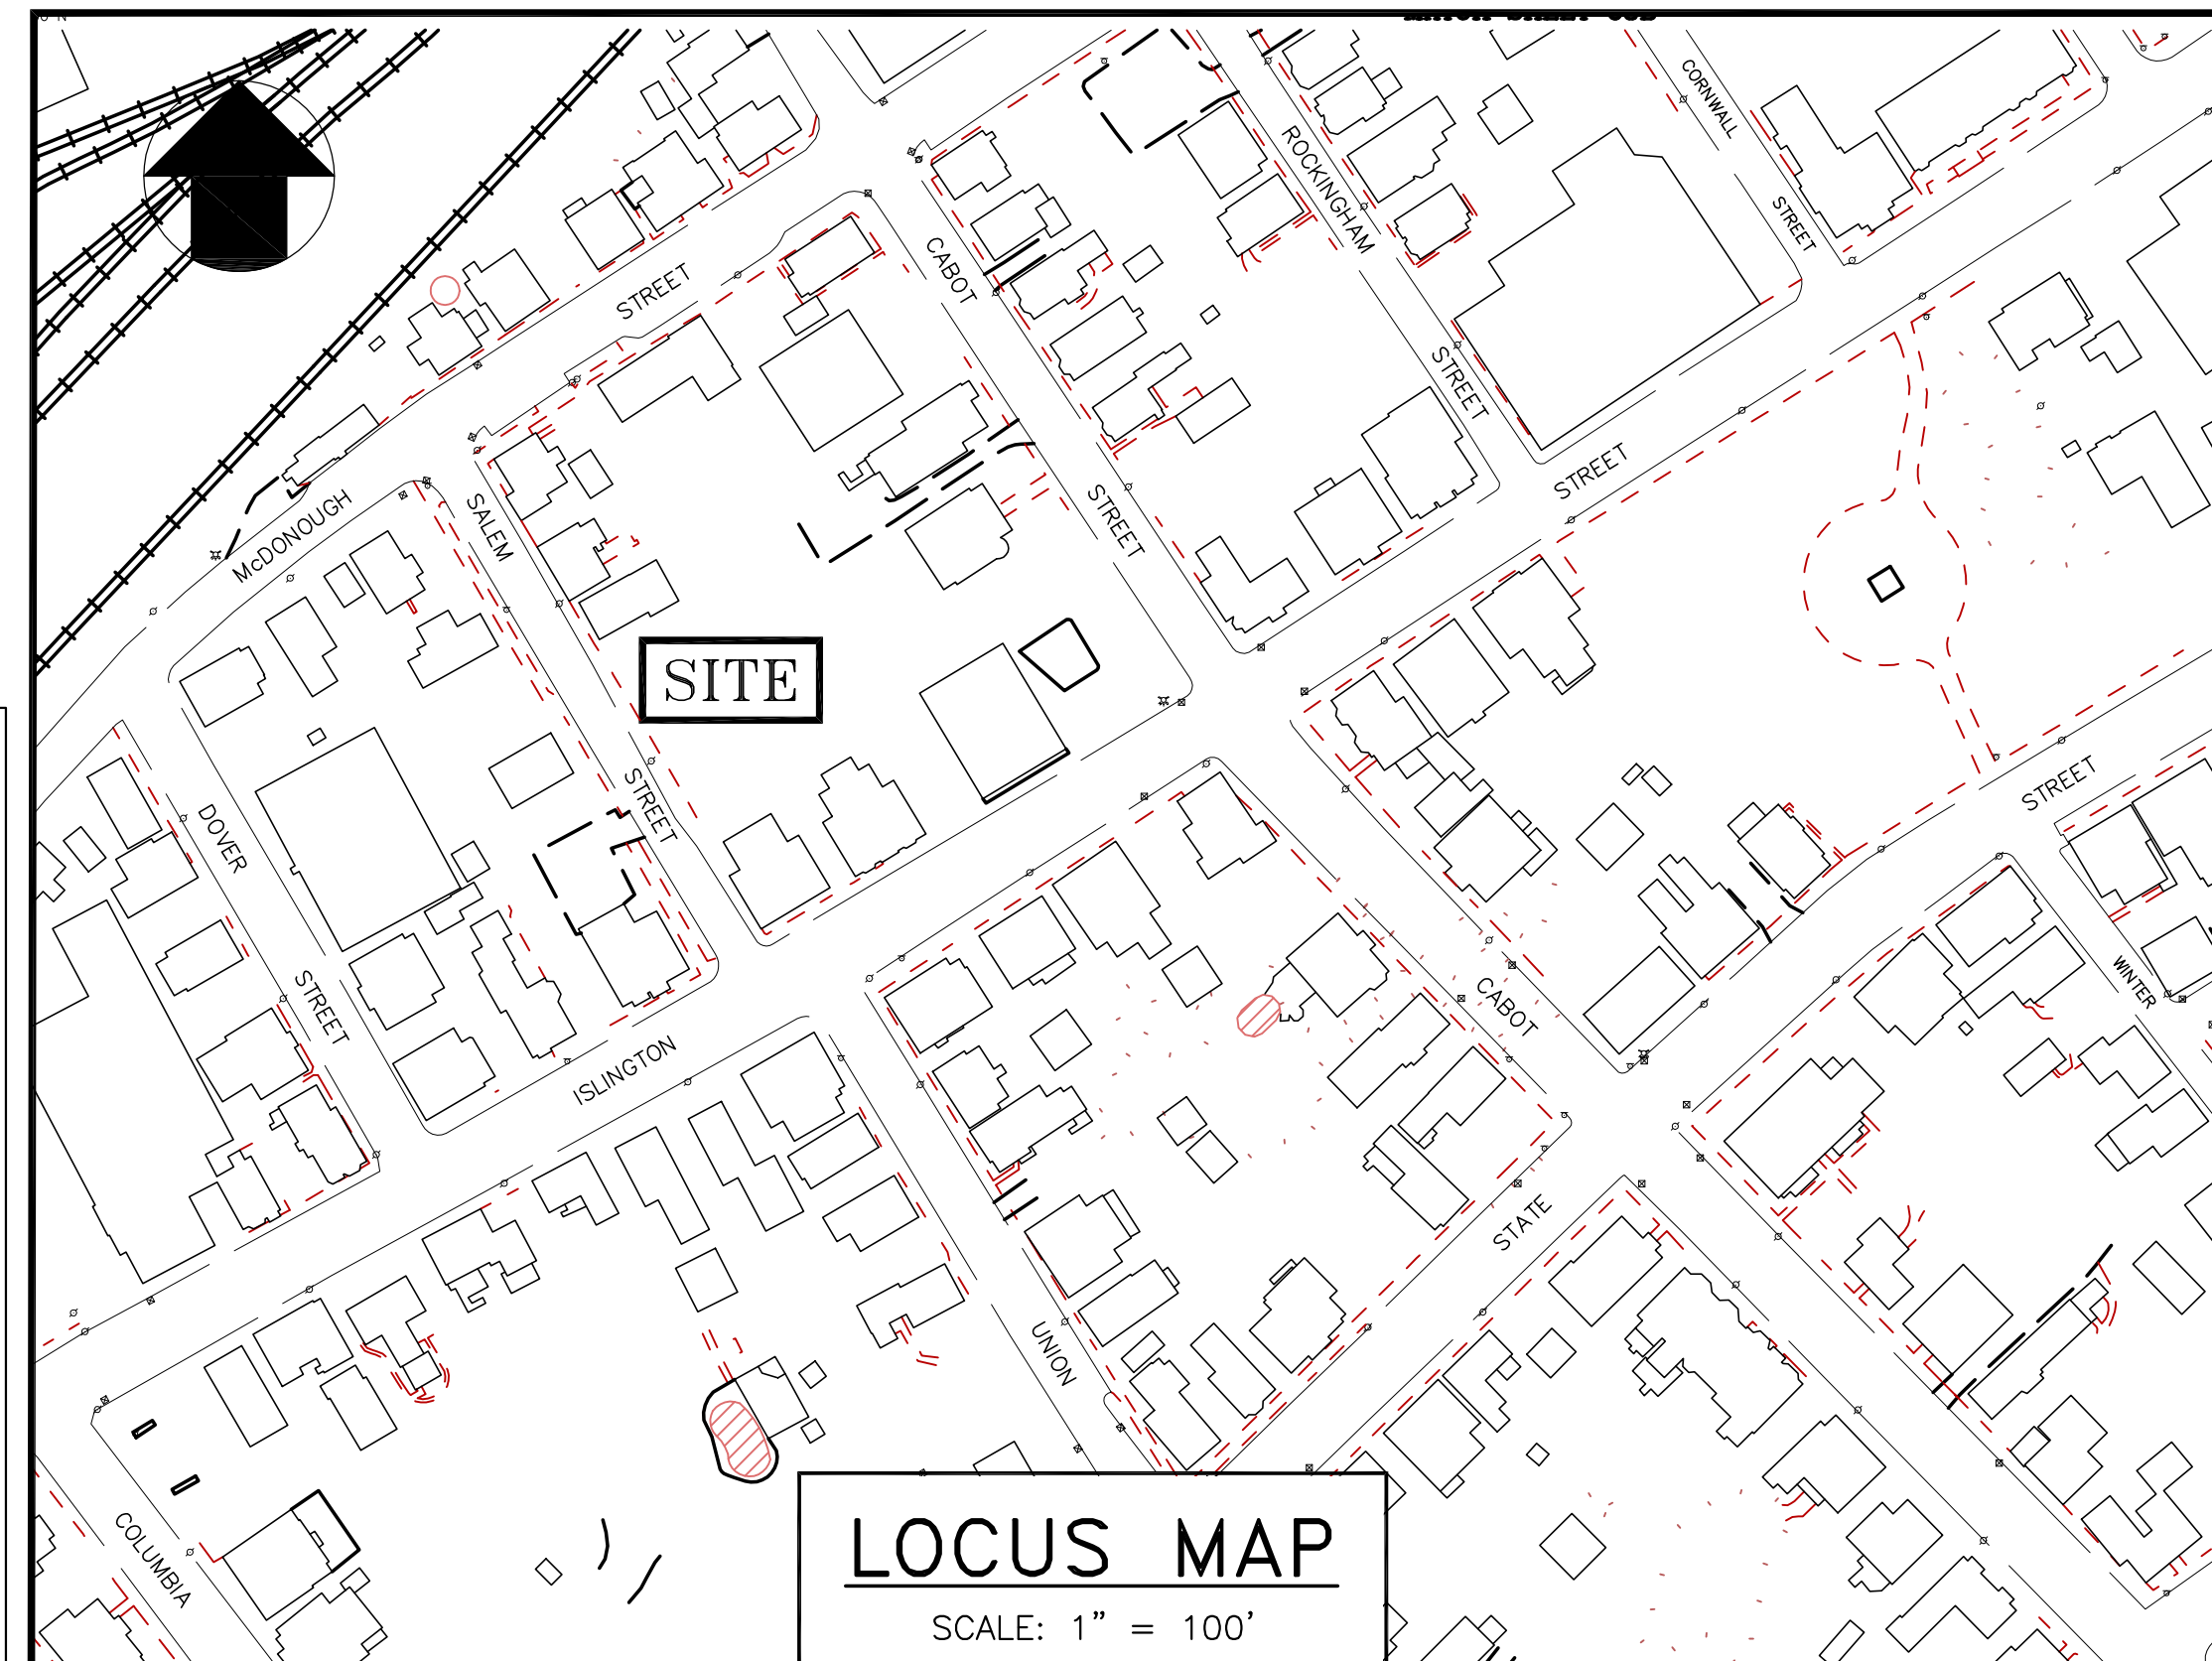

LEGEND:		
EXISTING	PROPOSED	
---	---	PROPERTY LINE
---	---	SETBACK
S	S	SEWER PIPE
SL	SL	SEWER LATERAL
G	G	GAS LINE
D	D	STORM DRAIN
W	W	WATER LINE
WS	WS	WATER SERVICE
UGE	UGE	UNDERGROUND ELECTRIC
OHW	OHW	OVERHEAD ELECTRIC/WIRES
---	---	FOUNDATION DRAIN
---	---	EDGE OF PAVEMENT (EP)
100	100	CONTOUR
97x3	98x0	SPOT ELEVATION
○	○	UTILITY POLE
☀	☀	WALL MOUNTED EXTERIOR LIGHTS
☀	☀	TRANSFORMER ON CONCRETE PAD
☀	☀	ELECTRIC HANDHOLD
☀	☀	SHUT OFFS (WATER/GAS)
☀	☀	GATE VALVE
☀	☀	HYDRANT
☀	☀	CATCH BASIN
☀	☀	SEWER MANHOLE
☀	☀	DRAIN MANHOLE
☀	☀	TELEPHONE MANHOLE
☀	☀	PARKING SPACE COUNT
☀	☀	PARKING METER
☀	☀	LANDSCAPED AREA
TBD	TBD	TO BE DETERMINED
CI	CI	CAST IRON PIPE
COP	COP	COPPER PIPE
DI	DI	DUCTILE IRON PIPE
PVC	PVC	POLYVINYL CHLORIDE PIPE
RCP	RCP	REINFORCED CONCRETE PIPE
AC	AC	ASBESTOS CEMENT PIPE
VC	VC	VITRIFIED CLAY PIPE
EP	EP	EDGE OF PAVEMENT
EL	EL	ELEVATION
FF	FF	FINISHED FLOOR
INV	INV	INVERT
S =	S =	SLOPE FT/FT
TBM	TBM	TEMPORARY BENCH MARK
TYP	TYP	TYPICAL
W.W.	W.W.	WINDOW WELL

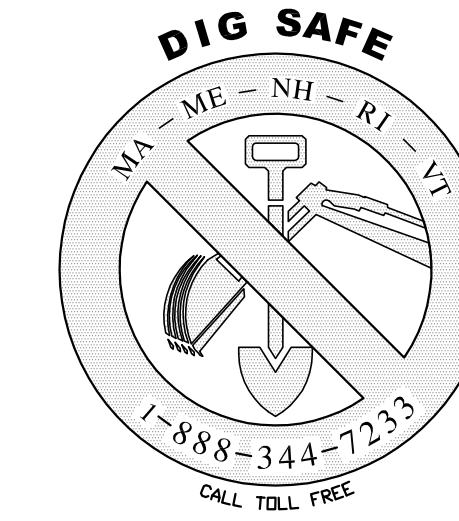

INDEX OF SHEETS

DWG No.	Description
-	STANDARD BOUNDARY SURVEY
C1	EXISTING CONDITIONS PLAN
C2	SITE LAYOUT PLAN
C3	UTILITY PLAN
C4	GRADING, DRAINAGE, & EROSION CONTROL PLAN
C5	LANDSCAPE PLAN
C6	DEMOLITION PLAN
P1	SALEM STREET PLAN & PROFILE
D1-D3	EROSION CONTROL NOTES & DETAILS

UTILITY CONTACTS

ELECTRIC:
EVERSOURCE
1700 LAFAYETTE ROAD
PORTSMOUTH, N.H. 03801
Tel. (603) 436-7708, Ext. 555.5678
ATTN: MICHAEL BUSBY, P.E. (MANAGER)

NATURAL GAS:
UNITIL
325 WEST ROAD
PORTSMOUTH, N.H. 03801
Tel. (603) 294-5144
ATTN: DAVE BEAULIEU

CABLE:
COMCAST
155 COMMERCE WAY
PORTSMOUTH, N.H. 03801
Tel. (603) 679-5695 (X1037)
ATTN: MIKE COLLINS

SEWER & WATER:
PORTSMOUTH DEPARTMENT OF PUBLIC WORKS
680 PEVERLY HILL ROAD
PORTSMOUTH, N.H. 03801
Tel. (603) 427-1530
ATTN: JIM TOW

COMMUNICATIONS:
CONSOLIDATED COMMUNICATIONS
JOE CONSIDINE
1575 GREENLAND ROAD
GREENLAND, N.H. 03840
Tel. (603) 427-5525

PORTSMOUTH APPROVAL CONDITIONS NOTE:
ALL CONDITIONS ON THIS PLAN SET SHALL REMAIN IN EFFECT IN PERPETUITY PURSUANT TO THE REQUIREMENTS OF THE CITY OF PORTSMOUTH SITE PLAN REVIEW REGULATIONS.

APPROVED BY THE PORTSMOUTH PLANNING BOARD

CHAIRMAN _____ DATE _____


PROPOSED RESIDENTIAL DEVELOPMENT
41 SALEM STREET
PORTSMOUTH, N.H.

AMBIT ENGINEERING, INC.
Civil Engineers & Land Surveyors
200 Griffin Road - Unit 3
Portsmouth, N.H. 03801-7114
Tel (603) 430-9282
Fax (603) 436-2315

PLAN SET SUBMITTAL DATE: 29 APRIL 2020

NOTES:

- 1) PARCEL IS SHOWN ON THE CITY OF PORTSMOUTH ASSESSOR'S MAP 144 AS LOT 31.
- 2) OWNER OF RECORD:
BONZA BUILDERS, LLC
79 EXETER ROAD
NORTH HAMPTON, NH 03862
6056/205
R.C.R.D. PLAN #0889
- 3) PARCEL IS NOT IN A SPECIAL FLOOD HAZARD AREA AS SHOWN ON FIRM PANEL 33015C0259E. EFFECTIVE DATE MAY 17, 2005.
- 4) EXISTING LOT AREA:
10,903 S.F.
0.2503 ACRES
- 5) PARCEL IS LOCATED IN THE GENERAL RESIDENCE C (GRC) ZONING DISTRICT.
- 6) DIMENSIONAL REQUIREMENTS:
MIN. LOT AREA: 3,500 S.F.
FRONTAGE: 70 FEET
DEPTH: 50 FEET
SETBACKS: FRONT 5 FEET
SIDE 10 FEET
REAR 20 FEET
MAXIMUM STRUCTURE HEIGHT: 35 FEET
MAXIMUM BUILDING COVERAGE: 35%
MINIMUM OPEN SPACE: 20%
- 7) THE PURPOSE OF THIS PLAN IS TO SHOW THE RESULT OF A STANDARD BOUNDARY SURVEY OF TAX MAP 144 LOT 31 IN THE CITY OF PORTSMOUTH.
- 8) VERTICAL DATUM IS MEAN SEA LEVEL NAVD88. BASIS OF VERTICAL DATUM IS REDUNDANT RTN GPS OBSERVATIONS.
- 9) PARCEL BENEFITS FROM A RIGHT-OF-WAY OVER ASSESSOR'S MAP 144 LOT 30 FROM McDONOUGH STREET TO "THE GARAGES ON THE PREMISES HEREIN CONVEYED". SAID GARAGES ARE NO LONGER PRESENT ON THE SUBJECT PARCEL.

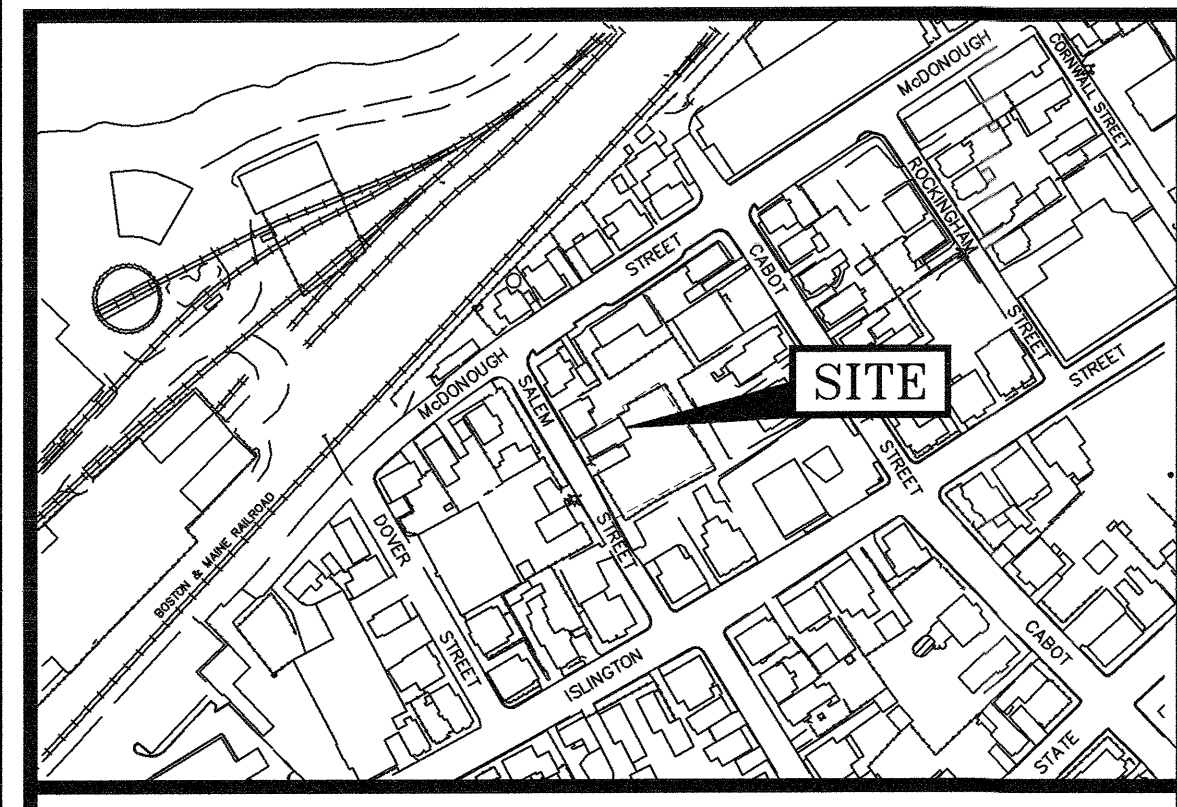


LOCATION MAP SCALE 1"=200'

LEGEND:

- N/F NOW OR FORMERLY
- RP RECORD OF PROBATE
- RCRD ROCKINGHAM COUNTY
- RR SPK REGISTRY OF DEEDS
- RR SPIKE RAILROAD SPIKE
- MAP 11/LOT 21
- IR FND IRON ROD FOUND
- IP FND IRON PIPE FOUND
- IR SET IRON ROD SET
- DH FND DRILL HOLE FOUND
- DH SET DRILL HOLE SET
- NHNB NHDOT BOUND FOUND
- TB TOWN BOUND
- BND w/DH BOUND WITH DRILL HOLE
- ST BND w/DH STONE BOUND WITH DRILL HOLE
- LSA LANDSCAPED AREA


PLAN REFERENCES:

- 1) PLAN OF TRACT OF LAND IN THE TOWN OF PORTSMOUTH; BELONGING TO A.W. HAVEN G.W. HAVEN & BENJ. CHEEVER ESQS AS LAID OUT INTO HOUSE LOTS. PREPARED BY BENJAMIN AKERMAN. DATED JULY 1846. R.C.R.D. PLAN #00561.
- 2) PLAN OF LAND CONVEYED TO ALFRED W. HAVEN AND GEORGE W. HAVEN BY SAMUEL HALE JUNE 1, 1846. R.C.R.D. 323/81.
- 3) AMENDED CONDOMINIUM SITE PLAN 383-385 ISLINGTON STREET CONDOMINIUM TAX SHEET & LOT 141-021-000 PORTSMOUTH, NH OWNER: GREENWAY MANAGEMENT NORTH, LLC. PREPARED BY JAMES VERRA AND ASSOCIATES, INC. DATED NOVEMBER 30, 2005. R.C.R.D. PLAN D-33370.
- 4) VARIANCE APPLICATION PLAN 200 McDONOUGH STREET PORTSMOUTH, N.H. PREPARED BY AMBIT ENGINEERING, INC. DATED APRIL 2016, FINAL REVISION DATE JUNE 1, 2016. NOT RECORDED.
- 5) LOT 45 SALEM ST. PORTSMOUTH, N.H. PREPARED BY JOHN W. DURGIN. DATED DECEMBER 1938. R.C.R.D. PLAN #0889.

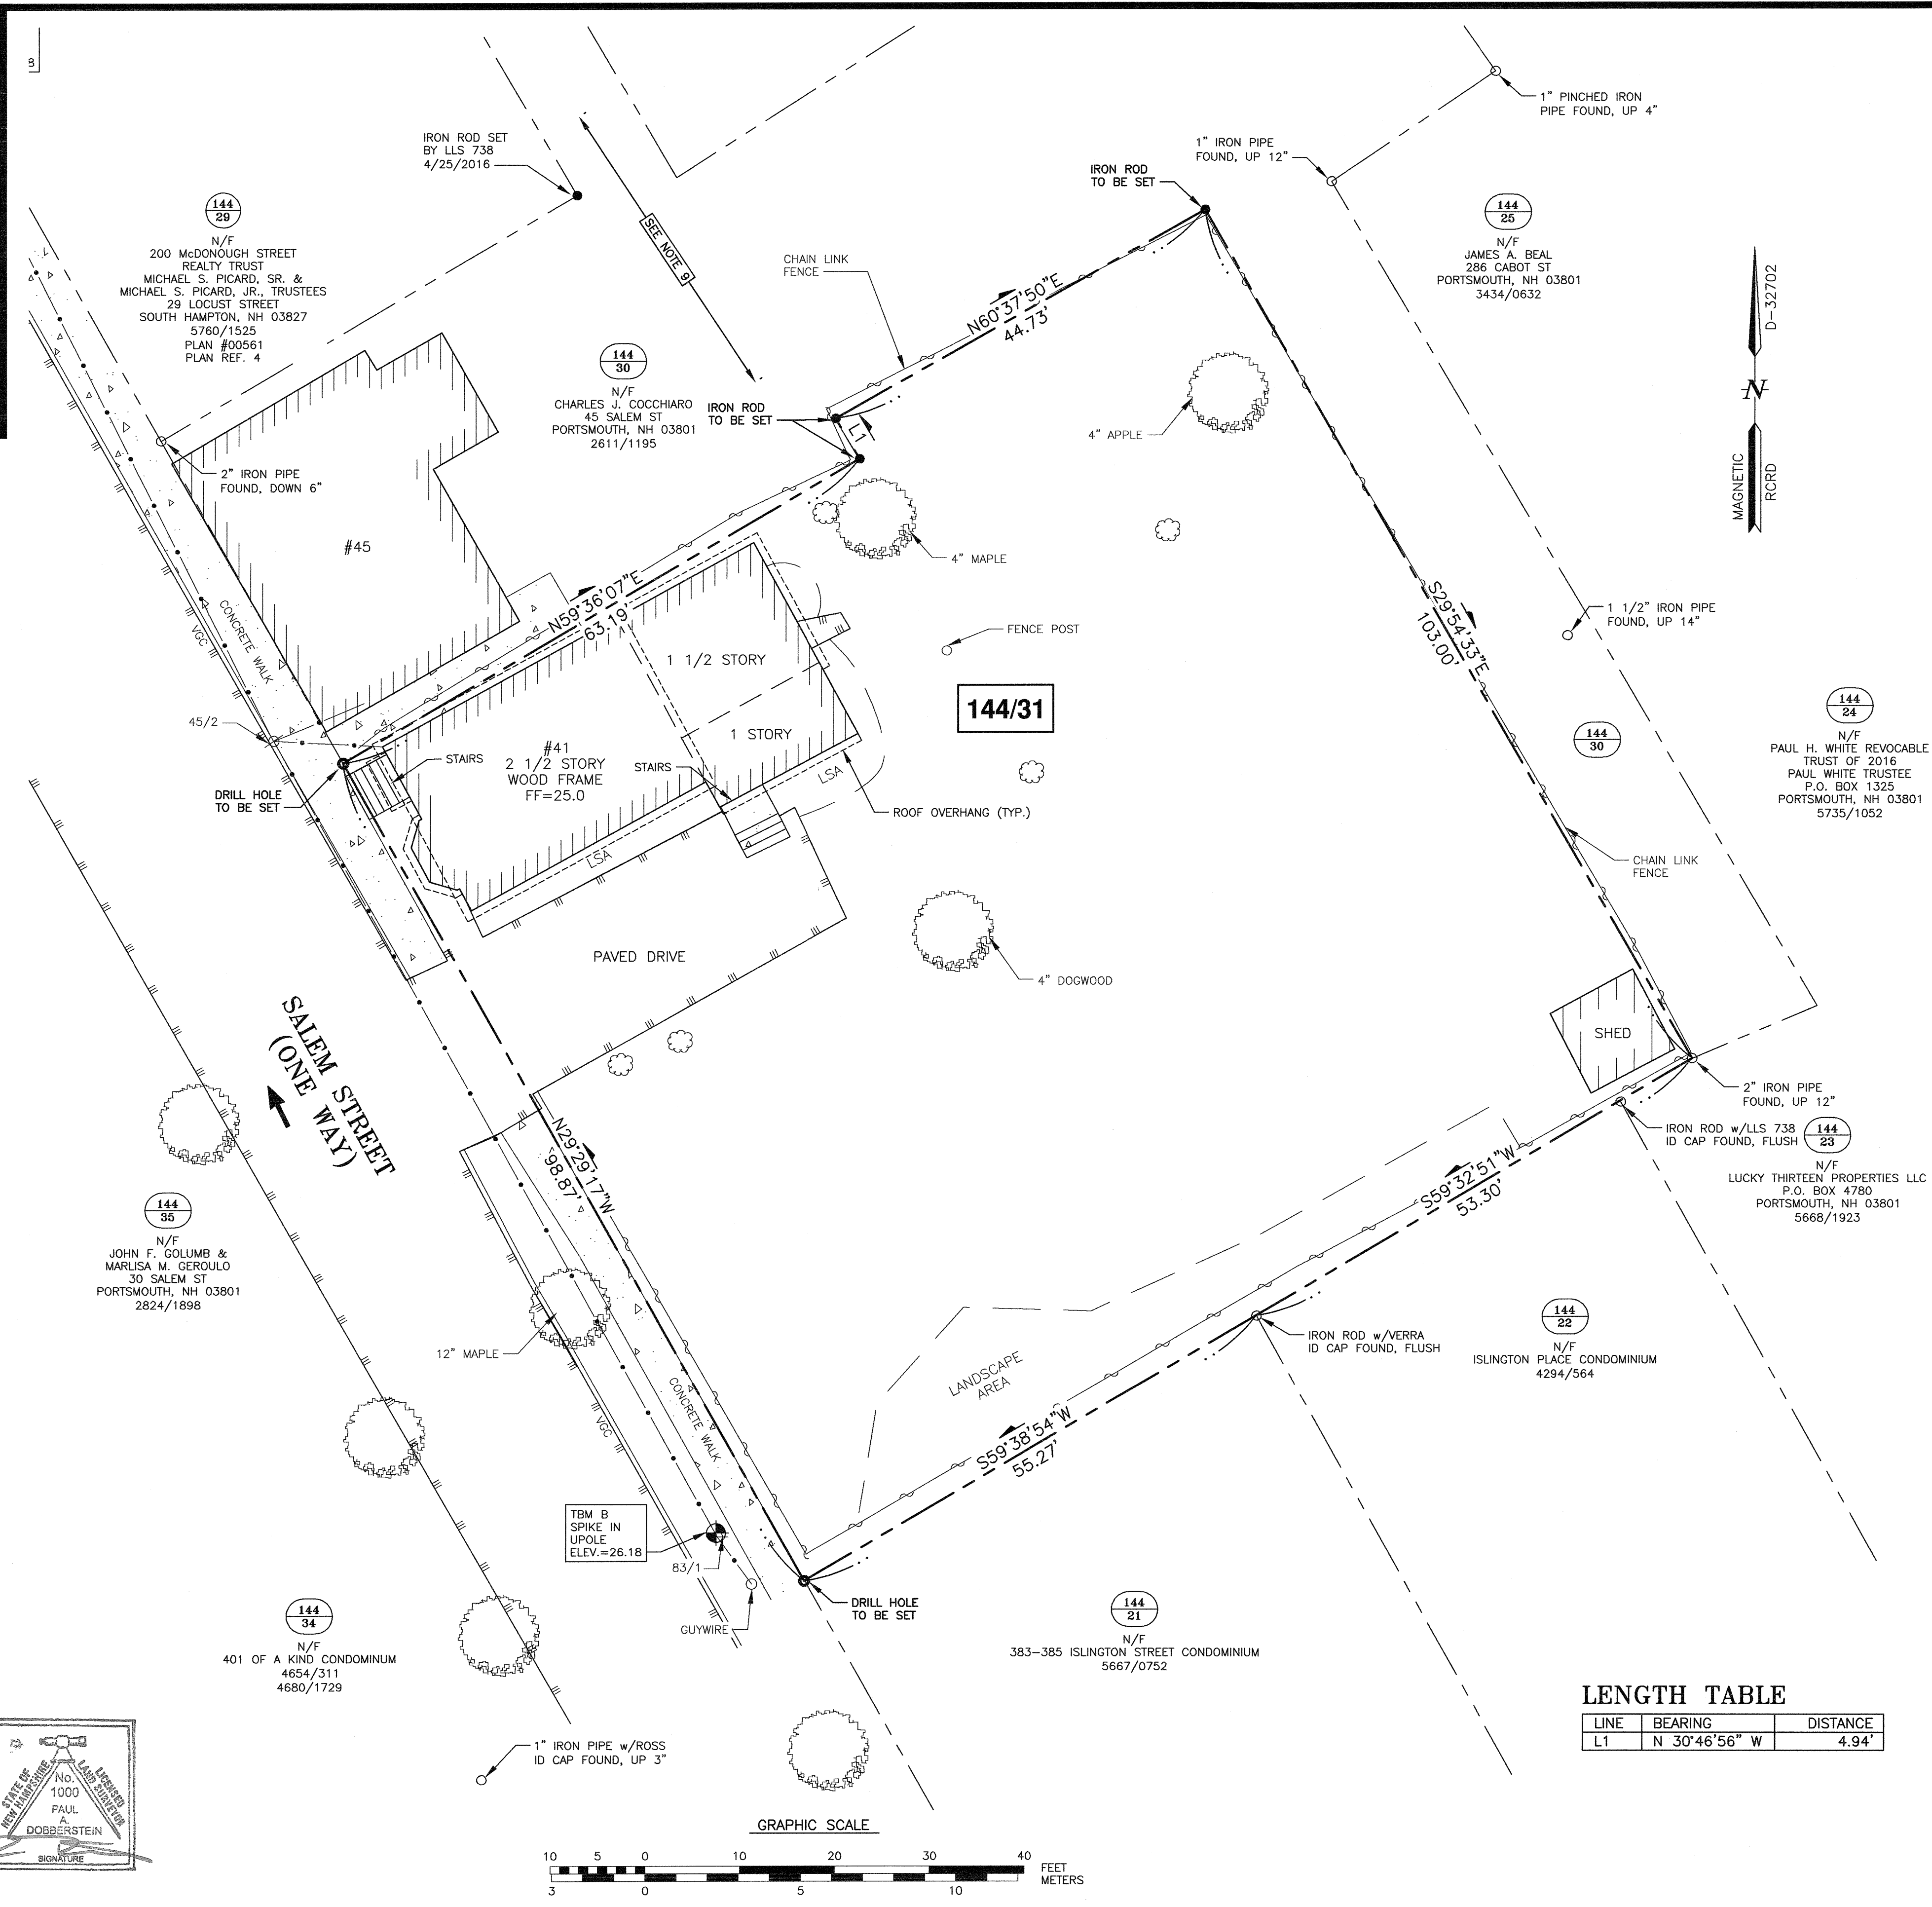


LENGTH TABLE

LINE	BEARING	DISTANCE
L1	N 30°46'56\" W	4.94'

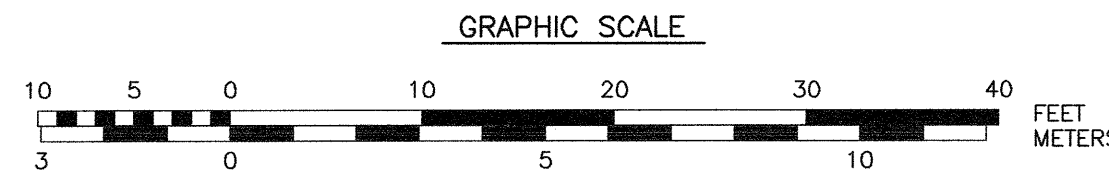

I CERTIFY THAT THIS PLAN WAS PREPARED UNDER MY DIRECT SUPERVISION, THAT IT IS THE RESULT OF A FIELD SURVEY BY THIS OFFICE AND HAS AN ACCURACY OF THE CLOSED TRAVERSE THAT EXCEEDS THE PRECISION OF 1:15,000.


I CERTIFY THAT THIS SURVEY PLAT IS NOT A SUBDIVISION PURSUANT TO THIS TITLE AND THAT THE LINES OF STREETS AND WAYS SHOWN ARE THOSE OF PUBLIC OR PRIVATE STREETS OR WAYS ALREADY ESTABLISHED AND THAT NO NEW WAYS ARE SHOWN.

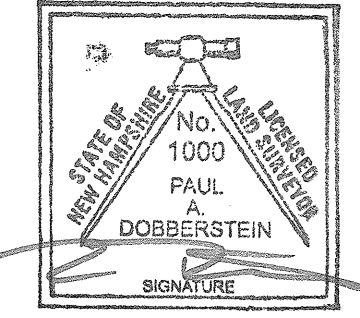

PAUL A. DOBBERSTEIN, LLS #1000
DATE 3/18/2020

NO.	DESCRIPTION	DATE
1	ISSUED FOR TAC SUBMISSION	3/18/20
0	ISSUED FOR COMMENT	12/2/19

STANDARD BOUNDARY SURVEY
TAX MAP 144 - LOT 31
OWNER
BONZA BUILDERS, LLC
41 SALEM STREET
CITY OF PORTSMOUTH
COUNTY OF ROCKINGHAM
STATE OF NEW HAMPSHIRE

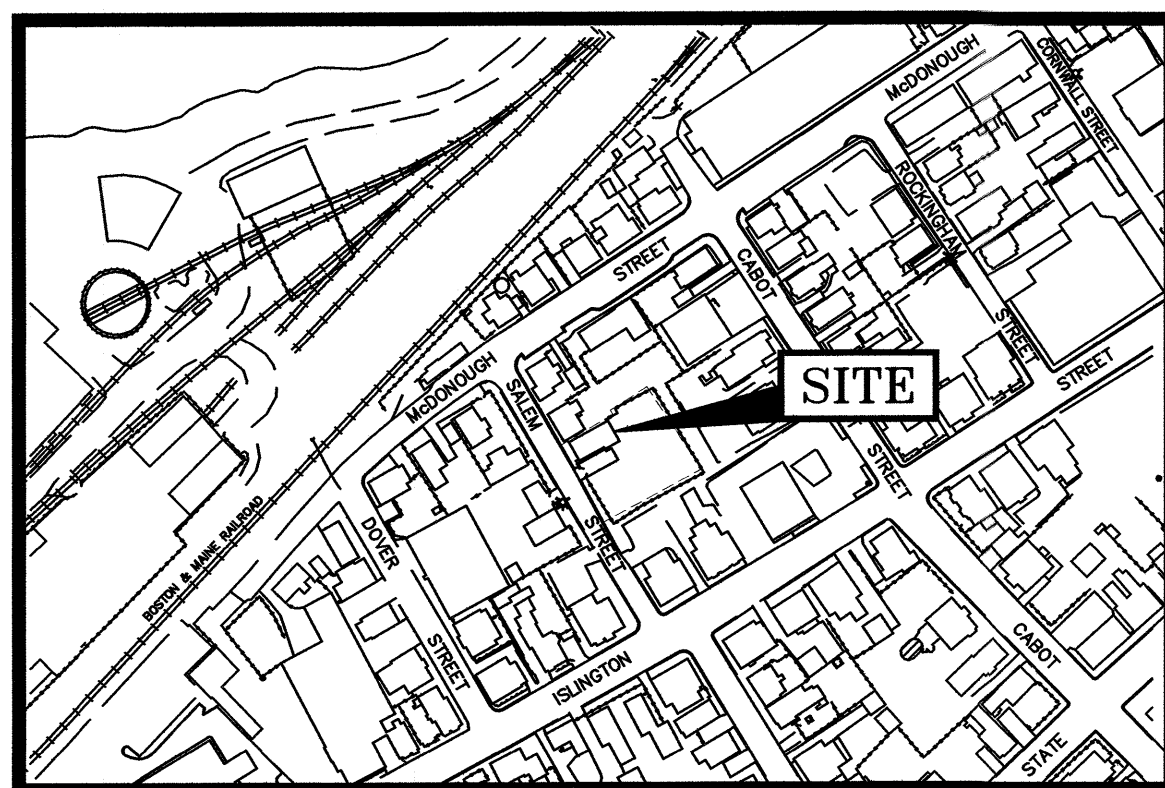


LOCATION MAP SCALE 1"=200'

LEGEND:

- N/F NOW OR FORMERLY
- RP RECORD OF PROBATE
- RCRD ROCKINGHAM COUNTY
- RR SPK RAILROAD SPIKE
- MAP 11/LOT 21
- IR FND IRON ROD FOUND
- IP FND IRON PIPE FOUND
- IR SET IRON ROD SET
- DH FND DRILL HOLE FOUND
- DH SET DRILL HOLE SET
- NHNB NHDOT BOUND FOUND
- TB TOWN BOUND
- BND w/DH BOUND WITH DRILL HOLE
- ST BND w/DH STONE BOUND WITH DRILL HOLE
- LSA LANDSCAPED AREA

PLAN REFERENCES:

- 1) PLAN OF TRACT OF LAND IN THE TOWN OF PORTSMOUTH; BELONGING TO A.W. HAVEN G.W. HAVEN & BENJ. CHEEVER ESQ.S AS LAID OUT INTO HOUSE LOTS. PREPARED BY BENJAMIN AKERMAN. DATED JULY 1846. R.C.R.D. PLAN #00561.
- 2) PLAN OF LAND CONVEYED TO ALFRED W. HAVEN AND GEORGE W. HAVEN BY SAMUEL HALE JUNE 1, 1846. R.C.R.D. 323/81.
- 3) STATION MAP—LANDS BOSTON AND MAINE R.R. OPERATED BY THE BOSTON AND MAINE R.R. STATION 2966+20 TO STATION 3019+0. PREPARED BY OFFICE OF THE VALUATION ENGINEER BOSTON, MASS. DATED JUNE 30, 1914, REVISED THROUGH AUGUST 2004. NOT RECORDED.
- 4) VARIANCE APPLICATION PLAN 200 MCDONOUGH STREET PORTSMOUTH, N.H. PREPARED BY AMBIT ENGINEERING, INC. DATED APRIL 2016, FINAL REVISION DATE JUNE 1, 2016. NOT RECORDED.

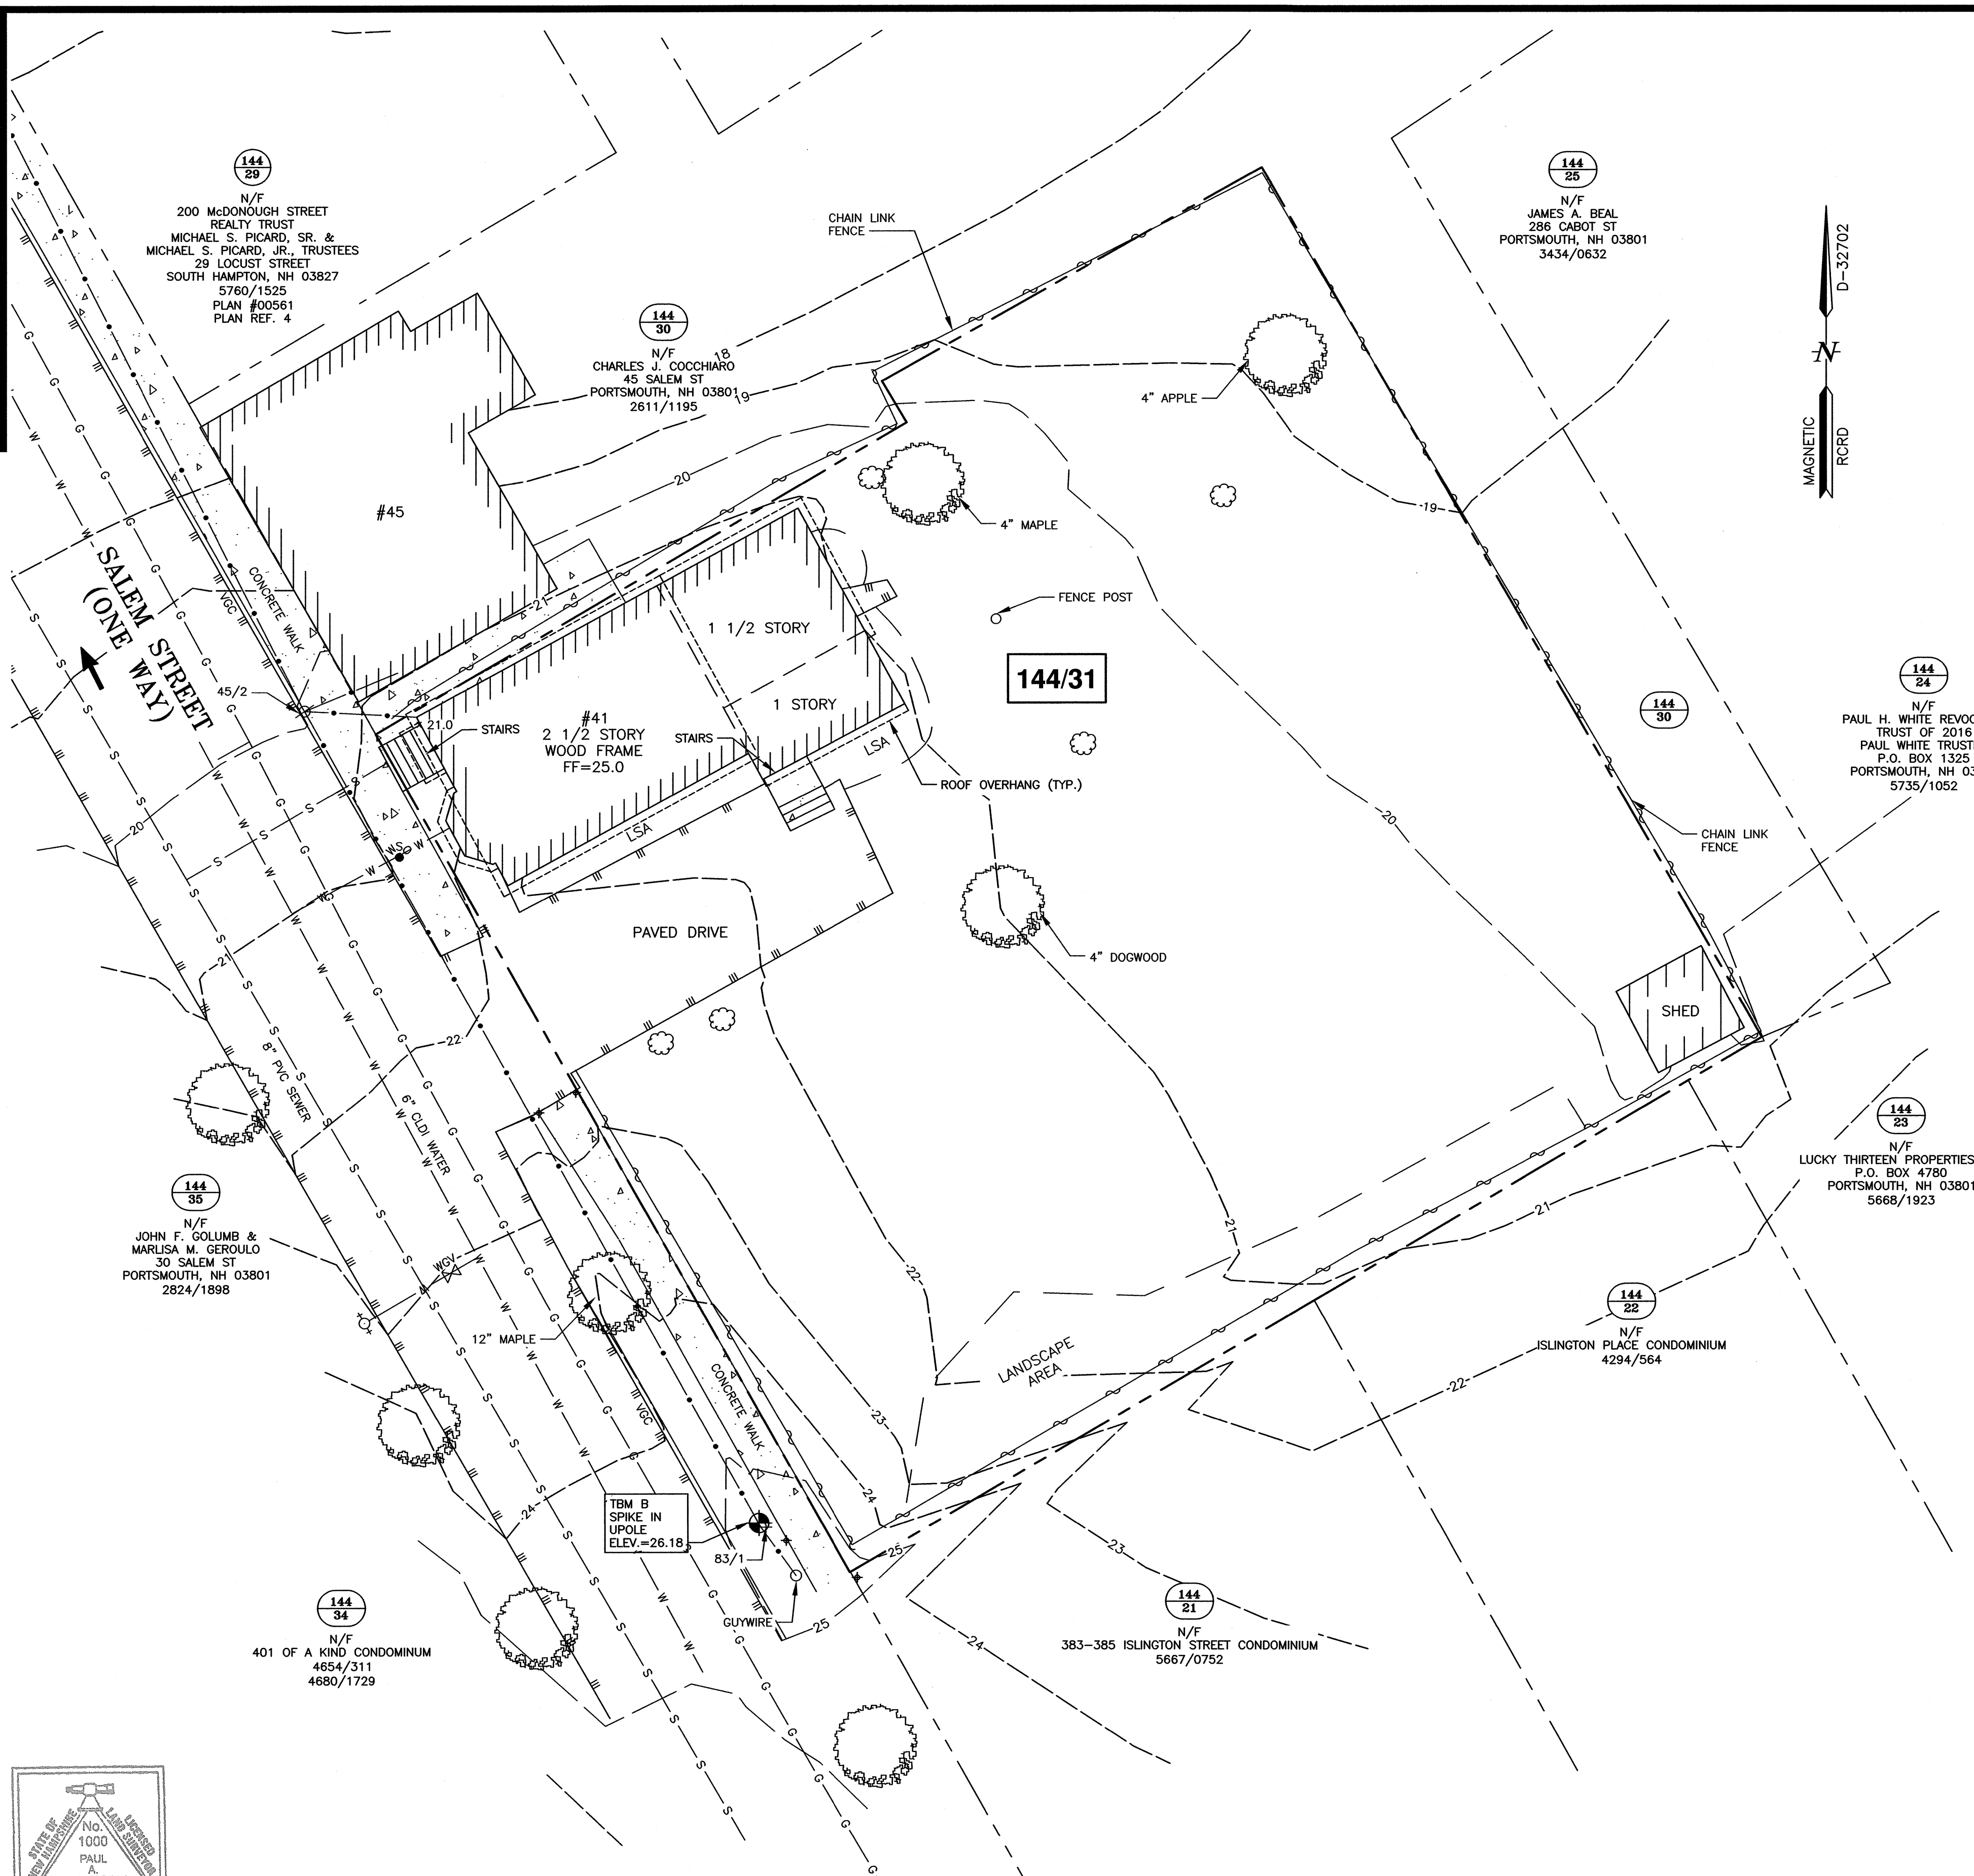

AMBIT ENGINEERING, INC.
 Civil Engineers & Land Surveyors
 200 Griffin Road - Unit 3
 Portsmouth, N.H. 03801-7114
 Tel (603) 430-9282
 Fax (603) 436-2315

- NOTES:**
- 1) PARCEL IS SHOWN ON THE CITY OF PORTSMOUTH ASSESSOR'S MAP 144 AS LOT 31.
 - 2) OWNER OF RECORD:
 BONZA BUILDERS, LLC
 79 EXETER ROAD
 NORTH HAMPTON, NH 03862
 6056/205
 - 3) PARCEL IS NOT IN A SPECIAL FLOOD HAZARD AREA AS SHOWN ON FIRM PANEL 33015C0259E. EFFECTIVE DATE MAY 17, 2005.
 - 4) EXISTING LOT AREA:
 10,903 S.F.
 0.2503 ACRES
 - 5) PARCEL IS LOCATED IN THE GENERAL RESIDENCE C (GRC) ZONING DISTRICT.
 - 6) DIMENSIONAL REQUIREMENTS:
 MIN. LOT AREA: 3,500 S.F.
 FRONTAGE: 70 FEET
 DEPTH: 50 FEET
 SETBACKS: FRONT 5 FEET
 SIDE 10 FEET
 REAR 20 FEET
 MAXIMUM STRUCTURE HEIGHT: 35 FEET
 MAXIMUM BUILDING COVERAGE: 35%
 MINIMUM OPEN SPACE: 20%
 - 7) THE PURPOSE OF THIS PLAN IS TO SHOW EXISTING CONDITIONS ON TAX MAP 144 LOT 31 IN THE CITY OF PORTSMOUTH.
 - 8) THERE ARE NO WETLANDS ON THE SUBJECT PROPERTY.


**SITE DEVELOPMENT
 41 SALEM STREET
 PORTSMOUTH, N.H.**

NO.	DESCRIPTION	DATE
2	WATER SERVICE	4/29/20
1	ISSUED FOR TAC	3/18/20
0	ISSUED FOR COMMENT	11/18/19


SCALE: 1"=10' NOVEMBER 2019


EXISTING CONDITIONS PLAN **C1**

I CERTIFY THAT THIS PLAN WAS PREPARED UNDER MY DIRECT SUPERVISION, THAT IT IS THE RESULT OF A FIELD SURVEY BY THIS OFFICE AND HAS AN ACCURACY OF THE CLOSED TRAVERSE THAT EXCEEDS THE PRECISION OF 1:15,000.

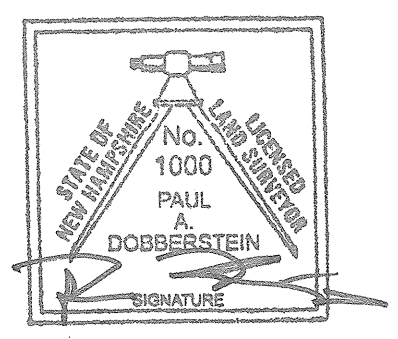

Paul A. Dobberstein
 PAUL A. DOBBERSTEIN, LLS #1000
 DATE 4/29/2020

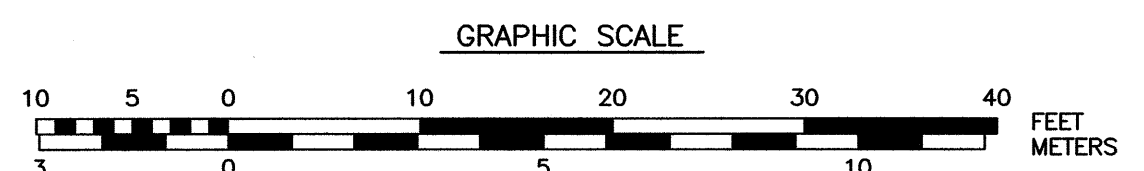




AMBIT ENGINEERING, INC.
Civil Engineers & Land Surveyors
200 Griffin Road - Unit 3
Portsmouth, N.H. 03801-7114
Tel (603) 430-9282
Fax (603) 436-2315

NOTES:

- 1) PARCEL IS SHOWN ON THE CITY OF PORTSMOUTH ASSESSOR'S MAP 144 AS LOT 31.
- 2) OWNER OF RECORD:
BONZA BUILDERS, LLC
79 EXETER ROAD
NORTH HAMPTON, NH 03862
6056/205
- 3) PARCEL IS NOT IN A SPECIAL FLOOD HAZARD AREA AS SHOWN ON FIRM PANEL 33015C0259E. EFFECTIVE DATE MAY 17, 2005.
- 4) EXISTING LOT AREA:
10,903 S.F.
0.2503 ACRES
- 5) PARCEL IS LOCATED IN THE GENERAL RESIDENCE C (GRC) ZONING DISTRICT.
- 6) DIMENSIONAL REQUIREMENTS:
MIN. LOT AREA: 3,500 S.F.
FRONTAGE: 70 FEET
DEPTH: 50 FEET
SETBACKS: FRONT 5 FEET
SIDE 10 FEET
REAR 20 FEET
MAXIMUM STRUCTURE HEIGHT: 35 FEET
MAXIMUM BUILDING COVERAGE: 35%
MINIMUM OPEN SPACE: 20%
- 7) THE PURPOSE OF THIS PLAN IS TO SHOW PROPOSED DEVELOPMENT ON TAX MAP 144 LOT 31 IN THE CITY OF PORTSMOUTH.
- 8) PROPOSED BUILDING COVERAGE:
STRUCTURES: 2,858 SF
STAIRS/STOOP: 117 SF
TOTAL: 2,975 SF

2,975 SF / 10,903 SF = 27%
- 9) REQUIRED PARKING:
3 UNITS x 1.3 SPACES PER UNIT = 4 SPACES
PROVIDED PARKING: 6 SPACES (ALL IN GARAGES)
- 10) ARCHITECTURAL PLANS BY ART FORM ARCHITECTURE "CLARA"
- 11) SALEM STREET TO BE MILLED AND PAVED TO REPAIR THE AREAS DISTURBED BY PROJECT CONSTRUCTION. WORK TO BE DONE ONE YEAR AFTER UTILITIES ARE COMPLETED.
- 12) ANY DAMAGE TO EXISTING CITY SIDEWALKS TO BE REPAIRED TO DPW SATISFACTION.

IMPERVIOUS SURFACE AREAS (TO PROPERTY LINE)		
STRUCTURE	PRE-CONSTRUCTION IMPERVIOUS (S.F.)	POST-CONSTRUCTION IMPERVIOUS (S.F.)
MAIN STRUCTURE	1,134	2,858
BULKHEAD	0	28
CONCRETE	14	68
STAIRS/PORCH	47	146
PAVEMENT	650	1,207
TOTAL	1,845	4,307
LOT SIZE	10,903	10,903
% LOT COVERAGE	16.9%	39.5%

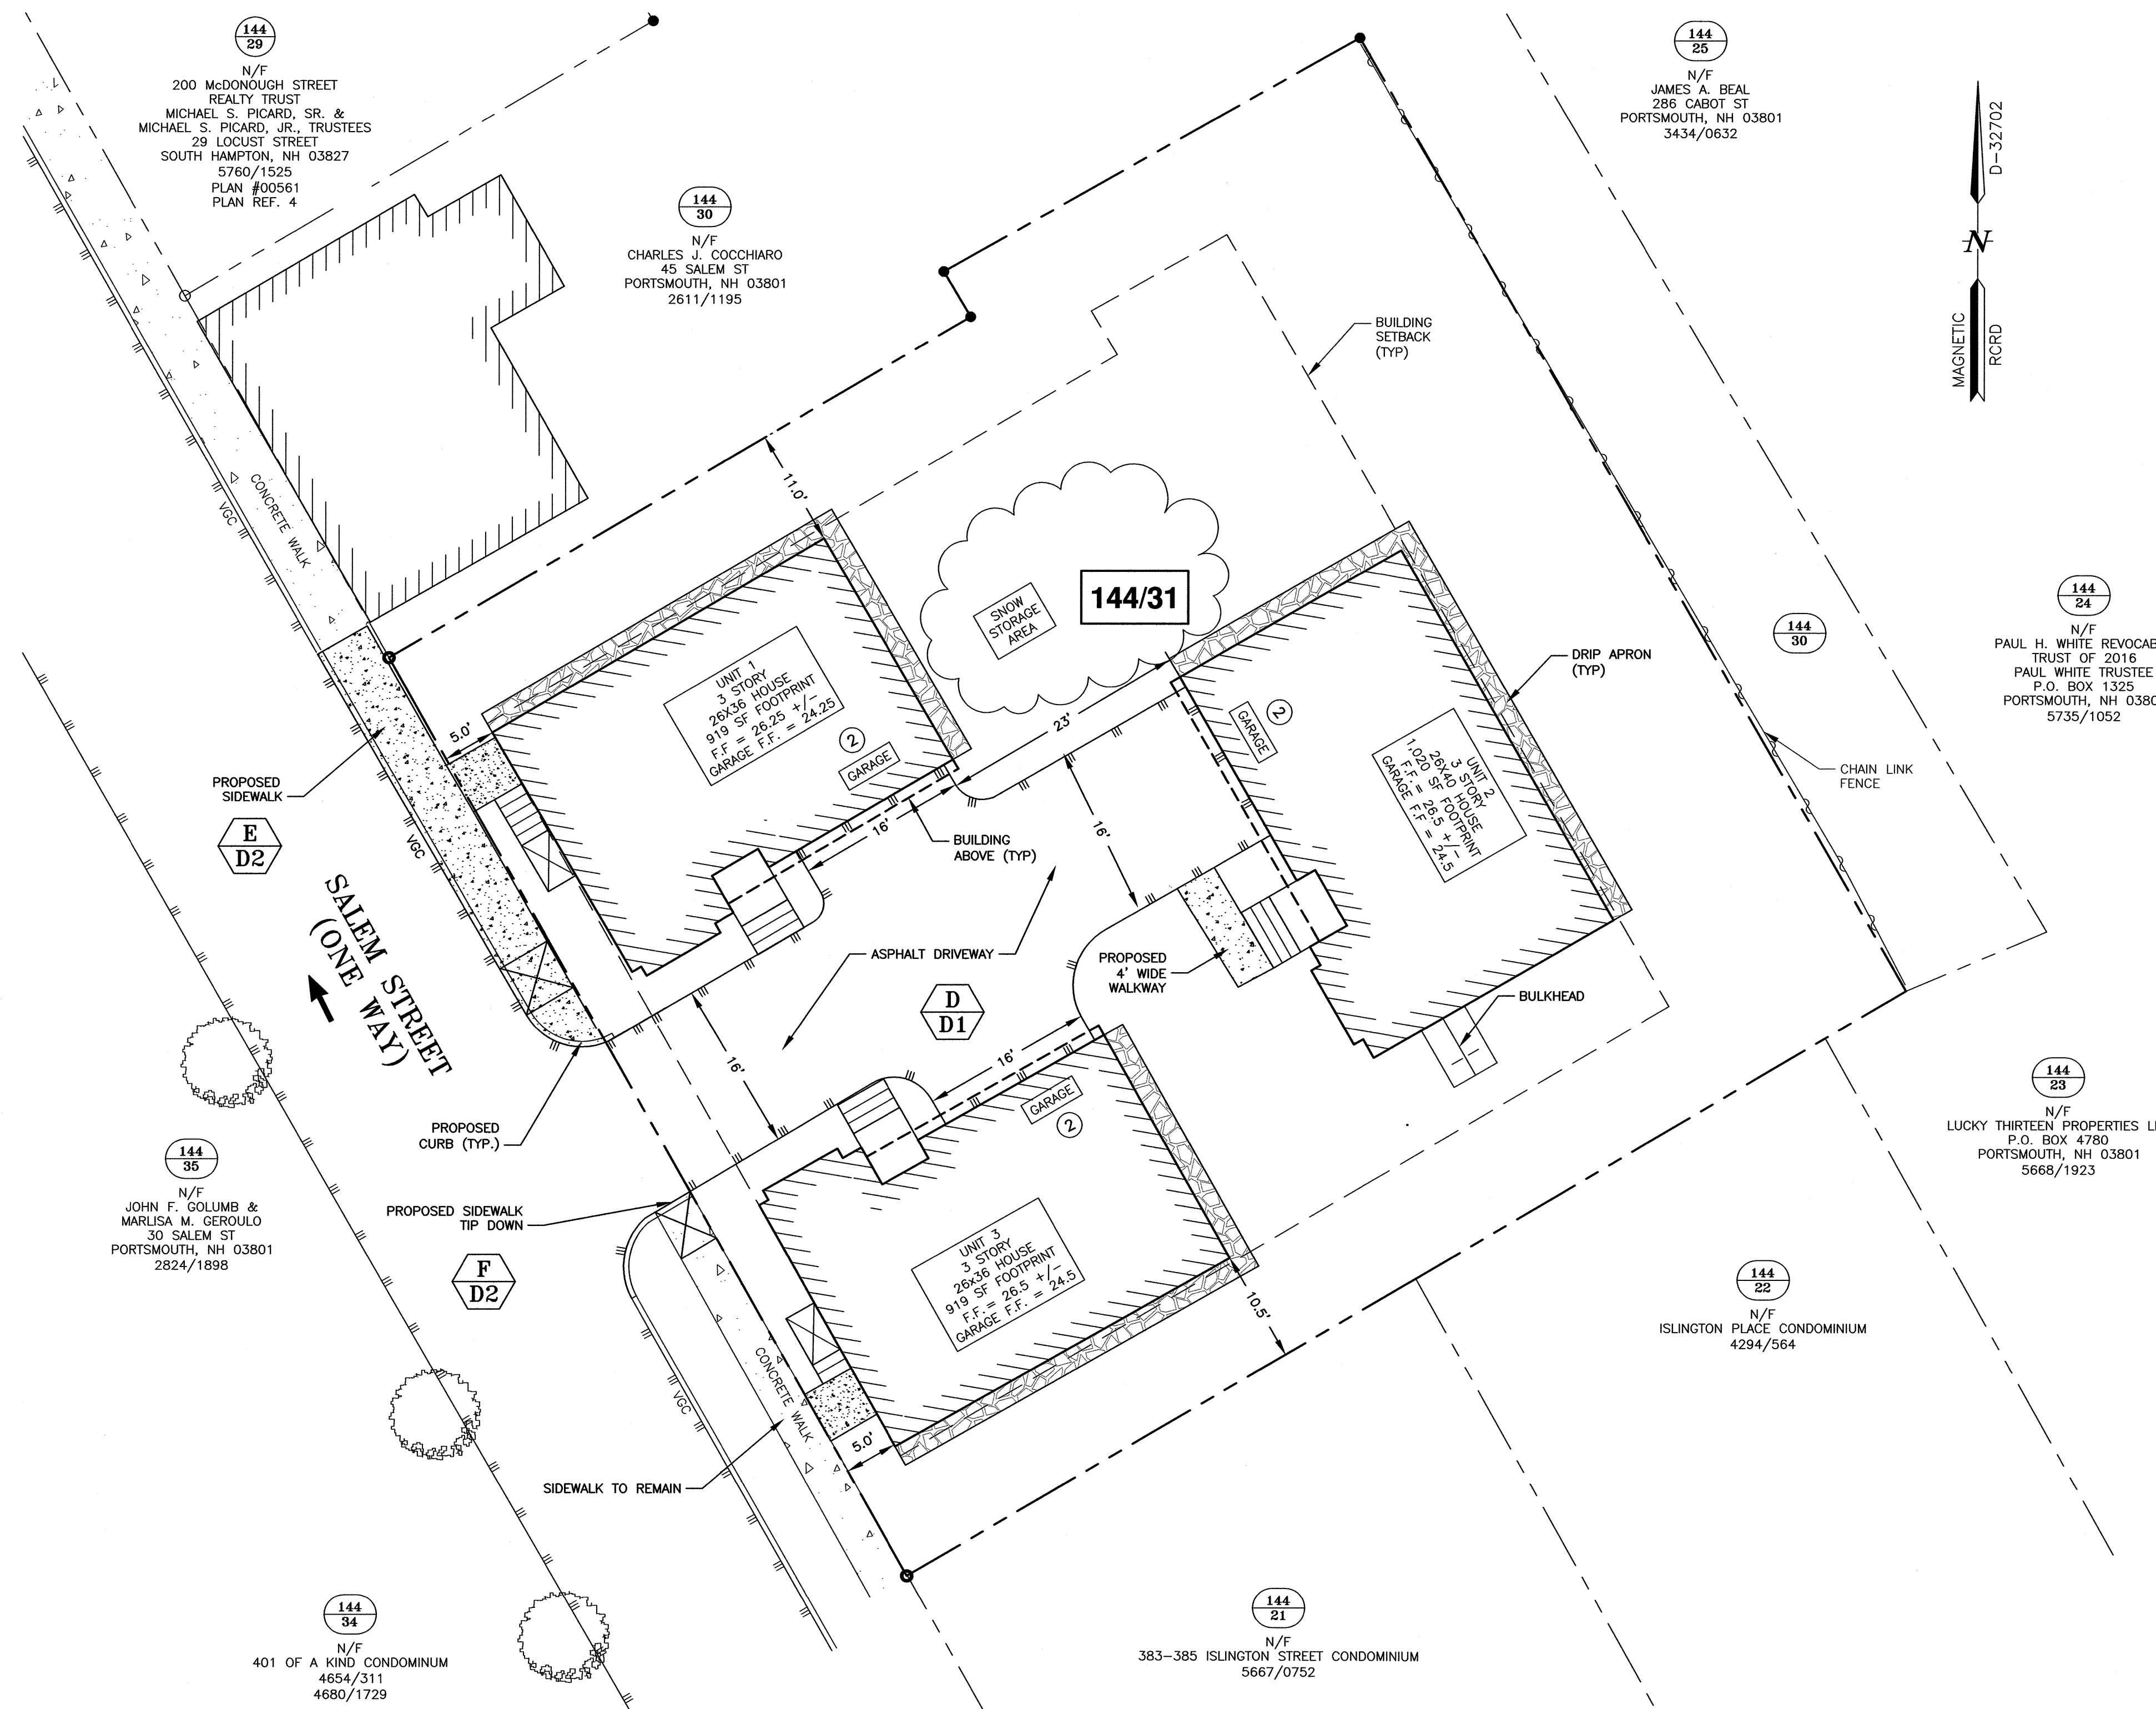


PORTSMOUTH APPROVAL CONDITIONS NOTE:
ALL CONDITIONS ON THIS PLAN SET SHALL REMAIN IN EFFECT IN PERPETUITY PURSUANT TO THE REQUIREMENTS OF THE CITY OF PORTSMOUTH SITE PLAN REVIEW REGULATIONS.

A. THIS SITE PLAN SHALL BE RECORDED IN THE ROCKINGHAM COUNTY REGISTRY OF DEEDS.

B. ALL IMPROVEMENTS SHOWN ON THIS SITE PLAN SHALL BE CONSTRUCTED AND MAINTAINED IN ACCORDANCE WITH THE PLAN BY THE PROPERTY OWNER AND ALL FUTURE PROPERTY OWNERS. NO CHANGES SHALL BE MADE TO THIS SITE PLAN WITHOUT THE EXPRESS APPROVAL OF THE PORTSMOUTH PLANNING DIRECTOR.

APPROVED BY THE PORTSMOUTH PLANNING BOARD


CHAIRMAN _____ DATE _____

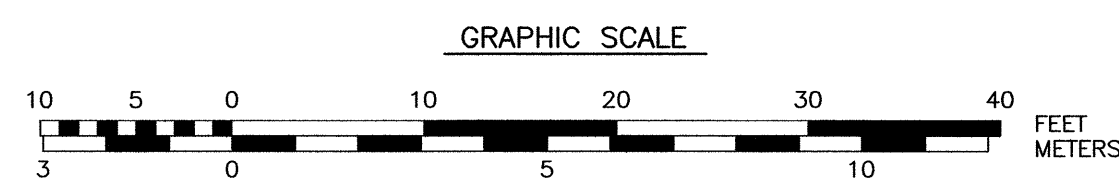

SITE DEVELOPMENT
41 SALEM STREET
PORTSMOUTH, N.H.

NO.	DESCRIPTION	DATE
2	NOTE 11, 12	4/29/20
1	ISSUED TO TAC	3/18/20
0	ISSUED FOR COMMENT	12/30/19

REVISIONS

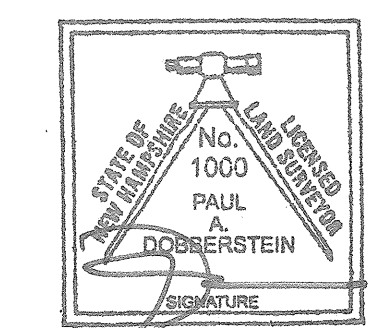


SCALE: 1" = 10' DECEMBER 2019

SITE LAYOUT PLAN



C2

UTILITY NOTES:

- 1) SEE EXISTING CONDITIONS PLAN FOR BENCHMARK INFORMATION.
- 2) COORDINATE ALL UTILITY WORK WITH APPROPRIATE UTILITY.
- 3) SEE GRADING AND DRAINAGE PLAN FOR PROPOSED GRADING AND EROSION CONTROL MEASURES.
- 4) ALL WATER MAIN INSTALLATIONS SHALL BE CLASS 52, POLYWRAPPED, CEMENT LINED DUCTILE IRON PIPE.
- 5) ALL WATERMAIN INSTALLATIONS SHALL BE PRESSURE TESTED AND CHLORINATED AFTER CONSTRUCTION AND BEFORE ACTIVATING THE SYSTEM. CONTRACTOR SHALL COORDINATE WITH THE CITY OF PORTSMOUTH.
- 6) ALL SEWER PIPE SHALL BE PVC SDR 35 UNLESS OTHERWISE STATED.
- 7) ALL WORK WITHIN CITY R.O.W. SHALL BE COORDINATED WITH CITY OF PORTSMOUTH.
- 8) CONTRACTOR SHALL MAINTAIN UTILITY SERVICES TO ABUTTING PROPERTIES THROUGHOUT CONSTRUCTION.
- 9) ANY CONNECTION TO EXISTING WATERMAIN SHALL BE CONSTRUCTED BY THE CITY OF PORTSMOUTH.
- 10) EXISTING UTILITIES TO BE REMOVED SHALL BE CAPPED AT THE MAIN AND MEET THE DEPARTMENT OF PUBLIC WORKS STANDARDS FOR CAPPING OF WATER AND SEWER SERVICES.
- 11) ALL ELECTRICAL MATERIAL WORKMANSHIP SHALL CONFORM TO THE NATIONAL ELECTRIC CODE, LATEST EDITION, AND ALL APPLICABLE STATE AND LOCAL CODES.
- 12) THE EXACT LOCATION OF NEW UTILITY SERVICES AND CONNECTIONS SHALL BE COORDINATED WITH BUILDING DRAWINGS AND UTILITY COMPANIES.
- 13) ADJUST ALL MANHOLES, CATCH BASINS, CURB BOXES, ETC. WITHIN LIMITS OF WORK TO FINISH GRADE.
- 14) ALL UNDERGROUND CONDUITS SHALL HAVE NYLON PULL ROPES TO FACILITATE PULLING CABLES.
- 15) THE CONTRACTOR SHALL OBTAIN, PAY FOR, AND COMPLY WITH ALL REQUIRED PERMITS, ARRANGE FOR ALL INSPECTIONS, AND SUBMIT COPIES OF ACCEPTANCE CERTIFICATED TO THE OWNER PRIOR TO THE COMPLETION OF PROJECT.
- 16) THE CONTRACTOR SHALL PROVIDE AND INSTALL ALL MANHOLES, BOXES, FITTINGS, CONNECTORS, COVER PLATES AND OTHER MISCELLANEOUS ITEMS NOT NECESSARILY DETAILED IN THESE DRAWING TO RENDER INSTALLATION OF UTILITIES COMPLETE AND OPERATIONAL.
- 17) CONTRACTOR SHALL PROVIDE EXCAVATION, BEDDING, BACKFILL AND COMPACTION FOR NATURAL GAS SERVICES.
- 18) A 10-FOOT MINIMUM EDGE TO EDGE HORIZONTAL SEPARATION SHALL BE PROVIDED BETWEEN ALL WATER AND SANITARY SEWER LINES. AN 18-INCH MINIMUM OUTSIDE TO OUTSIDE VERTICAL SEPARATION SHALL BE PROVIDED AT ALL WATER/SANITARY SEWER CROSSINGS WATER ABOVE SEWER.
- 19) SAWCUT AND REMOVE PAVEMENT AND CONSTRUCT PAVEMENT TRENCH PATCH FOR ALL PROPOSED UTILITIES LOCATED IN EXISTING PAVEMENT AREAS TO REMAIN.
- 20) GATE VALVES, FITTINGS, ETC. SHALL MEET THE REQUIREMENTS OF THE CITY OF PORTSMOUTH.
- 21) COORDINATE TESTING OF SEWER CONSTRUCTION WITH THE CITY OF PORTSMOUTH.
- 22) ALL SEWER PIPES WITH LESS THAN 6' COVER SHALL BE INSULATED.
- 23) CONTRACTOR SHALL COORDINATE ALL ELECTRIC WORK INCLUDING BUT NOT LIMITED TO: CONDUIT CONSTRUCTION, MANHOLE CONSTRUCTION, UTILITY POLE CONSTRUCTION, OVERHEAD WIRE RELOCATION, AND TRANSFORMER CONSTRUCTION WITH POWER COMPANY.
- 24) CONTRACTOR SHALL PHASE UTILITY CONSTRUCTION, PARTICULARLY WATER MAIN AND GAS MAIN CONSTRUCTION AS TO MAINTAIN CONTINUOUS SERVICE TO ABUTTING PROPERTIES. CONTRACTOR SHALL COORDINATE TEMPORARY SERVICES TO ABUTTERS WITH UTILITY COMPANY AND AFFECTED ABUTTER.
- 25) ALL WORK PERFORMED IN THE PUBLIC RIGHT-OF-WAY SHALL BE BUILT TO DEPARTMENT OF PUBLIC WATER WORKS STANDARDS.
- 26) WATER, SEWER, AND DRAIN LINES SHALL BE PRIVATE. CONDOMINIUM DOCUMENTS SHALL REFLECT MAINTENANCE OF PRIVATE UTILITIES.
- 27) THIRD PARTY UTILITY INSTALLATION INSPECTIONS SHALL BE REQUIRED ON WATER MAIN, SEWER, AND DRAINAGE SYSTEM.
- 28) A WATER UTILITY ACCESS EASEMENT SHALL BE PROVIDED TO THE CITY OF PORTSMOUTH FOR ACCESS TO WATER METERS, SHUT OFF VALVES & PIPING.

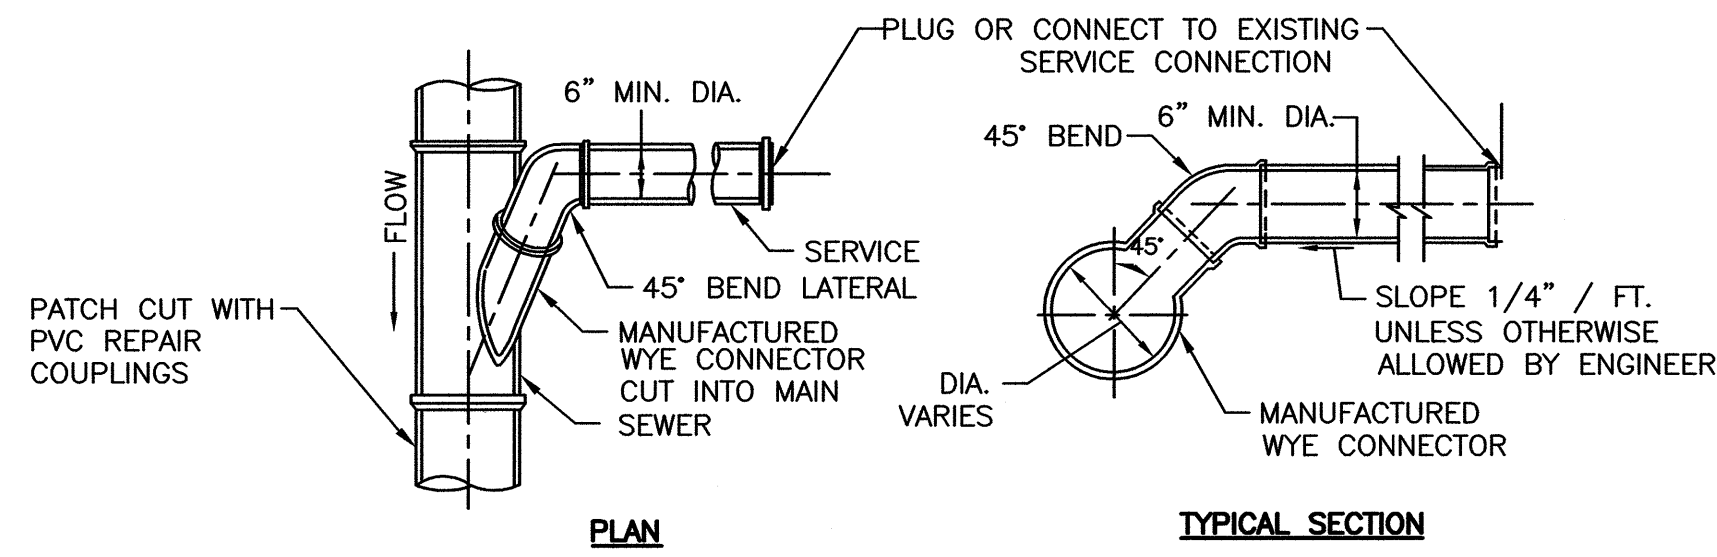

1 C3 STANDARD SERVICE LATERAL CONNECTION
NTS

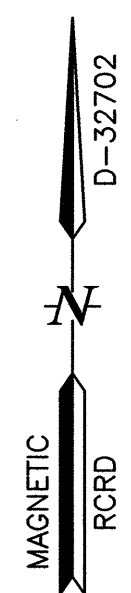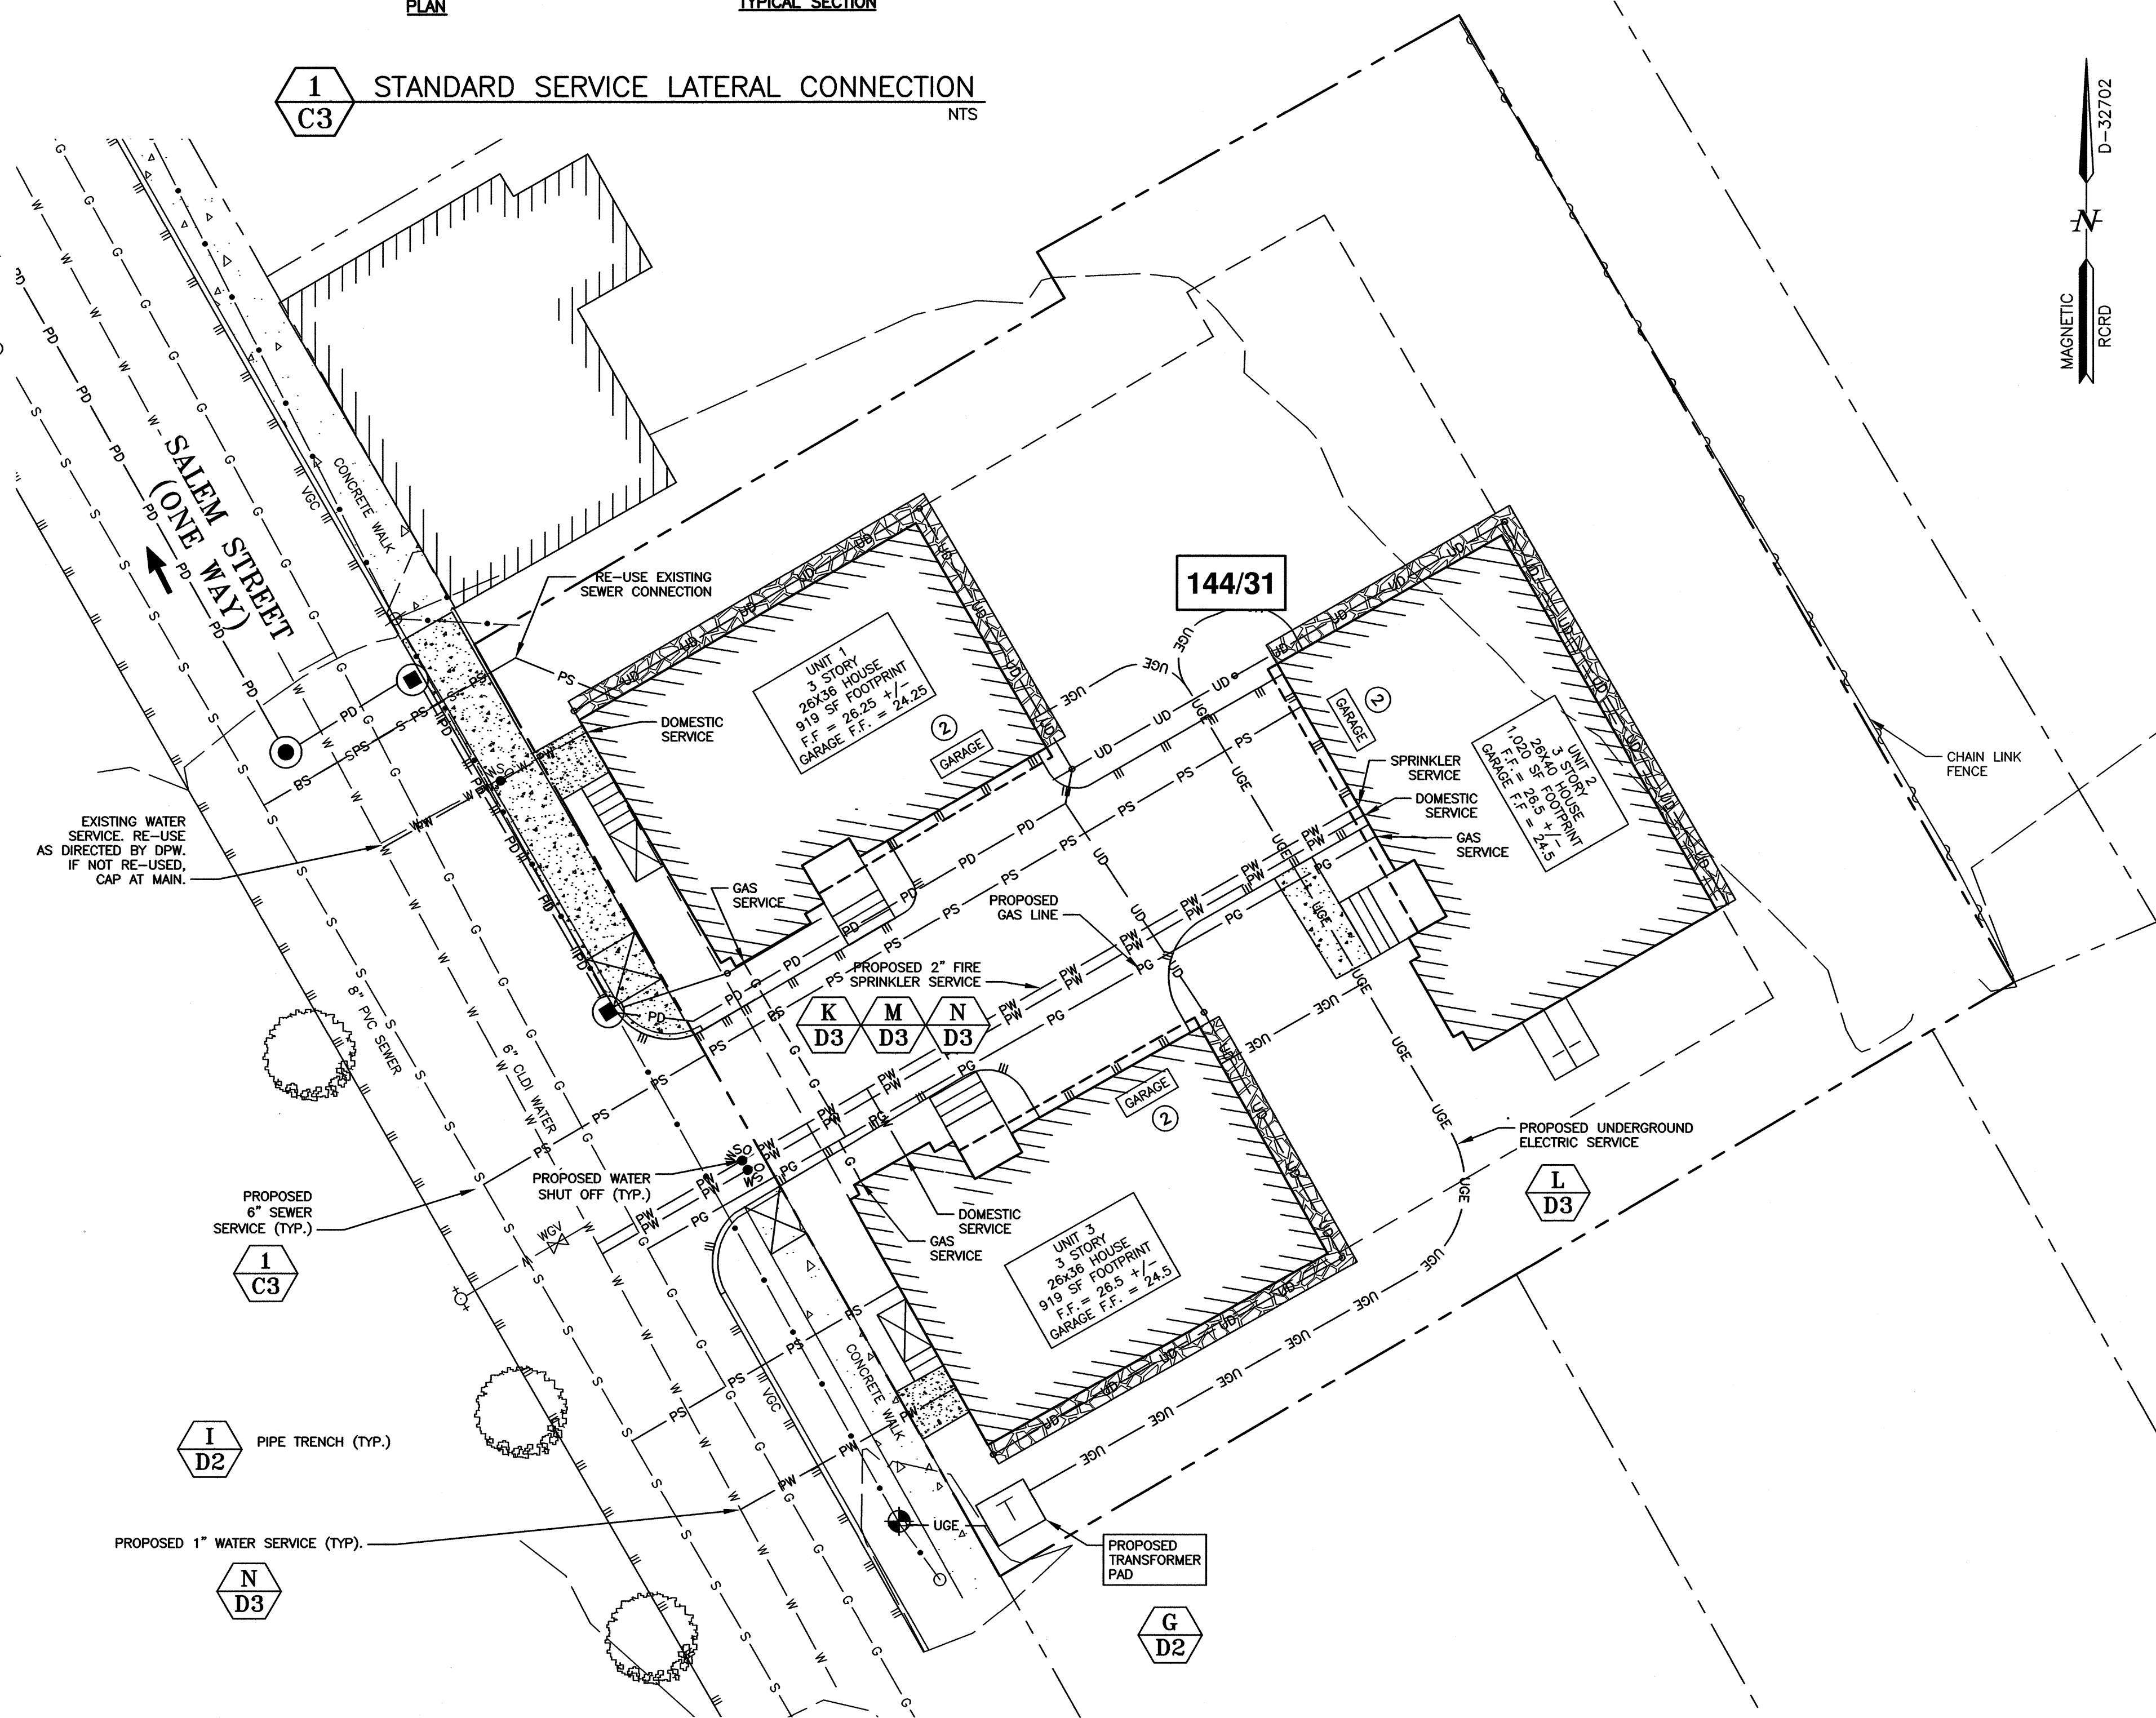


AMBIT ENGINEERING, INC.
Civil Engineers & Land Surveyors
200 Griffin Road - Unit 3
Portsmouth, N.H. 03801-7114
Tel (603) 430-9282
Fax (603) 436-2315

- NOTES:**
- 1) THE CONTRACTOR SHALL NOTIFY DIG SAFE AT 1-888-DIG-SAFE (1-888-344-7233) AT LEAST 72 HOURS PRIOR TO COMMENCING ANY EXCAVATION ON PUBLIC OR PRIVATE PROPERTY.
 - 2) UNDERGROUND UTILITY LOCATIONS ARE BASED UPON BEST AVAILABLE EVIDENCE AND ARE NOT FIELD VERIFIED. LOCATING AND PROTECTING ANY ABOVEGROUND OR UNDERGROUND UTILITIES IS THE SOLE RESPONSIBILITY OF THE CONTRACTOR AND/OR THE OWNER. UTILITY CONFLICTS SHOULD BE REPORTED AT ONCE TO THE DESIGN ENGINEER.
 - 3) CONTRACTOR SHALL INSTALL AND MAINTAIN EROSION CONTROL MEASURES IN ACCORDANCE WITH THE "NEW HAMPSHIRE STORMWATER MANUAL, VOLUME 3, EROSION AND SEDIMENT CONTROLS DURING CONSTRUCTION. (NHDES DECEMBER 2008)".
 - 4) INSTALL CATCH BASIN INLET PROTECTION ON ALL EXISTING AND INSTALLED CATCH BASINS UNTIL CONSTRUCTION IS COMPLETED AND THE SITE IS STABILIZED.
 - 5) ALL WATER MAIN AND SANITARY SEWER WORK SHALL MEET THE STANDARDS OF THE NEW HAMPSHIRE STATE PLUMBING CODE AND CITY OF PORTSMOUTH DEPARTMENT OF PUBLIC WORKS.
 - 6) UTILITY AS-BUILTS SHALL BE SUBMITTED TO THE CITY OF PORTSMOUTH DEPARTMENT OF PUBLIC WORKS UPON COMPLETION OF THE PROJECT.
 - 7) PROPOSED SEWER FLOW
3 UNITS X 2.33 RESIDENTS/UNIT = 7 RESIDENTS
7 RESIDENTS X 70 GPD/RESIDENT = 490 GPD
TOTAL PROPOSED FLOW = 490 GPD
NHDES SEWER DISCHARGE PERMIT NOT REQUIRED.

SITE DEVELOPMENT
41 SALEM STREET
PORTSMOUTH, N.H.

NO.	DESCRIPTION	DATE
3	WATER SERVICES, DETAIL 1	4/29/20
2	TAC SUBMISSION	3/18/20
1	TAC WORKSHOP	12/2/19
0	ISSUED FOR COMMENT	11/18/19

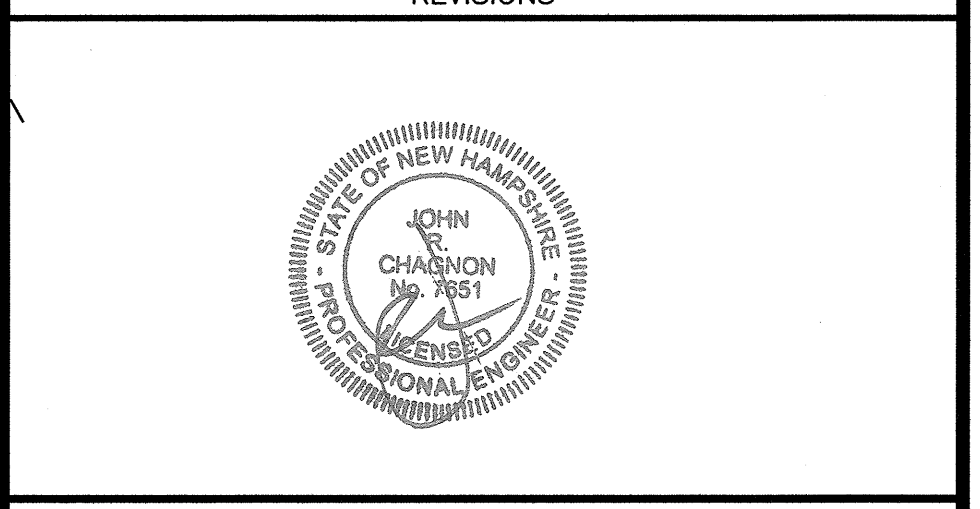


SCALE: 1" = 10' NOVEMBER 2019

UTILITY PLAN **C3**

APPROVED BY THE PORTSMOUTH PLANNING BOARD

CHAIRMAN _____ DATE _____

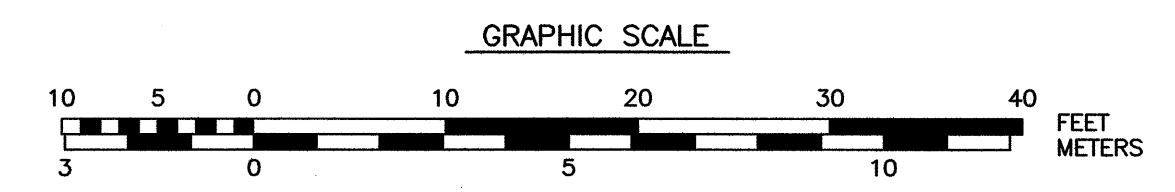


TEST PIT #1, ELEV.
 Date: 11/7/19
 Logged by: JOE MULLEDY
 ESHWT: -
 Observed Water: 64"
 REFUSAL: NONE
 Roots: 12"
 DEPTH DESCRIPTION
 0" - 12" 10YR 3/3 DARK BROWN, FINE SANDY LOAM
 12" - 18" 10YR 4/3 BROWN, LOAMY FINE SAND
 18" - 64" 2.5Y 6/4 GRAY, SILTY FINE SAND

TEST PIT #2, ELEV.
 Date: 11/7/19
 Logged by: JOE MULLEDY
 ESHWT: -
 Observed Water: 66"
 REFUSAL: NONE
 Roots: 14" MANY FINE
 DEPTH DESCRIPTION
 0" - 14" 10YR 3/3 DARK BROWN, FINE SANDY LOAM
 14" - 20" 10YR 4/3 BROWN, LOAMY FINE SAND
 20" - 66" 2.5Y 5/2 GRAY, SILTY FINE SAND

TEST PIT #3, ELEV.
 Date: 11/7/19
 Logged by: JOE MULLEDY
 ESHWT: -
 Observed Water: 62"
 REFUSAL: NONE
 Roots: 16"
 DEPTH DESCRIPTION
 0" - 16" 10YR 3/3 DARK BROWN, FINE SANDY LOAM
 16" - 40" 10YR 4/3 BROWN, LOAMY FINE SAND
 40" - 62" 2.5Y 4/2 GRAY, CLAYEY FINE SAND

TEST PIT #4, ELEV.
 Date: 11/7/19
 Logged by: JOE MULLEDY
 ESHWT: -
 Observed Water: 62"
 REFUSAL: NONE
 Roots: 6"
 DEPTH DESCRIPTION
 0" - 8" 10YR 3/3 DARK BROWN, FINE SANDY LOAM
 8" - 24" 10YR 4/3 BROWN, LOAMY FINE SAND
 24" - 34" 2.5Y 4/4 GRAY, LOAMY FINE SAND

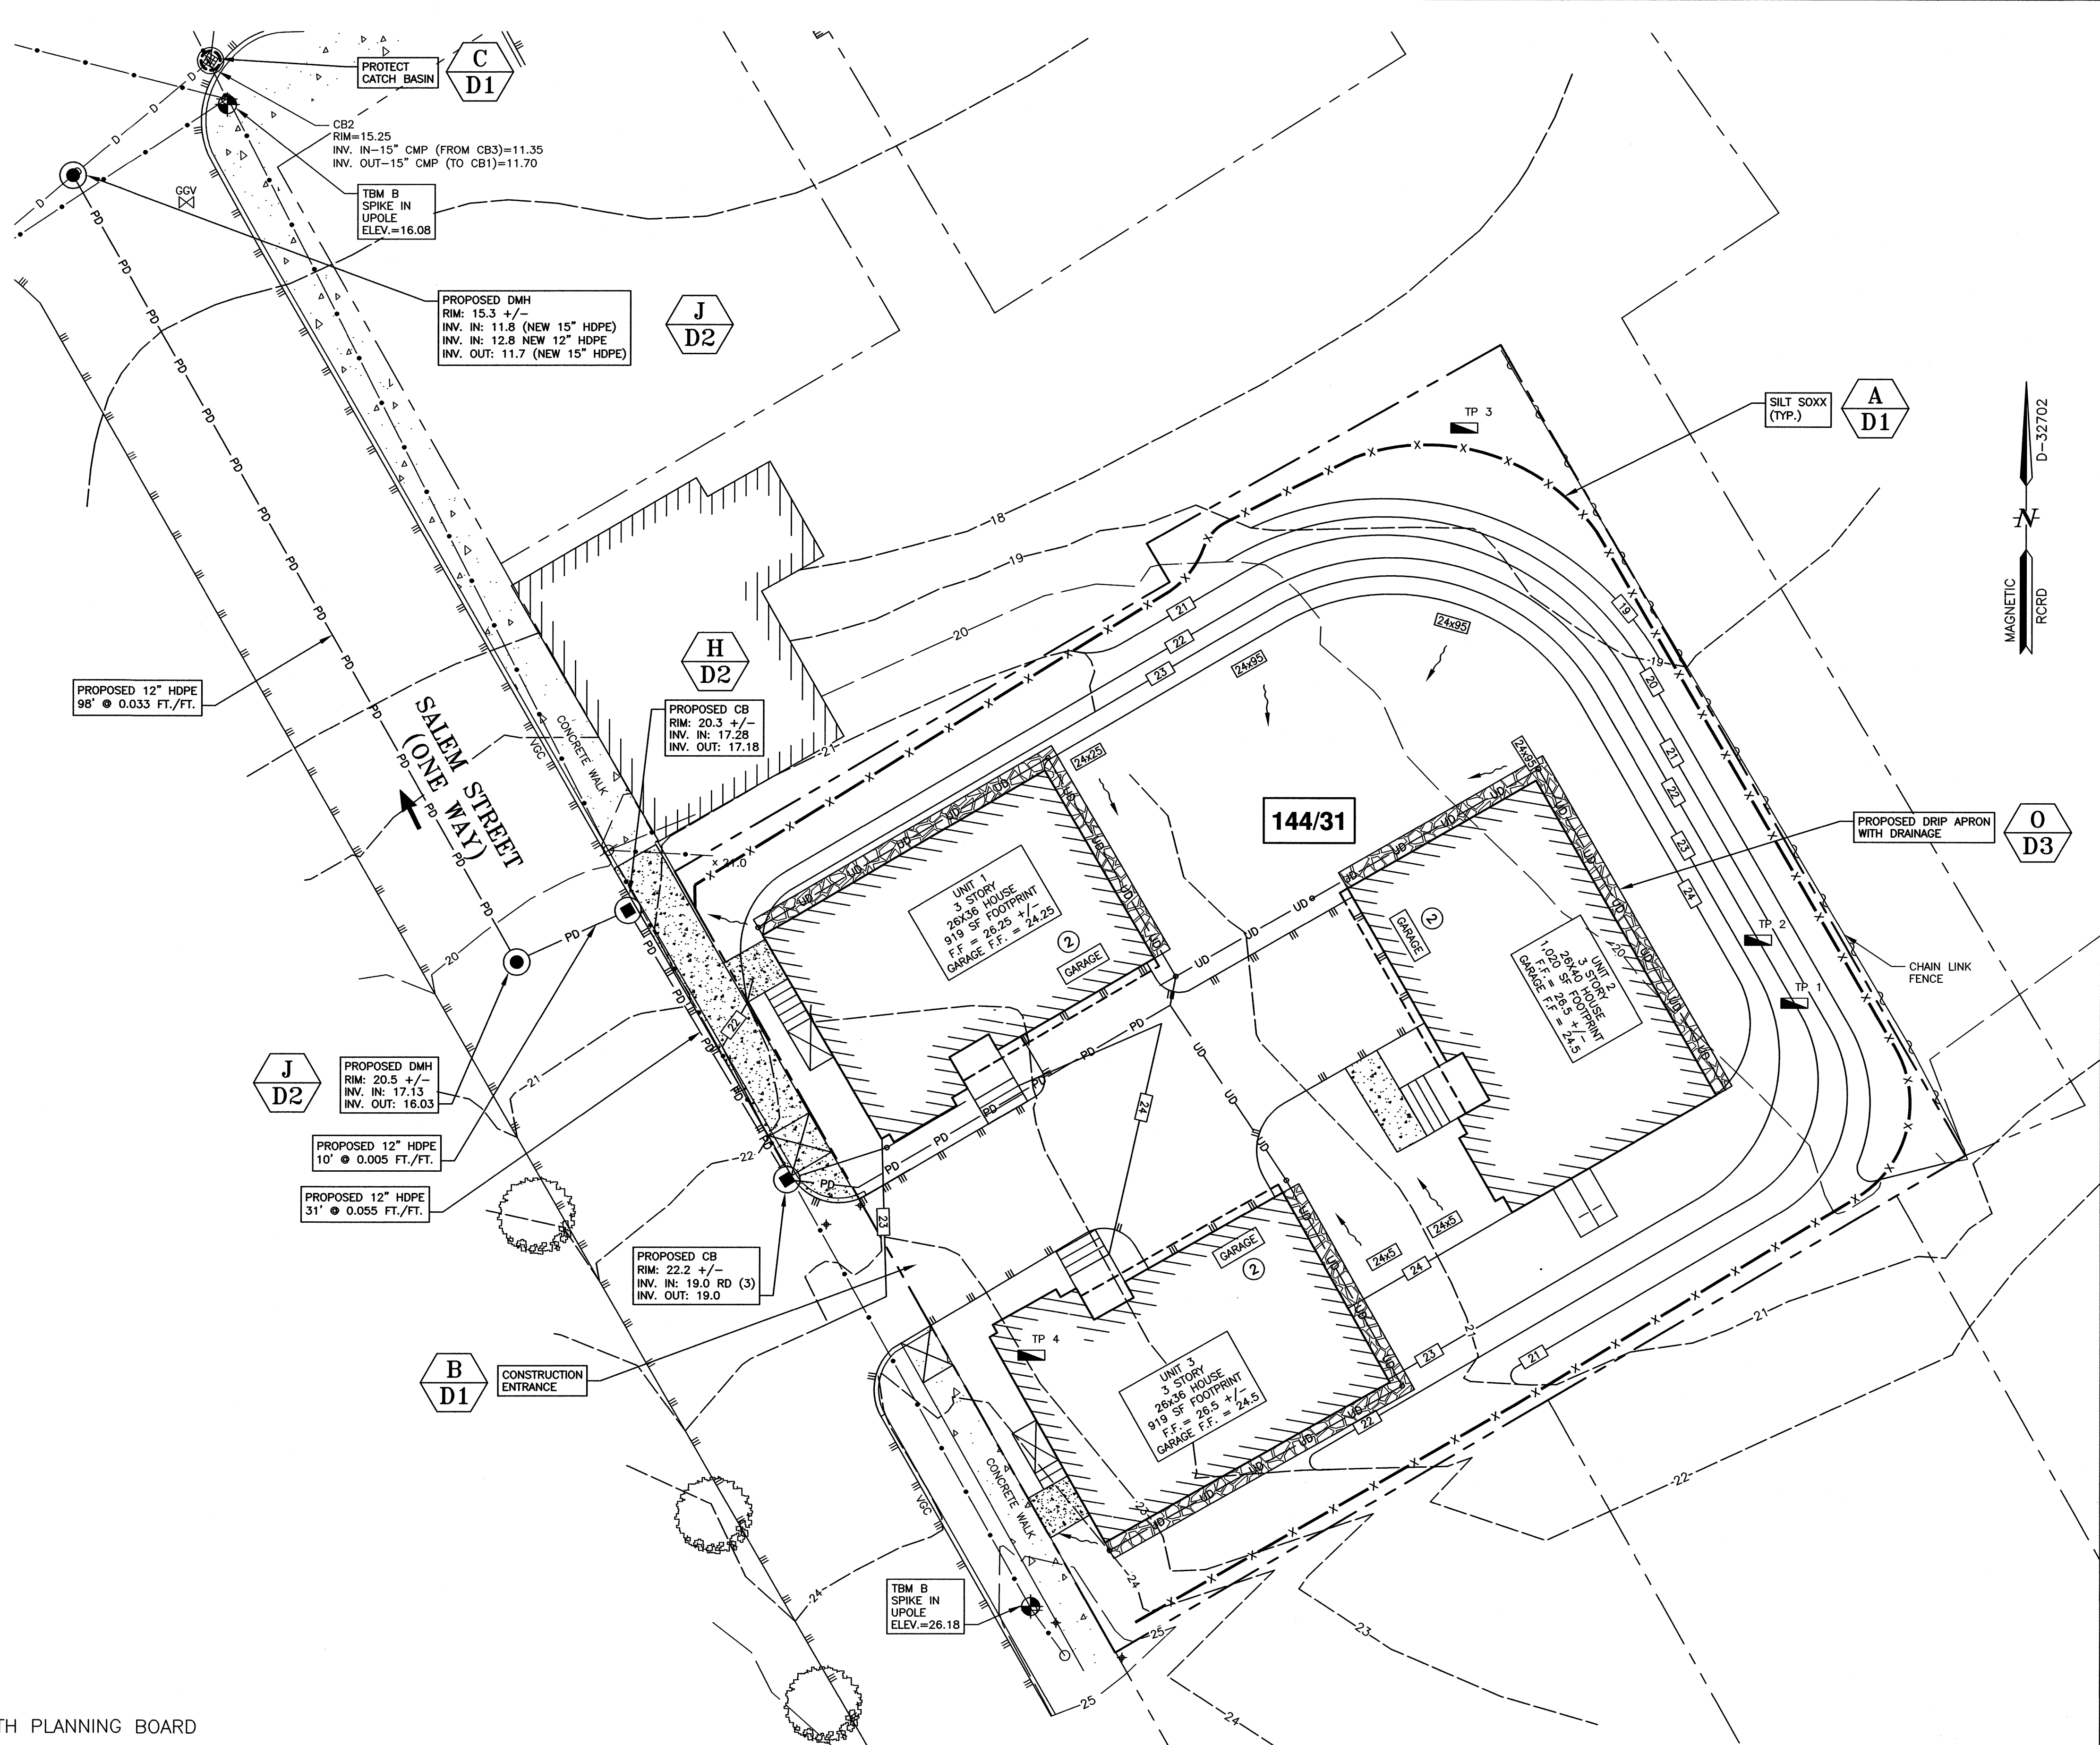

AMBIT ENGINEERING, INC.
 Civil Engineers & Land Surveyors
 200 Griffin Road - Unit 3
 Portsmouth, N.H. 03801-7114
 Tel (603) 430-9282
 Fax (603) 436-2315

- NOTES:**
- 1) THE CONTRACTOR SHALL NOTIFY DIG SAFE AT 1-888-DIG-SAFE (1-888-344-7233) AT LEAST 72 HOURS PRIOR TO COMMENCING ANY EXCAVATION ON PUBLIC OR PRIVATE PROPERTY.
 - 2) UNDERGROUND UTILITY LOCATIONS ARE BASED UPON BEST AVAILABLE EVIDENCE AND ARE NOT FIELD VERIFIED. LOCATING AND PROTECTING ANY ABOVEGROUND OR UNDERGROUND UTILITIES IS THE SOLE RESPONSIBILITY OF THE CONTRACTOR AND/OR THE OWNER. UTILITY CONFLICTS SHOULD BE REPORTED AT ONCE TO THE DESIGN ENGINEER.
 - 3) CONTRACTOR SHALL INSTALL AND MAINTAIN EROSION CONTROL MEASURES IN ACCORDANCE WITH THE "NEW HAMPSHIRE STORMWATER MANUAL, VOLUME 3, EROSION AND SEDIMENT CONTROLS DURING CONSTRUCTION. (NHDES DECEMBER 2008).
 - 4) CONTRACTOR SHALL DIG TEST PITS PRIOR TO CONSTRUCTING THE NEW DRAIN IN SALEM STREET TO VERIFY DEPTHS OF UTILITIES. TEST PITS SHALL BE AT THE DIRECTION OF AND WITNESSED BY THE DESIGN ENGINEER AND CITY OF PORTSMOUTH.

**SITE DEVELOPMENT
 41 SALEM STREET
 PORTSMOUTH, N.H.**

NO.	DESCRIPTION	DATE
3	CATCH BASIN, PIPES	4/29/20
2	TAC SUBMISSION	3/18/19
1	TAC WORKSHOP	12/2/19
0	ISSUED FOR COMMENT	11/18/19

REVISIONS

APPROVED BY THE PORTSMOUTH PLANNING BOARD


CHAIRMAN _____ DATE _____

STATE OF NEW HAMPSHIRE
 JOHN R. CHANNON
 No. 851
 LICENSED PROFESSIONAL ENGINEER

SCALE: 1" = 10' NOVEMBER 2019


**GRADING, DRAINAGE AND
 EROSION CONTROL PLAN**

C4

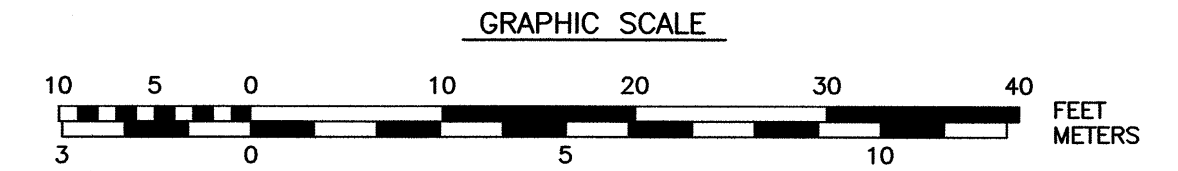

PLANTING KEY AND SCHEDULE

QTY	KEY	COMMON / BOTANICAL NAME	SIZE AT MATURITY		HARDINESS	DESCRIPTION
			w'	h'		
STREET TREE						
1	MA	Amur Maackia / Maackia amurensis "Starburst"	20'	20'	Z4	6' - 8' ht., b&b
SHADE TREES						
3	AF	Acer x freemanii / Freeman Maple	45'	25'	Z4	2" caliper (min.), b&b
4	BN	Betula nigra / River Birch	50'	40'	Z4	8' - 10' ht., b&b, clump
FOUNDATION PLANTINGS						
6	CP	Comptonia perengrina / Sweet Fern	3'	4'	Z2	#2 container, Plant 3' o.c. (min.)
2	CD	Cotoneaster dammerii 'Strieb's Finding' / Strieb's Cotoneaster	10"	3'	Z5	#2 container, Plant 3' o.c. (min.)
1	SMK	Syringa patula 'Miss Kim' / Miss Kim Lilac	8'	6'	Z3	2.5' - 3' ht, b&b or #3 container (min.)
5	TM	Taxus x media "Tautonii" / Tauton Yew	3'	5'	Z4	18" - 24" spread, b&b
SCREEN PLANTING						
14	AA	Aronia arbutifolia 'brilliantissima' / Aronia Chokeberry	10'	6'	Z3	3' - 4' ht., #3 container (min.) Plant 5' o.c. (typ.)
12	VB	Viburnum burkwoodii / Burkwood Viburnum	8'	6'	Z4	3' - 4' ht., #3 container (min.) Plant 5' o.c. (typ.)

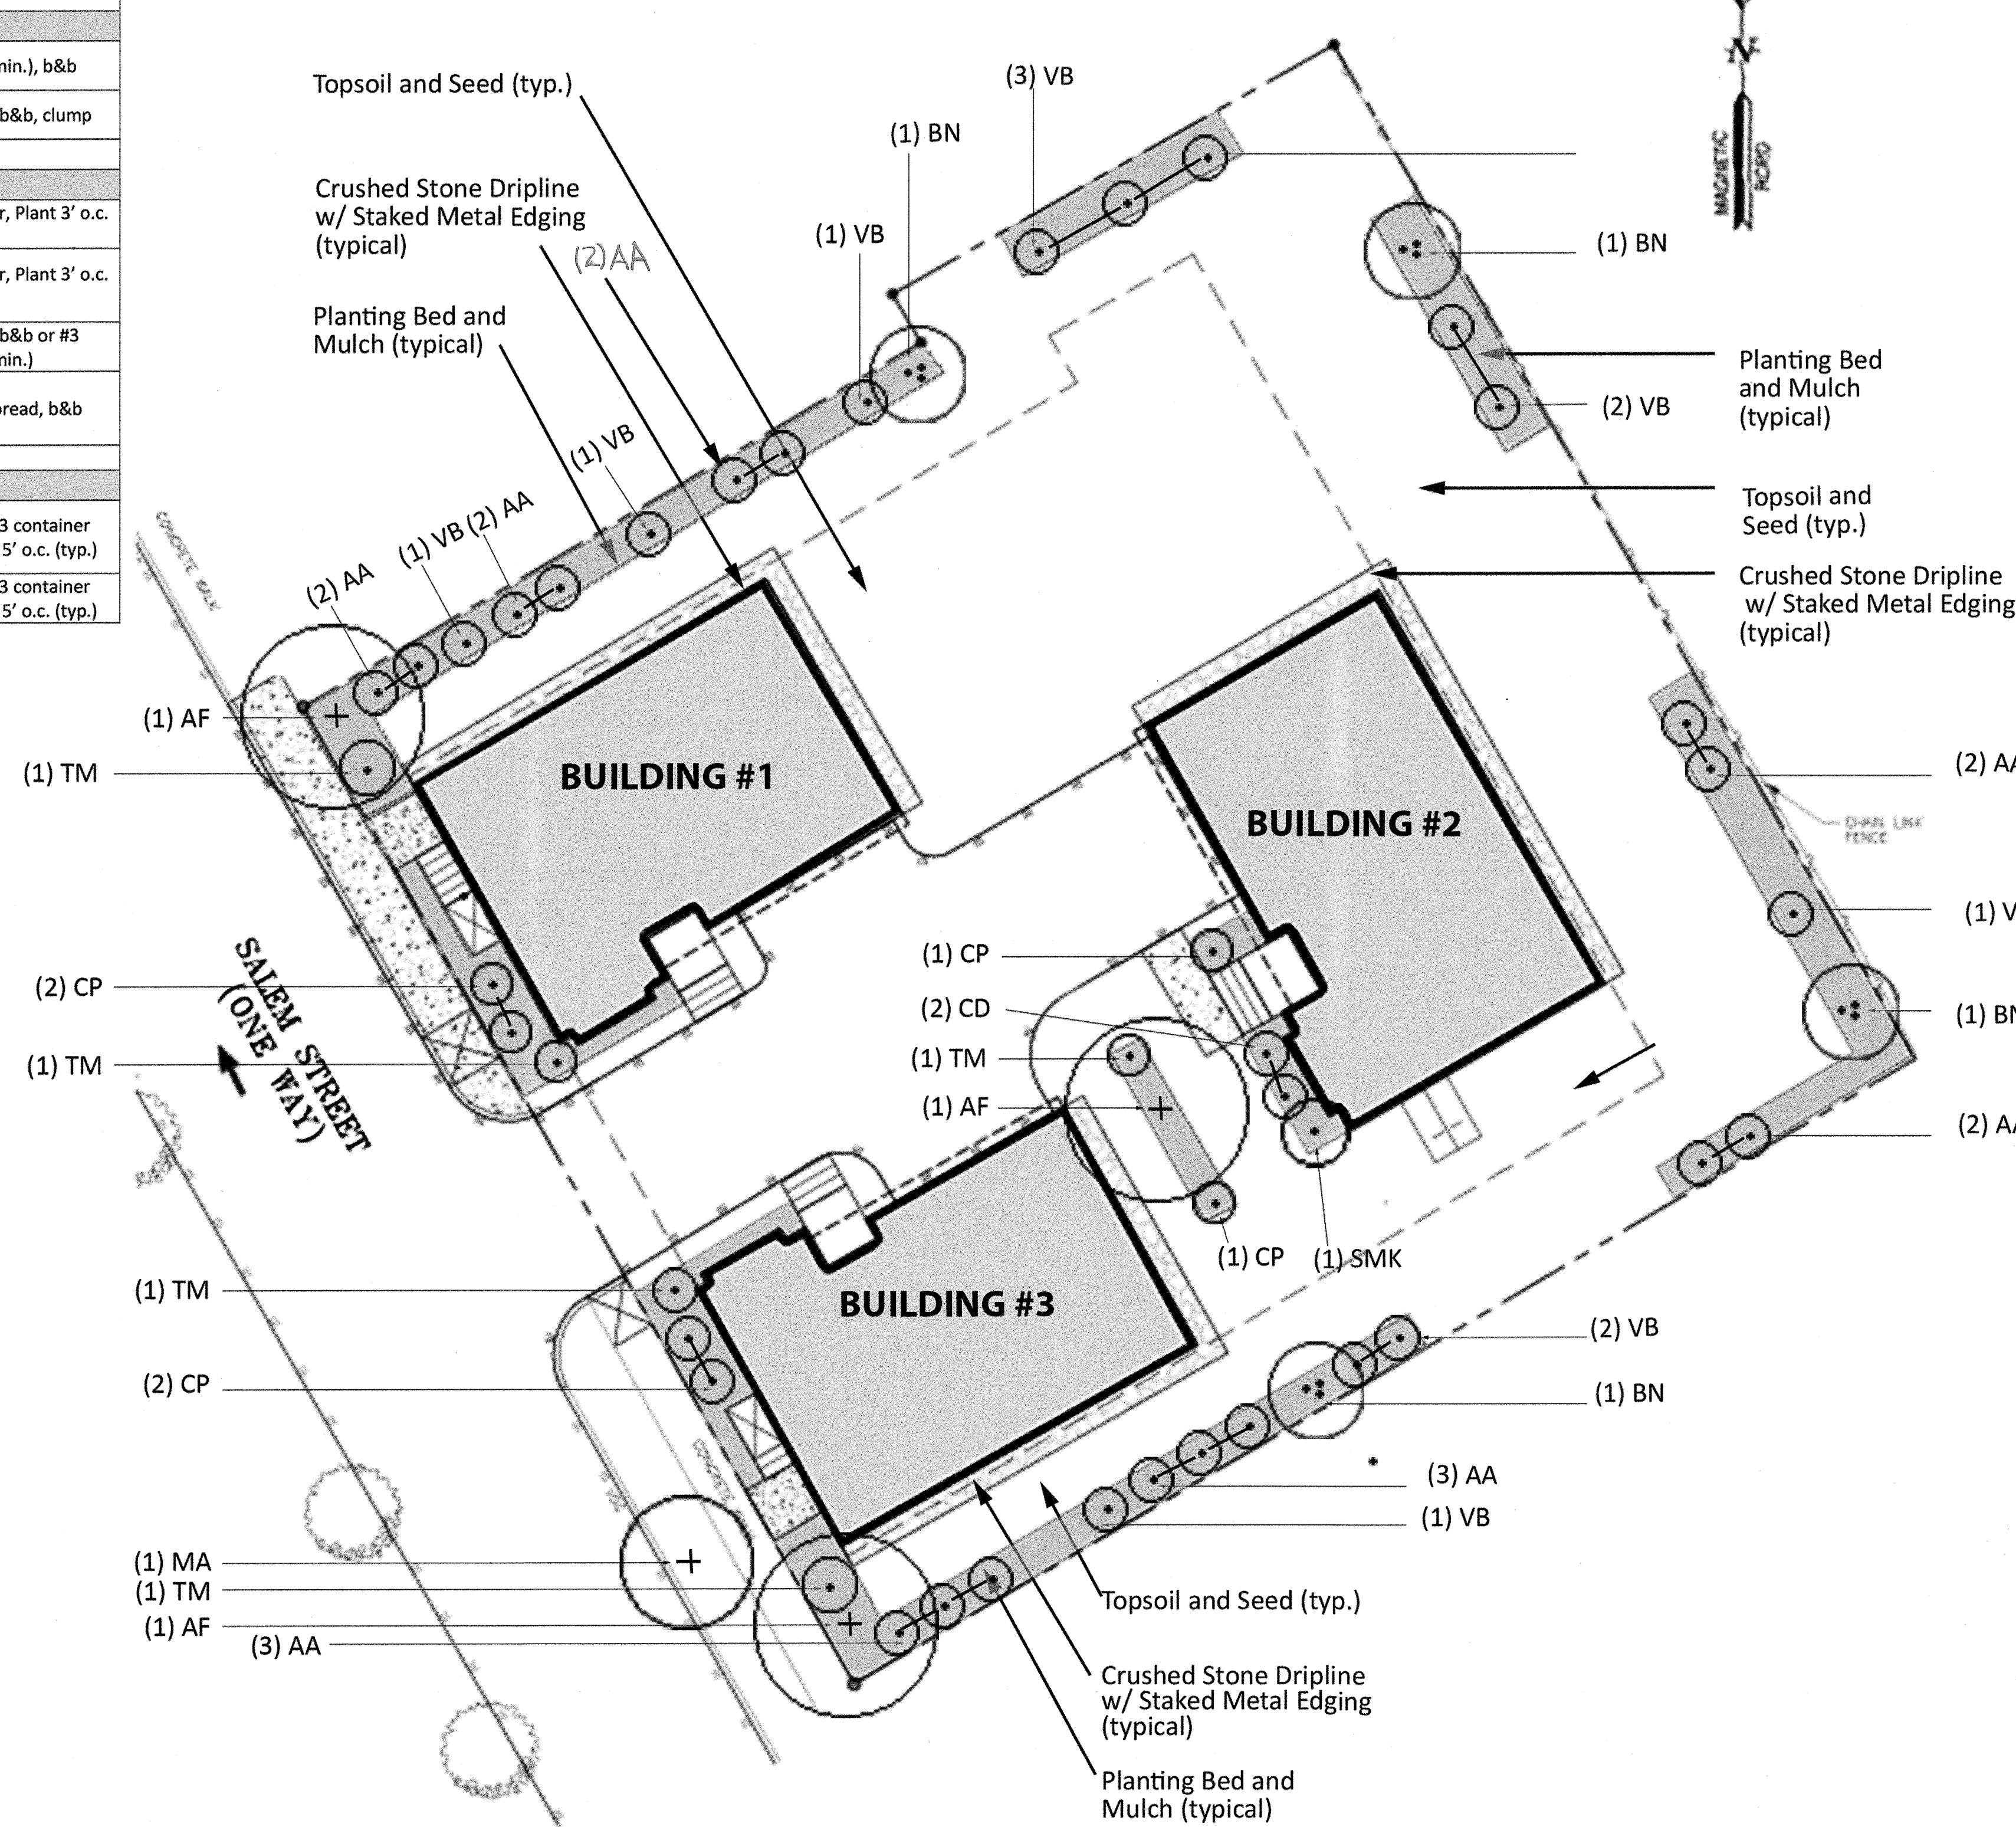

GENERAL NOTES

- The Contractor shall contact DigSafe prior to the installation of plant materials.
- Planting methods and overall care and maintenance of all planting stock shall meet the standards contained in The American National Institute A300 (Part 6) - 2012.
- All plant materials grown in containers shall have the containers removed prior to installation.
- All balled and burlapped ("b&b") plant materials shall have the burlap removed prior to backfilling the planting hole.
- All deciduous trees shall be staked and guyed with two (2) upright metal or wood stakes and flexible ties upon planting. Stakes and guys shall remain in place and be maintained for the duration of the first year after planting.
- All disturbed areas shall be treated with 3" topsoil and seed unless otherwise indicated.
- Finish grade of all lawn areas shall be a minimum of one (1) inch below adjacent curb or pavement.
- The surface of all planting beds shall be treated with three (3) inch (minimum) of bark mulch.
- All plant materials are selected for hardiness to the temperature zone of the proposed project.
- All improvements shown on this Site Plan shall be constructed and maintained in accordance with the plan by the Property Owners and all future property owners. No changes shall be made to this Site Plan without the expressed approval of the Portsmouth Planning Board.
- The Property Owner and all future property owners shall be responsible for the maintenance, repair and replacement of all required screening and landscape materials.
- All plant materials shall be tended and maintained in a healthy growing condition, replaced when necessary, and kept free of refuse and debris.
- The Property Owner shall be responsible for the removal and replacement of all dead plant material immediately with the same type, size, and quantity of plant materials as originally installed, unless alternative plantings are requested, justified and approved by the Planning Board or Planning Director.

Prepared by
 Scott N Collard MLLA, Principal
 Scott N Collard Landscape Architecture LLC
 P O Box 356
 Parsonsfield, Maine 04047
 scott@sncdesignpresence.com
 207.756.5636


SITE DEVELOPMENT
41 SALEM STREET
PORTSMOUTH, N.H.

0	ISSUED FOR COMMENT	
NO.	DESCRIPTION	DATE
REVISIONS		

SCALE: 1" = 10' April 28, 2020

DEMOLITION NOTES

- a) THE LOCATIONS OF UNDERGROUND UTILITIES ARE APPROXIMATE AND THE LOCATIONS ARE NOT GUARANTEED BY THE OWNER OR THE DESIGNER. IT IS THE CONTRACTOR'S RESPONSIBILITY TO LOCATE UTILITIES AND ANTICIPATE CONFLICTS. CONTRACTOR SHALL REPAIR EXISTING UTILITIES DAMAGED BY THEIR WORK AND RELOCATE EXISTING UTILITIES THAT ARE REQUIRED TO BE RELOCATED PRIOR TO COMMENCING ANY WORK IN THE IMPACTED AREA OF THE PROJECT.
- b) ALL MATERIALS SCHEDULED TO BE REMOVED SHALL BECOME THE PROPERTY OF THE CONTRACTOR UNLESS OTHERWISE SPECIFIED. THE CONTRACTOR SHALL DISPOSE OF ALL MATERIALS OFF-SITE IN ACCORDANCE WITH ALL FEDERAL, STATE, AND LOCAL REGULATIONS, ORDINANCES AND CODES. THE CONTRACTOR SHALL COORDINATE REMOVAL, RELOCATION, DISPOSAL, OR SALVAGE OF UTILITIES WITH THE OWNER AND APPROPRIATE UTILITY COMPANY.
- c) ANY EXISTING WORK OR PROPERTY DAMAGED OR DISRUPTED BY CONSTRUCTION/ DEMOLITION ACTIVITIES SHALL BE REPLACED OR REPAIRED TO THE ORIGINAL EXISTING CONDITIONS BY THE CONTRACTOR AT NO ADDITIONAL COST TO THE OWNER.
- d) THE CONTRACTOR SHALL VERIFY LOCATION OF ALL EXISTING UTILITIES AND CALL DIG SAFE AT LEAST 72 HOURS PRIOR TO THE COMMENCEMENT OF ANY DEMOLITION/CONSTRUCTION ACTIVITIES.
- e) SAWCUT AND REMOVE PAVEMENT ONE FOOT OFF PROPOSED EDGE OF PAVEMENT OR EXISTING CURB LINE IN AREAS WHERE PAVEMENT TO BE REMOVED ABUTS EXISTING PAVEMENT OR CONCRETE TO REMAIN.
- f) IT IS THE CONTRACTOR'S RESPONSIBILITY TO FAMILIARIZE THEMSELVES WITH THE CONDITIONS OF ALL THE PERMIT APPROVALS.
- g) THE CONTRACTOR SHALL OBTAIN AND PAY FOR ADDITIONAL CONSTRUCTION PERMITS, NOTICES AND FEES NECESSARY TO COMPLETE THE WORK AND ARRANGE FOR AND PAY FOR ANY INSPECTIONS AND APPROVALS FROM THE AUTHORITIES HAVING JURISDICTION. THE CONTRACTOR SHALL BE RESPONSIBLE FOR ANY ADDITIONAL AND OFF-SITE DISPOSAL OF MATERIALS REQUIRED TO COMPLETE THE WORK.
- h) THE CONTRACTOR SHALL REMOVE AND DISPOSE OF ALL EXISTING STRUCTURES, CONCRETE, UTILITIES, VEGETATION, PAVEMENT, AND CONTAMINATED SOIL WITHIN THE WORK LIMITS SHOWN UNLESS SPECIFICALLY IDENTIFIED TO REMAIN. ANY EXISTING DOMESTIC / IRRIGATION SERVICE WELLS IN THE PROJECT AREA IDENTIFIED DURING THE CONSTRUCTION AND NOT CALLED OUT ON THE PLANS SHALL BE BROUGHT TO THE ATTENTION OF THE OWNER AND ENGINEER FOR PROPER CAPPING / RE-USE. ANY EXISTING MONITORING WELLS IN THE PROJECT AREA IDENTIFIED DURING THE CONSTRUCTION AND NOT CALLED OUT ON THE PLANS SHALL BE BROUGHT TO THE ATTENTION OF THE OWNER AND ENGINEER TO COORDINATE MONITORING WELL REMOVAL AND/OR RELOCATION WITH NHDES AND OTHER AUTHORITY WITH JURISDICTION PRIOR TO CONSTRUCTION.
- i) ALL WORK WITHIN THE CITY OF PORTSMOUTH RIGHT OF WAY SHALL BE COORDINATED WITH THE CITY OF PORTSMOUTH DEPARTMENT OF PUBLIC WORKS (DPW).
- j) REMOVE TREES AND BRUSH AS REQUIRED FOR COMPLETION OF WORK. CONTRACTOR SHALL GRUB AND REMOVE ALL SLUMPS WITHIN LIMITS OF WORK AND DISPOSE OF OFF-SITE IN ACCORDANCE WITH FEDERAL, STATE, AND LOCAL LAWS AND REGULATIONS.
- k) CONTRACTOR SHALL PROTECT ALL PROPERTY MONUMENTATION THROUGHOUT DEMOLITION AND CONSTRUCTION OPERATIONS. SHOULD ANY MONUMENTATION BE DISTURBED, THE CONTRACTOR SHALL EMPLOY A NH LICENSED LAND SURVEYOR TO REPLACE THEM.
- l) PROVIDE INLET PROTECTION BARRIERS AT ALL CATCH BASINS WITHIN CONSTRUCTION LIMITS AND MAINTAIN FOR THE DURATION OF THE PROJECT. INLET PROTECTION BARRIERS SHALL BE HIGH FLOW SILT SACK BY ACF ENVIRONMENTAL OR APPROVED EQUAL. INSPECT BARRIERS WEEKLY AND AFTER EACH RAIN OF 0.25 INCHES OR GREATER. CONTRACTOR SHALL COMPLETE A MAINTENANCE INSPECTION REPORT AFTER EACH INSPECTION. SEDIMENT DEPOSITS SHALL BE REMOVED AFTER EACH STORM EVENT OR MORE OFTEN IF WARRANTED OR FABRIC BECOMES CLOGGED. EROSION CONTROL MEASURES SHALL BE INSTALLED PRIOR TO THE START OF ANY CLEARING OR DEMOLITION ACTIVITIES.
- m) THE CONTRACTOR SHALL PAY ALL COSTS NECESSARY FOR TEMPORARY PARTITIONING, BARRICADING, FENCING, SECURITY AND SAFELY DEVICES REQUIRED FOR THE MAINTENANCE OF A CLEAN AND SAFE CONSTRUCTION SITE.
- n) ANY CONTAMINATED MATERIAL REMOVED DURING THE COURSE OF THE WORK WILL REQUIRE HANDLING IN ACCORDANCE WITH NHDES REGULATIONS. CONTRACTOR SHALL HAVE A HEALTH AND SAFETY PLAN IN PLACE, AND COMPLY WITH ALL APPLICABLE PERMITS, APPROVALS, AUTHORIZATIONS, AND REGULATIONS

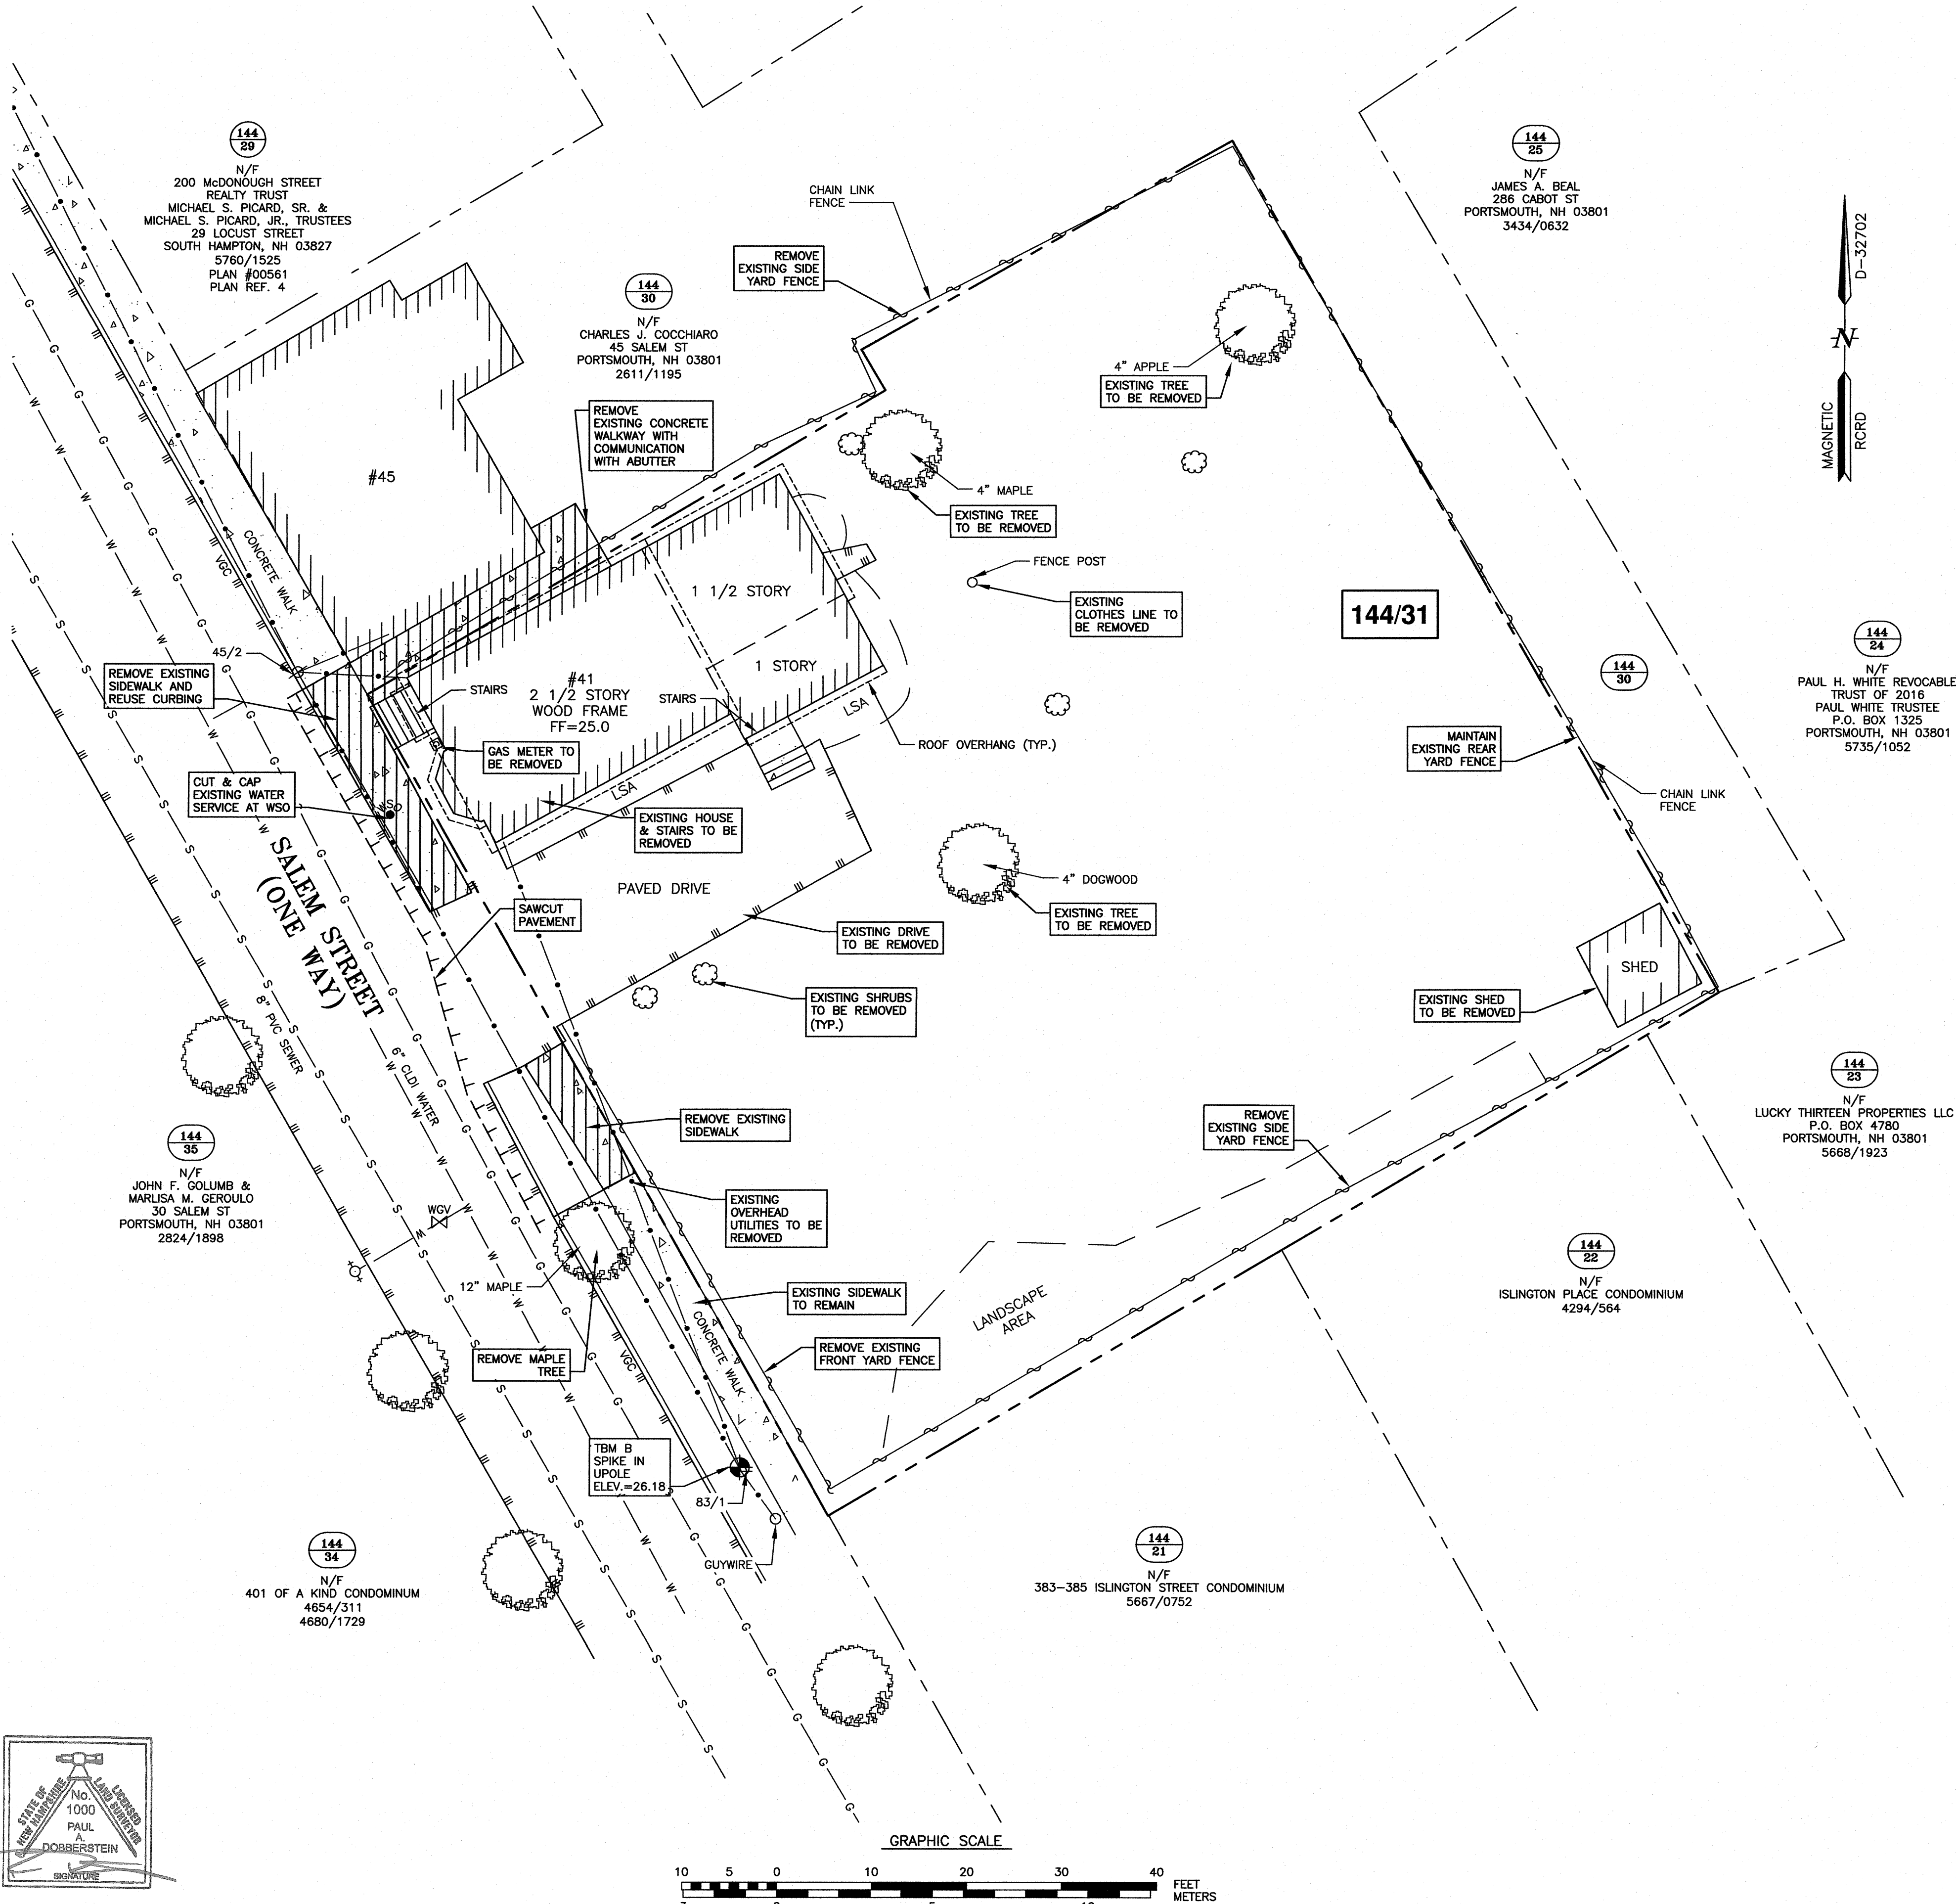


AMBIT ENGINEERING, INC.
 Civil Engineers & Land Surveyors
 200 Griffin Road - Unit 3
 Portsmouth, N.H. 03801-7114
 Tel (603) 430-9282
 Fax (603) 436-2315

- NOTES:**
- 1) THE CONTRACTOR SHALL NOTIFY DIG SAFE AT 1-888-DIG-SAFE (1-888-344-7233) AT LEAST 72 HOURS PRIOR TO COMMENCING ANY EXCAVATION ON PUBLIC OR PRIVATE PROPERTY.
 - 2) UNDERGROUND UTILITY LOCATIONS ARE BASED UPON BEST AVAILABLE EVIDENCE AND ARE NOT FIELD VERIFIED. LOCATING AND PROTECTING ANY ABOVEGROUND OR UNDERGROUND UTILITIES IS THE SOLE RESPONSIBILITY OF THE CONTRACTOR AND/OR THE OWNER. UTILITY CONFLICTS SHOULD BE REPORTED AT ONCE TO THE DESIGN ENGINEER.
 - 3) CONTRACTOR SHALL INSTALL AND MAINTAIN EROSION CONTROL MEASURES IN ACCORDANCE WITH THE "NEW HAMPSHIRE STORMWATER MANUAL, VOLUME 3, EROSION AND SEDIMENT CONTROLS DURING CONSTRUCTION. (NHDES DECEMBER 2008).
 - 4) EXISTING UTILITY CONNECTIONS SHALL BE ABANDONED IN ACCORDANCE WITH UTILITY COMPANY REQUIREMENTS. UTILITIES THAT ARE TO BE REUSED SHALL BE CUT & CAPPED.
 - 5) CONTRACTOR WILL COORDINATE STREET CLOSINGS, IF ANY, WITH CITY OF PORTSMOUTH.
 - 6) DURING CONSTRUCTION, TEMPORARY FENCING SHALL BE INSTALLED, AS REQUIRED, TO PROTECT THE SITE FROM THE PUBLIC.
 - 7) COORDINATE DEMOLITION WITH CITY OF PORTSMOUTH, PERMITS REQUIRED. PROVIDE TEMPORARY DRAINAGE STRUCTURES, AS REQUIRED, TO KEEP SITE FROM FLOODING DURING CONSTRUCTION.
 - 8) REMOVAL OF MAPLE TREE IN SALEM STREET RIGHT OF WAY APPROVED BY THE TREES AND GREENERY COMMITTEE 2/12/2020.

**SITE DEVELOPMENT
 41 SALEM STREET
 PORTSMOUTH, N.H.**

NO.	DESCRIPTION	DATE
2	TAC SUBMISSION	3/18/20
1	TAC WORKSHOP	12/2/19
0	ISSUED FOR COMMENT	11/18/19

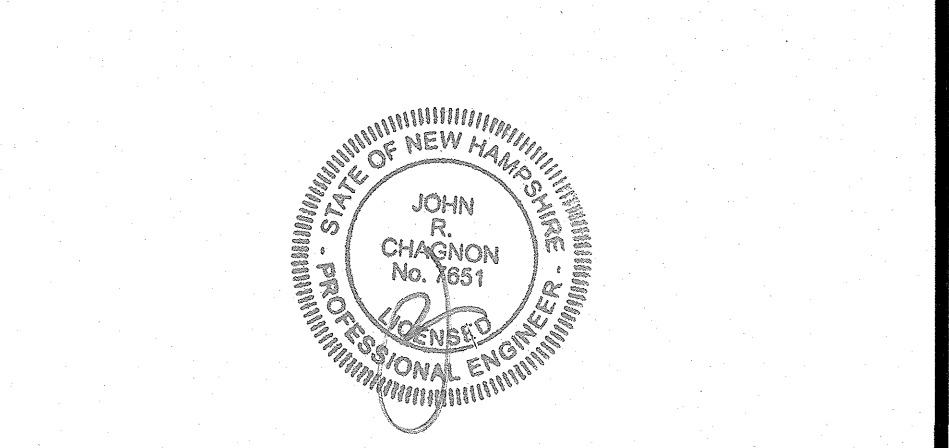



SCALE: 1"=10' NOVEMBER 2019

DEMOLITION PLAN

C6

I CERTIFY THAT THIS PLAN WAS PREPARED UNDER MY DIRECT SUPERVISION, THAT IT IS THE RESULT OF A FIELD SURVEY BY THIS OFFICE AND HAS AN ACCURACY OF THE CLOSED TRAVERSE THAT EXCEEDS THE PRECISION OF 1:15,000.

PAUL A. DOBBERSTEIN, LLS #1000
 DATE 3/18/2020

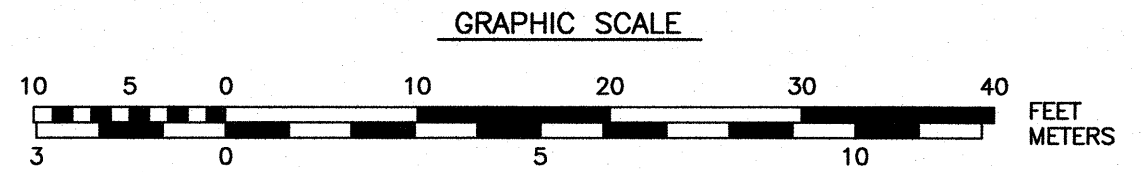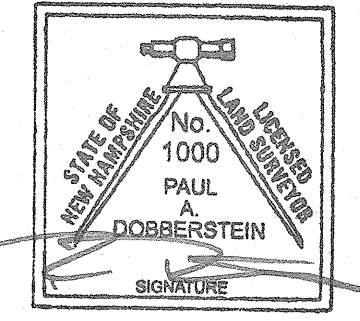






I:\JOB33\UN_3000\UN_3080\UN_3082\2019 Site Development\Plans & Specs\Site\3082_Site_2019.dwg, C6 DEMOLITION



AMBIT ENGINEERING, INC.
 Civil Engineers & Land Surveyors
 200 Griffin Road - Unit 3
 Portsmouth, N.H. 03801-7114
 Tel (603) 430-9282
 Fax (603) 436-2315


NOTES:

- 1) THE CONTRACTOR SHALL NOTIFY DIG SAFE AT 1-888-DIG-SAFE (1-888-344-7233) AT LEAST 72 HOURS PRIOR TO COMMENCING ANY EXCAVATION ON PUBLIC OR PRIVATE PROPERTY.
- 2) UNDERGROUND UTILITY LOCATIONS ARE BASED UPON BEST AVAILABLE EVIDENCE AND ARE NOT FIELD VERIFIED. LOCATING AND PROTECTING ANY ABOVEGROUND OR UNDERGROUND UTILITIES IS THE SOLE RESPONSIBILITY OF THE CONTRACTOR AND/OR THE OWNER. UTILITY CONFLICTS SHOULD BE REPORTED AT ONCE TO THE DESIGN ENGINEER.
- 3) CONTRACTOR SHALL INSTALL AND MAINTAIN EROSION CONTROL MEASURES IN ACCORDANCE WITH THE "NEW HAMPSHIRE STORMWATER MANUAL, VOLUME 3, EROSION AND SEDIMENT CONTROLS DURING CONSTRUCTION. (NHDES DECEMBER 2008).
- 4) CONTRACTOR SHALL DIG TEST PITS PRIOR TO CONSTRUCTING THE NEW DRAIN IN SALEM STREET TO LOCATE ALL SERVICES AND VERIFY DEPTHS OF UTILITIES. TEST PITS SHALL BE AT THE DIRECTION OF AND WITNESSED BY THE DESIGN ENGINEER.

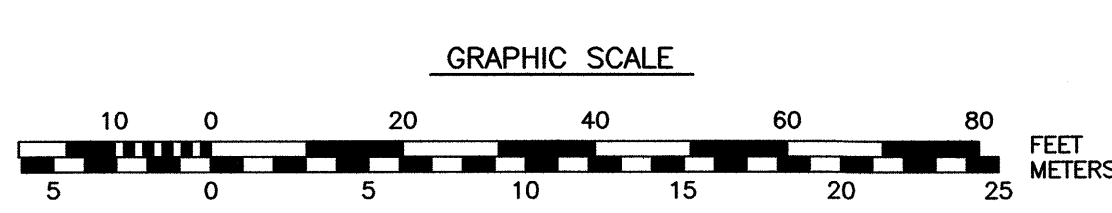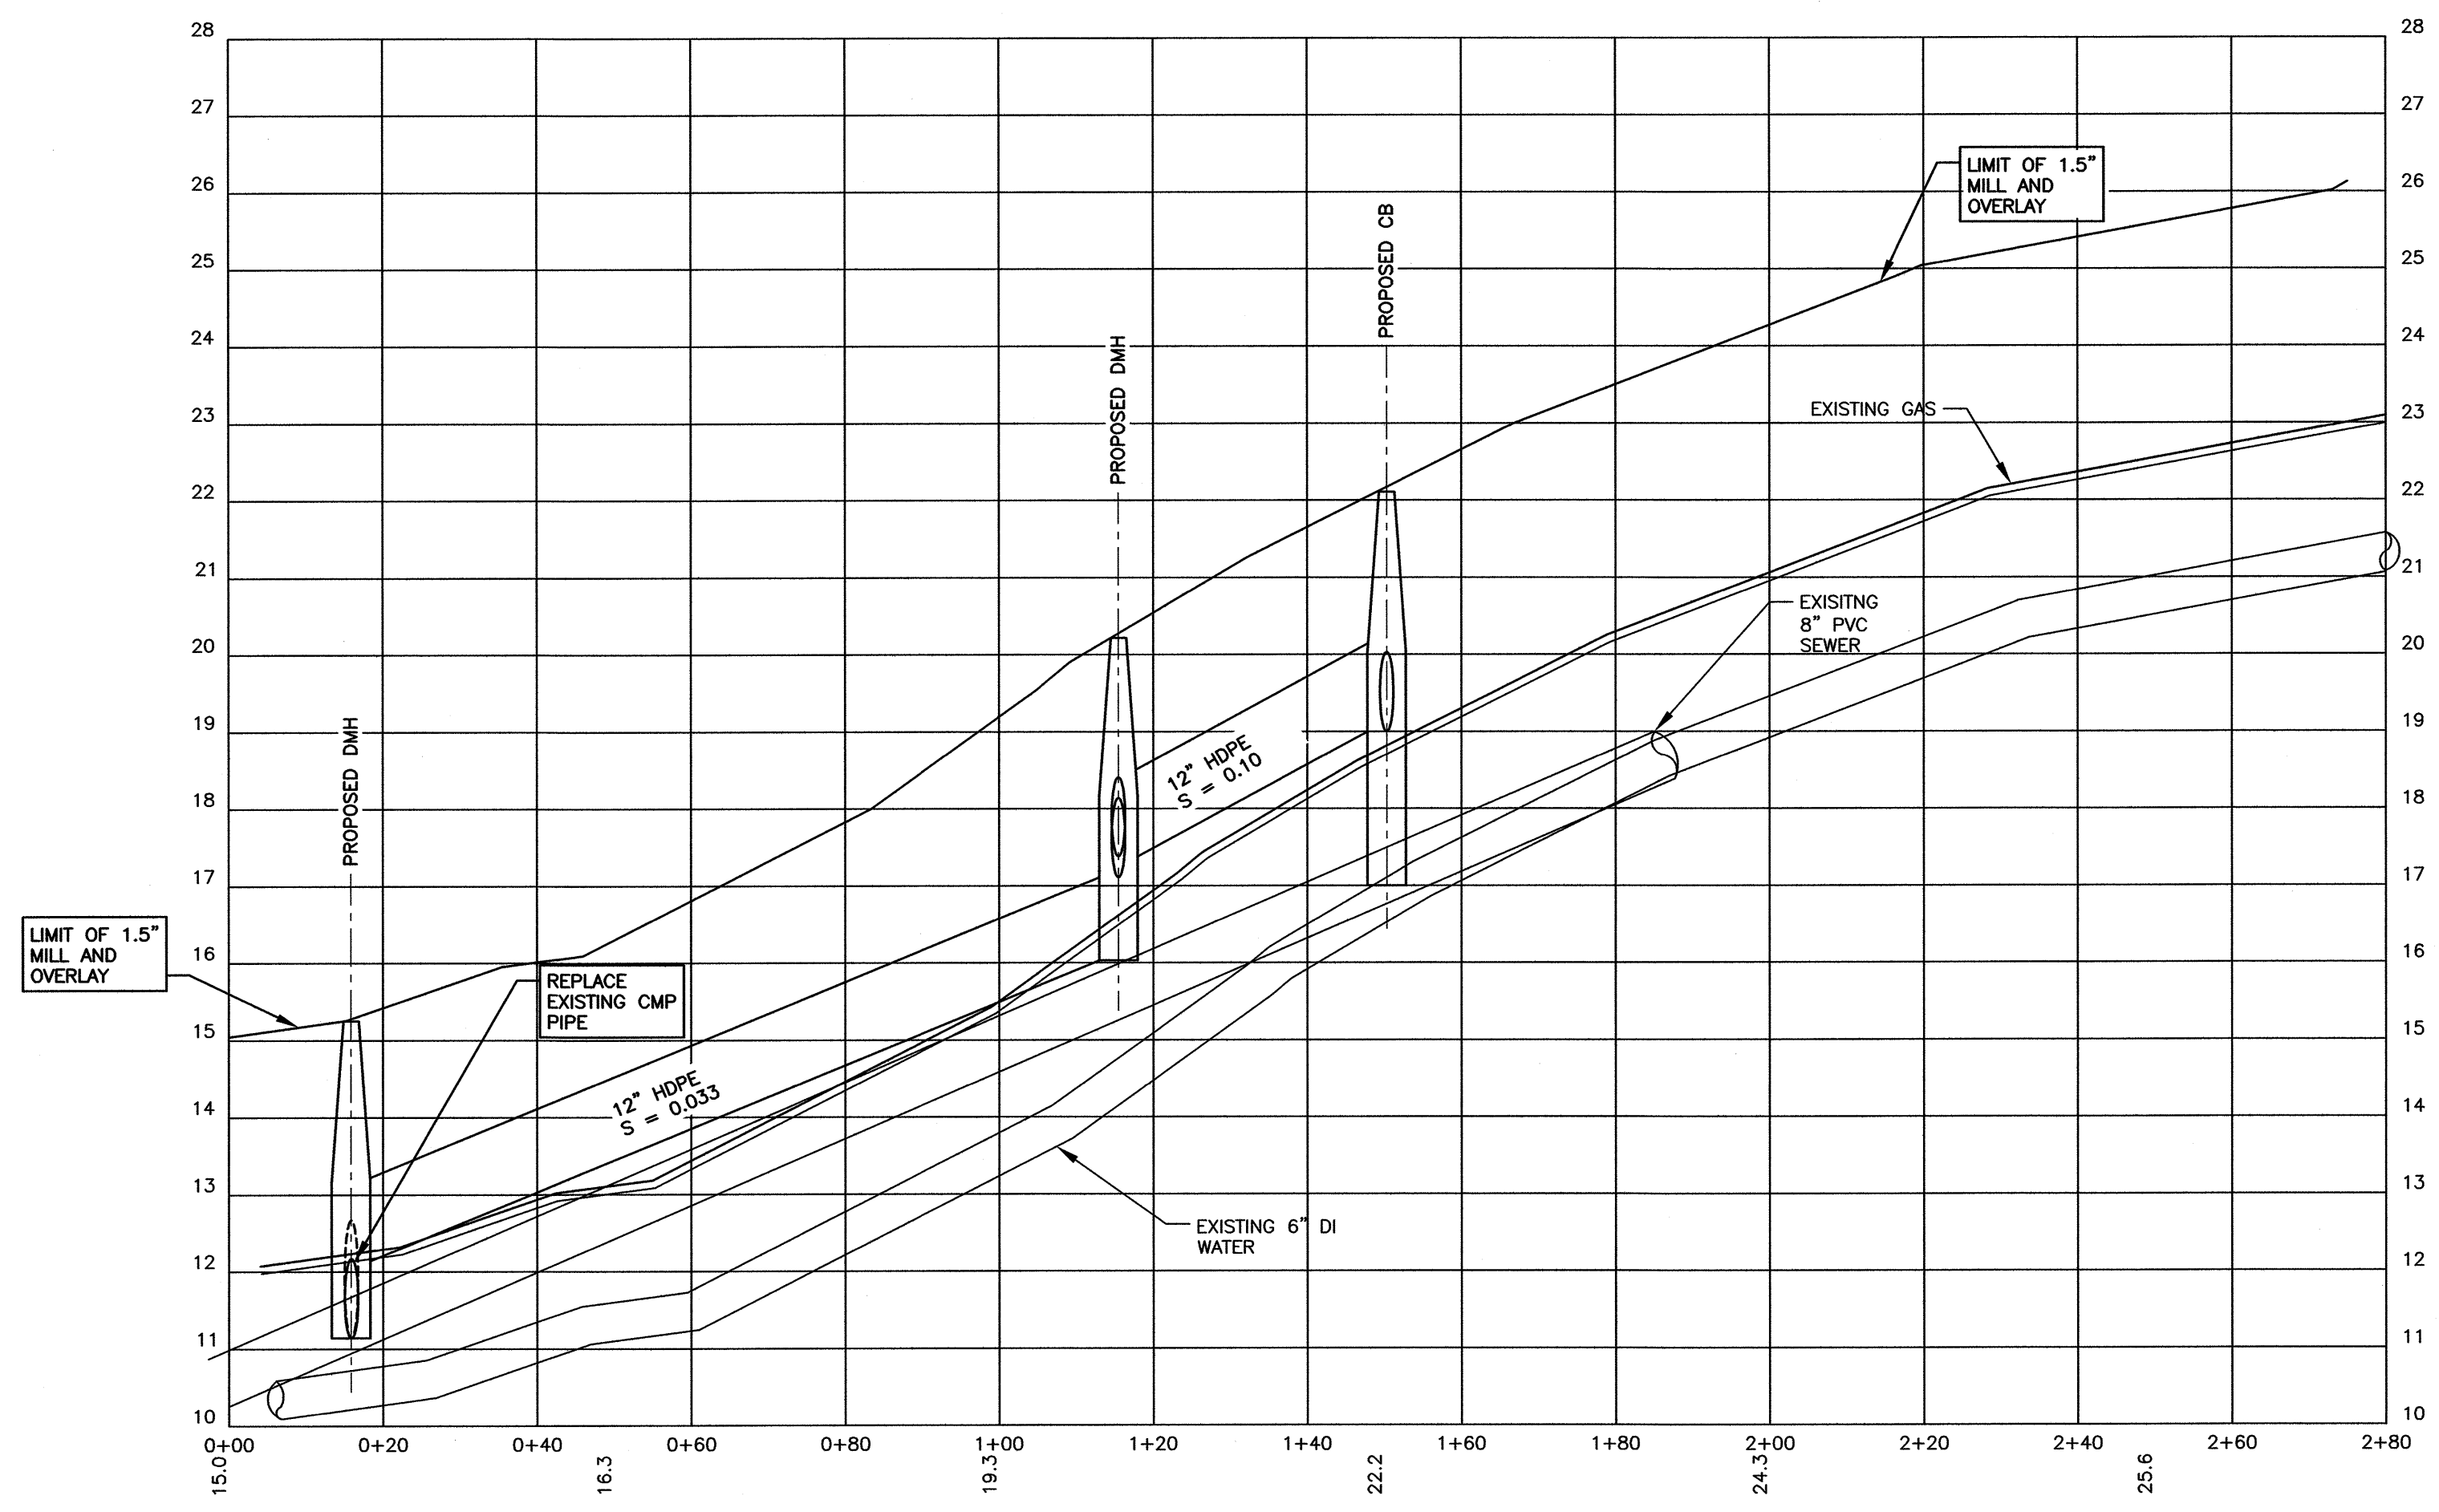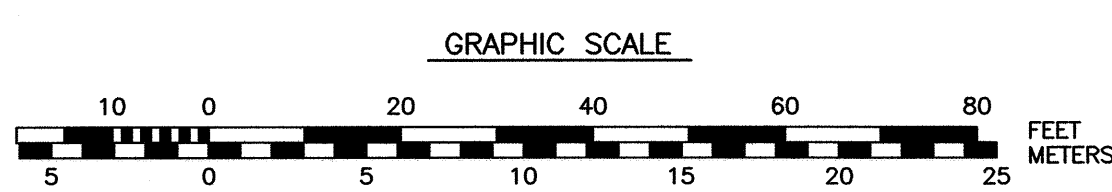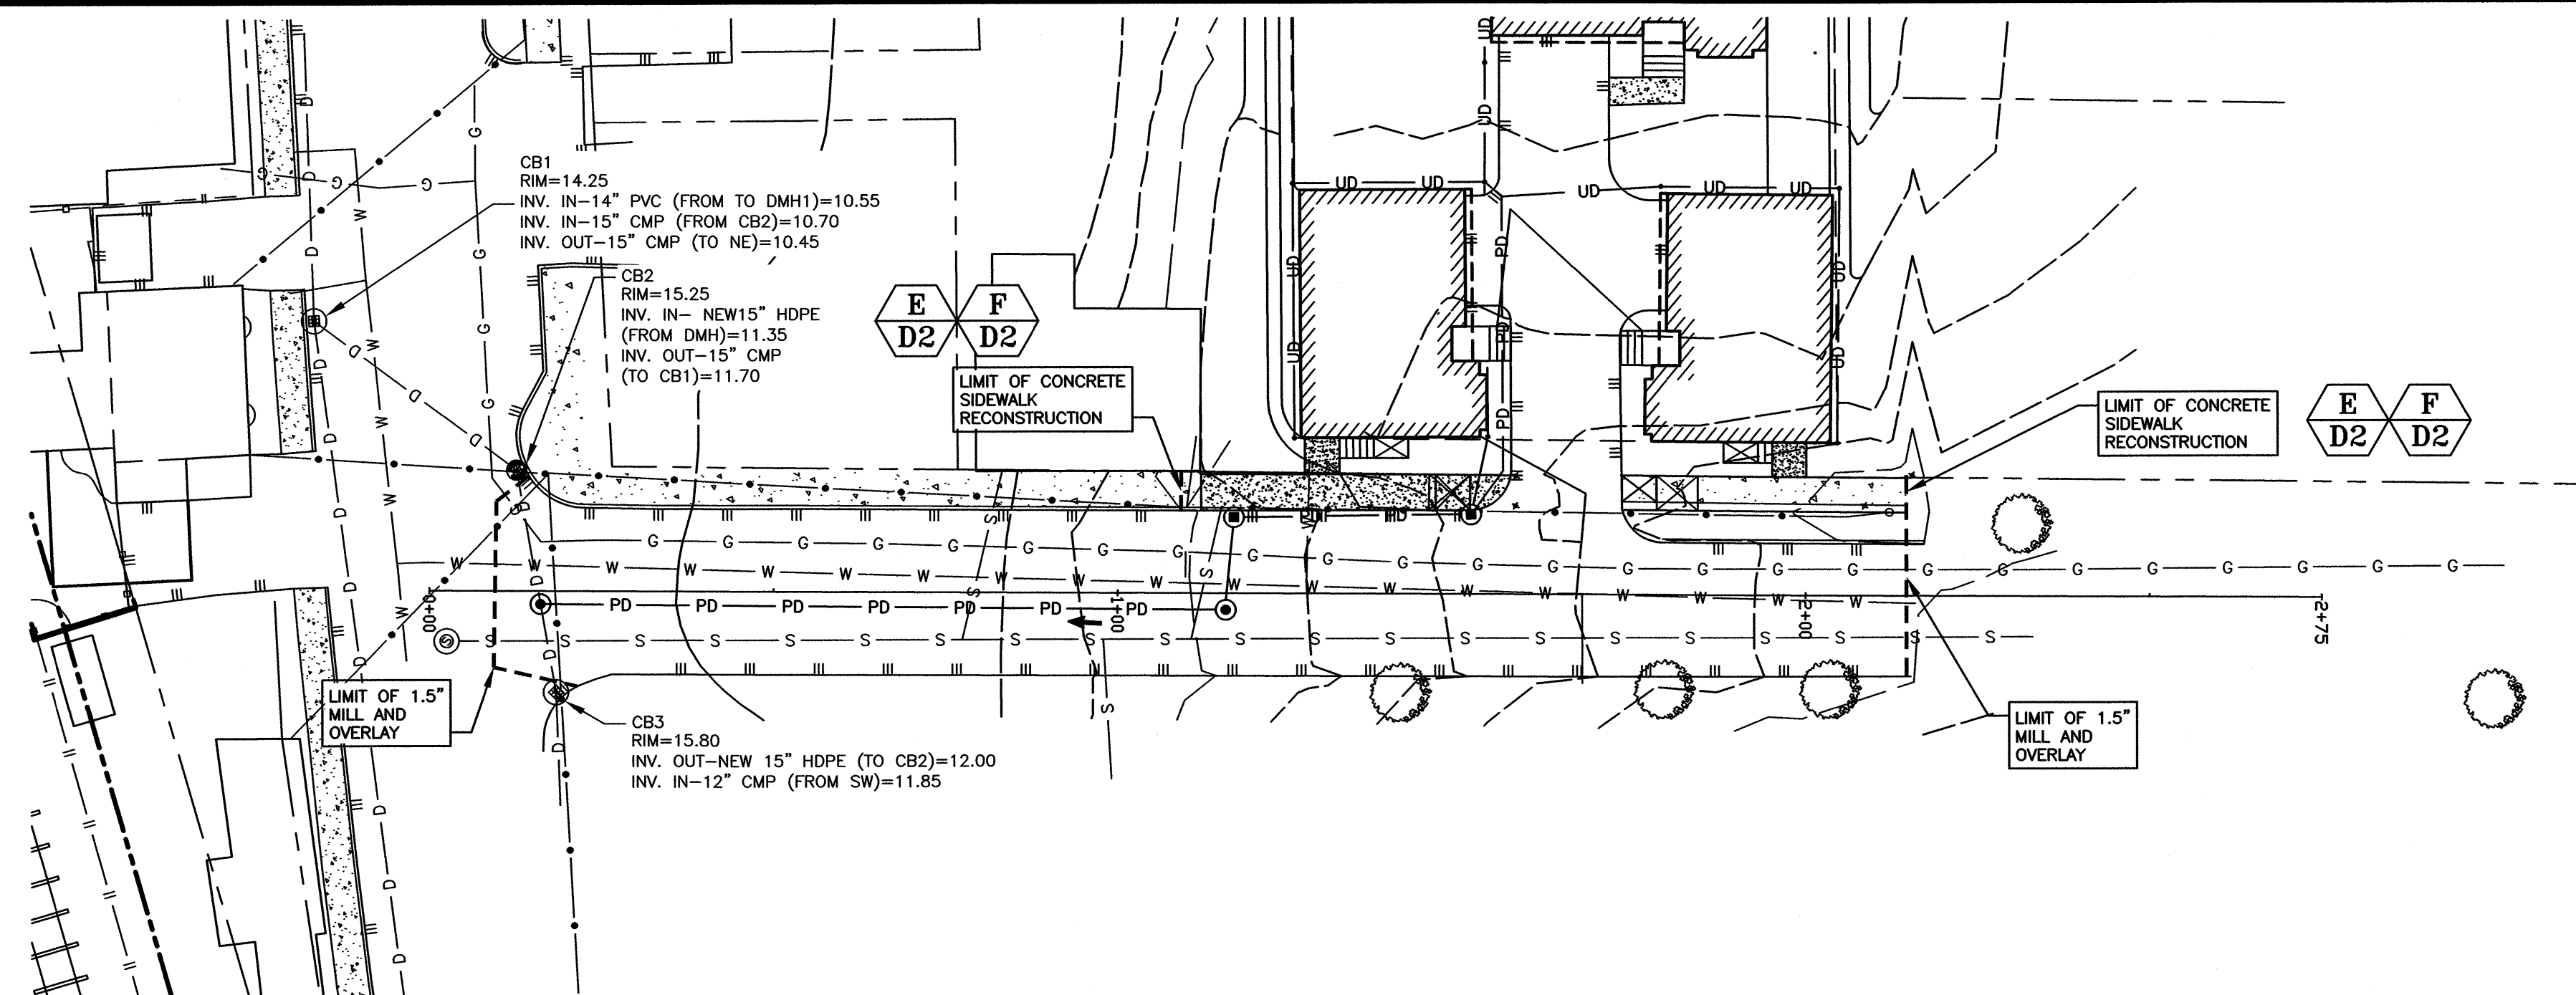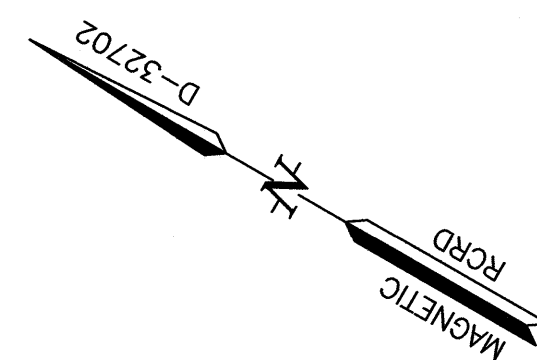

**SITE DEVELOPMENT
 41 SALEM STREET
 PORTSMOUTH, N.H.**

NO.	DESCRIPTION	DATE
1	SALEM DRAIN PIPE, SEWER, WATER	4/29/20
0	ISSUED FOR COMMENT	3/18/20

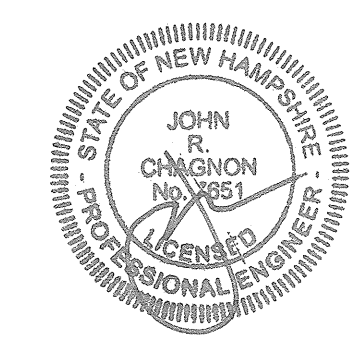

SCALE: 1" = 20' NOVEMBER 2019

**SALEM STREET
 PLAN AND PROFILE**

P1

APPROVED BY THE PORTSMOUTH PLANNING BOARD

CHAIRMAN _____ DATE _____

EROSION CONTROL NOTES

CONSTRUCTION SEQUENCE

- DO NOT BEGIN CONSTRUCTION UNTIL ALL LOCAL, STATE AND FEDERAL PERMITS HAVE BEEN APPLIED FOR AND RECEIVED.
- INSTALL PERIMETER CONTROLS AROUND THE LIMITS OF DISTURBANCE BEFORE ANY EARTH MOVING OPERATIONS. THE USE OF HAYBALES IS NOT ALLOWED.
- CONSTRUCT STABILIZED CONSTRUCTION ENTRANCE.
- PERFORM DEMOLITION.
- CUT AND GRUB ALL TREES, SHRUBS, SAPLINGS, BRUSH, VINES AND REMOVE OTHER DEBRIS AND RUBBISH AS REQUIRED.
- BULLDOZE TOPSOIL INTO STOCKPILES, AND CIRCLE WITH SILT FENCING OR SILTSOXX. IF EROSION IS EXCESSIVE, THEN COVER WITH MULCH.
- CONSTRUCT FOUNDATIONS.
- LAYOUT AND INSTALL ALL BURIED UTILITIES AND SERVICES TO THE PROPOSED BUILDING FOUNDATIONS. CAP AND MARK TERMINATIONS OR LOG SWING TIES.
- FINISH GRADE SITE, BACKFILL DRIVEWAY SUBBASE GRAVEL IN TWO, COMPACTED LIFTS. PROVIDE TEMPORARY EROSION PROTECTION TO SITE IN THE FORM OF MULCHING, JUTE MESH OR DITCH DAMS.
- PLACE BINDER LAYER OF PAVEMENT
- PLANT LANDSCAPING IN AREAS OUT OF WAY OF BUILDING CONSTRUCTION. PREPARE AND STABILIZE FINAL SITE GRADING BY ADDING TOPSOIL, SEED, MULCH AND FERTILIZER.
- AFTER BUILDINGS ARE COMPLETED, FINISH ALL REMAINING LANDSCAPED WORK.
- CONSTRUCT ASPHALT WEARING COURSE.
- REMOVE TRAPPED SEDIMENTS FROM COLLECTION DEVICES AS APPROPRIATE, AND THEN REMOVE TEMPORARY EROSION CONTROL MEASURES UPON COMPLETION OF FINAL STABILIZATION OF THE SITE.

GENERAL CONSTRUCTION NOTES

- THE EROSION CONTROL PROCEDURES SHALL CONFORM TO SECTION 645 OF THE "STANDARD SPECIFICATION FOR ROAD AND BRIDGE CONSTRUCTION" OF THE NHDOT, AND "STORM WATER MANAGEMENT AND EROSION AND SEDIMENT CONTROL HANDBOOK FOR URBAN AND DEVELOPING AREAS IN NEW HAMPSHIRE". THE PROJECT IS TO BE MANAGED IN A MANNER THAT MEETS THE REQUIREMENTS AND INTENT OF RSA 430:53 AND CHAPTER AGR 3800 RELATIVE TO INVASIVE SPECIES.
- DURING CONSTRUCTION AND THEREAFTER, EROSION CONTROL MEASURES ARE TO BE IMPLEMENTED AS NOTED. THE SMALLEST PRACTICAL AREA OF LAND SHOULD BE EXPOSED AT ANY ONE TIME DURING DEVELOPMENT. NO DISTURBED AREA SHALL BE LEFT UNSTABILIZED FOR MORE THAN 45 DAYS.
- ANY DISTURBED AREAS WHICH ARE TO BE LEFT TEMPORARILY, AND WHICH WILL BE REGRADED LATER DURING CONSTRUCTION SHALL BE MACHINE HAY MULCHED AND SEEDED WITH RYE GRASS TO PREVENT EROSION.
- DUST CONTROL: IF TEMPORARY STABILIZATION PRACTICES, SUCH AS TEMPORARY VEGETATION AND MULCHING, DO NOT ADEQUATELY REDUCE DUST GENERATION, APPLICATION OF WATER OR CALCIUM CHLORIDE SHALL BE APPLIED IN ACCORDANCE WITH BEST MANAGEMENT PRACTICES.
- SILT FENCES AND SILTSOXX SHALL BE PERIODICALLY INSPECTED DURING THE LIFE OF THE PROJECT AND AFTER EACH STORM. ALL DAMAGED SILT FENCES AND SILTSOXX SHALL BE REPAIRED. SEDIMENT DEPOSITS SHALL PERIODICALLY BE REMOVED AND DISPOSED IN A SECURED LOCATION.
- AVOID THE USE OF FUTURE OPEN SPACES (LOAM AND SEED AREAS) WHEREVER POSSIBLE DURING CONSTRUCTION. CONSTRUCTION TRAFFIC SHALL USE THE ROADBEDS OF FUTURE ACCESS DRIVES AND PARKING AREAS.
- ADDITIONAL TOPSOIL REQUIRED FOR THE ESTABLISHMENT OF VEGETATION SHALL BE STOCKPILED IN AMOUNTS NECESSARY TO COMPLETE FINISHED GRADING OF ALL EXPOSED AREAS—CONSTRUCT SILT FENCE OR SILTSOXX AROUND TOPSOIL STOCKPILE.
- AREAS TO BE FILLED SHALL BE CLEARED, GRUBBED AND STRIPPED OF TOPSOIL TO REMOVE TREES, VEGETATION, ROOTS OR OTHER OBJECTIONABLE MATERIAL. STUMPS SHALL BE DISPOSED OF IN AN APPROVED FACILITY.
- ALL FILLS SHALL BE PLACED AND COMPACTED TO REDUCE EROSION, SLIPPAGE, SETTLEMENT, SUBSIDENCE OR OTHER RELATED PROBLEMS.
- ALL NON-STRUCTURAL, SITE-FILL SHALL BE PLACED AND COMPACTED TO 90% MODIFIED PROCTOR DENSITY IN LAYERS NOT EXCEEDING 18 INCHES IN THICKNESS UNLESS OTHERWISE NOTED.
- FROZEN MATERIAL OR SOFT, MUCKY OR HIGHLY COMPRESSIBLE MATERIAL, TRASH, WOODY DEBRIS, LEAVES, BRUSH OR ANY DELETERIOUS MATTER SHALL NOT BE INCORPORATED INTO FILLS.
- FILL MATERIAL SHALL NOT BE PLACED ON FROZEN FOUNDATION SUBGRADE.
- DURING CONSTRUCTION AND UNTIL ALL DEVELOPED AREAS ARE FULLY STABILIZED, ALL EROSION CONTROL MEASURES SHALL BE INSPECTED WEEKLY AND AFTER EACH ONE HALF INCH OF RAINFALL.
- THE CONTRACTOR SHALL MODIFY OR ADD EROSION CONTROL MEASURES AS NECESSARY TO ACCOMMODATE PROJECT CONSTRUCTION.

- ALL ROADWAYS AND PARKING AREAS SHALL BE STABILIZED WITHIN 72 HOURS OF ACHIEVING FINISHED GRADE. ALL CUT AND FILL SLOPES SHALL BE SEEDED/LOAMED WITHIN 72 HOURS OF ACHIEVING FINISHED GRADE.
- AN AREA SHALL BE CONSIDERED STABLE IF ONE OF THE FOLLOWING HAS OCCURRED:
 - BASE COURSE GRAVELS HAVE BEEN INSTALLED ON AREAS TO BE PAVED
 - A MINIMUM OF 85% VEGETATED GROWTH HAS BEEN ESTABLISHED
 - A MINIMUM OF 3 INCHES OF NON-EROSIVE MATERIAL SUCH AS STONE OR RIPRAP HAS BEEN INSTALLED
 - EROSION CONTROL BLANKETS HAVE BEEN INSTALLED

VEGETATIVE PRACTICE

- FOR PERMANENT MEASURES AND PLANTINGS:
 - LIMESTONE SHALL BE THOROUGHLY INCORPORATED INTO THE LOAM LAYER AT A RATE OF 2 TONS PER ACRE.
 - FERTILIZER SHALL BE SPREAD ON THE TOP LAYER OF LOAM AND WORKED INTO THE SURFACE. FERTILIZER APPLICATION RATE SHALL BE 500 POUNDS PER ACRE OF 10-20-20 FERTILIZER.
 - SEED SHALL BE SOWN AT THE RATES SHOWN IN THE TABLE BELOW, IMMEDIATELY BEFORE SEEDING. THE SOIL SHALL BE LIGHTLY RAKED. ONE HALF THE SEED SHALL BE SOWN IN ONE DIRECTION AND THE OTHER HALF AT RIGHT ANGLES TO THE ORIGINAL DIRECTION. IT SHALL BE LIGHTLY RAKED INTO THE SOIL TO A DEPTH NOT OVER 1/4 INCH AND ROLLED WITH A HAND ROLLER WEIGHING NOT OVER 100 POUNDS PER LINEAR FOOT OF WIDTH. HAY MULCH SHALL BE APPLIED IMMEDIATELY AFTER SEEDING AT A RATE OF 1.5 TO 2 TONS PER ACRE, AND SHALL BE HELD IN PLACE USING APPROPRIATE TECHNIQUES FROM THE EROSION AND SEDIMENT CONTROL HANDBOOK.
 - THE SURFACE SHALL BE WATERED AND KEPT MOIST WITH A FINE SPRAY AS REQUIRED, WITHOUT WASHING AWAY THE SOIL, UNTIL THE GRASS IS WELL ESTABLISHED. ANY AREAS WHICH ARE NOT SATISFACTORILY COVERED SHALL BE RESEDED, AND ALL NOXIOUS WEEDS REMOVED.
- A GRASS SEED MIXTURE CONTAINING THE FOLLOWING SEED REQUIREMENTS SHALL BE:

GENERAL COVER	PROPORTION	SEEDING RATE
CREEPING RED FESCUE	50%	100 LBS/ACRE
KENTUCKY BLUEGRASS	50%	
- SLOPE SEED (USED ON ALL SLOPES GREATER THAN OR EQUAL TO 3:1)


CREEPING RED FESCUE	42%	
TALL FESCUE	42%	48 LBS/ACRE
BIRDSFOOT TREFLOIL	16%	
- IN NO CASE SHALL THE WEED CONTENT EXCEED ONE PERCENT BY WEIGHT. ALL SEED SHALL COMPLY WITH APPLICABLE STATE AND FEDERAL SEED LAWS.
- FOR TEMPORARY PROTECTION OF DISTURBED AREAS:
 - MULCHING AND SEEDING SHALL BE APPLIED AT THE FOLLOWING RATES:
 - PERENNIAL RYE: 0.7 LBS/1,000 S.F.
 - MULCH: 1.5 TONS/ACRE

MAINTENANCE AND PROTECTION

- THE CONTRACTOR SHALL MAINTAIN ALL LOAM & SEED AREAS UNTIL FINAL ACCEPTANCE AT THE COMPLETION OF THE CONTRACT. MAINTENANCE SHALL INCLUDE WATERING, WEEDING, REMOVAL OF STONES AND OTHER FOREIGN OBJECTS OVER 1/2 INCHES IN DIAMETER WHICH MAY APPEAR AND THE FIRST TWO (2) CUTTINGS OF GRASS NO CLOSER THAN TEN (10) DAYS APART. THE FIRST CUTTING SHALL BE ACCOMPLISHED WHEN THE GRASS IS FROM 2 1/2 TO 3 INCHES HIGH. ALL BARE AND DEAD SPOTS WHICH BECOME APPARENT SHALL BE PROPERLY PREPARED, LIMED AND FERTILIZED, AND RESEDED BY THE CONTRACTOR AT HIS EXPENSE AS MANY TIMES AS NECESSARY TO SECURE GOOD GROWTH. THE ENTIRE AREA SHALL BE MAINTAINED, WATERED AND CUT UNTIL ACCEPTANCE OF THE LAWN BY THE OWNER'S REPRESENTATIVE.
- THE CONTRACTOR SHALL TAKE WHATEVER MEASURES ARE NECESSARY TO PROTECT THE GRASS WHILE IT IS DEVELOPING.
- TO BE ACCEPTABLE, SEEDED AREAS SHALL CONSIST OF A UNIFORM STAND OF AT LEAST 90 PERCENT ESTABLISHED PERMANENT GRASS SPECIES, WITH UNIFORM COUNT OF AT LEAST 100 PLANTS PER SQUARE FOOT.
- SEEDED AREAS WILL BE FERTILIZED AND RESEDED AS NECESSARY TO INSURE VEGETATIVE ESTABLISHMENT.
- THE SWALES WILL BE CHECKED WEEKLY AND REPAIRED WHEN NECESSARY UNTIL ADEQUATE VEGETATION IS ESTABLISHED.
- THE SILT FENCE OR SILTSOXX BARRIER SHALL BE CHECKED AFTER EACH RAINFALL AND AT LEAST DAILY DURING PROLONGED RAINFALL.
- SILT FENCING AND SILTSOXX SHALL BE REMOVED ONCE VEGETATION IS ESTABLISHED, AND DISTURBED AREAS RESULTING FROM SILT FENCE AND SILTSOXX REMOVAL SHALL BE PERMANENTLY SEEDED.


WINTER NOTES

- ALL PROPOSED VEGETATED AREAS WHICH DO NOT EXHIBIT A MINIMUM OF 85% VEGETATIVE GROWTH BY OCTOBER 15TH, OR WHICH ARE DISTURBED AFTER OCTOBER 15TH, SHALL BE STABILIZED BY SEEDING AND INSTALLING EROSION CONTROL BLANKETS ON SLOPES GREATER THAN 3:1, AND SEEDING AND PLACING 3 TO 4 TONS OF MULCH PER ACRE, SECURED WITH ANCHORED NETTING, ELSEWHERE. THE INSTALLATION OF EROSION CONTROL BLANKETS OR MULCH AND NETTING SHALL NOT OCCUR OVER ACCUMULATED SNOW OR ON FROZEN GROUND AND SHALL BE COMPLETED IN ADVANCE OF THAW OR SPRING MELT EVENTS.
- ALL DITCHES OR SWALES WHICH DO NOT EXHIBIT A MINIMUM OF 85% VEGETATIVE GROWTH BY OCTOBER 15TH, OR WHICH ARE DISTURBED AFTER OCTOBER 15TH, SHALL BE STABILIZED TEMPORARILY WITH STONE OR EROSION CONTROL BLANKETS APPROPRIATE FOR THE DESIGN FLOW CONDITIONS.
- AFTER NOVEMBER 15TH, INCOMPLETE ROAD OR PARKING SURFACES, WHERE WORK HAS STOPPED FOR THE WINTER SEASON, SHALL BE PROTECTED WITH A MINIMUM OF 3 INCHES OF CRUSHED GRAVEL PER NHDOT ITEM 304.3.

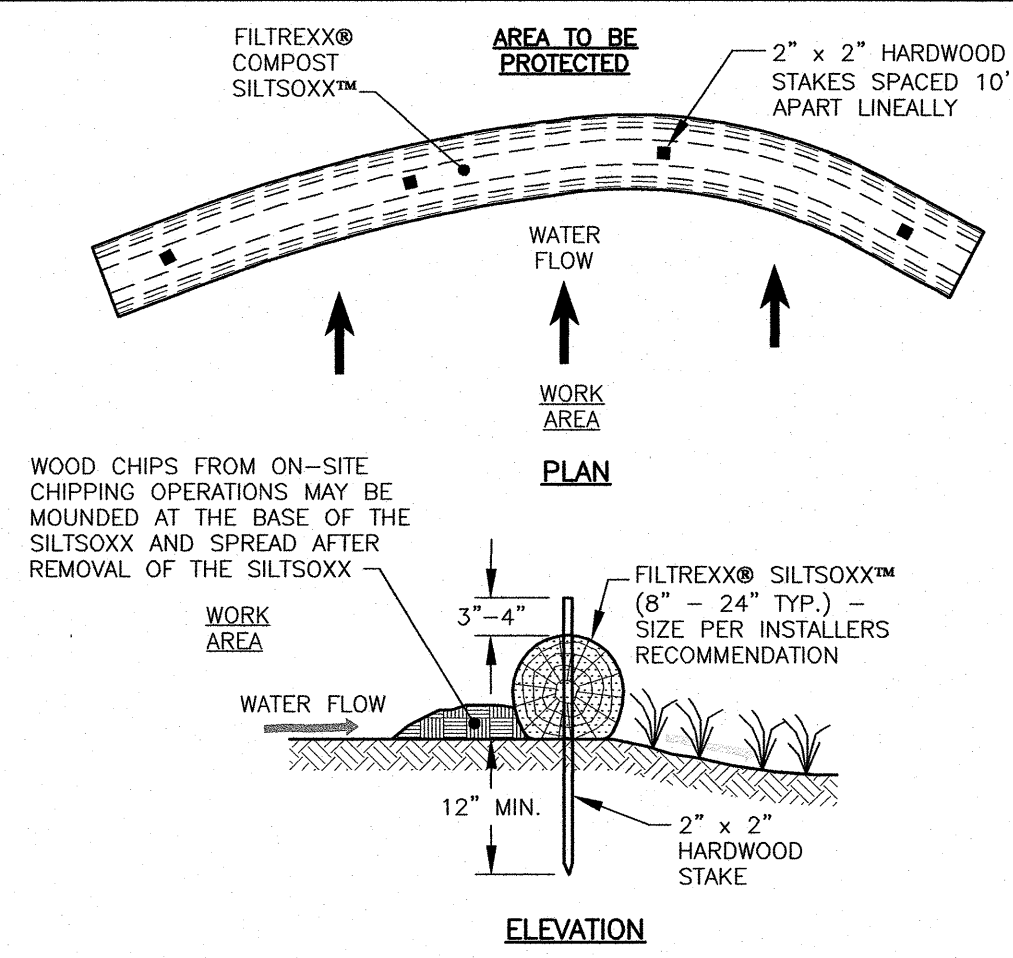

- NOTES:
- ALL MATERIAL TO MEET FILTREXX SPECIFICATIONS.
 - FILTREXX SYSTEM SHALL BE INSTALLED BY A CERTIFIED FILTREXX INSTALLER.
 - THE CONTRACTOR SHALL MAINTAIN THE COMPOST FILTRATION SYSTEM IN A FUNCTIONAL CONDITION AT ALL TIMES. IT WILL BE ROUTINELY INSPECTED AND REPAIRED WHEN REQUIRED.
 - SILTSOXX DEPICTED IS FOR MINIMUM SLOPES. GREATER SLOPES MAY REQUIRE ADDITIONAL PLACEMENTS.
 - THE COMPOST FILTER MATERIAL WILL BE DISPERSED ON SITE WHEN NO LONGER REQUIRED, AS DETERMINED BY THE ENGINEER.

A FILTREXX® SILTSOXX™ FILTRATION SYSTEM NTS

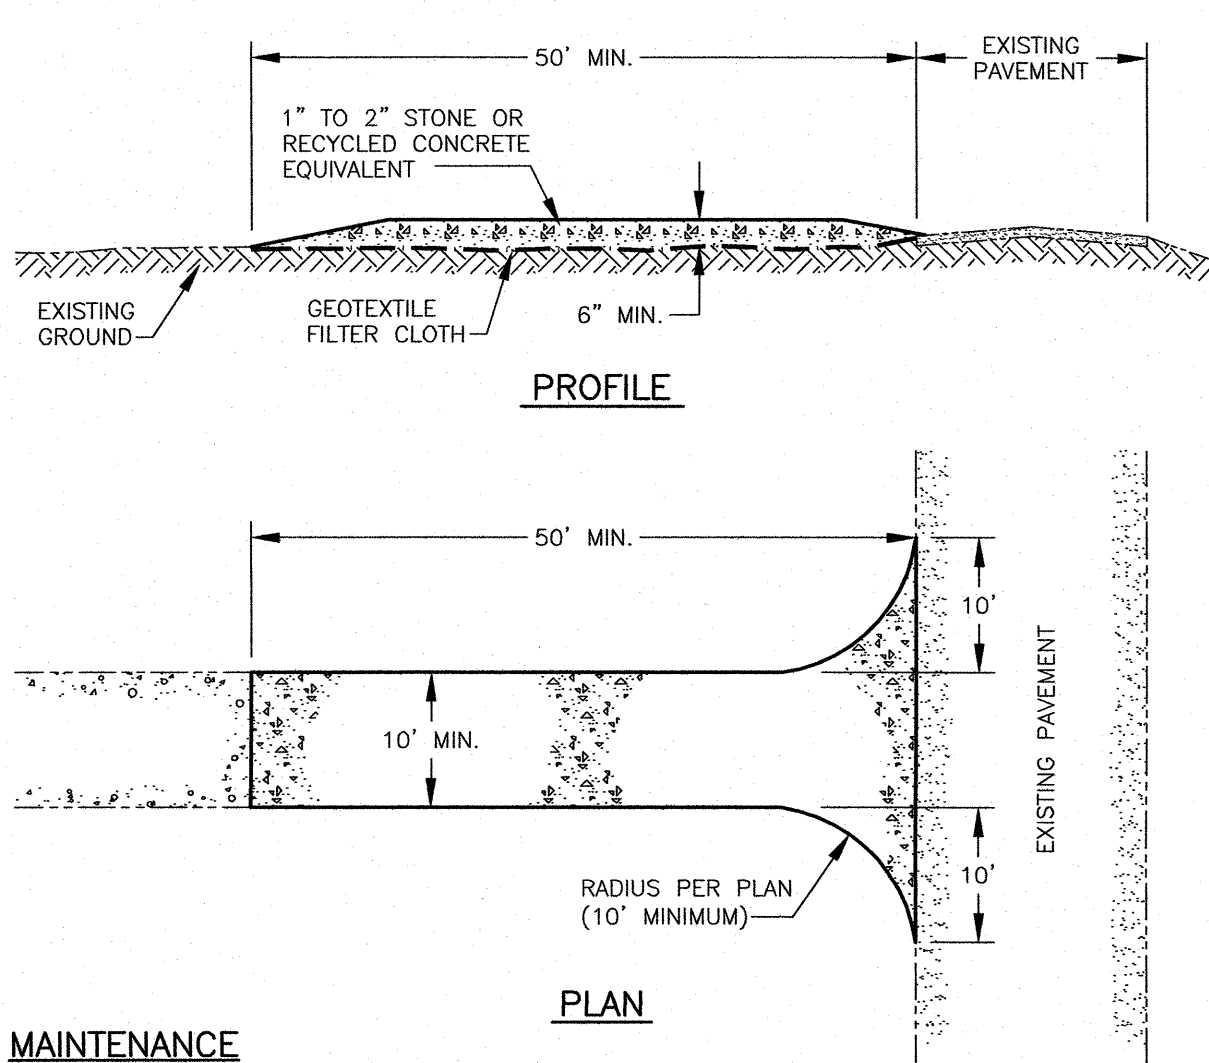


- MAINTENANCE
- MUD AND SOIL PARTICLES WILL EVENTUALLY CLOG THE VOIDS IN THE GRAVEL AND THE EFFECTIVENESS OF THE GRAVEL PAD WILL NOT BE SATISFACTORY. WHEN THIS OCCURS, THE PAD SHOULD BE TOP DRESSED WITH NEW STONE. COMPLETE REPLACEMENT OF THE PAD MAY BE NECESSARY WHEN THE PAD BECOMES COMPLETELY CLOGGED.
 - IF WASHING FACILITIES ARE USED, THE SEDIMENT TRAPS SHOULD BE CLEANED OUT AS OFTEN AS NECESSARY TO ASSURE THAT ADEQUATE TRAPPING EFFICIENCY AND STORAGE VOLUME IS AVAILABLE. VEGETATIVE FILTER STRIPS SHOULD BE MAINTAINED TO INSURE A VIGOROUS STAND OF VEGETATION AT ALL TIMES.

CONSTRUCTION SPECIFICATIONS

- STONE FOR A STABILIZED CONSTRUCTION ENTRANCE SHALL BE 1 TO 2 INCH STONE, RECLAIMED STONE, OR RECYCLED CONCRETE EQUIVALENT.
- THE LENGTH OF THE STABILIZED ENTRANCE SHALL NOT BE LESS THAN 50 FEET, EXCEPT FOR A SINGLE RESIDENTIAL LOT WHERE A 30 FOOT MINIMUM LENGTH WOULD APPLY.
- THE THICKNESS OF THE STONE FOR THE STABILIZED ENTRANCE SHALL NOT BE LESS THAN 6 INCHES
- THE WIDTH OF THE ENTRANCE SHALL NOT BE LESS THAN THE FULL WIDTH OF THE ENTRANCE WHERE INGRESS OR EGRESS OCCURS OR 10 FEET, WHICHEVER IS GREATER. GEOTEXTILE FILTER CLOTH SHALL BE PLACED OVER THE ENTIRE AREA PRIOR TO PLACING THE STONE. FILTER CLOTH IS NOT REQUIRED FOR A SINGLE FAMILY RESIDENCE LOT.
- ALL SURFACE WATER THAT IS FLOWING TO OR DIVERTED TOWARD THE CONSTRUCTION ENTRANCE SHALL BE PIPED BENEATH THE ENTRANCE. IF PIPING IS IMPRACTICAL, A BERM WITH 5:1 SLOPES THAT CAN BE CROSSED BY VEHICLES MAY BE SUBSTITUTED FOR THE PIPE.
- THE ENTRANCE SHALL BE MAINTAINED IN A CONDITION THAT WILL PREVENT TRACKING OR FLOWING OF SEDIMENT ONTO PUBLIC RIGHTS-OF-WAY. THIS MAY REQUIRE PERIODIC TOP DRESSING WITH ADDITIONAL STONE AS CONDITIONS DEMAND AND REPAIR AND/OR CLEANOUT OF ANY MEASURES USED TO TRAP SEDIMENT. ALL SEDIMENT SPILLED, WASHED, OR TRACKED ONTO PUBLIC RIGHT-OF-WAY MUST BE REMOVED PROMPTLY.
- WHEELS SHALL BE CLEANED TO REMOVE MUD PRIOR TO ENTRANCE ONTO PUBLIC RIGHT-OF-WAY, WHEN WASHING IS REQUIRED, IT SHALL BE DONE ON AN AREA STABILIZED WITH STONE WHICH DRAINS INTO AN APPROVED SEDIMENT TRAPPING DEVICE.


B STABILIZED CONSTRUCTION ENTRANCE NTS

C4 SUBSTITUTE FODS IF DESIRED

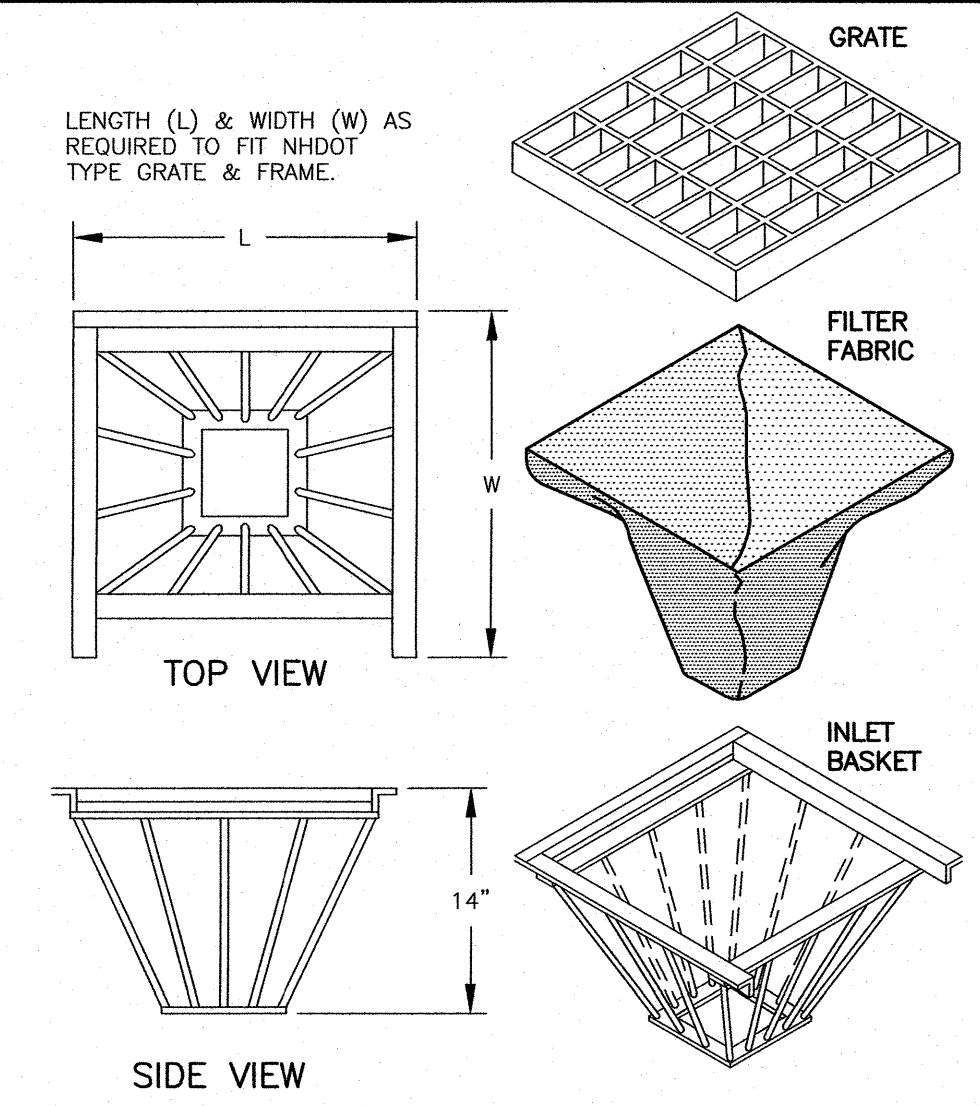

- INLET BASKETS SHALL BE INSTALLED IMMEDIATELY AFTER CATCH BASIN CONSTRUCTION IS COMPLETE AND SHALL REMAIN IN PLACE AND BE MAINTAINED UNTIL PAVEMENT BINDER COURSE IS COMPLETE.
- FILTER FABRIC SHALL BE PUSHED DOWN AND FORMED TO THE SHAPE OF THE BASKET. THE SHEET OF FABRIC SHALL BE LARGE ENOUGH TO BE SUPPORTED BY THE BASKET FRAME WHEN HOLDING SEDIMENT AND, SHALL EXTEND AT LEAST 6\"/>
- THE FILTER FABRIC SHALL BE A GEOTEXTILE FABRIC: POLYESTER, POLYPROPYLENE, STABILIZED NYLON, POLYETHYLENE, OR POLYVINYLIDENE CHLORIDE MEETING THE FOLLOWING SPECIFICATIONS:
 - RAB STRENGTH: 45 LB. MIN. IN ANY PRINCIPAL DIRECTION (ASTM D1682)
 - MULLEN BURST STRENGTH: MIN. 60 psi (ASTM D774)
- THE FABRIC SHALL HAVE AN OPENING NO GREATER THAN A NUMBER 20 U.S. STANDARD SIEVE AND A MINIMUM PERMEABILITY OF 120 gpm/s.f. (MULTIPLY THE PERMITTIVITY IN SEC.-1 FROM ASTM 54491-85 CONSTANT HEAD TEST USING THE CONVERSION FACTOR OF 74.)
- THE INLET BASKET SHALL BE INSPECTED WITHIN 24 HOURS AFTER EACH RAINFALL OR DAILY DURING EXTENDED PERIODS OF PRECIPITATION. REPAIRS SHALL BE MADE IMMEDIATELY, AS NECESSARY, TO PREVENT PARTICLES FROM REACHING THE DRAINAGE SYSTEM AND/OR CAUSING SURFACE FLOODING.
- SEDIMENT DEPOSITS SHALL BE REMOVED AFTER EACH STORM EVENT, OR MORE OFTEN IF THE FABRIC BECOMES CLOGGED.

C CATCH BASIN INLET BASKET NTS

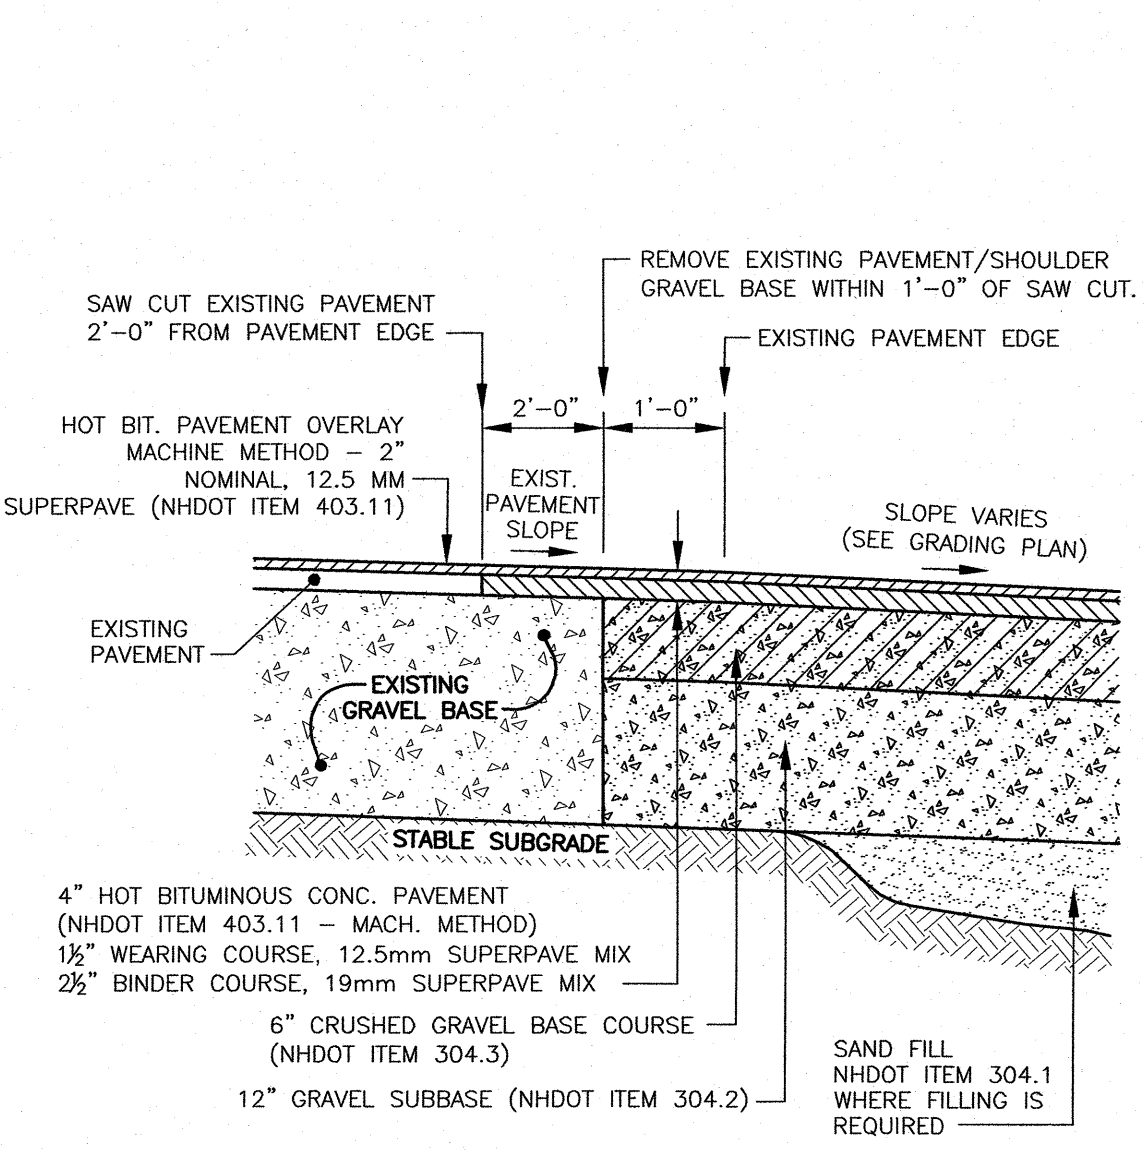

D FULL DEPTH PAVEMENT SECTION AND PAVEMENT JOINT DETAIL NTS

C2

AMBIT ENGINEERING, INC.
Civil Engineers & Land Surveyors
200 Griffin Road - Unit 3
Portsmouth, N.H. 03801-7114
Tel (603) 430-9282
Fax (603) 436-2315


- NOTES:
- UNDERGROUND UTILITY LOCATIONS ARE BASED UPON BEST AVAILABLE EVIDENCE AND ARE NOT FIELD VERIFIED. LOCATING AND PROTECTING ANY ABOVEGROUND OR UNDERGROUND UTILITIES IS THE SOLE RESPONSIBILITY OF THE CONTRACTOR AND/OR THE OWNER. UTILITY CONFLICTS SHOULD BE REPORTED AT ONCE TO THE DESIGN ENGINEER.
 - THE CONTRACTOR SHALL NOTIFY DIG SAFE AT 1-888-DIG-SAFE (1-888-344-7233) AT LEAST 72 HOURS PRIOR TO COMMENCING ANY EXCAVATION ON PUBLIC OR PRIVATE PROPERTY.
 - CONTRACTOR SHALL INSTALL AND MAINTAIN EROSION CONTROL MEASURES IN ACCORDANCE WITH THE "NEW HAMPSHIRE STORMWATER MANUAL, VOLUME 3, EROSION AND SEDIMENT CONTROLS DURING CONSTRUCTION. (NHDES DECEMBER 2008).

SITE DEVELOPMENT

41 SALEM STREET

PORTSMOUTH, N.H.


NO.	DESCRIPTION	DATE
0	ISSUED FOR COMMENT	3/18/20
REVISIONS		

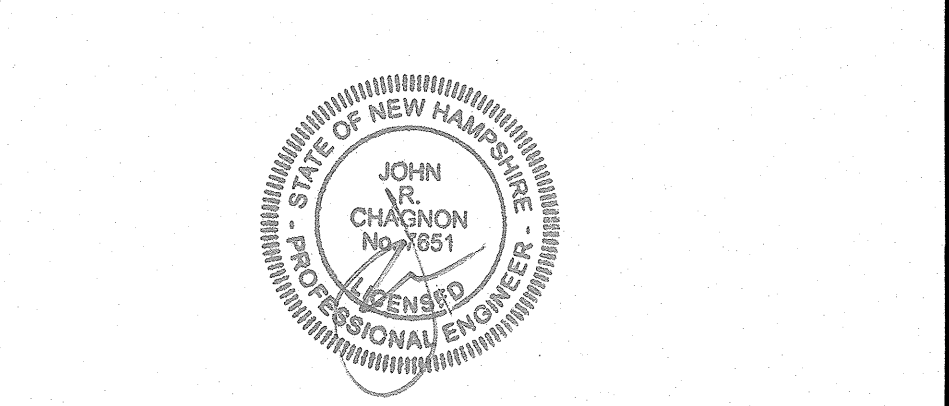

AS NOTED MARCH 2020



EROSION CONTROL NOTES & DETAILS

D1




NOTES:


- 1) UNDERGROUND UTILITY LOCATIONS ARE BASED UPON BEST AVAILABLE EVIDENCE AND ARE NOT FIELD VERIFIED. LOCATING AND PROTECTING ANY ABOVEGROUND OR UNDERGROUND UTILITIES IS THE SOLE RESPONSIBILITY OF THE CONTRACTOR AND/OR THE OWNER. UTILITY CONFLICTS SHOULD BE REPORTED AT ONCE TO THE DESIGN ENGINEER.
- 2) THE CONTRACTOR SHALL NOTIFY DIG SAFE AT 1-888-DIG-SAFE (1-888-344-7233) AT LEAST 72 HOURS PRIOR TO COMMENCING ANY EXCAVATION ON PUBLIC OR PRIVATE PROPERTY.
- 3) CONTRACTOR SHALL INSTALL AND MAINTAIN EROSION CONTROL MEASURES IN ACCORDANCE WITH THE "NEW HAMPSHIRE STORMWATER MANUAL, VOLUME 3, EROSION AND SEDIMENT CONTROLS DURING CONSTRUCTION. (NHDES DECEMBER 2008).

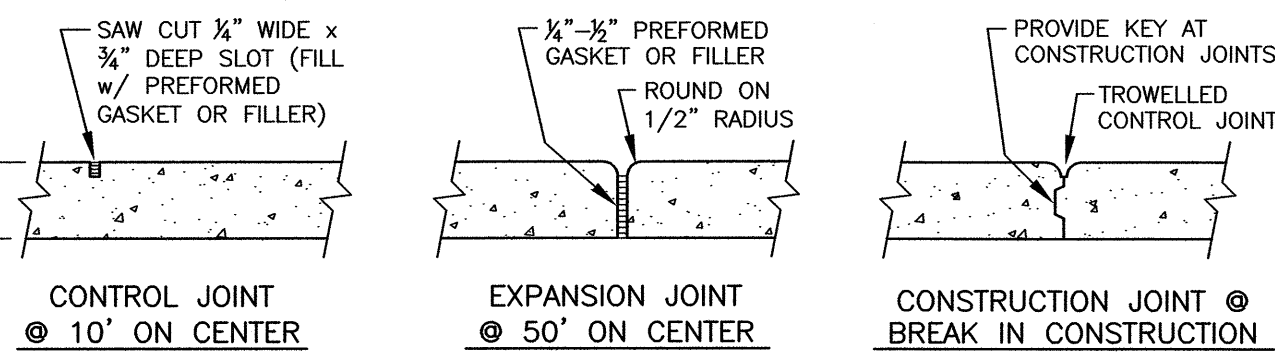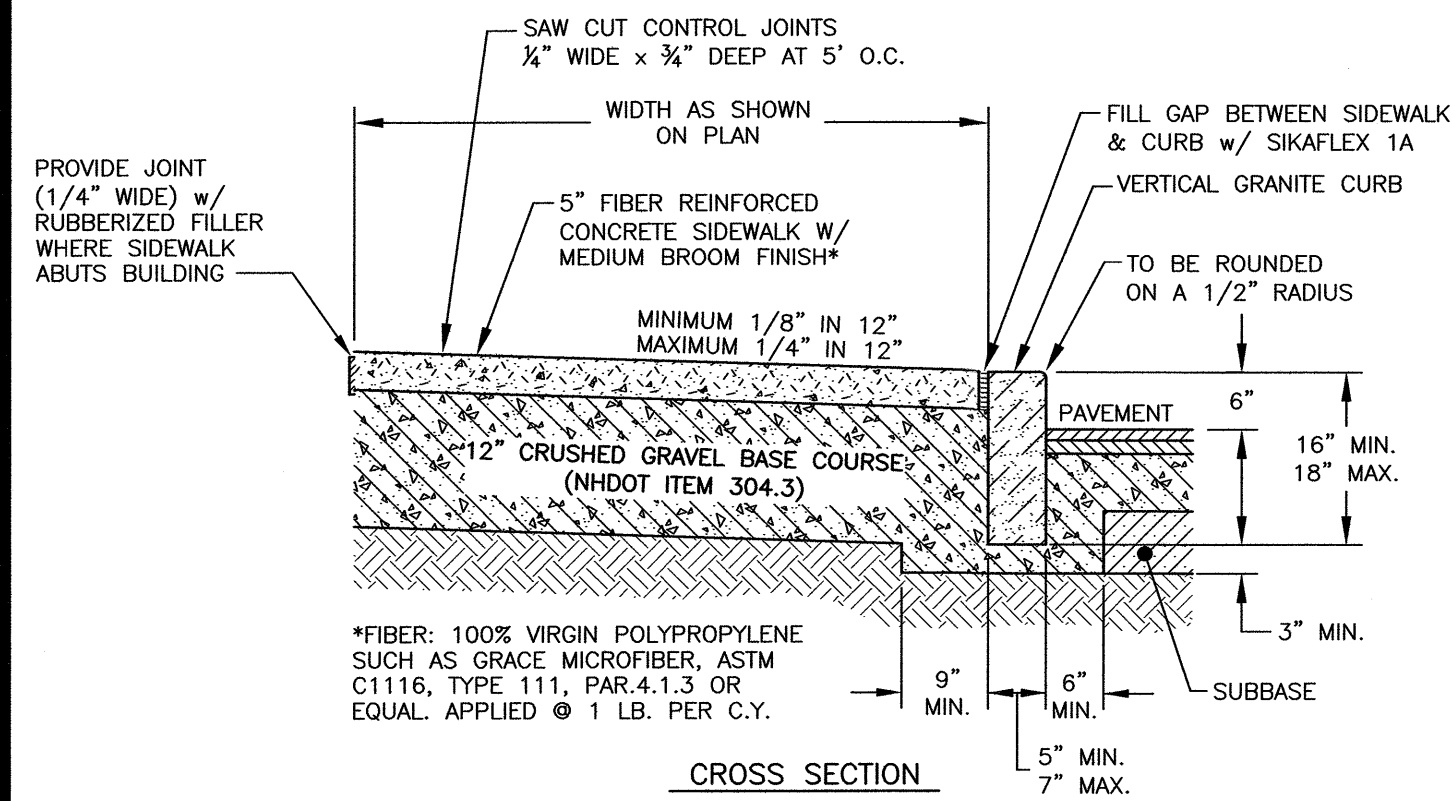

E PORTLAND CEMENT CONCRETE SIDEWALK (WITH VERTICAL GRANITE CURB) NTS

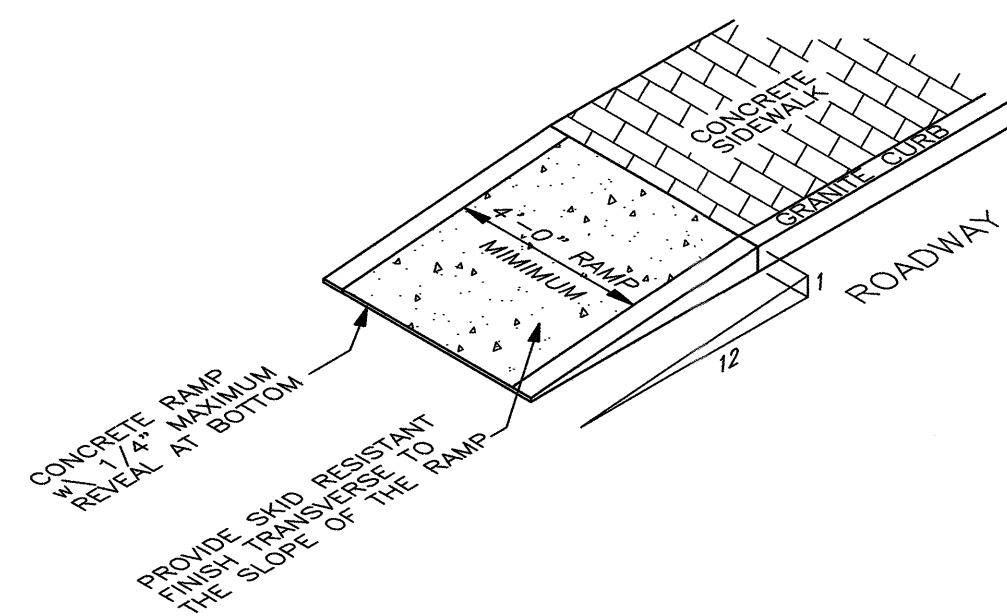


F SIDEWALK TIP DOWN NTS

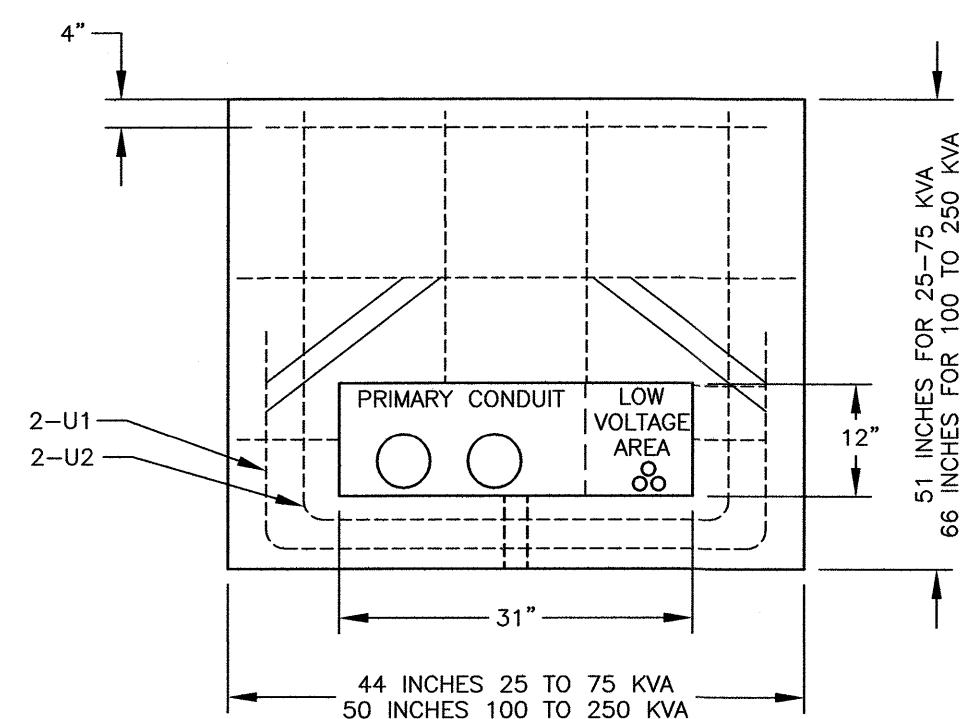


- NOTES:**
1. SEE SHEET "REQUIREMENTS FOR PAD MOUNTED TRANSFORMER SLAB DETAILS", EVERSOURCE SPECIFICATIONS.
 2. SEE DTR 56.223 FOR GROUNDING GRID.
 3. 1" PVC CONDUIT SLEEVE FOR GROUND GRID LEADS.
 4. ALL REBAR TO BE #6.
 5. CONDUITS CUT 4" ABOVE SLAB BASE.

G TRANSFORMER FOUNDATION SINGLE PHASE NTS


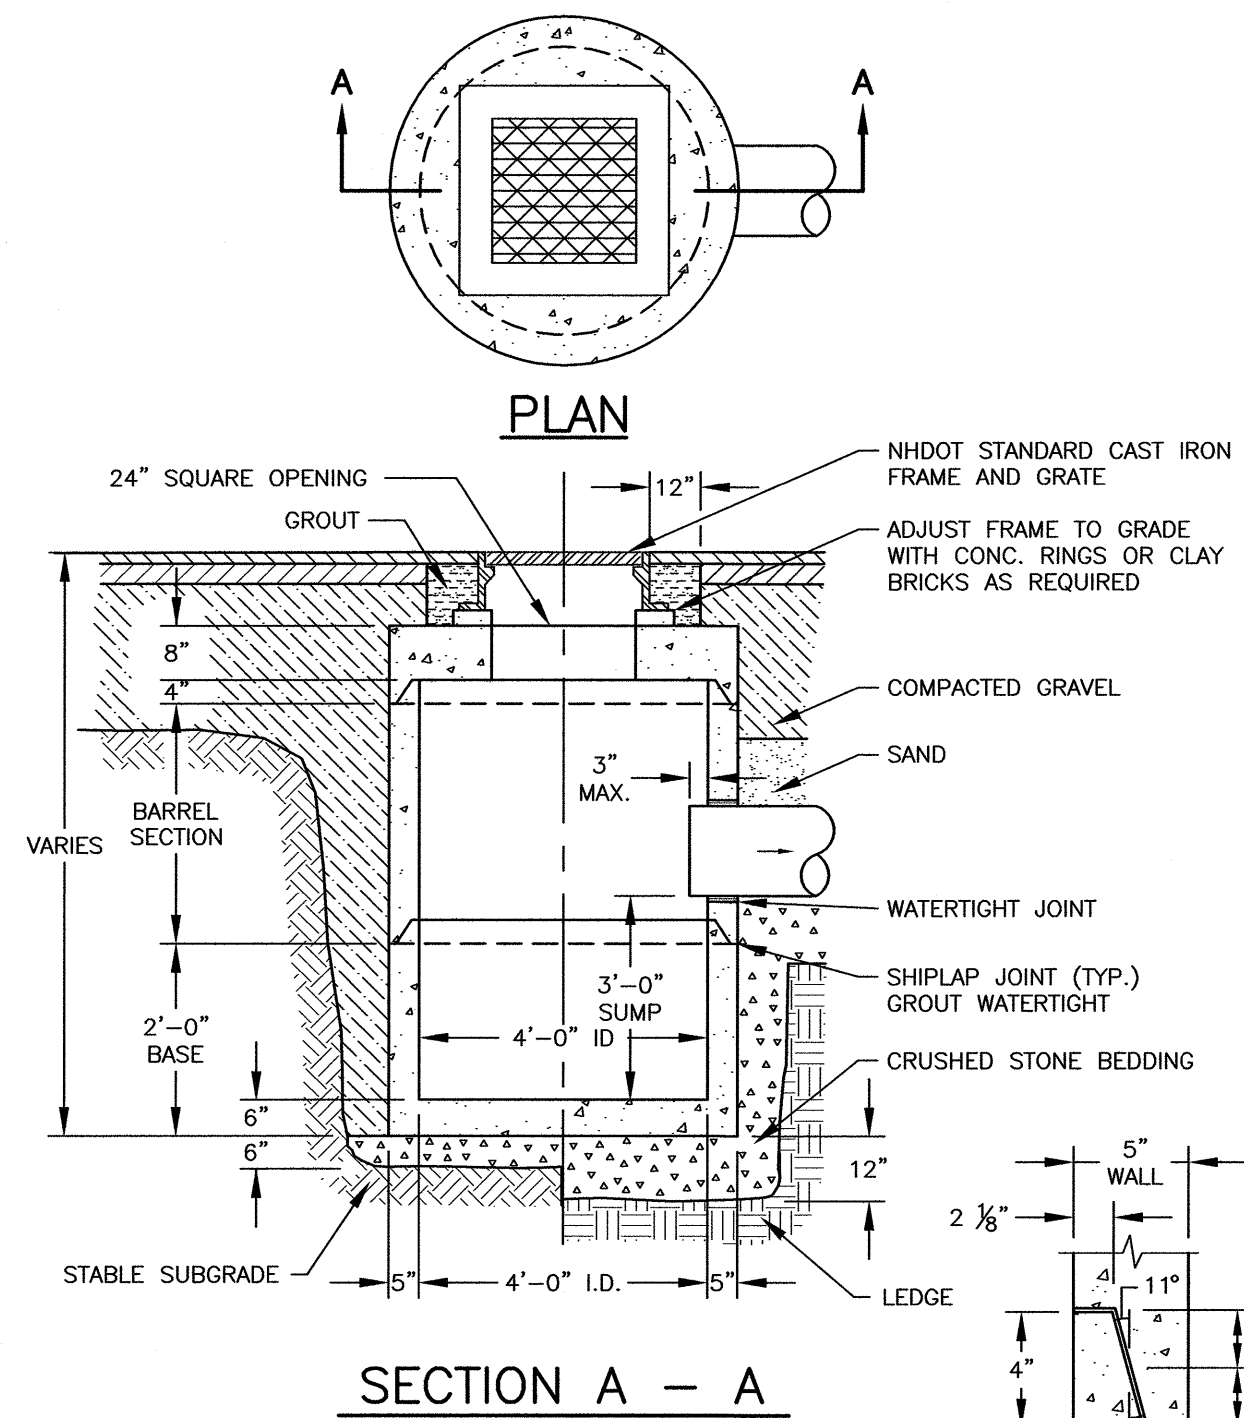


- NOTES:**
1. CONCRETE SHALL BE 4,000 P.S.I. AFTER 28 DAYS.
 2. CIRCUMFERENTIAL REINFORCEMENT SHALL BE 0.12 SQ. IN. PER LINEAR FT. IN ALL SECTIONS & SHALL BE PLACED IN THE CENTER THIRD OF WALL.
 3. THE TONGUE OR THE GROOVE OF THE JOINT SHALL CONTAIN ONE LINE OF CIRCUMFERENTIAL REINFORCEMENT EQUAL TO 0.12 SQ. IN. PER LINEAR FT.
 4. EACH CASTING TO HAVE LIFTING HOLES CAST IN.

H CATCH BASIN NTS

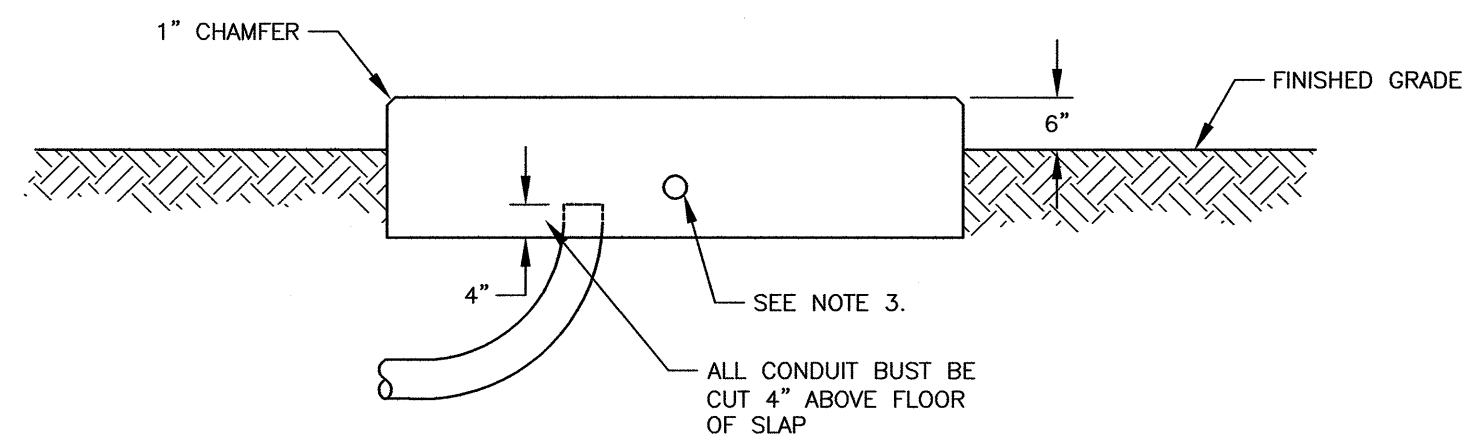


I TYPICAL PIPE TRENCH NTS

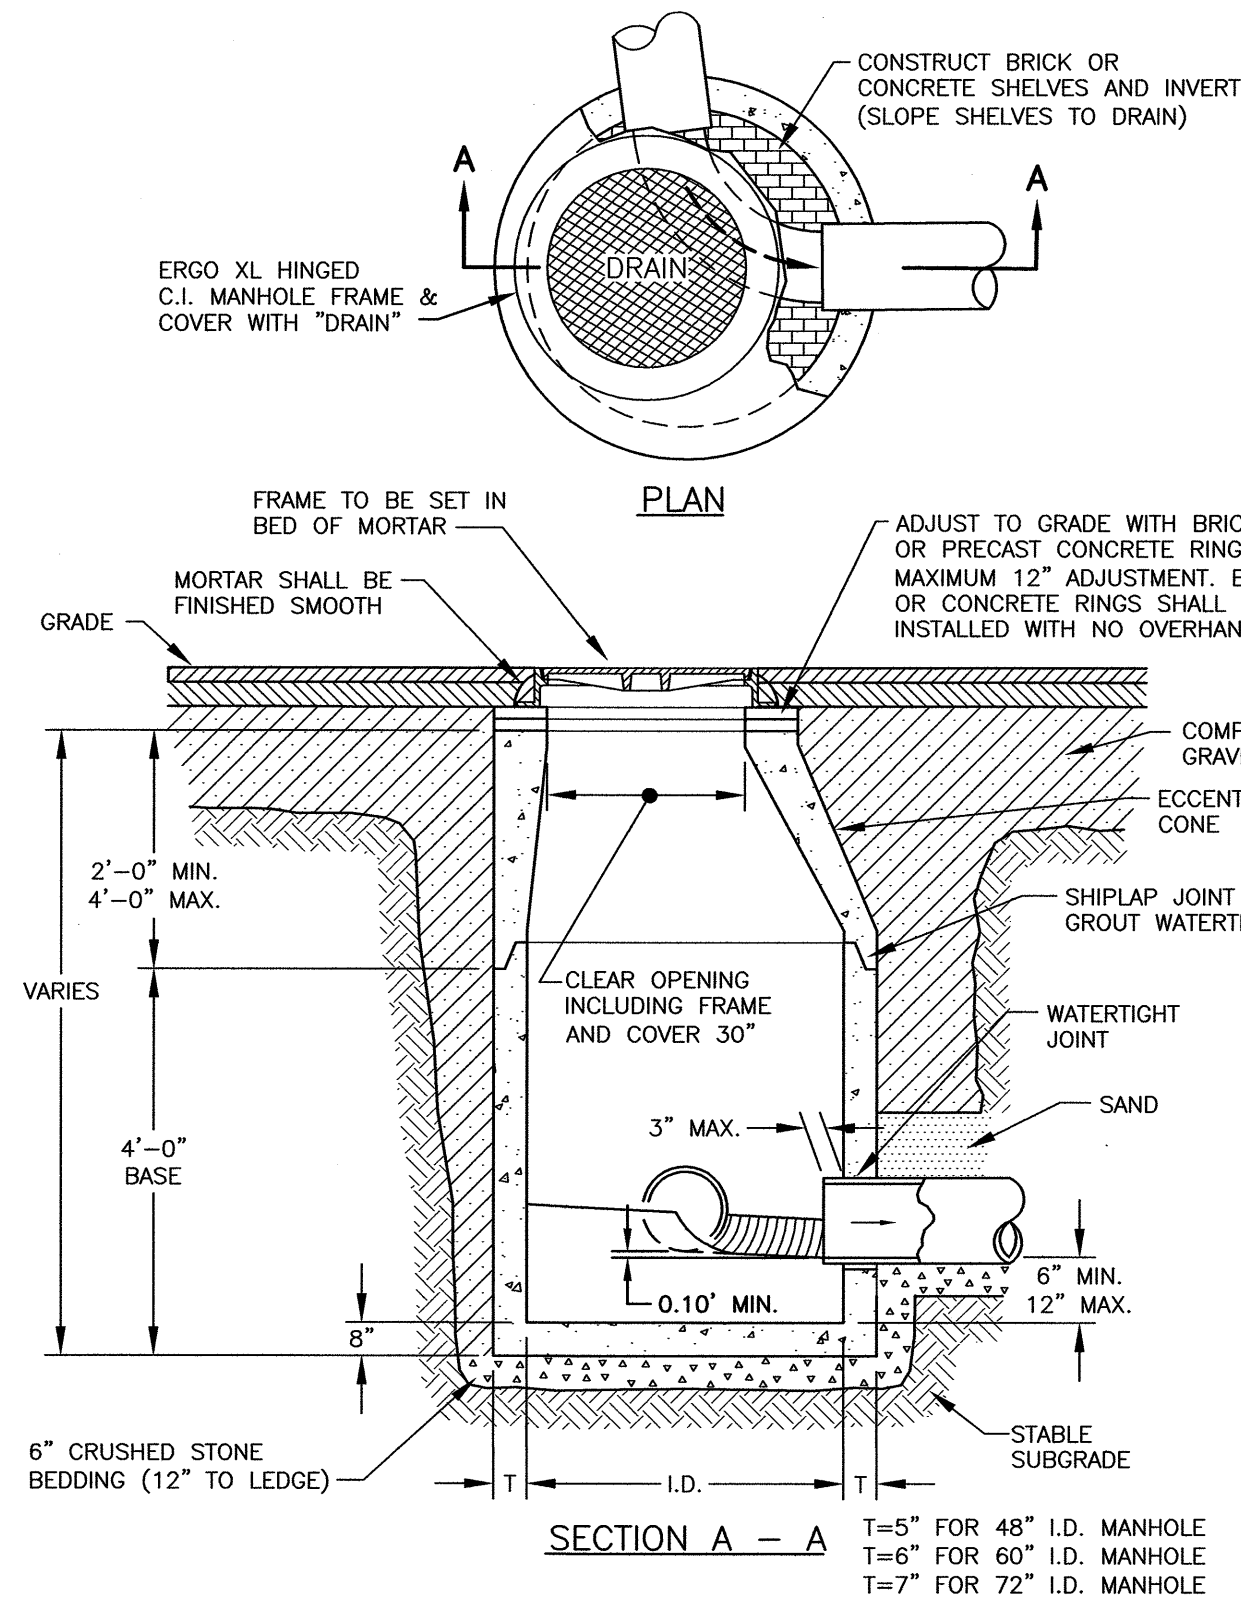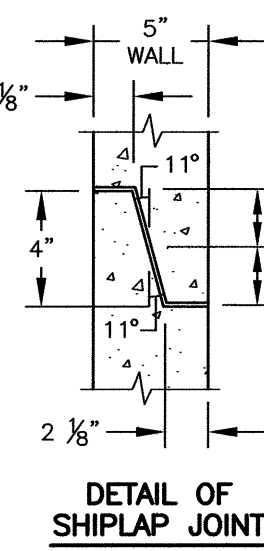

J DRAIN MANHOLE DETAIL NTS


SITE DEVELOPMENT
41 SALEM STREET
PORTSMOUTH, N.H.

NO.	DESCRIPTION	DATE
1	DETAIL I, H & J	4/29/20
0	ISSUED FOR COMMENT	3/18/20
REVISIONS		

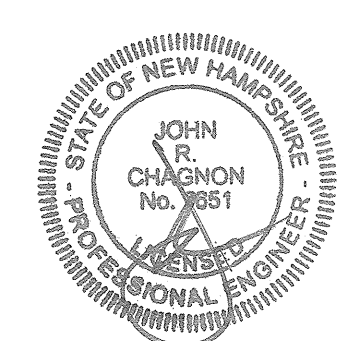

AS NOTED MARCH 2020

DETAILS **D2**



AMBIT ENGINEERING, INC.
Civil Engineers & Land Surveyors
200 Griffin Road - Unit 3
Portsmouth, N.H. 03801-7114
Tel (603) 430-9282
Fax (603) 436-2315

HORIZONTAL ANCHOR DIMENSIONS FOR PIPE INSTALLATION IN ROCK
UP TO 150 P.S.I. WORKING PRESSURE

PIPE SIZE	90° BEND		45° BEND		22 1/2° BEND		11 1/4° BEND	
	H	L	H	L	H	L	H	L
4"	0'-9"	1'-0"	1'-0"	0'-9"	1'-0"	0'-9"	1'-0"	0'-9"
6"	0'-9"	1'-0"	1'-0"	0'-9"	1'-0"	0'-9"	1'-0"	0'-9"
8"	1'-2"	1'-2"	1'-2"	1'-0"	1'-0"	0'-9"	1'-0"	0'-9"
10"	1'-4"	1'-4"	1'-4"	1'-0"	1'-0"	0'-9"	1'-0"	0'-9"
12"	1'-8"	1'-8"	1'-8"	1'-3"	1'-3"	1'-0"	0'-9"	1'-0"


* - FOR 3" AND SMALLER PIPES

HORIZONTAL ANCHOR DIMENSIONS FOR AVERAGE SOIL CONDITIONS
UP TO 150 P.S.I. WORKING PRESSURE

PIPE SIZE	TEE OR TAP SLEEVE		90° BEND		45° BEND		22 1/2° BEND		11 1/4° BEND	
	H	L	H	L	H	L	H	L	H	L
4"	1'-0"	2'-0"	1'-0"	2'-0"	1'-4"	0'-9"	1'-0"	0'-6"	1'-0"	0'-6"
6"	1'-0"	2'-0"	1'-0"	2'-0"	1'-4"	0'-9"	1'-0"	0'-6"	1'-0"	0'-6"
8"	1'-4"	2'-8"	1'-4"	2'-8"	1'-6"	1'-0"	1'-0"	0'-9"	1'-0"	0'-9"
10"	1'-8"	3'-4"	1'-8"	3'-4"	1'-8"	2'-0"	1'-3"	1'-3"	1'-0"	1'-0"
12"	2'-0"	4'-0"	2'-0"	4'-0"	2'-2"	1'-6"	1'-6"	1'-3"	1'-3"	1'-3"






* - FOR 3" AND SMALLER PIPES

NOTES:
1) TABLES ARE BASED ON AN ALLOWABLE SOIL PRESSURE OF 3000 P.S.F. ON UNDISTURBED EARTH BEHIND THE ANCHOR BLOCK. WHERE SOIL HAS BEEN DISTURBED BY ADJACENT EXCAVATIONS OR WHERE SOIL CANNOT WITHSTAND SUCH A PRESSURE, THE TABLE DOES NOT APPLY.
2) WHERE ENTIRE DEPTH OF PIPE IS BELOW THE TOP SURFACE OF SOUND ROCK, USE "HORIZONTAL ANCHOR DIMENSIONS FOR PIPE INSTALLATION IN ROCK" TABLE.

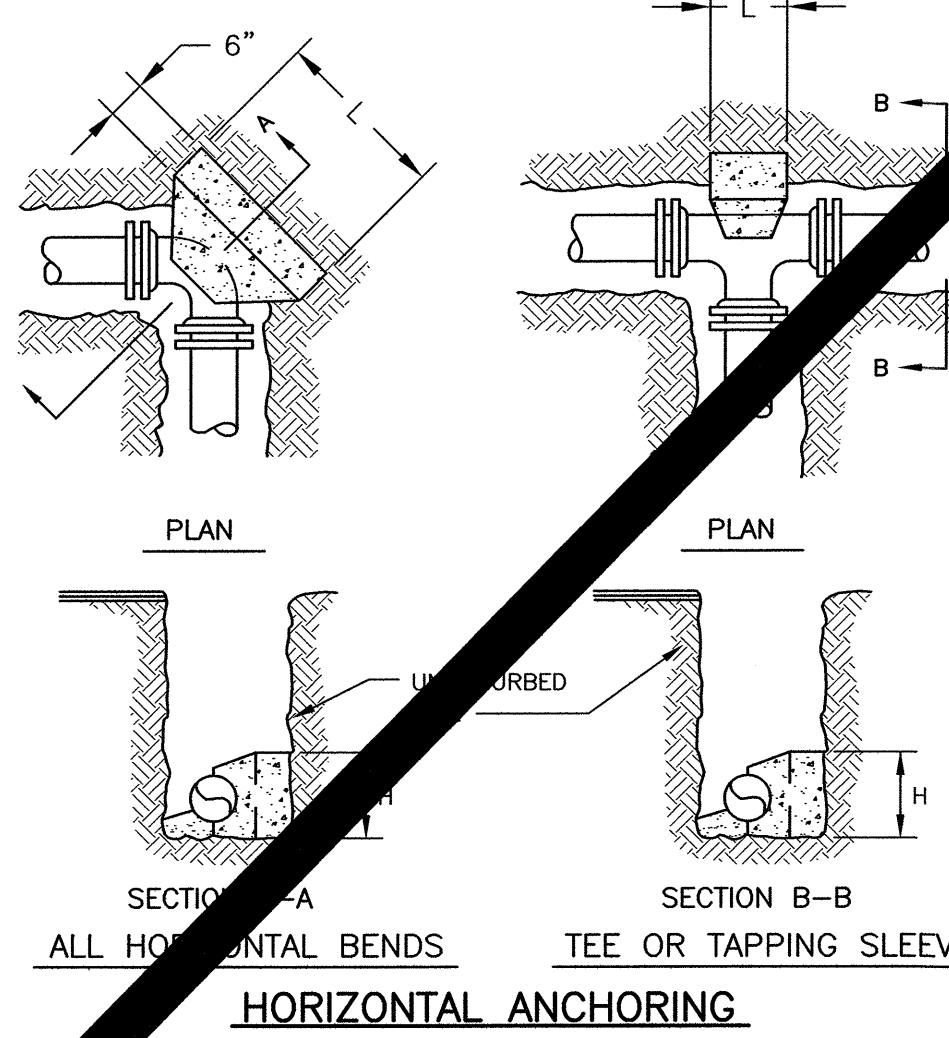

VERTICAL ANCHOR DIMENSIONS
UP TO 150 P.S.I. WORKING PRESSURE


PIPE SIZE	45° BEND			22 1/2° BEND			11 1/4° BEND		
	DIMENSION	ROD DIA.	CONCRETE	DIMENSION	ROD DIA.	CONCRETE	DIMENSION	ROD DIA.	CONCRETE
4"	3'-0"	3/4"	2'-0"	2'-6"	3/4"	2'-0"	2'-0"	3/4"	2'-0"
6"	3'-0"	3/4"	2'-0"	2'-6"	3/4"	2'-0"	2'-0"	3/4"	2'-0"
8"	3'-6"	3/4"	2'-6"	3'-0"	3/4"	2'-6"	2'-6"	3/4"	2'-6"
10"	4'-3"	3/4"	3'-0"	3'-6"	3/4"	3'-0"	3'-0"	3/4"	3'-0"
12"	4'-9"	3/4"	3'-3"	4'-0"	3/4"	3'-9"	3'-9"	3/4"	3'-9"

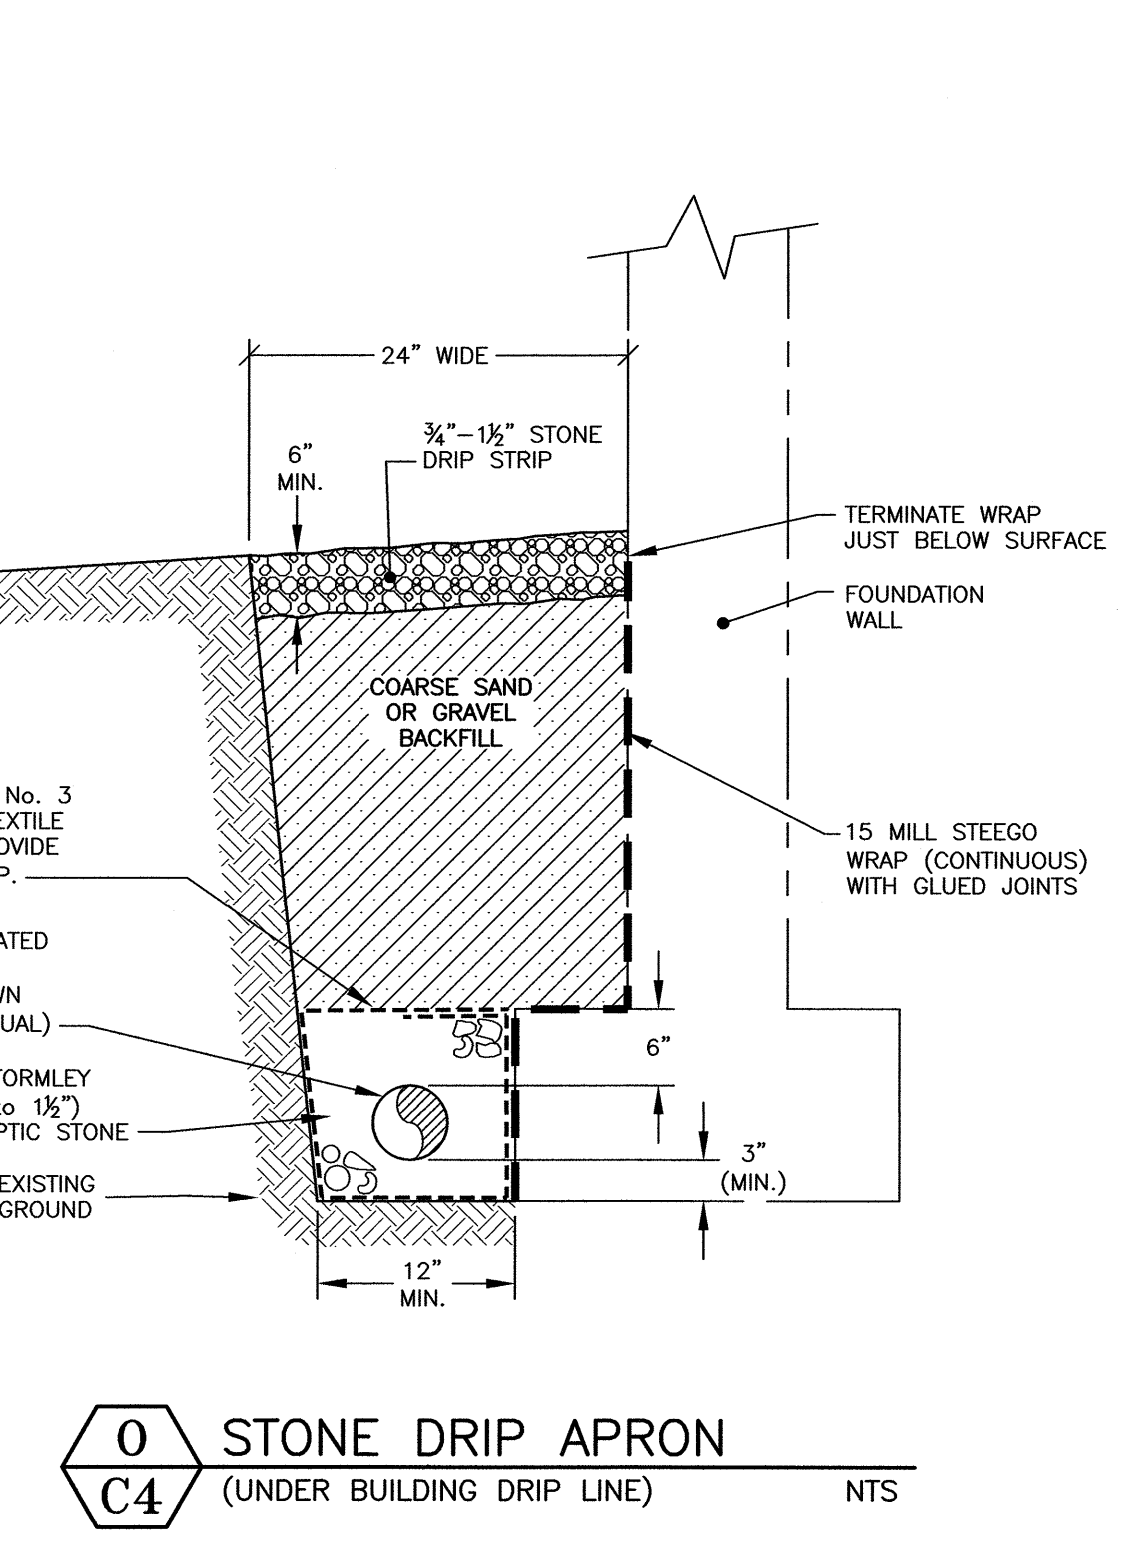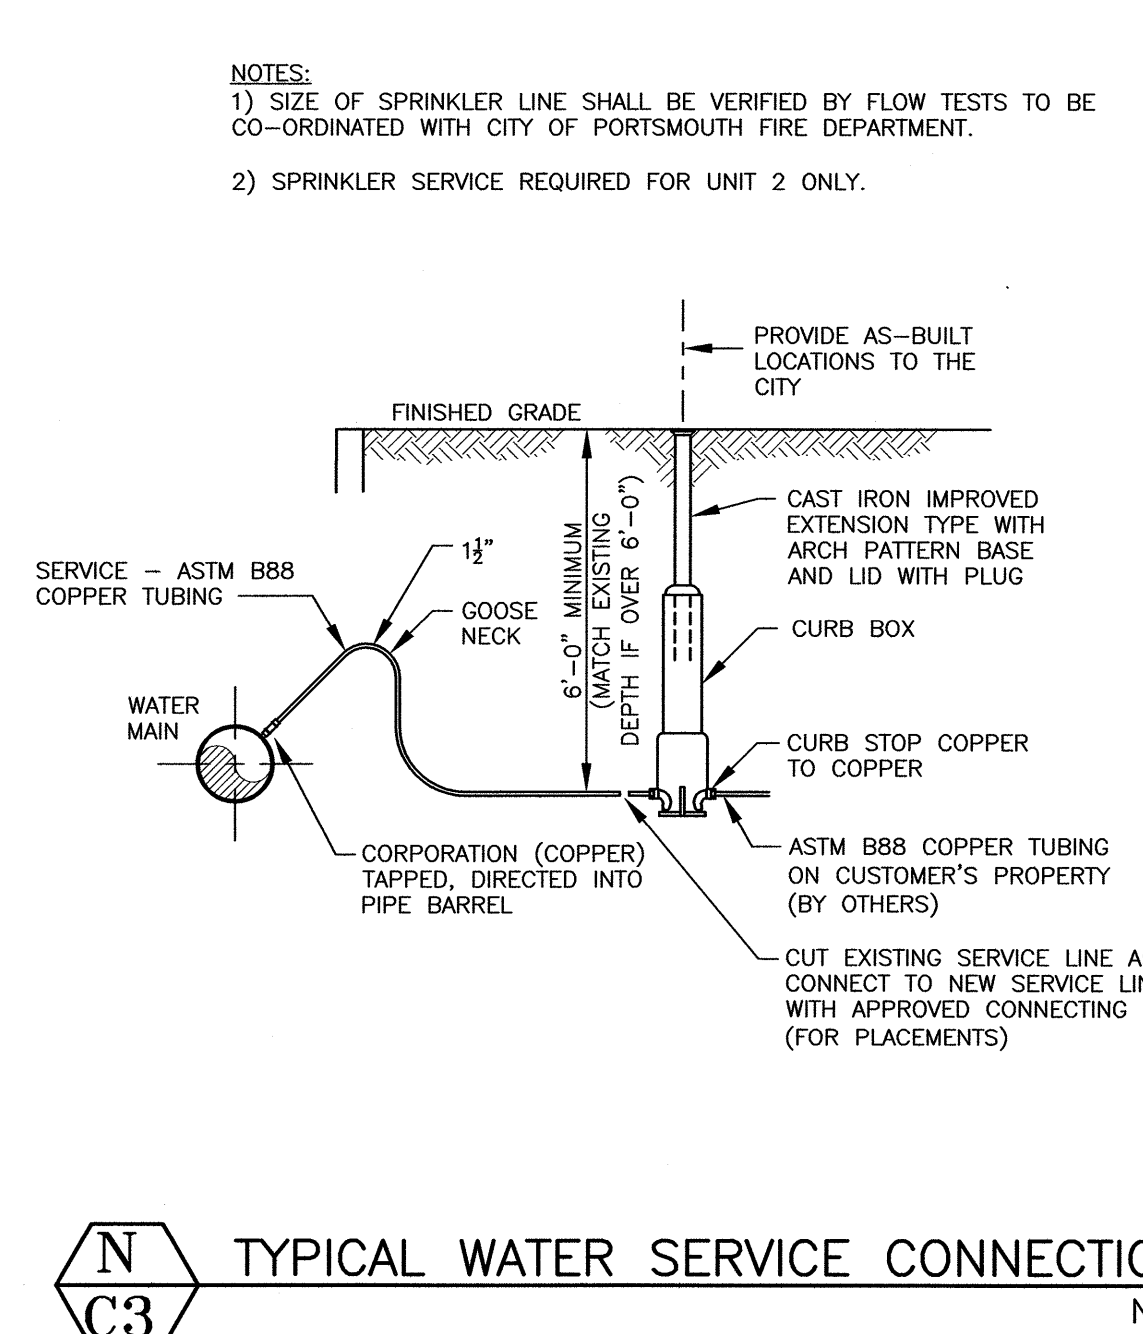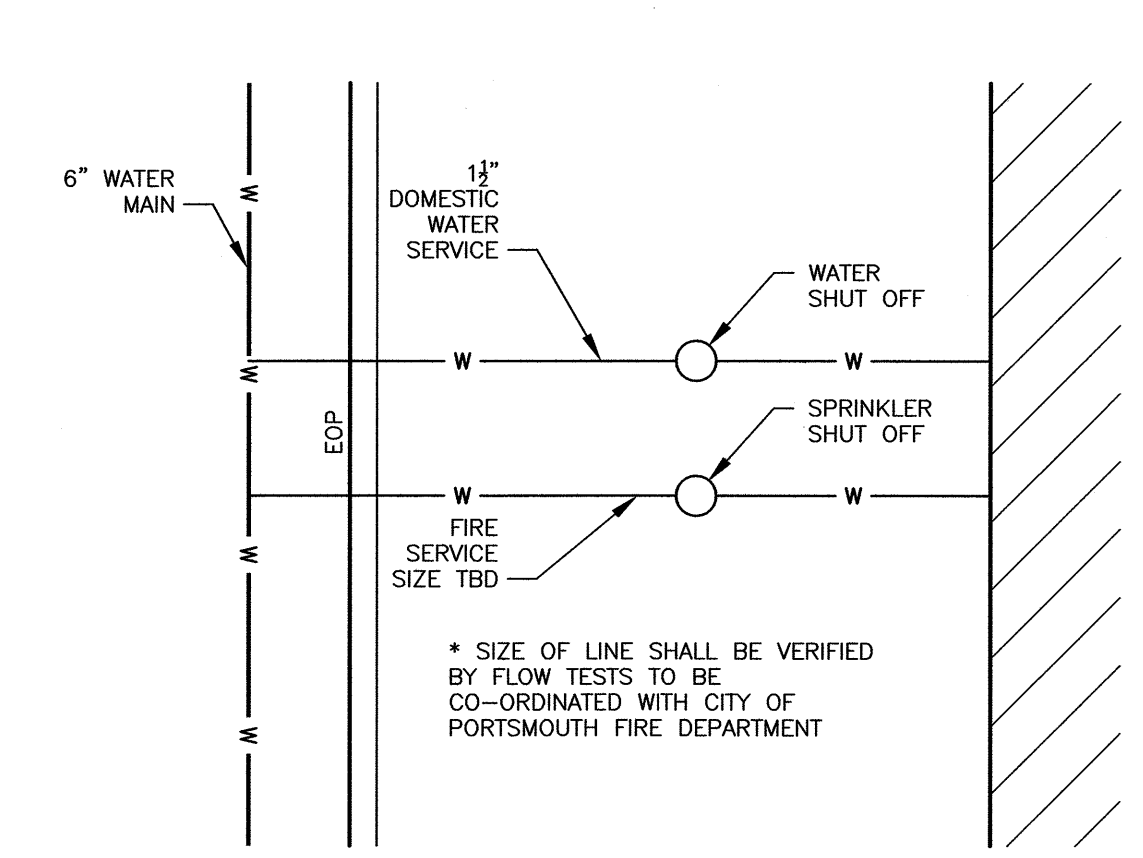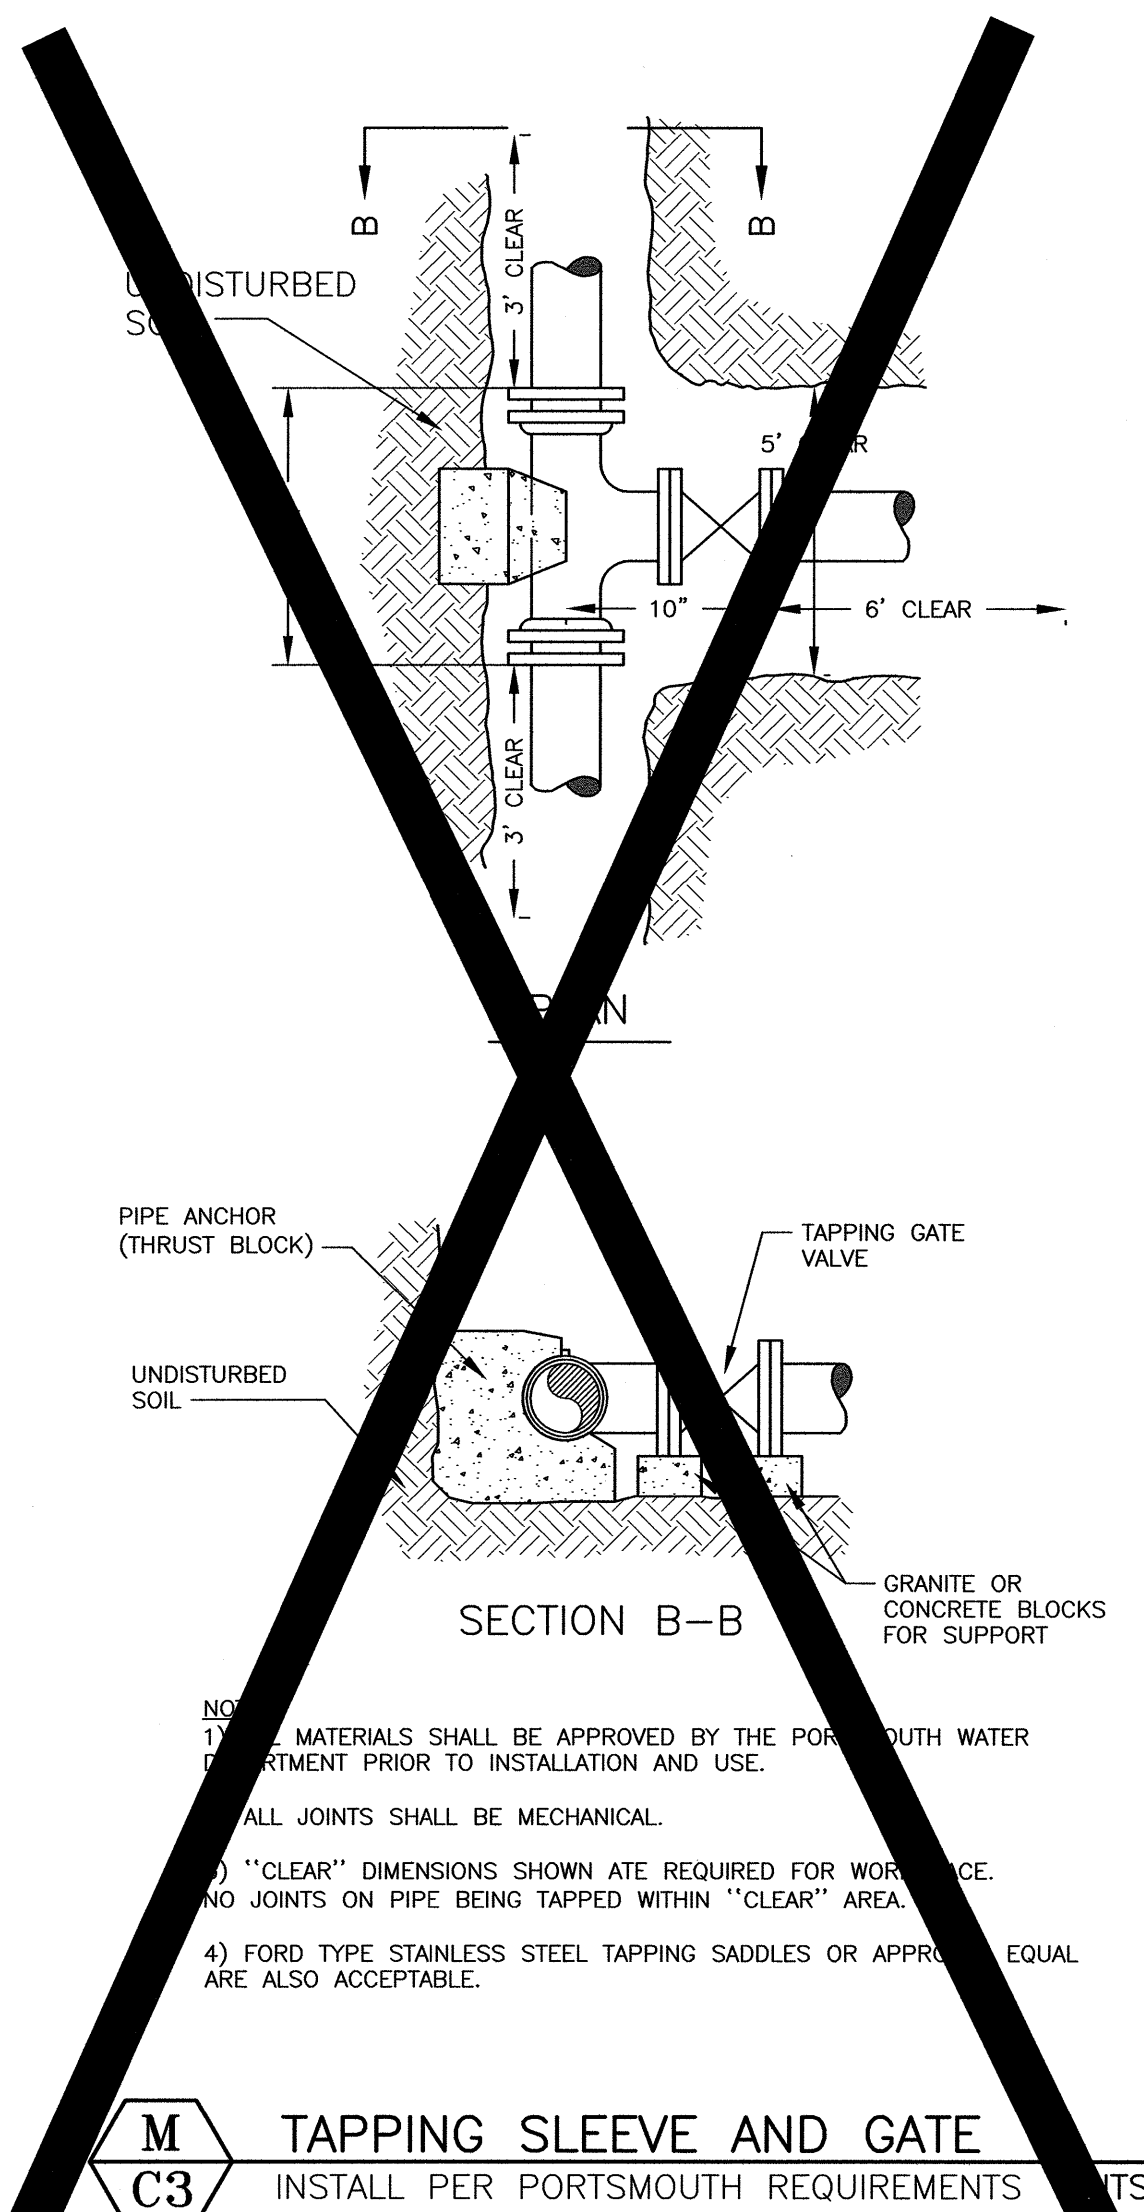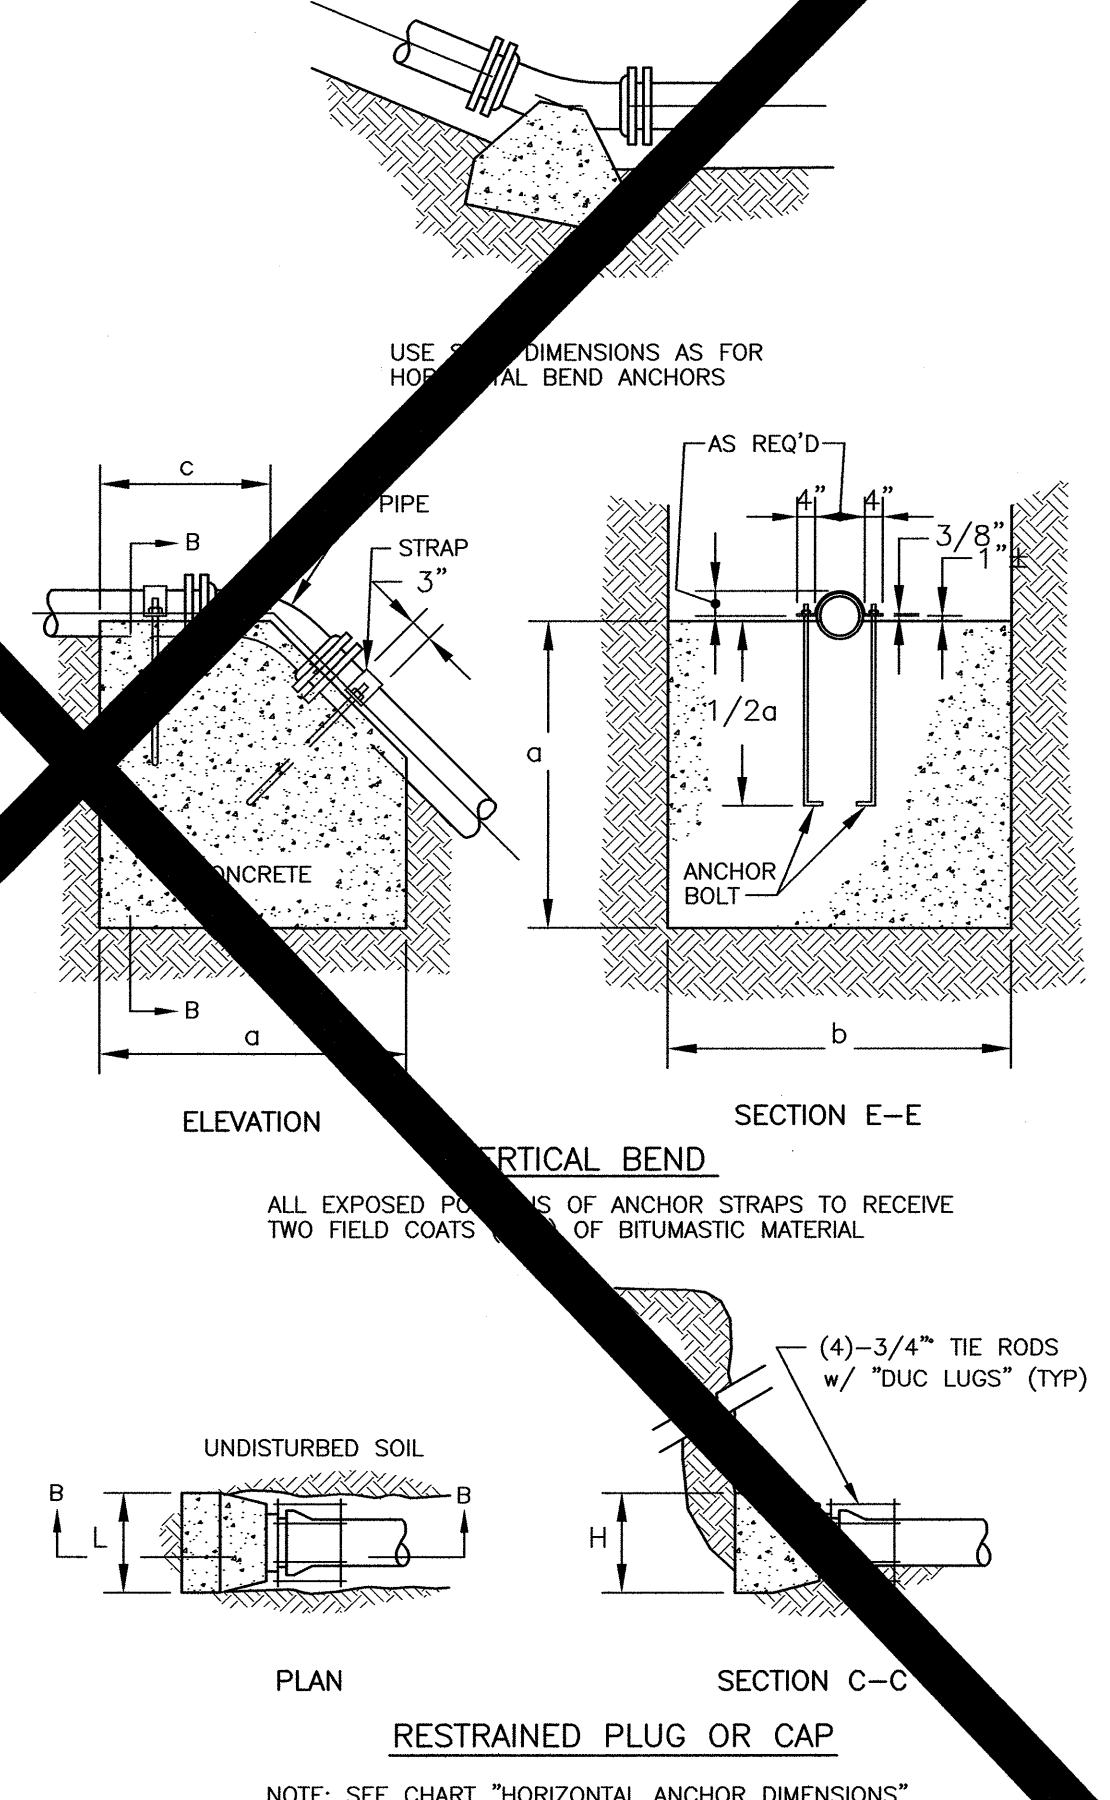

NOTES:
1) UNDERGROUND UTILITY LOCATIONS ARE BASED UPON BEST AVAILABLE EVIDENCE AND ARE NOT FIELD VERIFIED. LOCATING AND PROTECTING ANY ABOVEGROUND OR UNDERGROUND UTILITIES IS THE SOLE RESPONSIBILITY OF THE CONTRACTOR AND/OR THE OWNER. UTILITY CONFLICTS SHOULD BE REPORTED AT ONCE TO THE DESIGN ENGINEER.
2) THE CONTRACTOR SHALL NOTIFY DIG SAFE AT 1-888-DIG-SAFE (1-888-344-7233) AT LEAST 72 HOURS PRIOR TO COMMENCING ANY EXCAVATION ON PUBLIC OR PRIVATE PROPERTY.
3) CONTRACTOR SHALL INSTALL AND MAINTAIN EROSION CONTROL MEASURES IN ACCORDANCE WITH THE "NEW HAMPSHIRE STORMWATER MANUAL, VOLUME 3, EROSION AND SEDIMENT CONTROLS DURING CONSTRUCTION. (NHDES DECEMBER 2008).
4) ALL WATER LINE INSTALLATION WORK SHALL BE TO CITY OF PORTSMOUTH WATER DEPARTMENT STANDARDS. DETAILS MAY OR MAY NOT BE UP-TO-DATE.

SITE DEVELOPMENT
41 SALEM STREET
PORTSMOUTH, N.H.

NO.	DESCRIPTION	DATE
1	DETAILS K & M	4/29/20
0	ISSUED FOR COMMENT	3/18/20

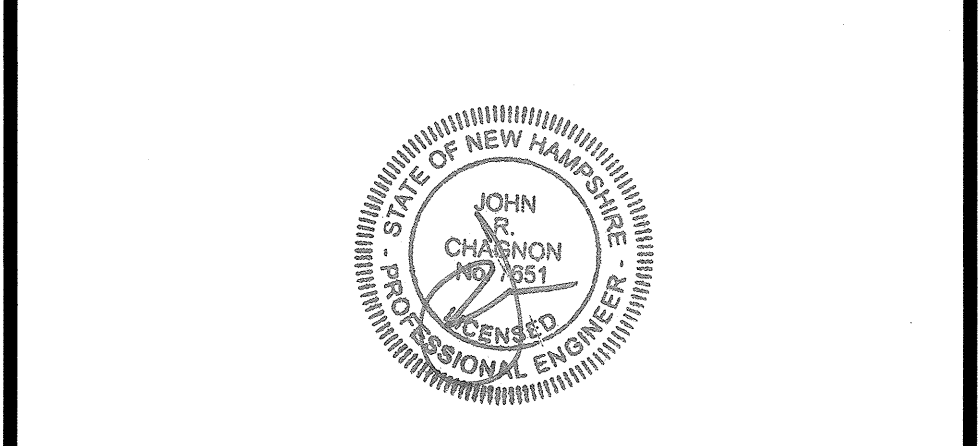

AS NOTED MARCH 2020

DETAILS **D3**



City of Portsmouth, New Hampshire

Site Plan Application Checklist

This site plan application checklist is a tool designed to assist the applicant in the planning process and for preparing the application for Planning Board review. A pre-application conference with a member of the planning department is strongly encouraged as additional project information may be required depending on the size and scope. The applicant is cautioned that this checklist is only a guide and is not intended to be a complete list of all site plan review requirements. Please refer to the Site Plan review regulations for full details.

Applicant Responsibilities (Section 2.5.2): Applicable fees are due upon application submittal along with required attachments. The application shall be complete as submitted and provide adequate information for evaluation of the proposed site development. Waiver requests must be submitted in writing with appropriate justification.

Name of Owner/Applicant: BONZA BUILDERS LLC. Date Submitted: 3-18-20

Phone Number: 603-770-5636 E-mail: _____

Site Address: 41 SALEM STREET Map: 144 Lot: 31

Zoning District: GENERAL RESIDENCE C Lot area: 10,903 sq. ft.

Application Requirements			
<input checked="" type="checkbox"/>	Required Items for Submittal	Item Location (e.g. Page or Plan Sheet/Note #)	Waiver Requested
<input checked="" type="checkbox"/>	Fully executed and signed Application form. (2.5.2.3)	ONLINE	N/A
<input checked="" type="checkbox"/>	All application documents, plans, supporting documentation and other materials provided in digital Portable Document Format (PDF). (2.5.2.8)	ONLINE	N/A

Site Plan Review Application Required Information			
<input checked="" type="checkbox"/>	Required Items for Submittal	Item Location (e.g. Page/line or Plan Sheet/Note #)	Waiver Requested
<input checked="" type="checkbox"/>	Statement that lists and describes "green" building components and systems. (2.5.3.1A)	SUBMITTED MATERIAL	
<input checked="" type="checkbox"/>	Gross floor area and dimensions of all buildings and statement of uses and floor area for each floor. (2.5.3.1B)	ARCHITECTURAL PLANS	N/A
<input checked="" type="checkbox"/>	Tax map and lot number, and current zoning of all parcels under Site Plan Review. (2.5.3.1C)	STANDARD BOUNDARY SURVEY	N/A
<input checked="" type="checkbox"/>	Owner's name, address, telephone number, and signature. Name, address, and telephone number of applicant if different from owner. (2.5.3.1D)	COVER SHEET	N/A

Site Plan Review Application Required Information			
<input checked="" type="checkbox"/>	Required Items for Submittal	Item Location (e.g. Page/line or Plan Sheet/Note #)	Waiver Requested
<input checked="" type="checkbox"/>	Names and addresses (including Tax Map and Lot number and zoning districts) of all direct abutting property owners (including properties located across abutting streets) and holders of existing conservation, preservation or agricultural preservation restrictions affecting the subject property. (2.5.3.1E)	COVER SHEET & STANDARD BOUNDARY SURVEY	N/A
<input checked="" type="checkbox"/>	Names, addresses and telephone numbers of all professionals involved in the site plan design. (2.5.3.1F)	COVER SHEET	N/A
<input checked="" type="checkbox"/>	List of reference plans. (2.5.3.1G)	STANDARD BOUNDARY SURVEY	N/A
<input checked="" type="checkbox"/>	List of names and contact information of all public or private utilities servicing the site. (2.5.3.1H)	COVER SHEET	N/A

Site Plan Specifications			
<input checked="" type="checkbox"/>	Required Items for Submittal	Item Location (e.g. Page/line or Plan Sheet/Note #)	Waiver Requested
<input checked="" type="checkbox"/>	Full size plans shall not be larger than 22 inches by 34 inches with match lines as required, unless approved by the Planning Director. Submittals shall be a minimum of 11 inches by 17 inches as specified by Planning Dept. staff. (2.5.4.1A)	Required on all plan sheets	N/A
<input checked="" type="checkbox"/>	Scale: Not less than 1 inch = 60 feet and a graphic bar scale shall be included on all plans. (2.5.4.1B)	Required on all plan sheets	N/A
<input checked="" type="checkbox"/>	GIS data should be referenced to the coordinate system New Hampshire State Plane, NAD83 (1996), with units in feet. (2.5.4.1C)	TO BE SUBMITTED	N/A
<input checked="" type="checkbox"/>	Plans shall be drawn to scale. (2.5.4.1D)	Required on all plan sheets	N/A
<input checked="" type="checkbox"/>	Plans shall be prepared and stamped by a NH licensed civil engineer. (2.5.4.1D)	YES	N/A
<input checked="" type="checkbox"/>	Wetlands shall be delineated by a NH certified wetlands scientist and so stamped. (2.5.4.1E)	N/A	N/A
<input checked="" type="checkbox"/>	Title (name of development project), north point, scale, legend. (2.5.4.2A)	COVER SHEET	N/A
<input checked="" type="checkbox"/>	Date plans first submitted, date and explanation of revisions. (2.5.4.2B)	YES	N/A
<input checked="" type="checkbox"/>	Individual plan sheet title that clearly describes the information that is displayed. (2.5.4.2C)	Required on all plan sheets	N/A
<input checked="" type="checkbox"/>	Source and date of data displayed on the plan. (2.5.4.2D)	STANDARD BOUNDARY SURVEY & EXISTING CONDITIONS PLAN	N/A

Site Plan Specifications

<input checked="" type="checkbox"/>	Required Items for Submittal	Item Location (e.g. Page/line or Plan Sheet/Note #)	Waiver Requested
<input checked="" type="checkbox"/>	A note shall be provided on the Site Plan stating: "All conditions on this Plan shall remain in effect in perpetuity pursuant to the requirements of the Site Plan Review Regulations." (2.5.4.2E)	SHEET C2	N/A
<input checked="" type="checkbox"/>	Plan sheets submitted for recording shall include the following notes: <ul style="list-style-type: none"> a. "This Site Plan shall be recorded in the Rockingham County Registry of Deeds." b. "All improvements shown on this Site Plan shall be constructed and maintained in accordance with the Plan by the property owner and all future property owners. No changes shall be made to this Site Plan without the express approval of the Portsmouth Planning Director." (2.13.3)	SHEET C2	N/A
<input checked="" type="checkbox"/>	Plan sheets showing landscaping and screening shall also include the following additional notes: <ul style="list-style-type: none"> a. "The property owner and all future property owners shall be responsible for the maintenance, repair and replacement of all required screening and landscape materials." b. "All required plant materials shall be tended and maintained in a healthy growing condition, replaced when necessary, and kept free of refuse and debris. All required fences and walls shall be maintained in good repair." c. "The property owner shall be responsible to remove and replace dead or diseased plant materials immediately with the same type, size and quantity of plant materials as originally installed, unless alternative plantings are requested, justified and approved by the Planning Board or Planning Director." (2.13.4)	SHEET C5	N/A

Site Plan Specifications – Required Exhibits and Data

<input checked="" type="checkbox"/>	Required Items for Submittal	Item Location (e.g. Page/line or Plan Sheet/Note #)	Waiver Requested
	1. Existing Conditions: (2.5.4.3A)		
<input checked="" type="checkbox"/>	a. Surveyed plan of site showing existing natural and built features;	STANDARD BOUNDARY SURVEY	
<input checked="" type="checkbox"/>	b. Zoning boundaries;	COVER SHEET	
<input checked="" type="checkbox"/>	c. Dimensional Regulations;	SHEET C2	
<input checked="" type="checkbox"/>	d. Wetland delineation, wetland function and value assessment;	N/A	
<input checked="" type="checkbox"/>	e. SFHA, 100-year flood elevation line and BFE data.	N/A	
	2. Buildings and Structures: (2.5.4.3B)		
<input checked="" type="checkbox"/>	a. Plan view: Use, size, dimensions, footings, overhangs, 1st fl. elevation;	ARCHITECTS PLAN	
<input checked="" type="checkbox"/>	b. Elevations: Height, massing, placement, materials, lighting, façade treatments;	ARCHITECTS PLAN	
<input checked="" type="checkbox"/>	c. Total Floor Area;	ARCHITECTS PLAN	
<input checked="" type="checkbox"/>	d. Number of Usable Floors;	ARCHITECTS PLAN	
<input checked="" type="checkbox"/>	e. Gross floor area by floor and use.	ARCHITECTS PLAN	
	3. Access and Circulation: (2.5.4.3C)		
<input checked="" type="checkbox"/>	a. Location/width of access ways within site;	SHEET C2	
<input checked="" type="checkbox"/>	b. Location of curbing, right of ways, edge of pavement and sidewalks;	SHEET C2	
<input checked="" type="checkbox"/>	c. Location, type, size and design of traffic signing (pavement markings);	N/A	
<input checked="" type="checkbox"/>	d. Names/layout of existing abutting streets;	STANDARD BOUNDARY SURVEY	
<input checked="" type="checkbox"/>	e. Driveway curb cuts for abutting prop. and public roads;	SHEET C2	
<input checked="" type="checkbox"/>	f. If subdivision; Names of all roads, right of way lines and easements noted;	N/A	
<input checked="" type="checkbox"/>	g. AASHTO truck turning templates, description of minimum vehicle allowed being a WB-50 (unless otherwise approved by TAC).	N/A	
	4. Parking and Loading: (2.5.4.3D)		
<input checked="" type="checkbox"/>	a. Location of off street parking/loading areas, landscaped areas/buffers;	SHEET C2	
<input checked="" type="checkbox"/>	b. Parking Calculations (# required and the # provided).	SHEET C2	
	5. Water Infrastructure: (2.5.4.3E)		
<input checked="" type="checkbox"/>	a. Size, type and location of water mains, shut-offs, hydrants & Engineering data;	SHEET C3	
<input checked="" type="checkbox"/>	b. Location of wells and monitoring wells (include protective radii).	N/A	
	6. Sewer Infrastructure: (2.5.4.3F)		
<input checked="" type="checkbox"/>	a. Size, type and location of sanitary sewage facilities & Engineering data.	SHEET C3	
	7. Utilities: (2.5.4.3G)		
<input checked="" type="checkbox"/>	a. The size, type and location of all above & below ground utilities;	SHEET C3	
<input checked="" type="checkbox"/>	b. Size type and location of generator pads, transformers and other fixtures.	SHEET C3	

Site Plan Specifications – Required Exhibits and Data

<input checked="" type="checkbox"/>	Required Items for Submittal	Item Location (e.g. Page/line or Plan Sheet/Note #)	Waiver Requested
<input type="checkbox"/>	8. Solid Waste Facilities: (2.5.4.3H)		
<input checked="" type="checkbox"/>	a. The size, type and location of solid waste facilities.	N/A	
	9. Storm water Management: (2.5.4.3I)		
<input checked="" type="checkbox"/>	a. The location, elevation and layout of all storm-water drainage.	SHEET C4	
	10. Outdoor Lighting: (2.5.4.3J)		
<input checked="" type="checkbox"/>	a. Type and placement of all lighting (exterior of building, parking lot and any other areas of the site) and; b. photometric plan.	N/A	
<input checked="" type="checkbox"/>	11. Indicate where dark sky friendly lighting measures have been implemented. (10.1)	N/A	
	12. Landscaping: (2.5.4.3K)		
<input checked="" type="checkbox"/>	a. Identify all undisturbed area, existing vegetation and that which is to be retained;	SHEET C5	
<input checked="" type="checkbox"/>	b. Location of any irrigation system and water source.	N/A	
	13. Contours and Elevation: (2.5.4.3L)		
<input checked="" type="checkbox"/>	a. Existing/Proposed contours (2 foot minimum) and finished grade elevations.	SHEET C4	
	14. Open Space: (2.5.4.3M)		
<input checked="" type="checkbox"/>	a. Type, extent and location of all existing/proposed open space.	SHEET C2	
<input checked="" type="checkbox"/>	15. All easements, deed restrictions and non-public rights of ways. (2.5.4.3N)	N/A	
<input checked="" type="checkbox"/>	16. Location of snow storage areas and/or off-site snow removal. (2.5.4.3O)	SHEET C2	
<input checked="" type="checkbox"/>	17. Character/Civic District (All following information shall be included): (2.5.4.3Q)	N/A	
	a. Applicable Building Height (10.5A21.20 & 10.5A43.30);		
	b. Applicable Special Requirements (10.5A21.30);		
	c. Proposed building form/type (10.5A43);		
	d. Proposed community space (10.5A46).		

Other Required Information			
<input checked="" type="checkbox"/>	Required Items for Submittal	Item Location (e.g. Page/line or Plan Sheet/Note #)	Waiver Requested
<input checked="" type="checkbox"/>	Traffic Impact Study or Trip Generation Report, as required. <i>(Four (4) hardcopies of the full study/report and Six (6) summaries to be submitted with the Site Plan Application) (3.2.1-2)</i>	SUBMITTED MATERIAL	
<input checked="" type="checkbox"/>	Indicate where Low Impact Development Design practices have been incorporated. (7.1)	SUBMITTED MATERIAL	
<input checked="" type="checkbox"/>	Indicate whether the proposed development is located in a wellhead protection or aquifer protection area. Such determination shall be approved by the Director of the Dept. of Public Works. (7.3.1)	N/A	
<input checked="" type="checkbox"/>	Indicate where measures to minimize impervious surfaces have been implemented. (7.4.3)	SHEET C4	
<input checked="" type="checkbox"/>	Calculation of the maximum effective impervious surface as a percentage of the site. (7.4.3.2)	SEE DRAINAGE ANALYSIS	
<input checked="" type="checkbox"/>	Stormwater Management and Erosion Control Plan. <i>(Four (4) hardcopies of the full plan/report and Six (6) summaries to be submitted with the Site Plan Application) (7.4.4.1)</i>	DRAINAGE ANALYSIS	

Final Site Plan Approval Required Information			
<input checked="" type="checkbox"/>	Required Items for Submittal	Item Location (e.g. Page/line or Plan Sheet/Note #)	Waiver Requested
<input checked="" type="checkbox"/>	All local approvals, permits, easements and licenses required, including but not limited to: <ul style="list-style-type: none"> a. Waivers; b. Driveway permits; c. Special exceptions; d. Variances granted; e. Easements; f. Licenses. (2.5.3.2A)	COVER SHEET	
<input checked="" type="checkbox"/>	Exhibits, data, reports or studies that may have been required as part of the approval process, including but not limited to: <ul style="list-style-type: none"> a. Calculations relating to stormwater runoff; b. Information on composition and quantity of water demand and wastewater generated; c. Information on air, water or land pollutants to be discharged, including standards, quantity, treatment and/or controls; d. Estimates of traffic generation and counts pre- and post-construction; e. Estimates of noise generation; f. A Stormwater Management and Erosion Control Plan; g. Endangered species and archaeological / historical studies; h. Wetland and water body (coastal and inland) delineations; i. Environmental impact studies. (2.5.3.2B)	SITE PLANS	

AMBIT ENGINEERING, INC. CIVIL ENGINEERS AND LAND SURVEYORS

200 Griffin Road, Unit 3, Portsmouth, NH 03801
Phone (603) 430-9282 Fax 436-2315

18 March, 2020

Trip Generation Calculation
Site Redevelopment
41 Salem Street
Portsmouth, NH

The purpose of this calculation is to identify the net change in vehicle trips expected to be generated by the site development at 41 Salem Street. Currently the lot has a single family residence. The plan is to remove the existing single family residence and construct three residential units on the lot.

In developing the expected trips Ambit Engineering considered the standard trip generation rates and equations published in the Institute of Transportation Engineers (ITE) Trip Generation Manual, 9th Edition (2012). The land use category that best correlates with the existing use is Single Family Home (ITE Land Use Code 220). The land use category that best correlates with the proposed use is “Residential Condominium / Townhouse” (ITE Land Use Code 230). The trip rates, based upon the number of dwelling units in the buildings are summarized below for the **Weekday AM and PM Peak Hour**:

Trip Generation Summary

Existing – AM Peak Hour

Single Family Home (0.75 trips per dwelling unit)	<u>0.75 x 1 units = 1 trip</u>
Total	1 trip

Proposed – AM Peak Hour

Condominium/Townhouse (0.44 trips per dwelling unit)	<u>0.44 x 3 units = 2 trips</u>
Total	2 trips

Existing – PM Peak Hour

Single Family Home (0.75 trips per dwelling unit)	<u>0.75 x 1 units = 1 trip</u>
Total	1 trip

Proposed – PM Peak Hour

Condominium/Townhouse (0.52trips per dwelling unit)	<u>0.52 x 3 units = 2 trips</u>
Total	2 trips

Trip Generation Impact

The increase anticipated with this project is 1 additional trip in the AM and 1 additional trip in the PM peak hours. The anticipated increase in traffic is negligible and does not substantially alter the traffic conditions. Salem Street is designed for uses such as the proposed project.

Please feel free to call if you have any questions or comments.

Sincerely,

John Chagnon

John R. Chagnon, PE

4/29/2020

Clara

1011.500 - 41 Salem St

© 2019-2020 Art Form Architecture, Inc., all rights reserved . You may not build this design without purchasing a license, even if you make changes. This design may have geographic restrictions.

Art Form Architecture, Inc.

603-431-9559



4/29/2020

Clara

1011.500 - 41 Salem St

© 2019-2020 Art Form Architecture, Inc., all rights reserved . You may not build this design without purchasing a license, even if you make changes. This design may have geographic restrictions.

Art Form Architecture, Inc.

603-431-9559



4/29/2020


Clara

1011.500 - 41 Salem St

© 2019-2020 Art Form Architecture, Inc., all rights reserved. You may not build this design without purchasing a license, even if you make changes. This design may have geographic restrictions.

Art Form Architecture, Inc.

603-431-9559

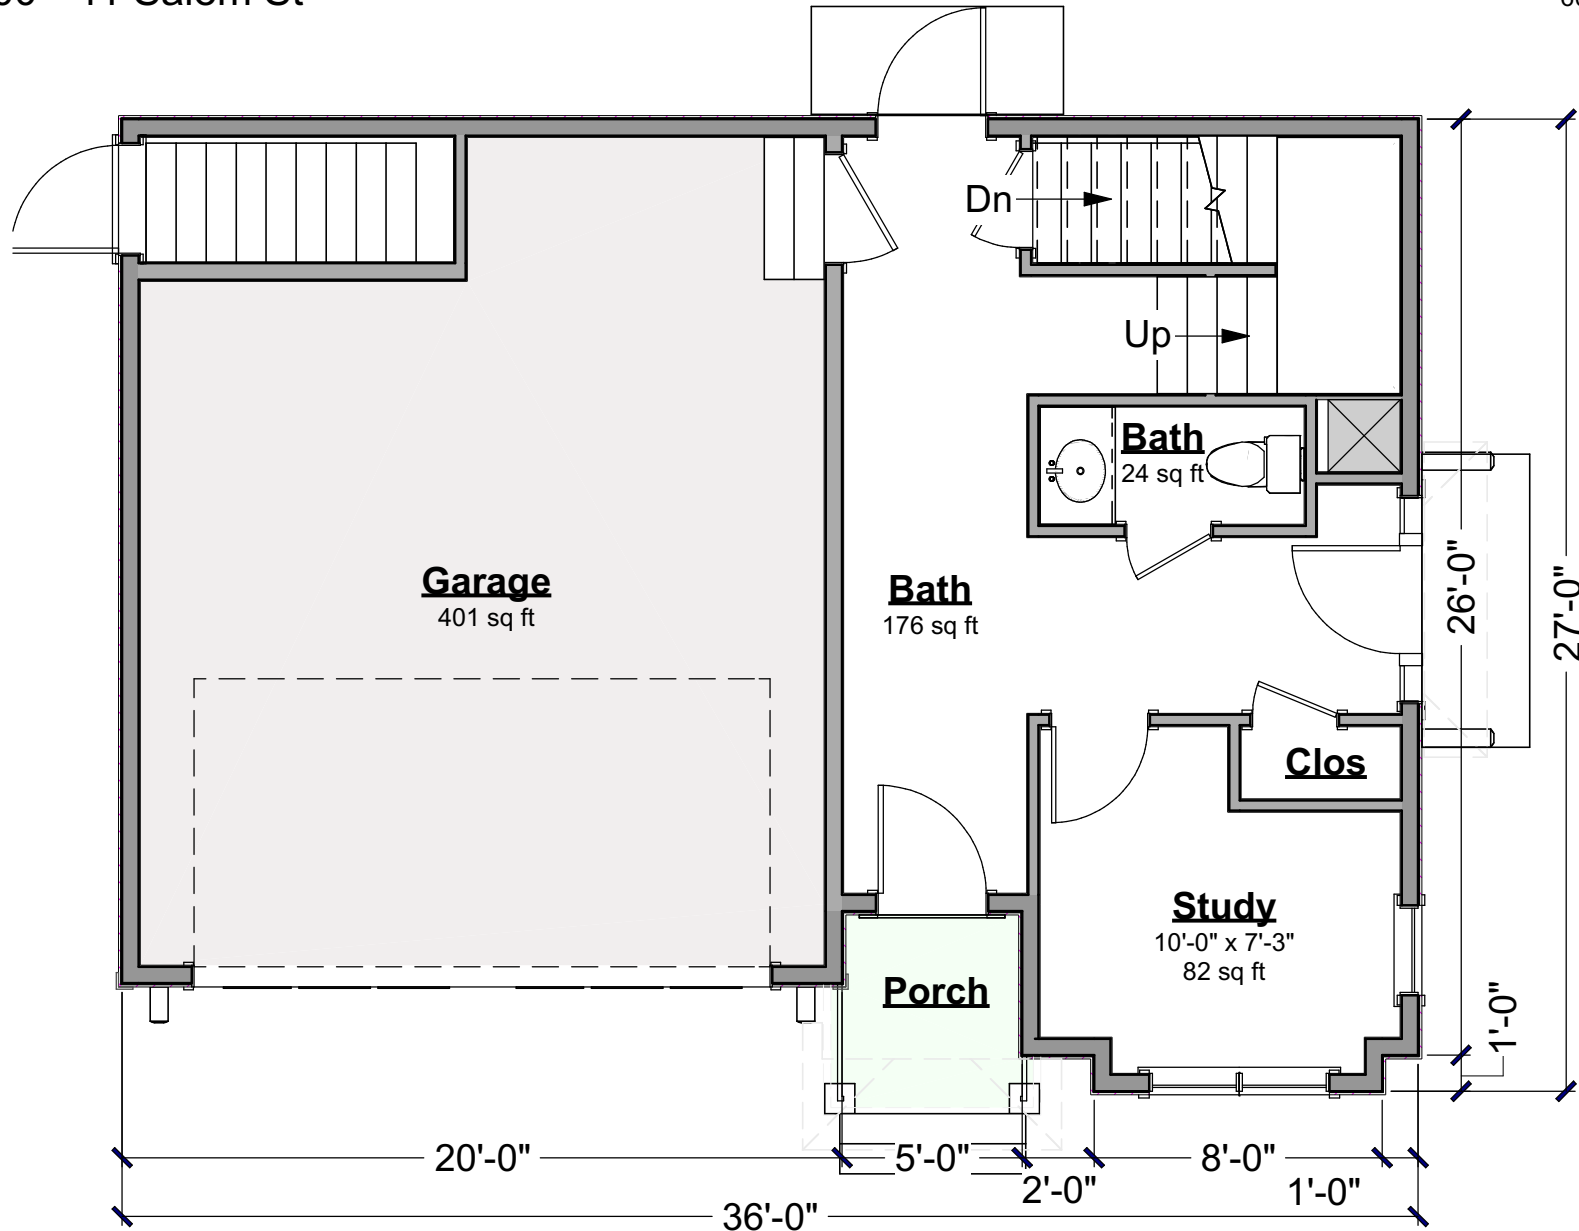

First Floor Plan

Scale: 3/16" = 1'-0"

Living Area this Floor: 457 sq ft
8ft Finished Ceiling Height

4/29/2020


Clara

1011.500 - 41 Salem St

© 2019-2020 Art Form Architecture, Inc., all rights reserved. You may not build this design without purchasing a license, even if you make changes. This design may have geographic restrictions.

Art Form Architecture, Inc.

603-431-9559

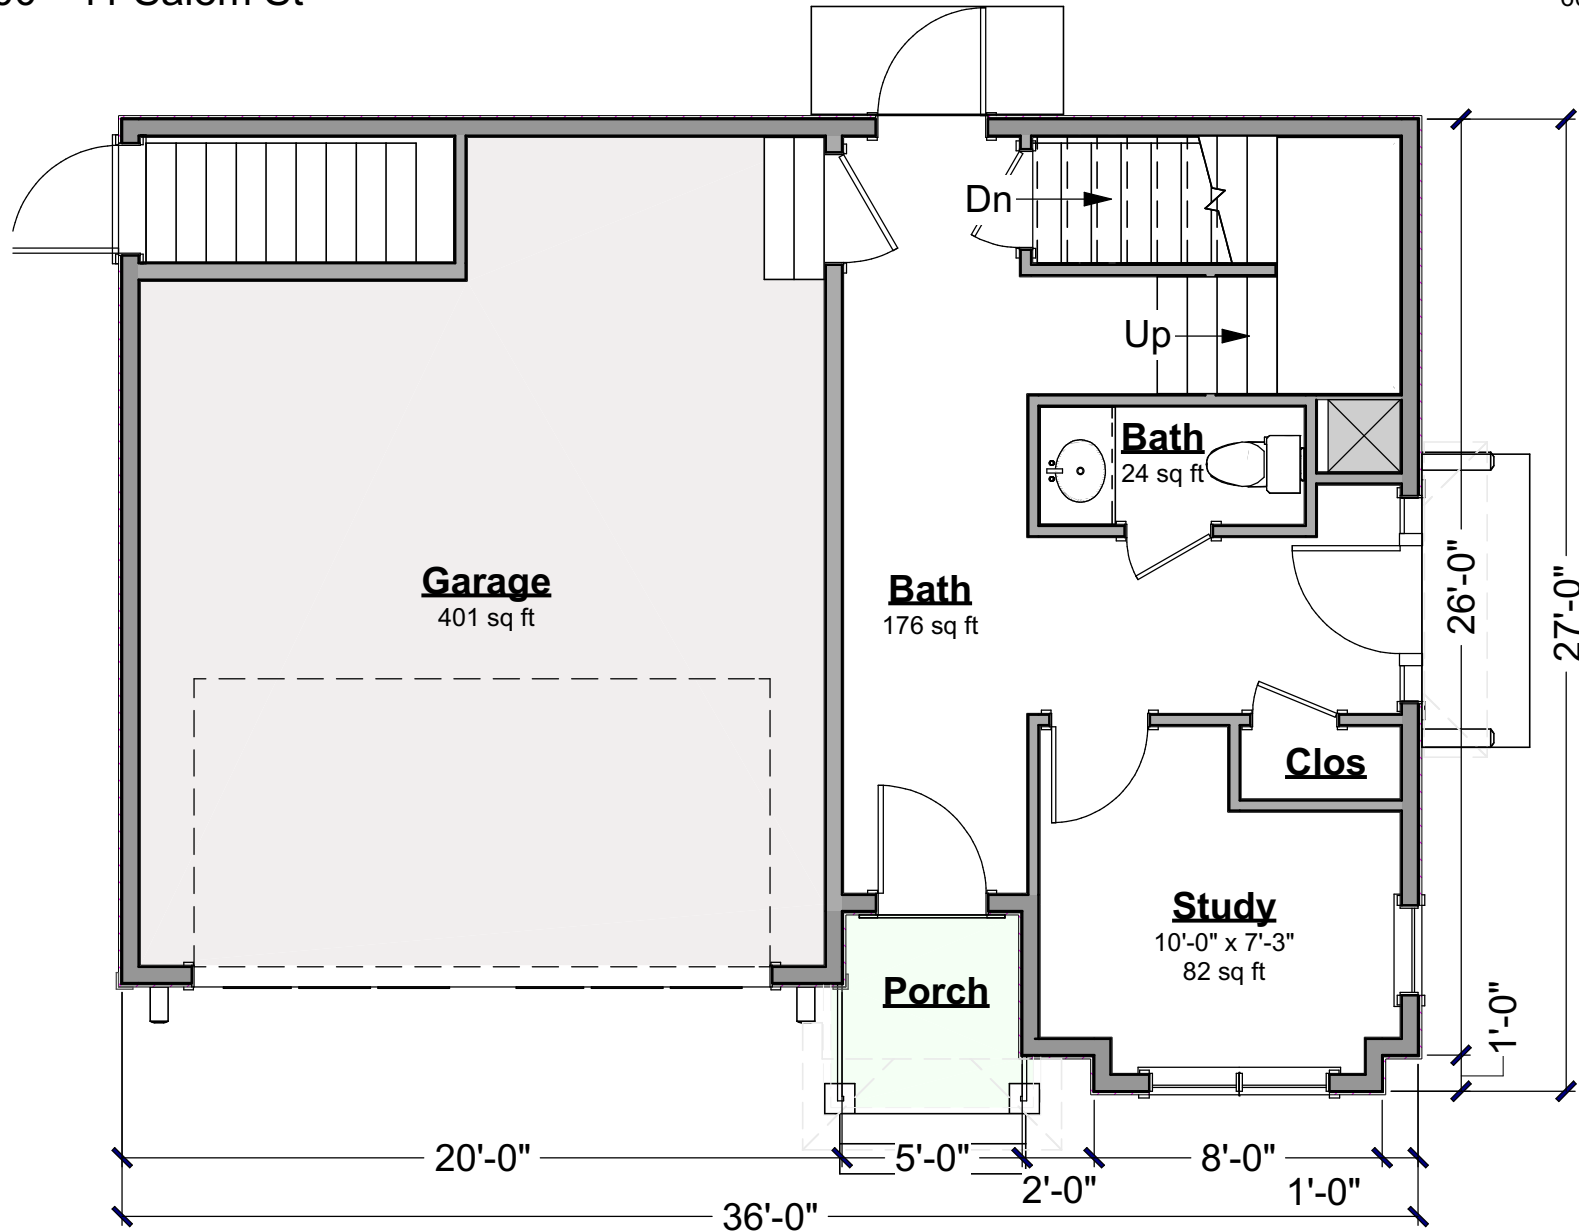

First Floor Plan

Scale: 3/16" = 1'-0"

Living Area this Floor: 457 sq ft
8ft Finished Ceiling Height


Clara

1011.500 - 41 Salem St

© 2019-2020 Art Form Architecture, Inc., all rights reserved . You may not build this design without purchasing a license, even if you make changes. This design may have geographic restrictions.

Art Form Architecture, Inc.

603-431-9559

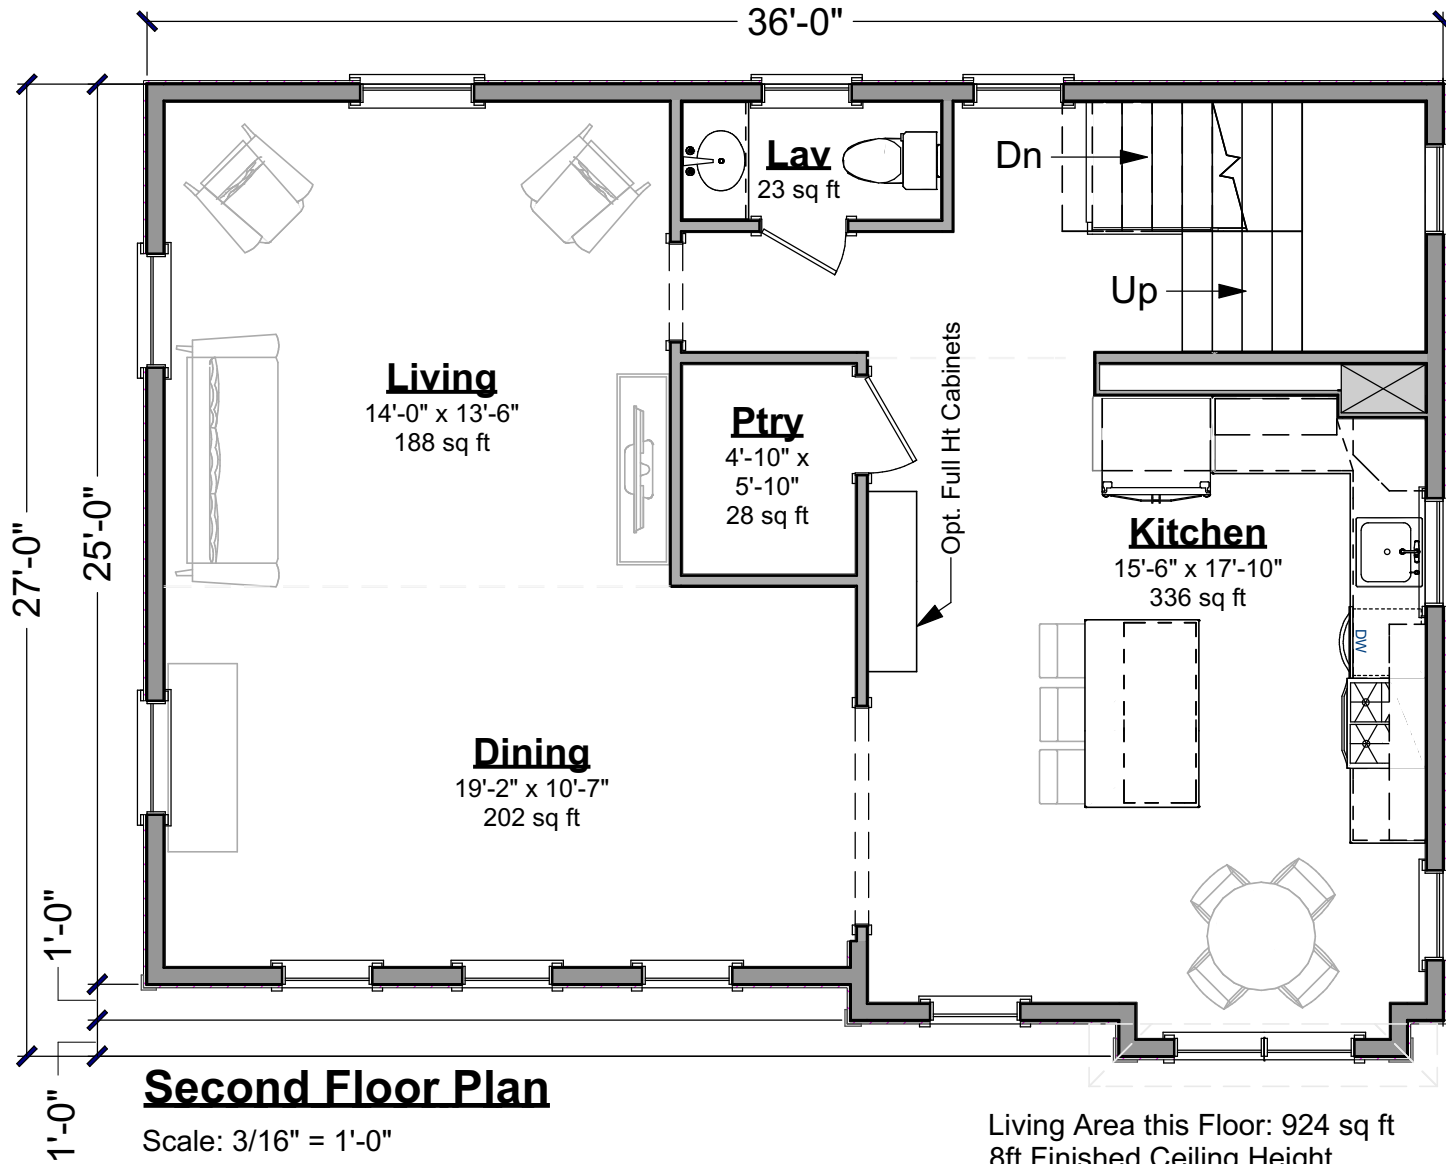


Clara

1011.500 - 41 Salem St

© 2019-2020 Art Form Architecture, Inc., all rights reserved . You may not build this design without purchasing a license, even if you make changes. This design may have geographic restrictions.

Art Form Architecture, Inc.

603-431-9559

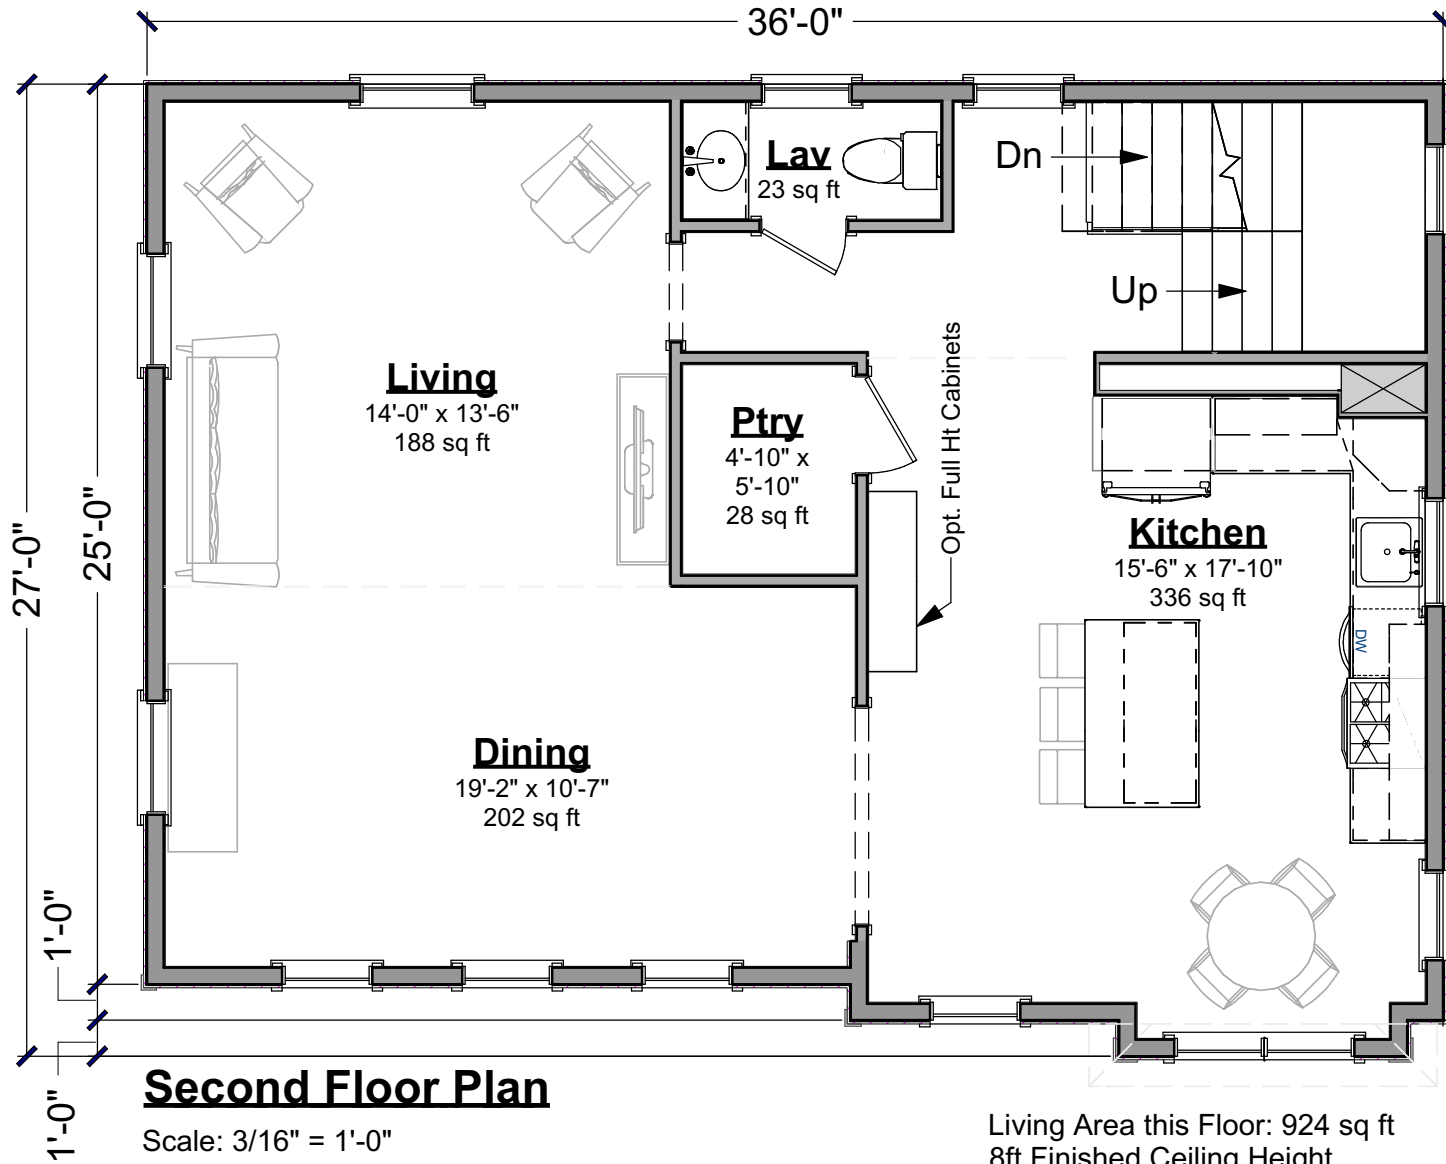


Clara

1011.500 - 41 Salem St

© 2019-2020 Art Form Architecture, Inc., all rights reserved . You may not build this design without purchasing a license, even if you make changes. This design may have geographic restrictions.

Art Form Architecture, Inc.

603-431-9559

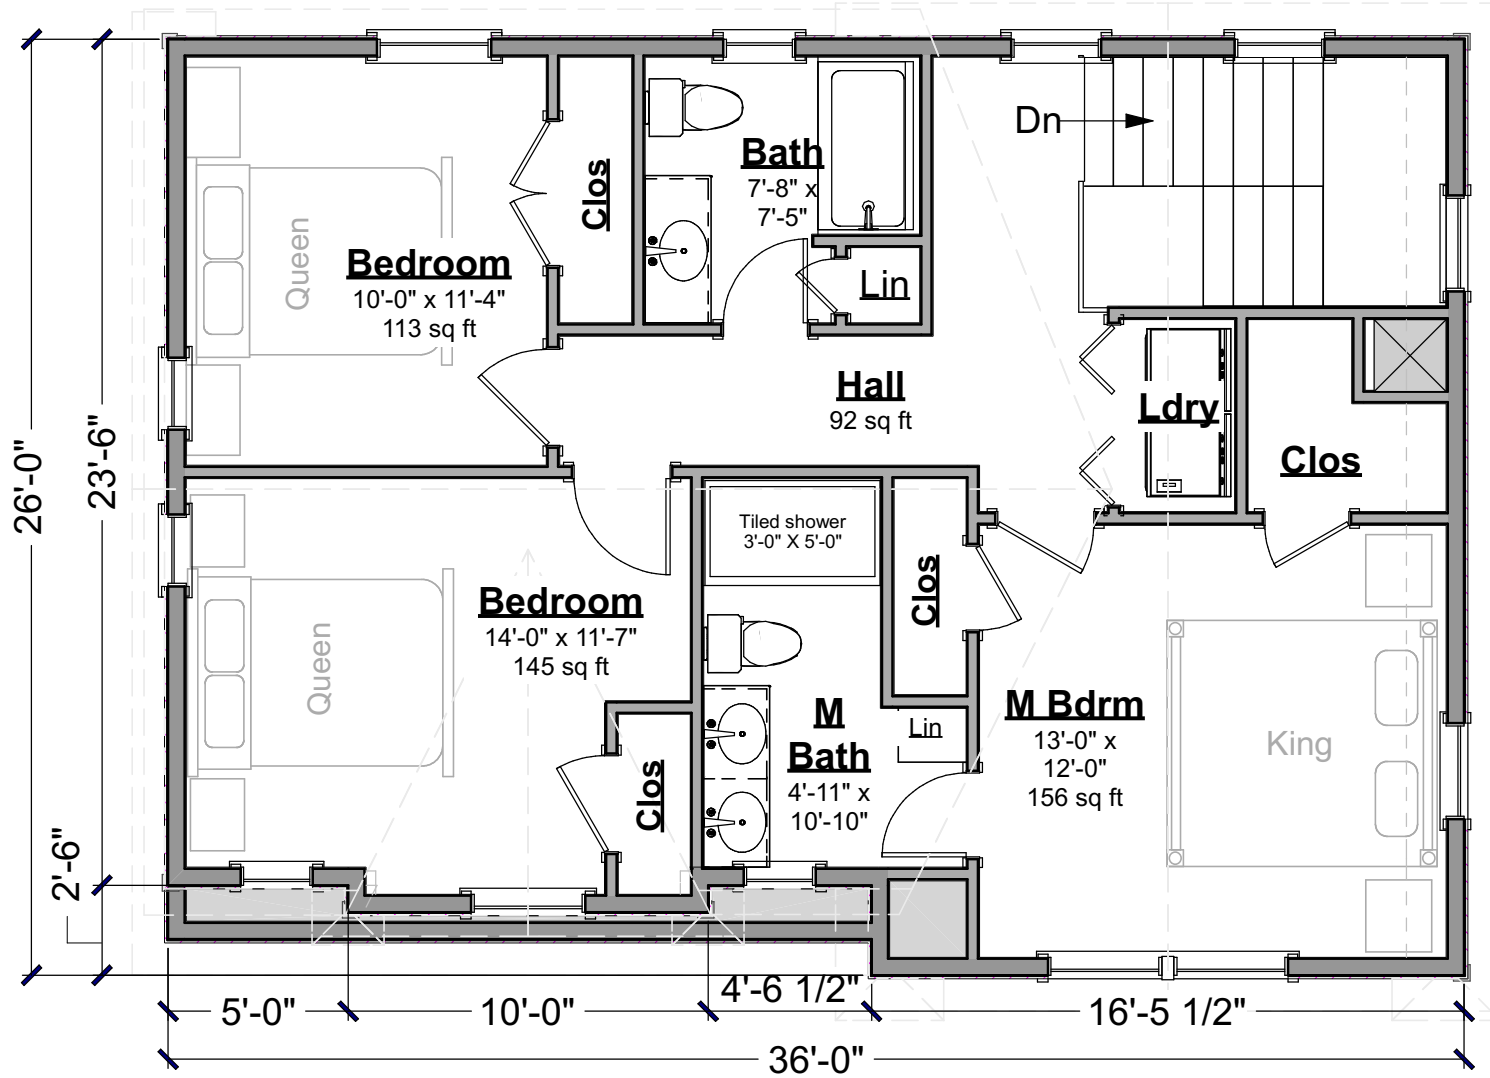

Third Floor Plan

Scale: 1/8" = 1'-0"

Living Area this Floor: 888 sq ft
8ft Finished Ceiling Height


Clara

1011.500 - 41 Salem St

© 2019-2020 Art Form Architecture, Inc., all rights reserved. You may not build this design without purchasing a license, even if you make changes. This design may have geographic restrictions.

Art Form Architecture, Inc.

603-431-9559

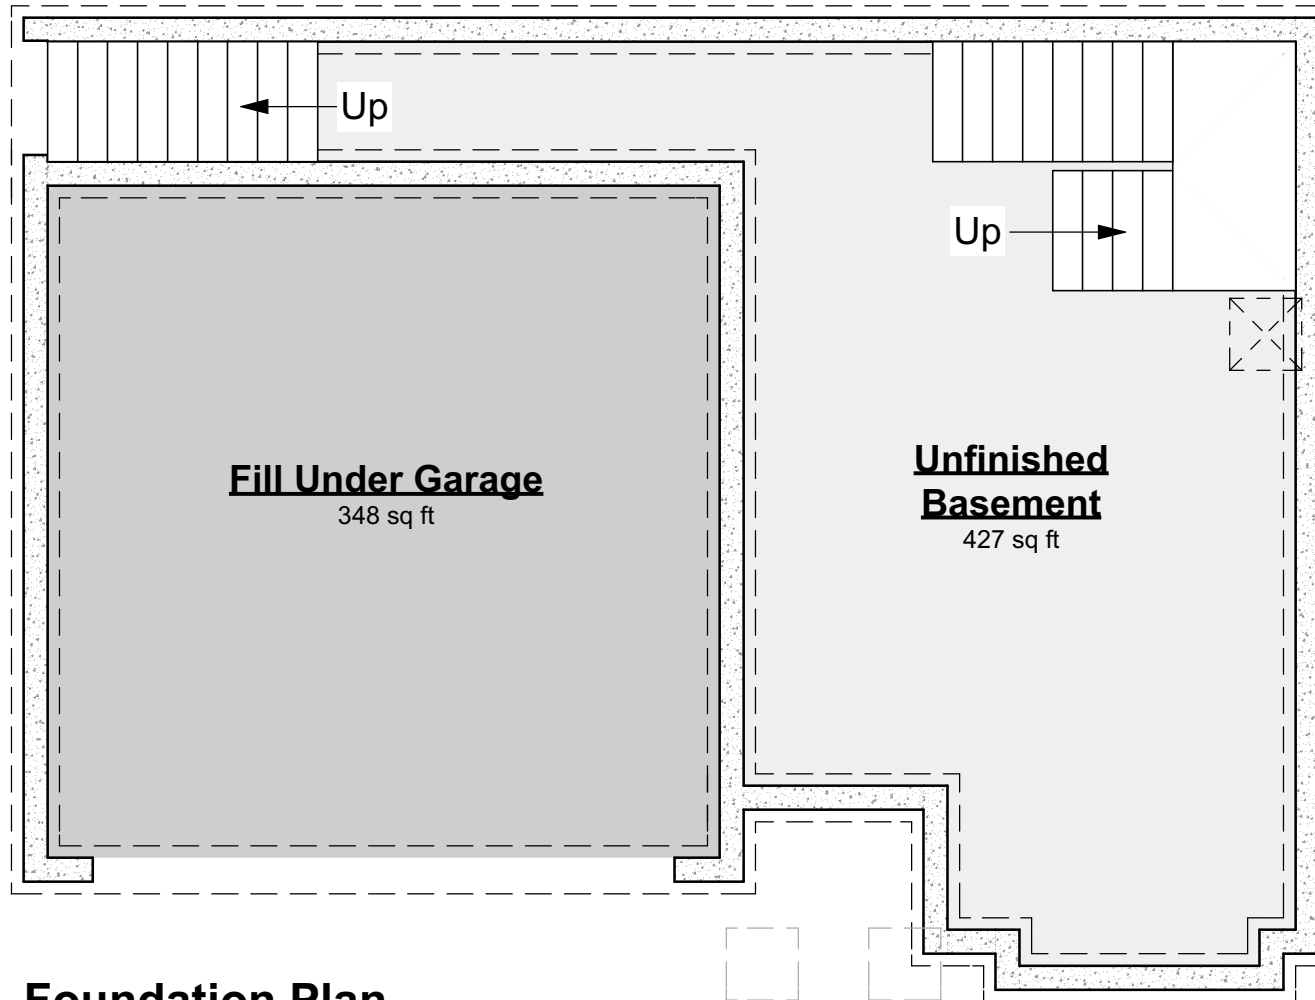**Foundation Plan**

Scale: 3/16" = 1'-0"

IMPORTANT:

- Unless an area is specifically designed as "no posts", additional posts may be required.
- Unless specifically noted otherwise, basement beams will be framed below the floor joists.
- Basement spaces accommodate utilities, mechanical equipment and the horizontal movement of plumbing pipes, electrical wires and heating ducts. Both as part of any Construction Drawings produced based on this design and as future decisions made by the builder, changes to accommodate these items must be expected.
- Basement window locations are dependent on site conditions and utility locations. Clarify number and location with your builder.

Clara

1011.500 - 41 Salem St

© 2019-2020 Art Form Architecture, Inc., all rights reserved. You may not build this design without purchasing a license, even if you make changes. This design may have geographic restrictions.

Art Form Architecture, Inc.

603-431-9559



Front Elevation

4/29/2020

Clara

1011.500 - 41 Salem St

© 2019-2020 Art Form Architecture, Inc., all rights reserved . You may not build this design without purchasing a license, even if you make changes. This design may have geographic restrictions.

Art Form Architecture, Inc.

603-431-9559



Rear Elevation

Deck or
Patio TBD

Clara
1011.500 - 41 Salem St

© 2019-2020 Art Form Architecture, Inc., all rights reserved . You may not build this design without purchasing a license, even if you make changes. This design may have geographic restrictions.

Art Form Architecture, Inc.

603-431-9559



Right Elevation



Left Elevation

11/25/2019

Clara

1011.500.v2 - 41 Salem St

© 2019 Art Form Architecture, Inc., all rights reserved .
You may not build this design without purchasing a
license, even if you make changes. This design may
have geographic restrictions.

Art Form Architecture, Inc.

Prelim / Work in Progress 603-431-9559



11/25/2019

Clara

1011.500.v2 - 41 Salem St

© 2019 Art Form Architecture, Inc., all rights reserved .
You may not build this design without purchasing a
license, even if you make changes. This design may
have geographic restrictions.

Art Form Architecture, Inc.

Prelim / Work in Progress 603-431-9559



© 2019 Art Form Architecture, Inc.
26'x36' - 41 Salem St

11/25/2019

Clara


1011.500.v2 - 41 Salem St

© 2019 Art Form Architecture, Inc., all rights reserved .
You may not build this design without purchasing a
license, even if you make changes. This design may
have geographic restrictions.

Art Form Architecture, Inc.

Prelim / Work in Progress 603-431-9559

Deck or Patio TBD

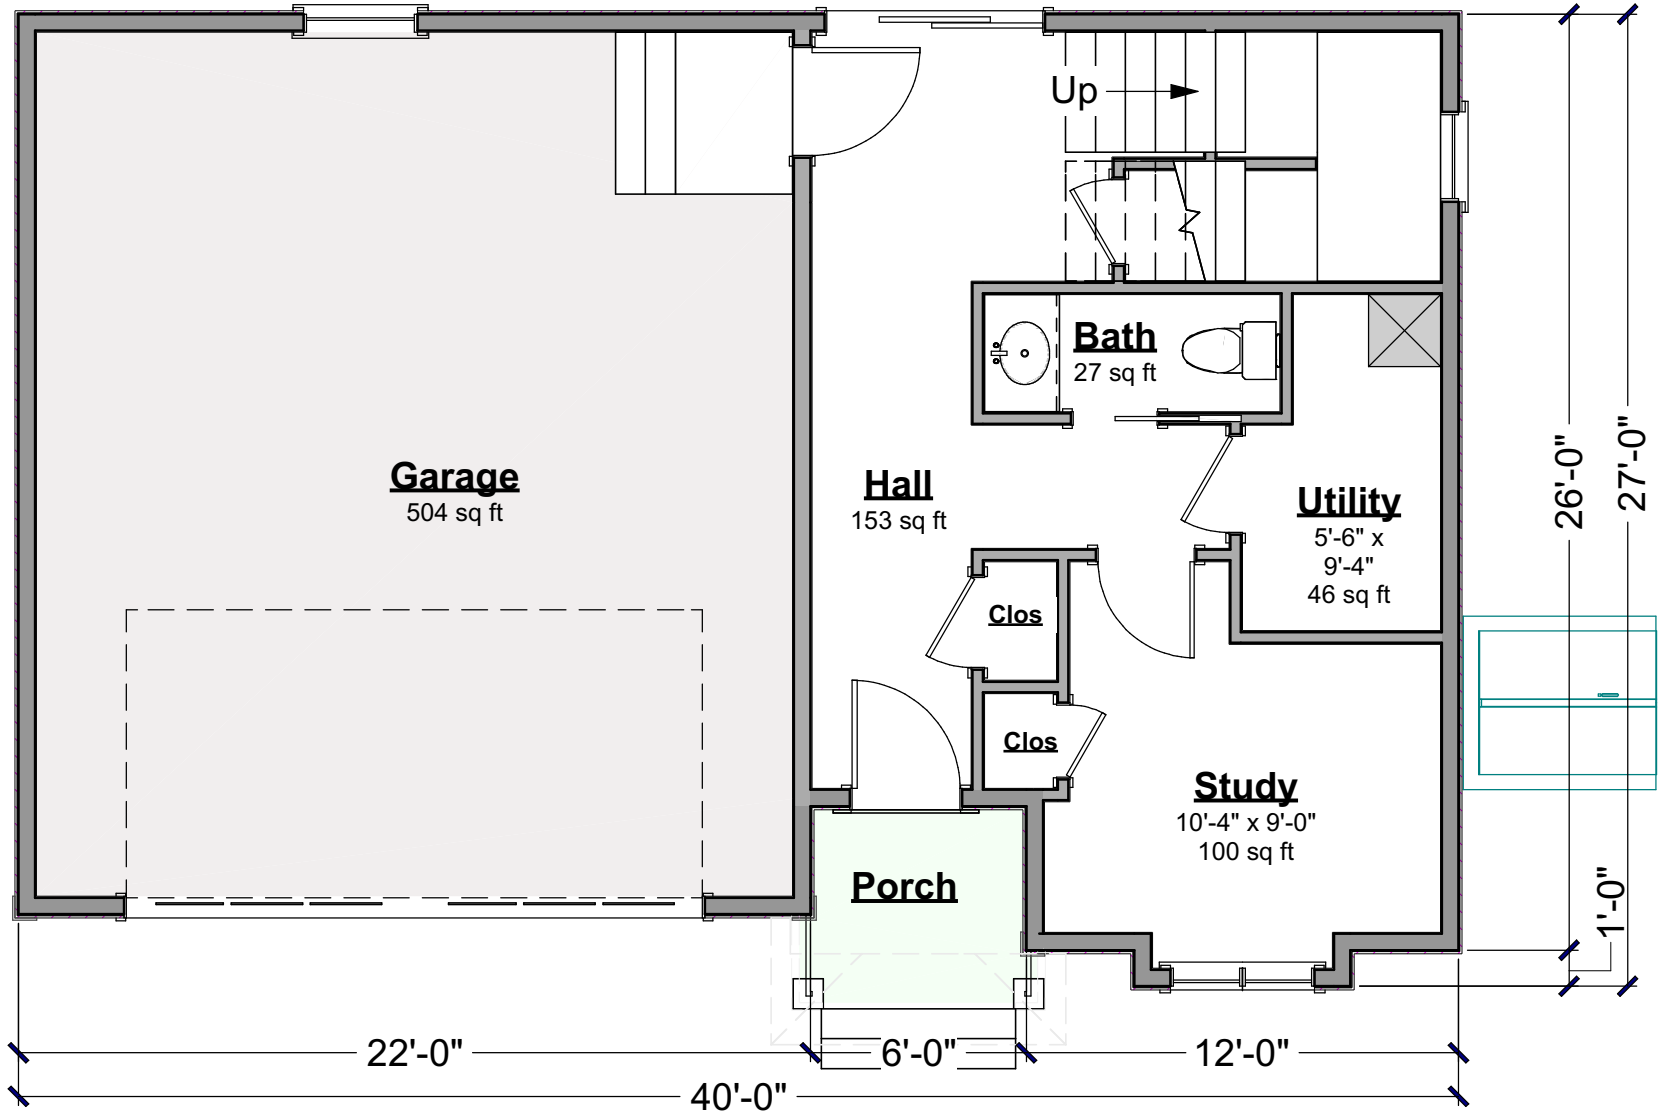

First Floor Plan

Scale: 1/8" = 1'-0"

Living Area this Floor: 460 sq ft
8ft Finished Ceiling Height


Clara

1011.500.v2 - 41 Salem St

© 2019 Art Form Architecture, Inc., all rights reserved .
You may not build this design without purchasing a
license, even if you make changes. This design may
have geographic restrictions.

Art Form Architecture, Inc.

Prelim / Work in Progress 603-431-9559

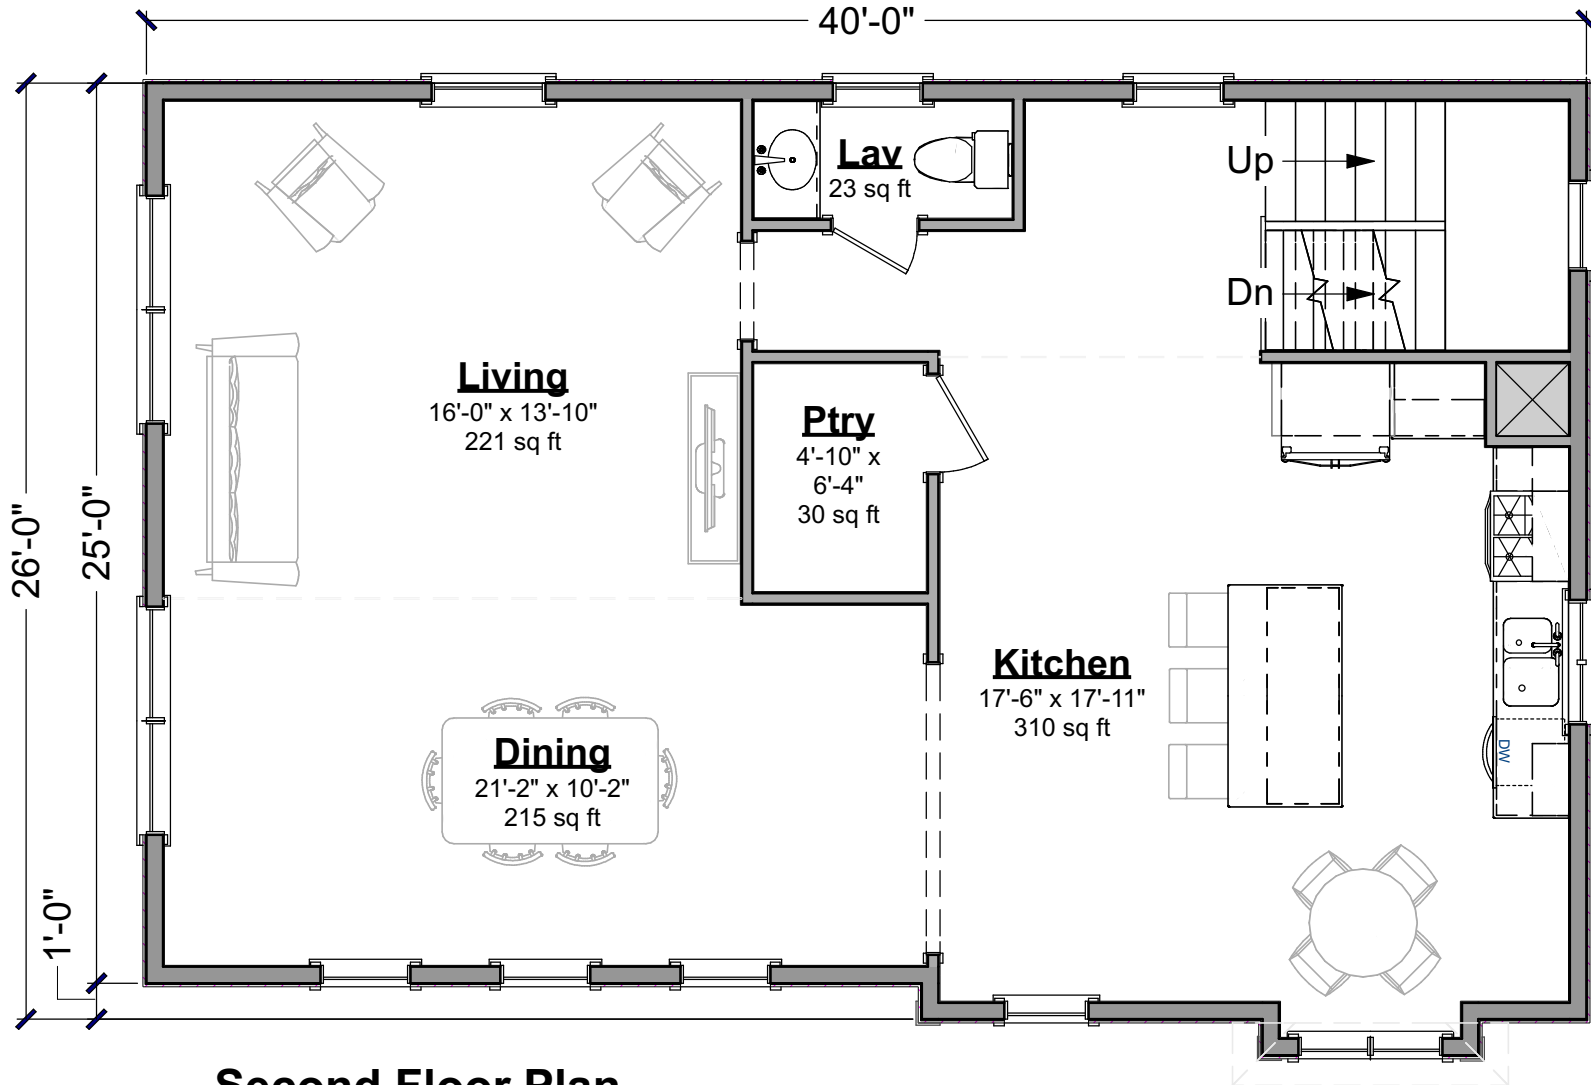

Second Floor Plan

Scale: 1/8" = 1'-0"

Living Area this Floor: 1024 sq ft
8ft Finished Ceiling Height

11/25/2019


Clara

1011.500.v2 - 41 Salem St

© 2019 Art Form Architecture, Inc., all rights reserved .
You may not build this design without purchasing a
license, even if you make changes. This design may
have geographic restrictions.

Art Form Architecture, Inc.

Prelim / Work in Progress 603-431-9559

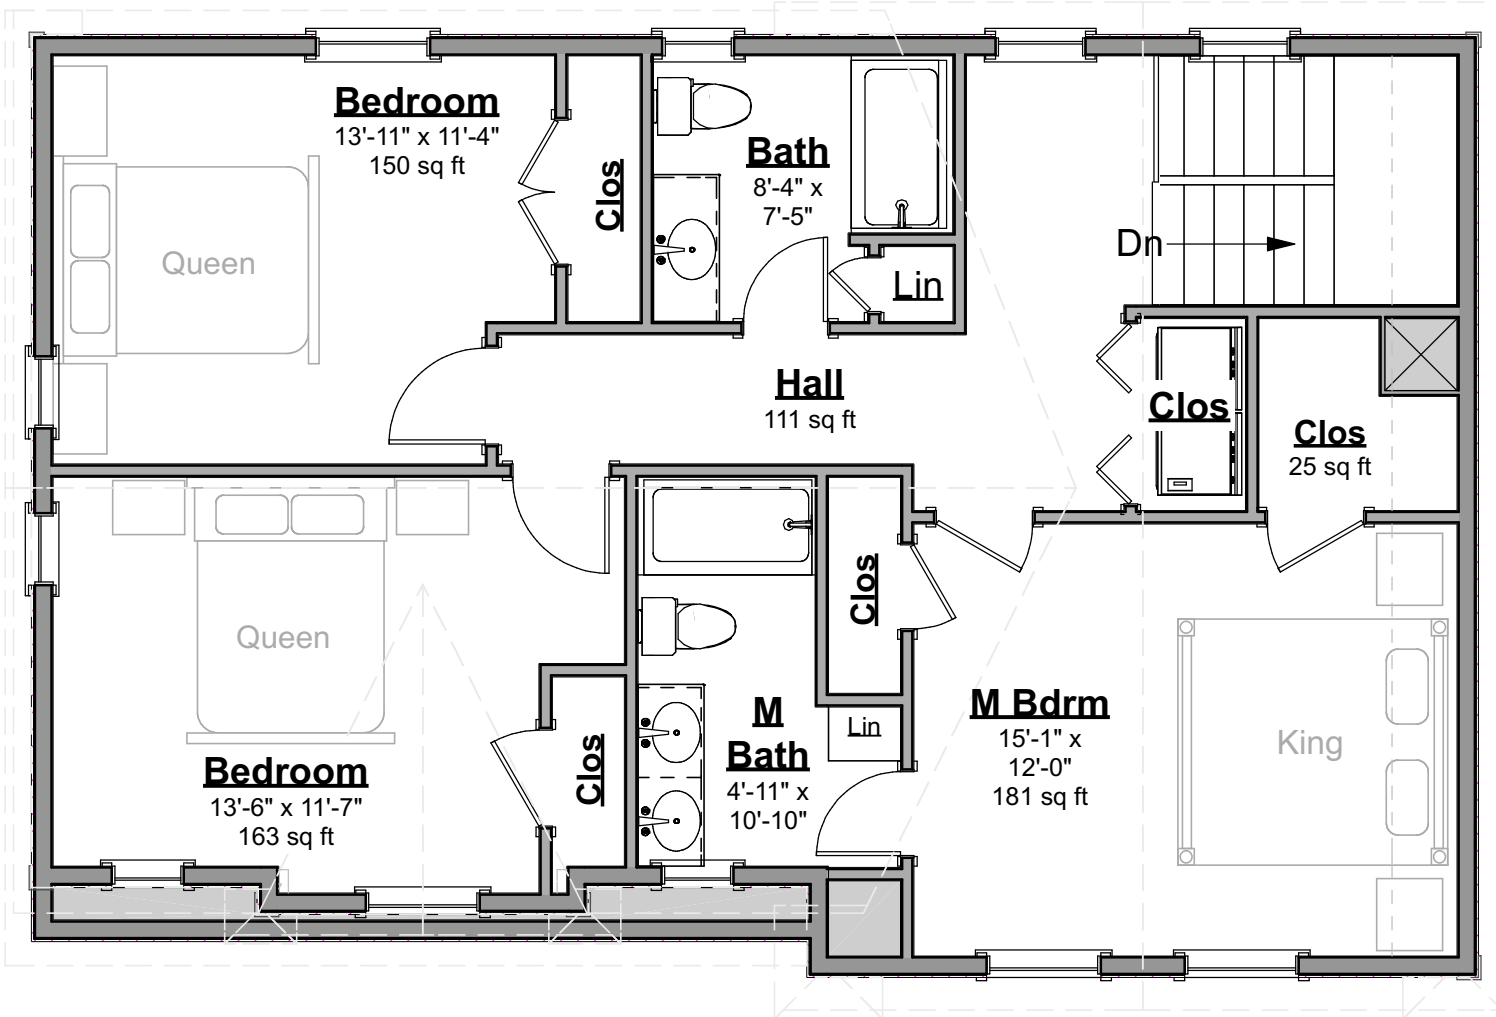

Third Floor Plan

Scale: 1/8" = 1'-0"

Living Area this Floor: 986 sq ft
8ft Finished Ceiling Height


Clara

1011.500.v2 - 41 Salem St

© 2019 Art Form Architecture, Inc., all rights reserved .
You may not build this design without purchasing a
license, even if you make changes. This design may
have geographic restrictions.

Art Form Architecture, Inc.

Prelim / Work in Progress 603-431-9559

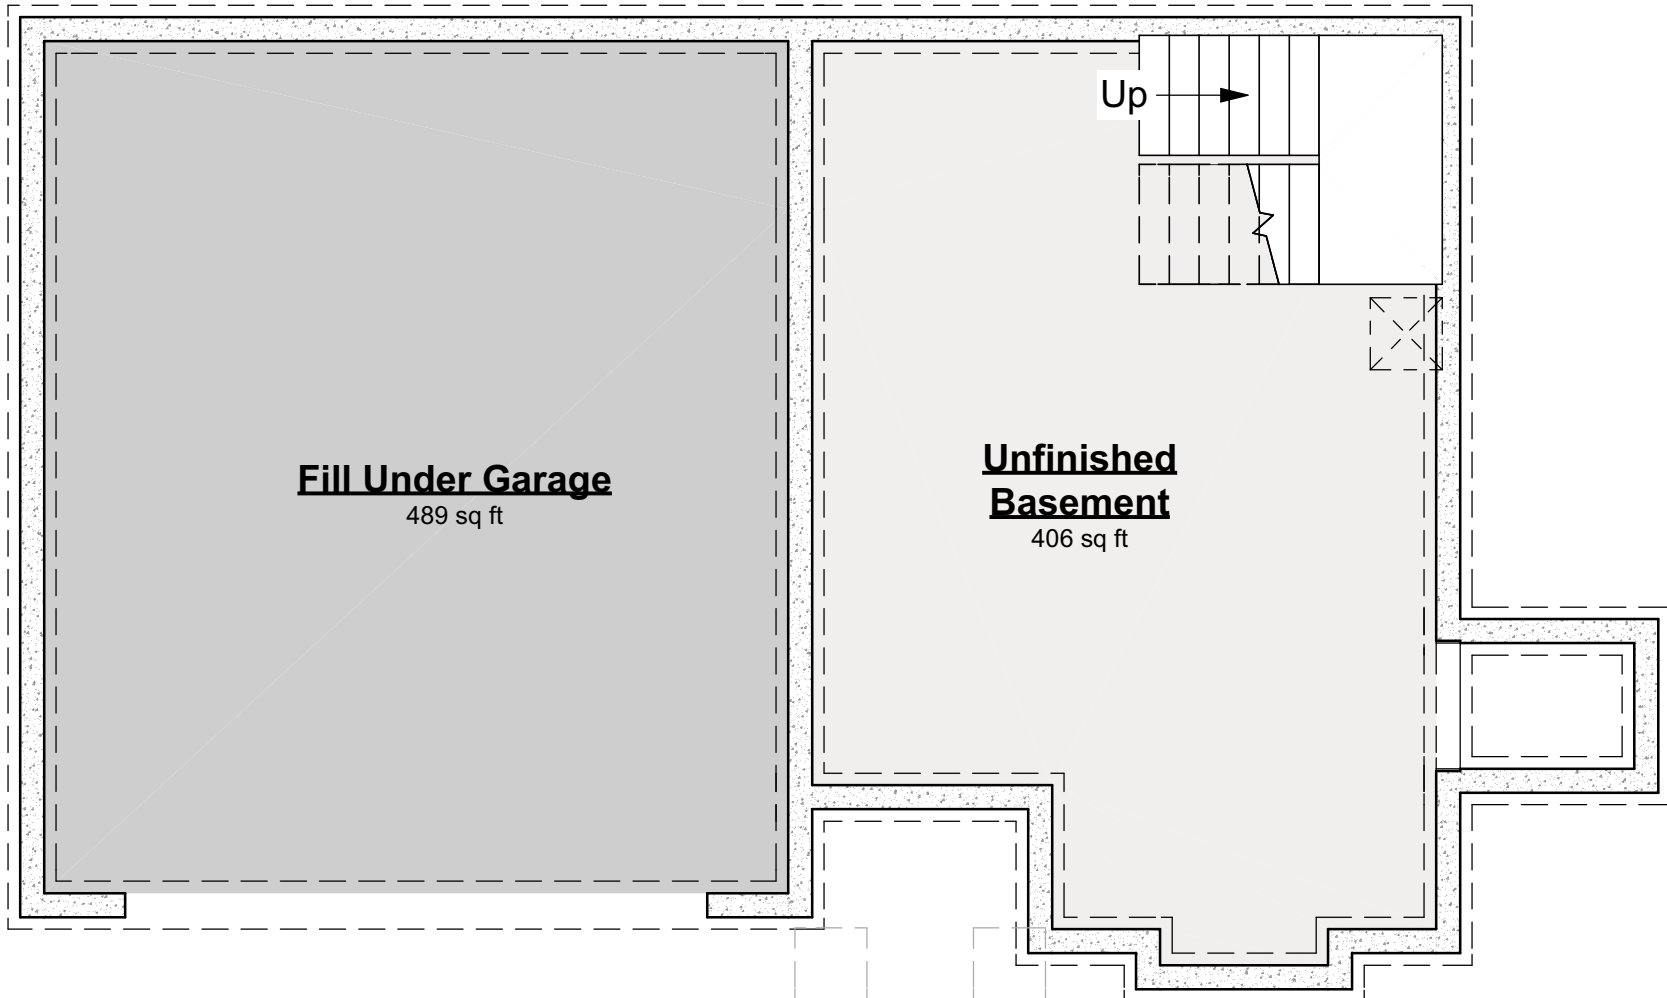

IMPORTANT:

- Unless an area is specifically designed as "no posts", additional posts may be required.
- Unless specifically noted otherwise, basement beams will be framed below the floor joists.
- Basement spaces accommodate utilities, mechanical equipment and the horizontal movement of plumbing pipes, electrical wires and heating ducts. Both as part of any Construction Drawings produced based on this design and as future decisions made by the builder, changes to accommodate these items must be expected.
- Basement window locations are dependent on site conditions and utility locations. Clarify number and location with your builder.

11/25/2019

Clara

1011.500.v2 - 41 Salem St

© 2019 Art Form Architecture, Inc., all rights reserved .
You may not build this design without purchasing a
license, even if you make changes. This design may
have geographic restrictions.

Art Form Architecture, Inc.

Prelim / Work in Progress 603-431-9559



Front Elevation

11/25/2019

Clara

1011.500.v2 - 41 Salem St

© 2019 Art Form Architecture, Inc., all rights reserved .
You may not build this design without purchasing a
license, even if you make changes. This design may
have geographic restrictions.

Art Form Architecture, Inc.

Prelim / Work in Progress 603-431-9559



Rear Elevation

Deck or
Patio TBD

11/25/2019

Clara

1011.500.v2 - 41 Salem St

© 2019 Art Form Architecture, Inc., all rights reserved .
You may not build this design without purchasing a
license, even if you make changes. This design may
have geographic restrictions.

Art Form Architecture, Inc.

Prelim / Work in Progress 603-431-9559



Right Elevation




Left Elevation


DRAINAGE ANALYSIS

PROPOSED RESIDENTIAL
REDEVELOPMENT

41 Salem Street
PORTSMOUTH, NH

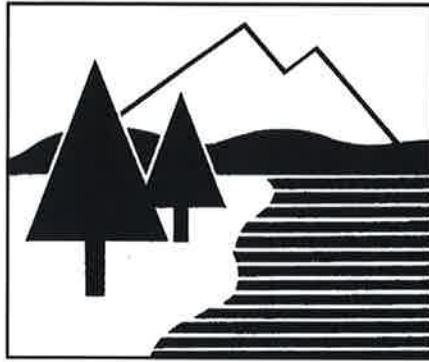

March 18, 2020

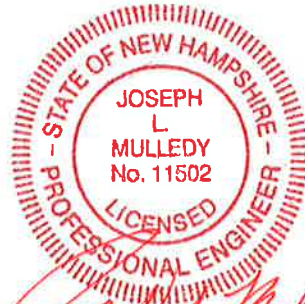

Joseph L. Mulledy
3/16/20
Ambit Engineering, Inc.



Civil Engineers and Land Surveyors
200 Griffin Road, Unit 3
Portsmouth, NH 03801
Phone: 603.430.9282; Fax: 603.436.2315
E-mail: jlm@ambitengineering.com
(Ambit Job Number3082.01)

TABLE OF CONTENTS

REPORT

Executive Summary	1
Introduction / Project Description	2
Methodology	2
Site Specific Information	3
Pre-Development Drainage	3
Post-Development Drainage	4
Erosion and Sediment Control Practices	6
Conclusion	7
References	8

APPENDIX

- A. Vicinity (Tax) Map
- B. Tables, Charts, Etc.
- C. HydroCAD Drainage Analysis Calculations
- D. Soil Survey Information
- E. FEMA FIRM Map
- F. Stormwater Inspection & Maintenance Plan

ATTACHMENTS

- Existing Drainage Plan - W1
- Proposed Drainage Plan - W2
- Offsite Drainage Plan – W3

EXECUTIVE SUMMARY

The hydrologic modeling for this project considers the “Extreme Precipitation” values from The Northeast Regional Climate Center (Cornell University). For modeling purposes, these values have been used and are included in this report.

This drainage analysis examines the pre-development (existing) and post-development (proposed) stormwater drainage patterns for the proposed redevelopment of a residential lot with an existing single family home and construction of three single family homes and associated site improvements at 41 Salem Street in Portsmouth, NH. The site is shown on the City of Portsmouth Assessor’s Tax Map 144 as Lot 31. The total lot size is 10,903 square-feet (0.2503 acres).

The new buildings will be serviced by public water and sewer. The development has the potential to increase stormwater runoff to adjacent properties, and therefore must be designed in a manner to prevent that occurrence. This will be done primarily by capturing stormwater runoff and routing it through appropriate stormwater facilities, designed to ensure that there will be no increase in peak runoff from the site as a result of this project.

PROPOSED RESIDENTIAL

REDEVELOPMENT

41 Salem Street

PORTSMOUTH, NH

INTRODUCTION / PROJECT DESCRIPTION

This drainage report is designed to assist the owner, planning board, contractor, regulatory reviewer, and others in understanding the impact of the proposed development project on local surface water runoff and quality. The project site is shown on the City of Portsmouth, NH Assessor's Tax Map 144 as Lot 31.

Bounding the site to the east, south and west are single and multi-family residential properties. Bounding the site to the west is Salem Street and beyond are residential properties. The property is situated in the General Residence C (GRC) Zoning District. A vicinity map is included in the Appendix to this report.

The proposed development will demolish an existing residential structure and construct three new single family units, new driveway and other associated improvements such as a utilities and landscaping. The project is anticipated to begin construction in the spring of 2020 and be substantially completed by the fall of 2020.

This report includes information about the existing site and the proposed development necessary to analyze stormwater runoff and to design any required mitigation. The report includes maps of pre-development and post-development watersheds, sub-catchment areas and calculations of runoff. The report will provide a narrative of the stormwater runoff and describe numerically and graphically the surface water runoff patterns for this site. Proposed stormwater management and treatment structures and methods will also be described, as well as erosion and sediment control practices. To fully understand the proposed site development the reader should also review a complete site plan set in addition to this report.

METHODOLOGY

This report uses the US Soil Conservation Service (SCS) Method for estimating stormwater runoff. The SCS method is published in The National Engineering Handbook (NEH), Section 4 "Hydrology" and includes the Technical Release No. 20, (TR-20) "Computer Program for Project Formulation Hydrology", and Technical Release No. 55 (TR-55) "Urban Hydrology for

Small Watersheds” methods. This report uses the HydroCAD version 10.0 program, written by HydroCAD Software Solutions LLC, Chocorua, N.H., to apply these methods for the calculation of runoff and for pond modeling. The hydrologic modeling considers the “Extreme Precipitation” values from The Northeast Regional Climate Center (Cornell University). These values have been used and are included in this report.

Time of Concentration (Tc) is calculated by entering measured flow path data such as flow path type, length, slope and surface characteristics into the HydroCAD program. For the purposes of this report, a minimum time of concentration of 5 minutes is used.

The storm events used for the calculations in this report are the 10-year and 50-year (24-hour) storms. Watershed basin boundaries have been delineated using topographic maps prepared by Ambit Engineering and field observations to confirm.

SITE SPECIFIC INFORMATION

Based on the United States Department of Agriculture (USDA) Natural Resources Conservation Service (NRCS), Soil Survey of Rockingham County, New Hampshire, and confirmed by field exploration conducted by Ambit Engineering, Inc., the site is made up of one soil type:

699 – Urban land – This soil does not have a Hydrologic Soil Group (HSG) classification. Four test pits were conducted to a depth of about 60” and found to have fairly consistent soil types across all four. Soils were found to be generally fine sandy loam over fine loamy sand and silty or clayey soils to greater depths. The test pit locations and logs can be reviewed on Sheet C4.

The physical characteristics of the site consist of (1-5%) grades that generally slope downward from the west (front along Salem Street) to the east (back). Elevations on the site range from 24 to 19 feet above sea level. The existing site is partially developed and includes an existing building located at the front of the lot, with an asphalt driveway. Vegetation around the developed portion of the lot consists of established grasses, shrubs and trees.

According to the Federal Emergency Management Agency (FEMA) Flood Insurance Rate Map (FIRM) number 33015C0259E (effective date May 17, 2005), the project site is located in Zone X and is determined to be outside of the 0.2% annual chance floodplain. A copy of the FIRM map is included in the Appendix.

PRE-DEVELOPMENT DRAINAGE

The existing site drains via overland flow from the front of the lot at Salem Street towards the rear of the site. There is no existing stormwater detention or treatment on the site.

In the pre-development condition, the site has been analyzed as one single watershed basin (ES1) based on localized topography and discharge location. Additionally, there is runoff entering the

lot from Off Site. This off site area has been analyzed as a single watershed basin (OS1). ES1 and OS1 flow overland directly to the northeast corner of the lot to Discharge Point 1 (DP1) and further at Discharge Point 2 (DP2) which is a catch basin located at the corner of McDonough and Cabot Street. The majority of the lot is previously developed consisting of a single family home, paved driveway and grassed / landscaped yard. The runoff curve number (CN) for Subcatchment ES1 is calculated to be 67 with impervious coverage of 15.13%. The CN value for Subcatchment OS1 is calculated to be 89 with 74.45% impervious coverage. The Time of Concentration in all subcatchments accounts for the flow paths that are not modeled as ponds (catch basins). This produces an accurate analysis of the timing of the peak at Discharge Point 2.

Table 1: Pre-Development Watershed Basin Summary

Watershed Basin ID	Basin Area (SF)	Tc (MIN)	CN	10-Year Runoff (CFS)	50-Year Runoff (CFS)	Design Point
ES1	10,903	5.5	67	0.63	1.31	DP1/DP2
OS1	18,588	10.6	89	1.78	2.86	DP1/DP2

POST-DEVELOPMENT DRAINAGE

The proposed development has been designed to match the pre-development drainage patterns to the greatest extent feasible. In the post-development condition, the site has been analyzed as five separate watersheds (PS1, PS1a, PS2, PS3 and OS 1) based on localized topography and discharge locations. Subcatchments PS1 and PS2 are primarily site runoff (grass and asphalt driveway pavement) that flow overland to a proposed catch basin located on site near the driveway entrance along Salem Street and further down Salem Street within a proposed closed drainage system which will tie into the existing closed drainage in McDonough Street. Subcatchment PS1a is runoff from the roofs of all three homes that is filtered through Drip Edge Filter Strips located at each home. This treated runoff discharges to the catch basin located at the corner of the driveway entrance along Salem Street. Subcatchment PS3 is the remainder of the lot which is not directed to Salem Street. This runoff flows via a grassed pathway through adjacent lots to McDonough Street. Subcatchment OS 1 is the same area of off site runoff as in the existing conditions which combines with the runoff from PS3 and discharges via the same grassed pathway to McDonough Street and further to the catch basin located at the corner of McDonough and Cabot Streets. This allows for a detailed review of Design Points to show the comparison of runoff from the site in the pre-development and post-development conditions as well as off site points of interest. The Time of Concentration in all subcatchments accounts for

the flow paths that are not modeled as ponds (catch basins). This produces an accurate analysis of the timing of the peak at Discharge Point 2.

The runoff curve number (CN) for basin PS1 is calculated to be 79 with impervious coverage of 48.83%. The runoff curve number (CN) for basin PS1a is calculated to be 98 with impervious coverage of 100.00%. The runoff curve number (CN) for basin PS2 is calculated to be 79 with impervious coverage of 47.84%. The runoff curve number (CN) for basin PS3 is calculated to be 61 with impervious coverage of 0.00%. The runoff curve number (CN) for basin OS 1 is unchanged compared to the existing conditions.

Table 2: Post-Development Watershed Basin Summary

Watershed Basin ID	Basin Area (SF)	Tc (MIN)	CN	10-Year Runoff (CFS)	50-Year Runoff (CFS)	Design Point
PS1	2,893	0.8	79	0.29	0.51	DP1/DP2
PS1a	2,717	10.0	98	0.30	0.45	DP1/DP2
PS2	1,411	1.1	79	0.14	0.24	DP1/DP2
PS3	3,882	6.3	61	0.16	0.38	DP1/DP2
OS 1	18,588	10.6	89	1.78	2.86	DP1/DP2

The overall impervious coverage of the area analyzed in this report for all basins **increases** from 15,489 square feet (52.52%) in the pre-development condition to 18,641 square feet (63.21%) in the post-development condition. Since the site represents an increase in impervious area, the project proposes the construction of Drip Edge Soil Filters along the rooflines of each home to filter and slow the rate of runoff from the site. Since no treatment systems currently exist for the site, providing this proposed treatment is a vast improvement on the water quality of the runoff.

Table 3 shows a summary of the comparison between pre-developed flows and post-developed flows for the design point.

Table 3: Pre-Development to Post-Development Peak Flow Comparison

Design Point	Q2 (CFS)		Q10 (CFS)		Q25 (CFS)		Q50 (CFS)	
	Pre	Post	Pre	Post	Pre	Post	Pre	Post
DP 1	1.29	1.12	2.34	1.94	3.20	2.61	4.02	3.23
DP 2	1.29	1.41	2.34	2.44	3.20	3.25	4.02	4.02

Table 4 shows a summary of the comparison between the timing of pre-developed flows and the timing of post-developed flows for the design point. The goal here was to match those peaks as close as possible.

Table 3: Pre-Development to Post-Development Timing of Peak Flow Comparison

Design Point	Q2 (hrs)		Q10 (hrs)		Q25 (hrs)		Q50 (hrs)	
	Pre	Post	Pre	Post	Pre	Post	Pre	Post
DP 1	12.15	12.14	12.14	12.14	12.13	12.14	12.12	12.14
DP 2	12.14	12.14	12.14	12.13	12.13	12.13	12.12	12.13

EROSION AND SEDIMENT CONTROL PRACTICES

The erosion potential for this site as it exists is low due to the existing vegetation and the built-up nature of the surrounding sites. During construction, the major potential for erosion is wind and stormwater runoff. The contractor will be required to inspect and maintain all necessary erosion control measures, as well as installing any additional measures as required. All erosion control practices shall conform to “The Stormwater Management and Erosion Control Handbook for Urban and Developing Areas in New Hampshire.” Some examples of erosion and sediment control measures to be utilized for this project during construction may include:

- Silt Soxx (or approved alternative) located at the toe of disturbed slopes
- Stabilized construction entrance at access point to the site
- Temporary mulching and seeding for disturbed areas
- Spraying water over disturbed areas to minimize wind erosion

After construction, permanent stabilization will be accomplished by permanent seeding, landscaping and surfacing the access drives and parking areas with either compacted gravel or asphalt paving.


CONCLUSION

The proposed development has been designed to be low impact in terms of stormwater quality and quantity. With the design of a much needed closed drainage system within Salem Street and on Site Stormwater Controls such as the Drip Edge Soil Filters, Stormwater runoff is managed to mitigate impacts to neighboring properties. Erosion and sediment control practices will be implemented for both the temporary condition during construction and for final stabilization after construction. Therefore, there are no negative impacts to downstream receptors or adjacent properties anticipated as a result of this project. There is also no negative impact to the City of Portsmouth storm drainage system.

REFERENCES

1. City of Portsmouth, NH. Site Plan Review Regulations amended December 18, 2014.
2. Comprehensive Environmental Inc. and New Hampshire Department of Environmental Services. *New Hampshire Stormwater Manual (Volumes 1, 2 and 3)*, December 2008 (Revision 1.0).
3. Minnick, E.L. and H.T. Marshall. *Stormwater Management and Erosion and Sediment Control Handbook for Urban and Developing Areas in New Hampshire*, prepared by Rockingham County Conservation District, prepared for New Hampshire Department of Environmental Services, in cooperation with USDA Soil Conservation Service, August 1992.
4. HydroCAD Software Solution, LLC. *HydroCAD Stormwater Modeling System Version 10.0* copyright 2013.

APPENDIX A
VICINITY (TAX) MAP

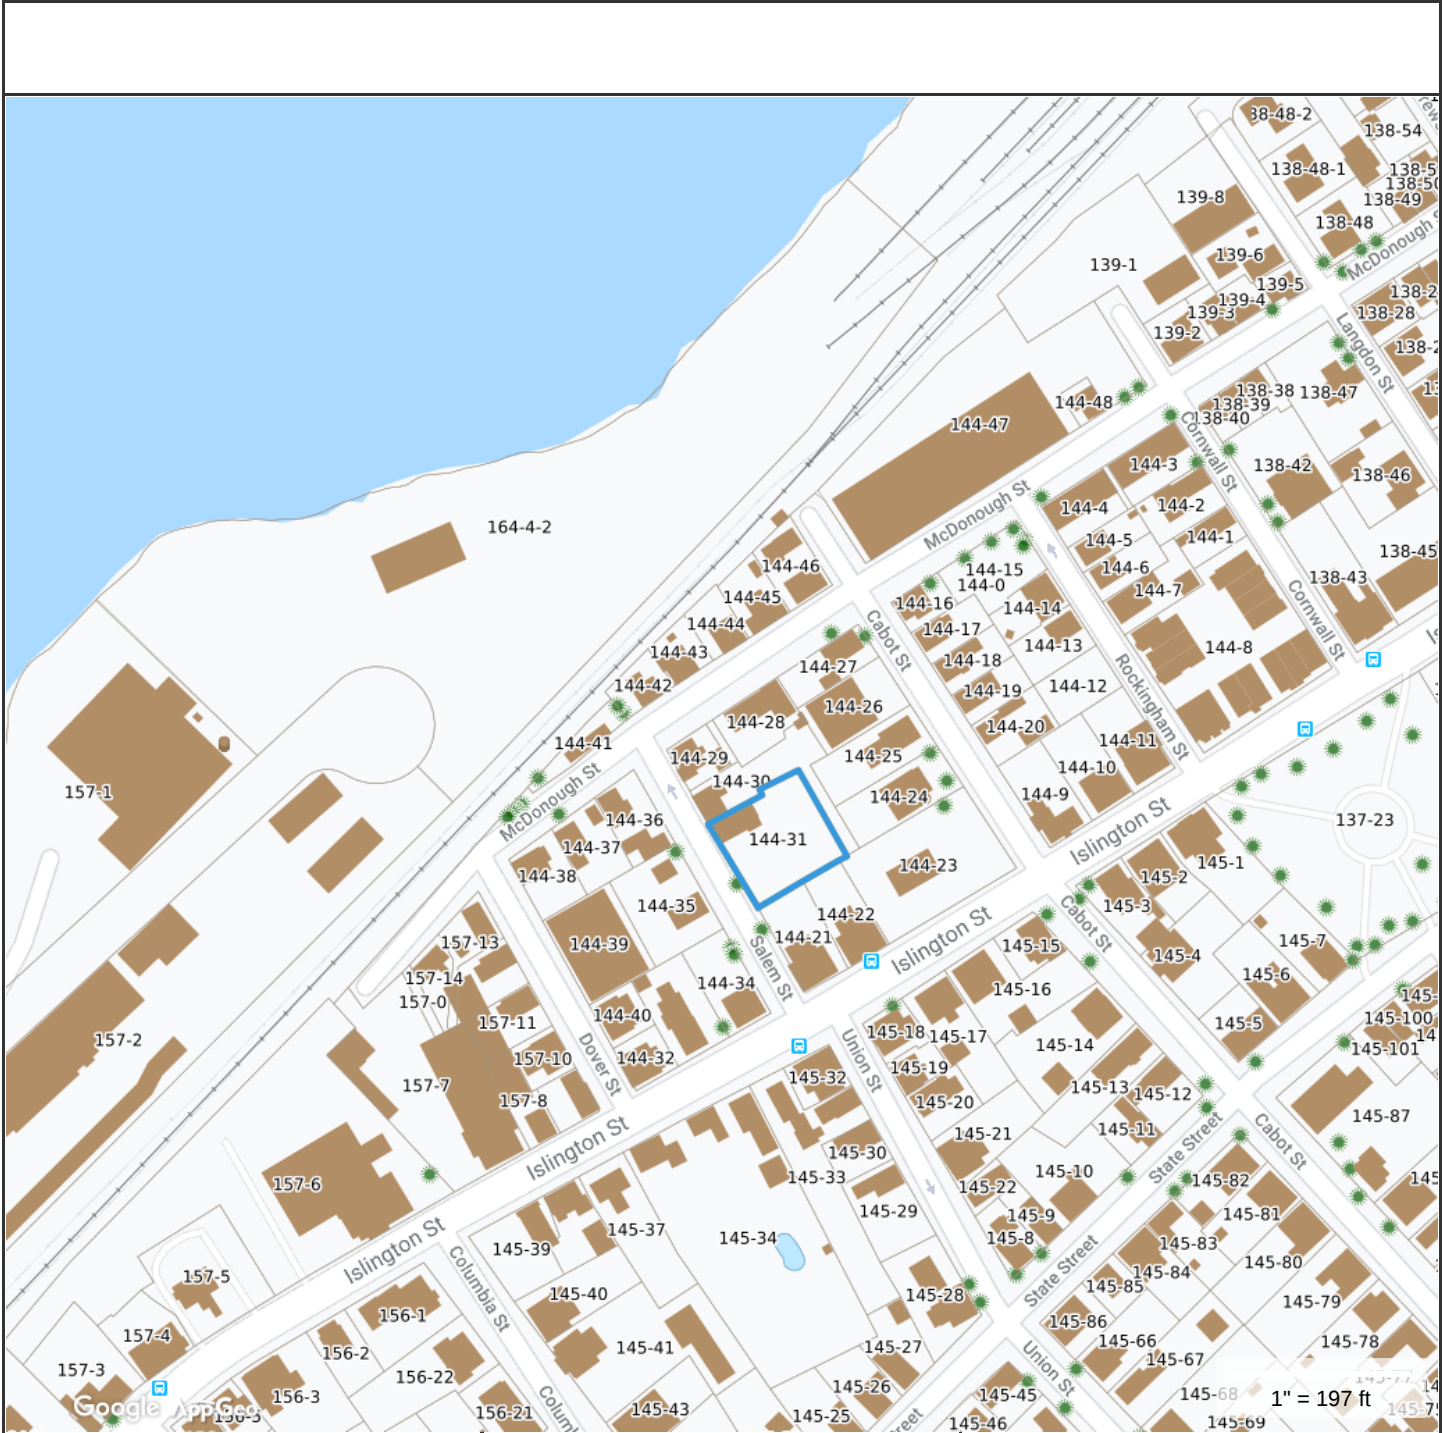

Property Information

Property ID 0144-0031-0000
Location 41 SALEM ST
Owner BONZA BUILDERS LLC



**MAP FOR REFERENCE ONLY
NOT A LEGAL DOCUMENT**

City of Portsmouth, NH makes no claims and no warranties, expressed or implied, concerning the validity or accuracy of the GIS data presented on this map.

Geometry updated 4/1/2019
Data updated 7/17/2019

APPENDIX B
TABLES, CHARTS, ETC.

Extreme Precipitation Tables

Northeast Regional Climate Center

Data represents point estimates calculated from partial duration series. All precipitation amounts are displayed in inches.

Smoothing	No
State	New Hampshire
Location	
Longitude	70.770 degrees West
Latitude	43.069 degrees North
Elevation	0 feet
Date/Time	Tue, 17 Apr 2018 15:07:43 -0400

Inches of Rain - 24 HR Event

2 YR = 3.21 x 15% = 3.69
 10 YR = 4.87 x 15% = 5.60
 25 YR = 6.17 x 15% = 7.10
 50 Yr = 7.39 x 15% = 8.50

Extreme Precipitation Estimates

	5min	10min	15min	30min	60min	120min		1hr	2hr	3hr	6hr	12hr	24hr	48hr		1day	2day	4day	7day	10day	
1yr	0.26	0.40	0.49	0.66	0.81	1.00	1yr	0.70	0.98	1.14	1.57	2.01	2.66	2.92	1yr	2.35	2.81	3.22	3.94	4.55	1yr
2yr	0.32	0.50	0.61	0.83	1.02	1.21	2yr	0.88	1.18	1.40	1.87	2.40	3.21	3.57	2yr	2.84	3.43	3.94	4.68	5.33	2yr
5yr	0.37	0.58	0.71	0.98	1.25	1.50	5yr	1.08	1.47	1.73	2.32	2.96	4.07	4.58	5yr	3.60	4.40	5.04	5.94	6.70	5yr
10yr	0.42	0.65	0.80	1.12	1.45	1.76	10yr	1.25	1.72	2.04	2.72	3.47	4.87	5.53	10yr	4.31	5.32	6.08	7.11	7.98	10yr
25yr	0.50	0.76	0.94	1.35	1.77	2.19	25yr	1.53	2.14	2.53	3.38	4.28	6.17	7.10	25yr	5.46	6.83	7.80	9.02	10.05	25yr
50yr	0.56	0.86	1.07	1.54	2.07	2.58	50yr	1.78	2.52	2.98	3.99	5.02	7.39	8.58	50yr	6.54	8.25	9.42	10.81	11.98	50yr
100yr	0.64	0.97	1.22	1.76	2.41	3.04	100yr	2.08	2.97	3.51	4.70	5.89	8.85	10.38	100yr	7.84	9.98	11.38	12.96	14.28	100yr
200yr	0.73	1.10	1.40	2.02	2.82	3.59	200yr	2.43	3.51	4.14	5.55	6.91	10.61	12.55	200yr	9.39	12.07	13.75	15.55	17.03	200yr
500yr	0.88	1.30	1.68	2.44	3.47	4.47	500yr	2.99	4.37	5.14	6.90	8.55	13.49	16.15	500yr	11.93	15.53	17.67	19.78	21.50	500yr

Lower Confidence Limits

	5min	10min	15min	30min	60min	120min		1hr	2hr	3hr	6hr	12hr	24hr	48hr		1day	2day	4day	7day	10day	
1yr	0.23	0.36	0.44	0.59	0.73	0.88	1yr	0.63	0.86	0.92	1.33	1.68	2.23	2.50	1yr	1.98	2.40	2.86	3.17	3.89	1yr
2yr	0.31	0.49	0.60	0.81	1.00	1.19	2yr	0.86	1.16	1.37	1.82	2.34	3.06	3.45	2yr	2.71	3.32	3.82	4.55	5.08	2yr
5yr	0.35	0.54	0.67	0.92	1.17	1.40	5yr	1.01	1.37	1.61	2.12	2.73	3.79	4.19	5yr	3.35	4.03	4.72	5.54	6.24	5yr
10yr	0.39	0.59	0.73	1.03	1.32	1.60	10yr	1.14	1.56	1.81	2.39	3.06	4.37	4.87	10yr	3.87	4.68	5.45	6.42	7.20	10yr
25yr	0.44	0.67	0.83	1.19	1.56	1.90	25yr	1.35	1.86	2.10	2.76	3.54	4.71	5.90	25yr	4.17	5.68	6.66	7.80	8.69	25yr
50yr	0.48	0.73	0.91	1.31	1.77	2.17	50yr	1.52	2.12	2.35	3.08	3.94	5.32	6.82	50yr	4.71	6.56	7.74	9.06	10.03	50yr
100yr	0.54	0.81	1.01	1.47	2.01	2.47	100yr	1.74	2.41	2.63	3.42	4.36	5.98	7.87	100yr	5.29	7.57	9.00	10.53	11.58	100yr
200yr	0.59	0.89	1.13	1.63	2.28	2.82	200yr	1.97	2.75	2.93	3.79	4.80	6.70	9.09	200yr	5.93	8.74	10.46	12.25	13.39	200yr
500yr	0.69	1.02	1.31	1.91	2.71	3.37	500yr	2.34	3.29	3.41	4.33	5.47	7.79	10.98	500yr	6.89	10.56	12.75	14.99	16.21	500yr

Upper Confidence Limits

	5min	10min	15min	30min	60min	120min		1hr	2hr	3hr	6hr	12hr	24hr	48hr		1day	2day	4day	7day	10day	
1yr	0.28	0.44	0.54	0.72	0.89	1.08	1yr	0.77	1.06	1.26	1.74	2.21	2.99	3.16	1yr	2.64	3.04	3.58	4.38	5.05	1yr
2yr	0.34	0.52	0.64	0.86	1.07	1.27	2yr	0.92	1.24	1.48	1.96	2.51	3.43	3.70	2yr	3.03	3.56	4.09	4.84	5.63	2yr
5yr	0.40	0.62	0.76	1.05	1.34	1.62	5yr	1.15	1.58	1.88	2.53	3.25	4.34	4.96	5yr	3.84	4.77	5.38	6.37	7.15	5yr
10yr	0.47	0.72	0.89	1.24	1.61	1.97	10yr	1.39	1.93	2.28	3.10	3.95	5.34	6.19	10yr	4.72	5.96	6.81	7.83	8.74	10yr
25yr	0.57	0.87	1.09	1.55	2.04	2.56	25yr	1.76	2.51	2.95	4.07	5.14	7.79	8.33	25yr	6.90	8.01	9.13	10.33	11.40	25yr
50yr	0.67	1.02	1.27	1.82	2.45	3.12	50yr	2.12	3.05	3.59	4.99	6.30	9.76	10.44	50yr	8.64	10.03	11.41	12.71	13.95	50yr
100yr	0.79	1.19	1.49	2.15	2.95	3.80	100yr	2.55	3.72	4.37	6.15	7.74	12.22	13.07	100yr	10.81	12.57	14.25	15.67	17.07	100yr
200yr	0.92	1.39	1.76	2.54	3.55	4.64	200yr	3.06	4.54	5.33	7.57	9.50	15.33	16.40	200yr	13.57	15.77	17.84	19.31	20.90	200yr
500yr	1.14	1.70	2.19	3.18	4.52	6.02	500yr	3.90	5.88	6.91	10.00	12.50	20.72	22.13	500yr	18.34	21.28	24.00	25.46	27.31	500yr

SCS METHODS

Technical Release - 55 Urban Hydrology for Small Watersheds

TR-55 presents simplified procedures to calculate storm runoff volume, peak rate of discharge, partial hydrographs and storage volumes for water control structures. The procedures are applicable to small watersheds, especially urbanizing watersheds with time of concentration between 0.1 hours and 10.0 hours. TR-55 is an approximation of the more detailed TR-20 method and does not have TR-20's capability to flood route. The user should examine the sensitivity of the analysis being conducted to ensure that the degree of error is tolerable. TR-55 contains two methods, the Tabular Hydrograph method and the Graphical Peak Discharge method. The accuracy of both methods is comparable; they differ only in their output. Both methods are based on open and unconfined flow over land and in channels.

The TR-55 Tabular Method can develop partial composite flood hydrographs at any point in a watershed by dividing the watershed into homogeneous subareas. By doing this, the method can estimate runoff from a larger nonhomogeneous watershed. The method is especially applicable for estimating the effects of land use change in a portion of a watershed. It can also be used to estimate the effects of proposed structures. The TR-55 Graphical Peak Discharge method calculates peak discharge using an assumed unit hydrograph and a thorough, but rapid, evaluation of the soils, slope, and surface cover characteristics of the watershed. This method is recommended for use in the design of all erosion and sediment control measures and simple stormwater management practices. When more detail and accuracy are required or when an accurate simulation of natural conditions is required, one of the other appropriate methods should be used. The TR-55 Graphical Peak Discharge method is the method that is discussed in this manual.

SCS TR-55 Graphical Peak Discharge Method

The peak discharge equation used in this method is:

$$q_p = q_u A_m Q F_p$$

where:

q_p is the peak discharge in cubic feet per second (cfs).

q_u is the unit peak discharge in cubic feet per second per square mile per inch of runoff (csm/in).

A_m is the drainage area in square miles.

Q is the runoff from the watershed in inches.

F_p is a pond and swamp adjustment factor that can be applied for ponds or swamps that are spread throughout the watershed and not in the time of concentration flow path.

Technical Release-20 Computer Program for Project Formulation Hydrology

The TR-20 computer program assists the engineer in hydrologic evaluation of flood events for use in analysis of water resource projects. The program is a single event model which computes direct runoff resulting from any natural or synthetic rainstorm. It develops flood hydrographs from runoff and routes the flow through stream channels and reservoirs. It combines the routed hydrograph with those from tributaries and computes the peak discharges, their times of occurrence and the water surface elevations at any desired cross section or structure. The program provides for the analysis of up to nine different rainstorm distributions over a watershed under various combinations of land treatment. The analysis can be performed on as many as 200 reaches and 99 structures in any one continuous run. The procedure should probably not be used for subarea drainage areas less than 5 acres nor more than 20 square miles.

Input Data Required

The following information is required to use TR-20:

Drainage Area - The drainage area of each subwatershed in square miles.

Runoff Curve Number - A factor that relates mass rainfall to mass runoff. It is based on soil characteristics, cover type, and land treatment. Tables 6-4.1 - 6-4.3 provides runoff curve numbers for urban areas and agricultural areas.

Time of Concentration - The time which would be required for the surface runoff from the hydraulically most remote part of the drainage area to reach the point being evaluated. A more detailed discussion of time of concentration is found later in this chapter.

Reach Length - The length of the stream or valley in feet selected for generally constant hydraulic characteristics for use in the study. A watershed may have several reaches in the flow path.

Cross Section Information - This information consists of either surveyed valley and channel sections with appropriate Manning's "n" values or "x" and "m" discharge coefficient values obtained from nomographs in the TR-20 documentation for the valley and channel reach.

Rainfall Data - The average depth, in inches, of rainfall occurring over a watershed or subwatershed for a given design frequency and duration storm event.

Structural Data - Information on any culverts, bridges, or reservoirs in the watershed that includes elevations, discharges, and storage behind the structures.

Output Data

The type and amount of output can be controlled by options within the program. In general the output data will provide estimates of peak flow, hydrographs, peak times, runoff volumes, and water surface elevations at any location within the watershed.

Runoff Curve Number (RCN)

The runoff curve number is a factor that relates mass rainfall to mass runoff. It is based on soil characteristics, cover type, hydrologic condition, and land treatment. Tables 6-4.1 through 6-4.3 provide runoff curve numbers for urban areas, cultivated agricultural areas, and other agricultural areas for various hydrologic conditions

Cover type relates to the kind of cover found on the soil such as vegetation, bare soil, and impervious surfaces such as parking areas, roofs, streets, and roads.

Hydrologic condition indicates the effects of cover type and treatment on infiltration and runoff rates. It is generally estimated from the density of plant and crop residue on the area. Good hydrologic condition indicates that the soil usually has low runoff potential for that specific hydrologic soil group, cover type and treatment. Some factors to consider in estimating the effect of cover on infiltration and runoff are: canopy or density of leaves, amount of year-round cover, amount of grass or close-seeded legumes in a rotation, percent of residue cover, and the degree of surface roughness.

Treatment is a cover type modifier used to describe the management of cultivated agricultural lands. It includes mechanical practices such as contouring and terracing, and management practices, such as crop rotations and reduced or no tillage.

TABLE 6-4.1 -- RUNOFF CURVE NUMBERS (Average Watershed Condition)

COVER DESCRIPTION	CURVE NUMBERS FOR HYDROLOGIC SOIL GROUP			
	A	B	C	D
	Average percent impervious area ²			
<u>FULLY DEVELOPED URBAN AREAS¹</u> (Vegetation Established)				
Lawns, open spaces, parks, golf courses, cemeteries, etc. good condition; grass cover on 75% or more of the area	39	61	74	80
fair condition; grass cover on 50% to 75% of the area	49	69	79	84
poor condition; grass cover on 50% or less of the area	68	79	86	89
Paved parking lots, roofs, driveways, etc. streets and roads; paved with curbs and storm sewers	98	98	98	98
gravel	98	98	98	98
dirt	76	85	89	91
paved with open ditches	72	82	87	89
	83	89	92	93
Commercial and business areas	89	92	94	95
Industrial districts	81	88	91	93
Row houses, town houses, and residential with lot sizes 1/8 acre or less	77	85	90	92
<u>Residential</u>				
Average lot size				
1/4 acre	61	75	83	87
1/3 acre	57	72	81	86
1/2 acre	54	70	80	85
1 acre	51	68	79	84
2 acre	46	65	77	82
<u>DEVELOPING URBAN AREAS³</u> (No vegetation Established)				
Newly graded area	77	86	91	94

1. For land uses with impervious areas, curve numbers are computed assuming that 100% of runoff from impervious areas is directly connected to the drainage system. Pervious areas (lawn) are considered to be equivalent to lawns in good condition and the impervious areas have an RCN of 98.

2. Includes paved streets.

3. Use for the design of temporary measures during grading and construction. Impervious area percent for urban areas under development vary considerably. The user will determine the percent impervious. Then using the newly graded area RCN and Table 6-4, the composite RCN can be computed for any degree of development.

Source: USDA Soil Conservation Service

TABLE 6-4.2 -- RUNOFF CURVE NUMBERS (Average Watershed Condition)

COVER DESCRIPTION	CURVE NUMBERS FOR HYDROLOGIC SOIL GROUP			
	A	B	C	D
COVER TYPE AND HYDROLOGIC CONDITION	Hydrologic condition ⁴			
CULTIVATED AGRICULTURAL LAND				
Fallow	77 76 74	86 85 83	91 90 88	94 93 90
Bare soil				
Crop residue cover (CR)				
Row crops	72	81	88	91
Straight row (SR)	67	78	85	89
SR & CR	71	80	87	90
SR & CR	64	75	82	85
Contoured (C)	70	79	84	88
C	65	75	82	86
C & CR	69	78	83	87
C & CR	64	74	81	85
Contoured & Terraces (C&T)	66	74	80	82
C&T	62	71	78	81
C&T & CR	65	73	79	81
C&T & CR	61	70	77	80
Small grain	65	76	84	88
SR	63	75	83	87
SR & CR	64	75	83	86
SR & CR	60	72	80	84
C	63	74	82	85
C	61	73	81	84
C & CR	62	73	81	84
C & CR	60	72	80	83
C&T	61	72	79	82
C&T	59	70	78	81
C&T & CR	60	71	78	81
C&T & CR	58	69	77	80
Close-seeded	66	77	85	89
Legumes or	58	72	81	85
Rotation	64	75	83	85
Meadow ⁵	55	69	78	83
C&T	63	73	80	83
C&T	51	67	76	80

4. For conservation tillage poor hydrologic condition, 5 to 20 percent of the surface is covered with residue (less than 750 #/acre row crops or 300#/acre small grain).
 For conservation tillage good hydrologic condition, more than 20 percent of the surface is covered with residue (greater than 750 #/acre row crops or 300 #/acre small grain).

5. Close-drilled or broadcast.

Source: USDA Soil Conservation Service

TABLE 6-4.3 -- RUNOFF CURVE NUMBERS (Average Watershed Condition)

COVER DESCRIPTION Cover type and hydrologic condition	CURVE NUMBERS FOR HYDROLOGIC SOIL GROUP			
	A	B	C	D
<u>NON-CULTIVATED AGRICULTURAL LAND</u>				
Pasture, grassland, or range - continuous forage for grazing	68	79	86	89
	49	69	79	84
	39	61	74	80
Meadow - continuous grass, protected from grazing and generally mowed for hay	---	58	71	78
	---	---	---	---
Woods-grass combination (orchard or tree farm)	57	73	82	86
	43	65	76	82
	32	58	72	79
Brush - brush-weed-grass mixture with brush the major element	48	67	77	83
	35	56	70	77
	30	48	65	73
Woods	45	66	77	83
	36	60	75	79
	30	55	70	77
Farmsteads - buildings, lanes, driveways, and surrounding lots	59	74	82	86
	---	---	---	---


Hydrologic condition⁶

6. Poor hydrologic condition has less than 50 percent ground cover density.
 Fair hydrologic condition has between 50 and 75 percent ground cover density.
 Good hydrologic condition has more than 75 percent ground cover density.



APPENDIX C
HYDROCAD DRAINAGE
ANALYSIS CALCULATIONS



CB at corner of Cabot Street and McDonough Street



Off Site



3082 Pre-construction

Prepared by Ambit Engineering, Inc.

HydroCAD® 10.00 s/n 00801 © 2013 HydroCAD Software Solutions LLC

Printed 3/16/2020

Page 2

Area Listing (selected nodes)

Area (sq-ft)	CN	Description (subcatchment-numbers)
14,003	61	>75% Grass cover, Good, HSG B (ES1, OS1)
650	98	Paved parking, HSG B (ES1)
1,000	98	Roofs, HSG B (ES1)
13,838	98	Unconnected roofs, HSG B (OS1)
29,491	80	TOTAL AREA

3082 Pre-construction

Prepared by Ambit Engineering, Inc.

HydroCAD® 10.00 s/n 00801 © 2013 HydroCAD Software Solutions LLC

Printed 3/16/2020

Page 3

Soil Listing (selected nodes)

Area (sq-ft)	Soil Group	Subcatchment Numbers
0	HSG A	
29,491	HSG B	ES1, OS1
0	HSG C	
0	HSG D	
0	Other	
29,491		TOTAL AREA

3082 Pre-construction

Prepared by Ambit Engineering, Inc.

HydroCAD® 10.00 s/n 00801 © 2013 HydroCAD Software Solutions LLC

Printed 3/16/2020

Page 4

Ground Covers (selected nodes)

HSG-A (sq-ft)	HSG-B (sq-ft)	HSG-C (sq-ft)	HSG-D (sq-ft)	Other (sq-ft)	Total (sq-ft)	Ground Cover	Sub Num
0	14,003	0	0	0	14,003	>75% Grass cover, Good	
0	650	0	0	0	650	Paved parking	
0	1,000	0	0	0	1,000	Roofs	
0	13,838	0	0	0	13,838	Unconnected roofs	
0	29,491	0	0	0	29,491	TOTAL AREA	

3082 Pre-construction

Type III 24-hr 2 Year Storm Rainfall=3.69"

Prepared by Ambit Engineering, Inc.

Printed 3/16/2020

HydroCAD® 10.00 s/n 00801 © 2013 HydroCAD Software Solutions LLC

Page 5

Time span=0.00-30.00 hrs, dt=0.06 hrs, 501 points x 5
Runoff by SCS TR-20 method, UH=SCS, Weighted-CN
Reach routing by Dyn-Stor-Ind method - Pond routing by Dyn-Stor-Ind method

Subcatchment ES1: Runoff Area=10,903 sf 15.13% Impervious Runoff Depth=0.96"
Flow Length=515' Tc=5.5 min CN=67 Runoff=0.24 cfs 871 cf

Subcatchment OS1: Off Site Runoff Area=18,588 sf 74.45% Impervious Runoff Depth=2.53"
Flow Length=722' Tc=10.6 min CN=89 Runoff=1.06 cfs 3,924 cf

Pond DP2: CB at corner of Cabot Street and McDonough Street Inflow=1.29 cfs 4,795 cf
Primary=1.29 cfs 4,795 cf

Link DP1: Inflow=1.29 cfs 4,795 cf
Primary=1.29 cfs 4,795 cf

Total Runoff Area = 29,491 sf Runoff Volume = 4,795 cf Average Runoff Depth = 1.95"
47.48% Pervious = 14,003 sf 52.52% Impervious = 15,488 sf

3082 Pre-construction

Type III 24-hr 2 Year Storm Rainfall=3.69"

Prepared by Ambit Engineering, Inc.

Printed 3/16/2020

HydroCAD® 10.00 s/n 00801 © 2013 HydroCAD Software Solutions LLC

Page 6

Summary for Subcatchment ES1:

Runoff = 0.24 cfs @ 12.10 hrs, Volume= 871 cf, Depth= 0.96"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-30.00 hrs, dt= 0.06 hrs
Type III 24-hr 2 Year Storm Rainfall=3.69"

Area (sf)	CN	Description
9,253	61	>75% Grass cover, Good, HSG B
1,000	98	Roofs, HSG B
650	98	Paved parking, HSG B
10,903	67	Weighted Average
9,253	61	84.87% Pervious Area
1,650	98	15.13% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
4.0	305	0.0328	1.27		Shallow Concentrated Flow, Short Grass Pasture Kv= 7.0 fps
1.5	210	0.0130	2.31		Shallow Concentrated Flow, Paved Kv= 20.3 fps
5.5	515	Total			

Subcatchment ES1:

Hydrograph

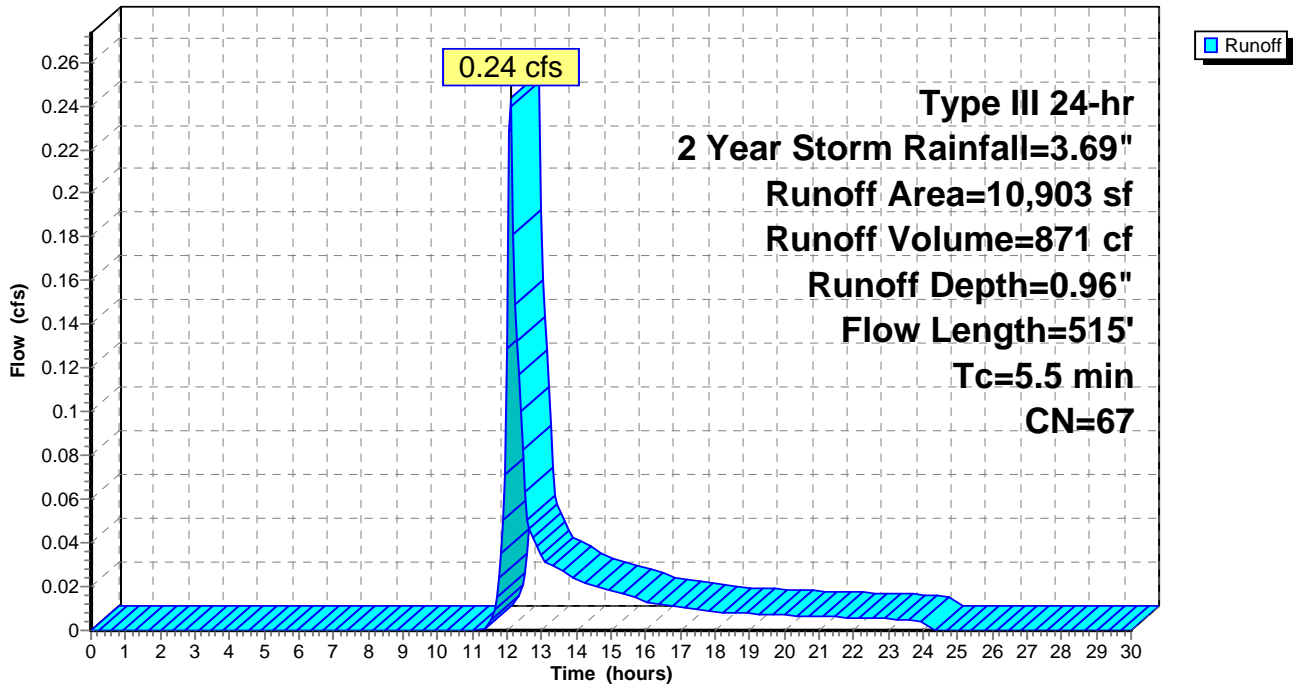

3082 Pre-construction

Type III 24-hr 2 Year Storm Rainfall=3.69"

Prepared by Ambit Engineering, Inc.

Printed 3/16/2020

HydroCAD® 10.00 s/n 00801 © 2013 HydroCAD Software Solutions LLC

Page 7

Summary for Subcatchment OS1: Off Site


Runoff = 1.06 cfs @ 12.15 hrs, Volume= 3,924 cf, Depth= 2.53"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-30.00 hrs, dt= 0.06 hrs
Type III 24-hr 2 Year Storm Rainfall=3.69"

Area (sf)	CN	Description
13,838	98	Unconnected roofs, HSG B
4,750	61	>75% Grass cover, Good, HSG B
18,588	89	Weighted Average
4,750	61	25.55% Pervious Area
13,838	98	74.45% Impervious Area
13,838		100.00% Unconnected

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
1.8	119	0.0252	1.11		Shallow Concentrated Flow, Short Grass Pasture Kv= 7.0 fps
2.8	42	0.0833	0.25		Sheet Flow, Grass: Short n= 0.150 P2= 3.21"
0.5	46	0.0326	1.43		Sheet Flow, Smooth surfaces n= 0.011 P2= 3.21"
4.0	305	0.0328	1.27		Shallow Concentrated Flow, Short Grass Pasture Kv= 7.0 fps
1.5	210	0.0130	2.31		Shallow Concentrated Flow, Paved Kv= 20.3 fps
10.6	722	Total			

Subcatchment OS1: Off Site

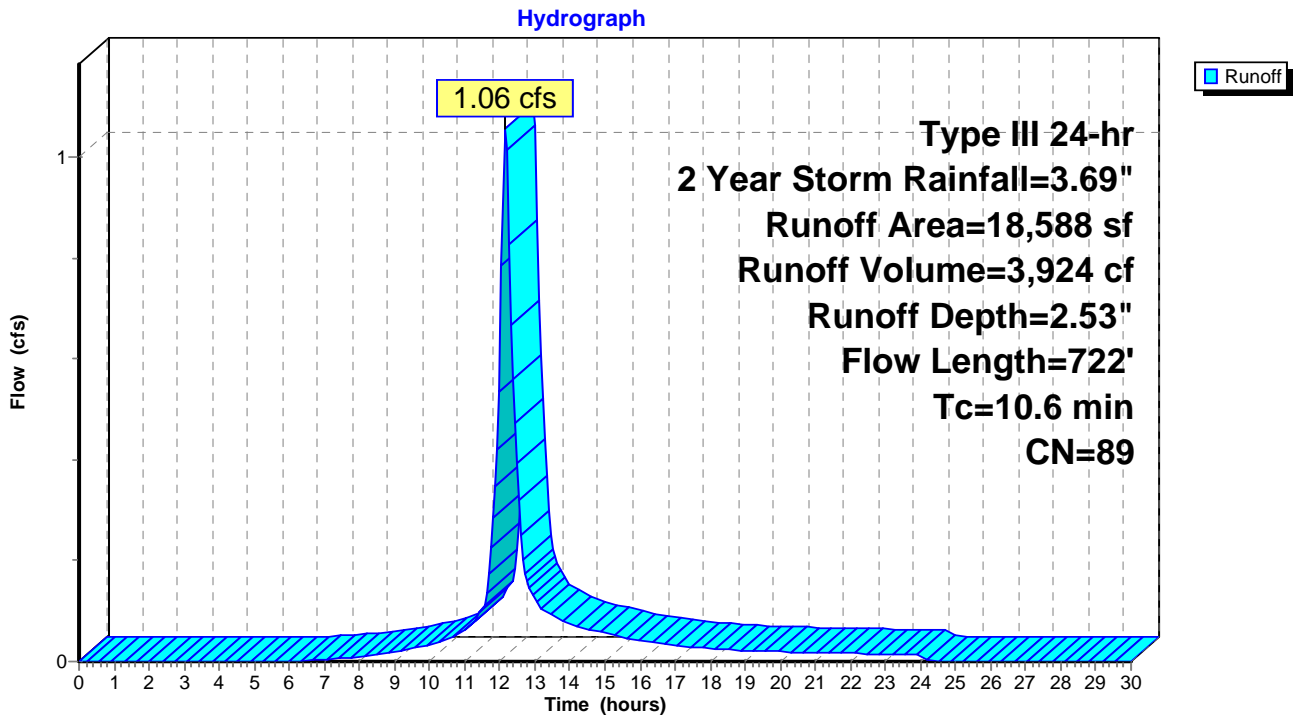


Summary for Pond DP2: CB at corner of Cabot Street and McDonough Street

Inflow Area = 29,491 sf, 52.52% Impervious, Inflow Depth = 1.95" for 2 Year Storm event
Inflow = 1.29 cfs @ 12.14 hrs, Volume= 4,795 cf
Primary = 1.29 cfs @ 12.14 hrs, Volume= 4,795 cf, Atten= 0%, Lag= 0.0 min

Routing by Dyn-Stor-Ind method, Time Span= 0.00-30.00 hrs, dt= 0.06 hrs / 5

Pond DP2: CB at corner of Cabot Street and McDonough Street

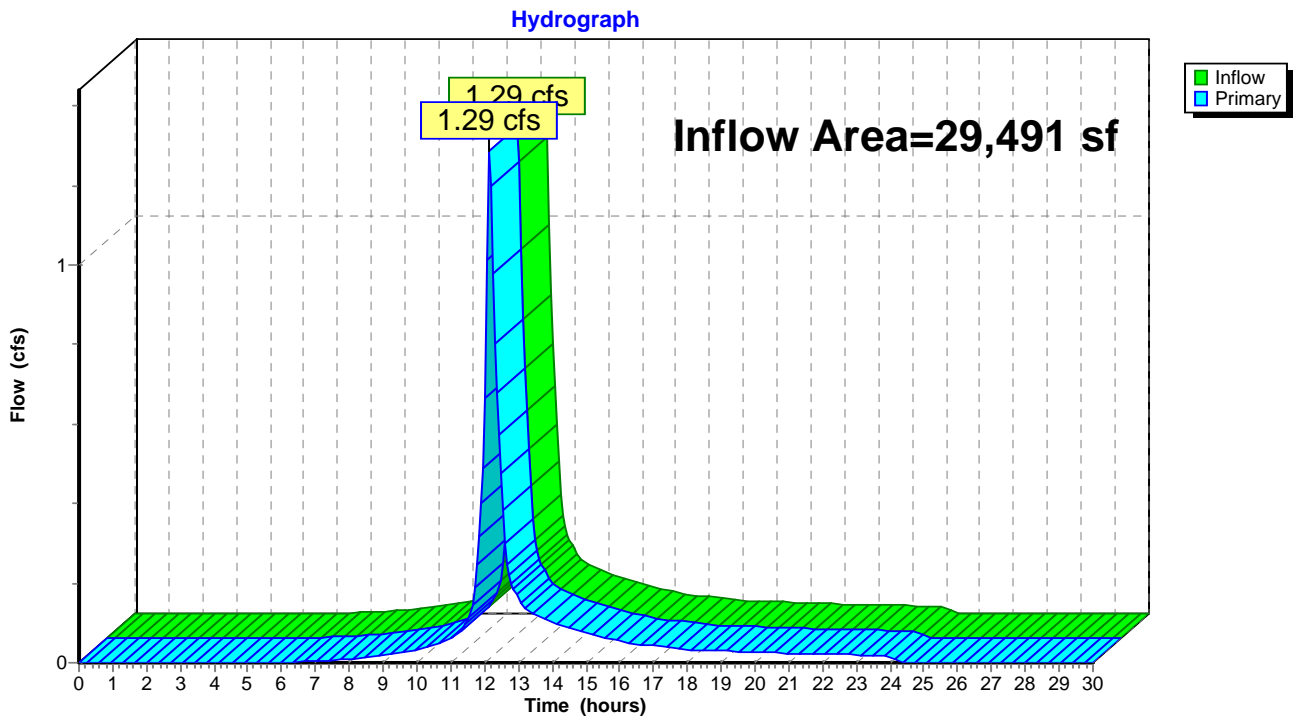


Summary for Link DP1:

Inflow Area = 29,491 sf, 52.52% Impervious, Inflow Depth = 1.95" for 2 Year Storm event
Inflow = 1.29 cfs @ 12.14 hrs, Volume= 4,795 cf
Primary = 1.29 cfs @ 12.14 hrs, Volume= 4,795 cf, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-30.00 hrs, dt= 0.06 hrs

Link DP1:

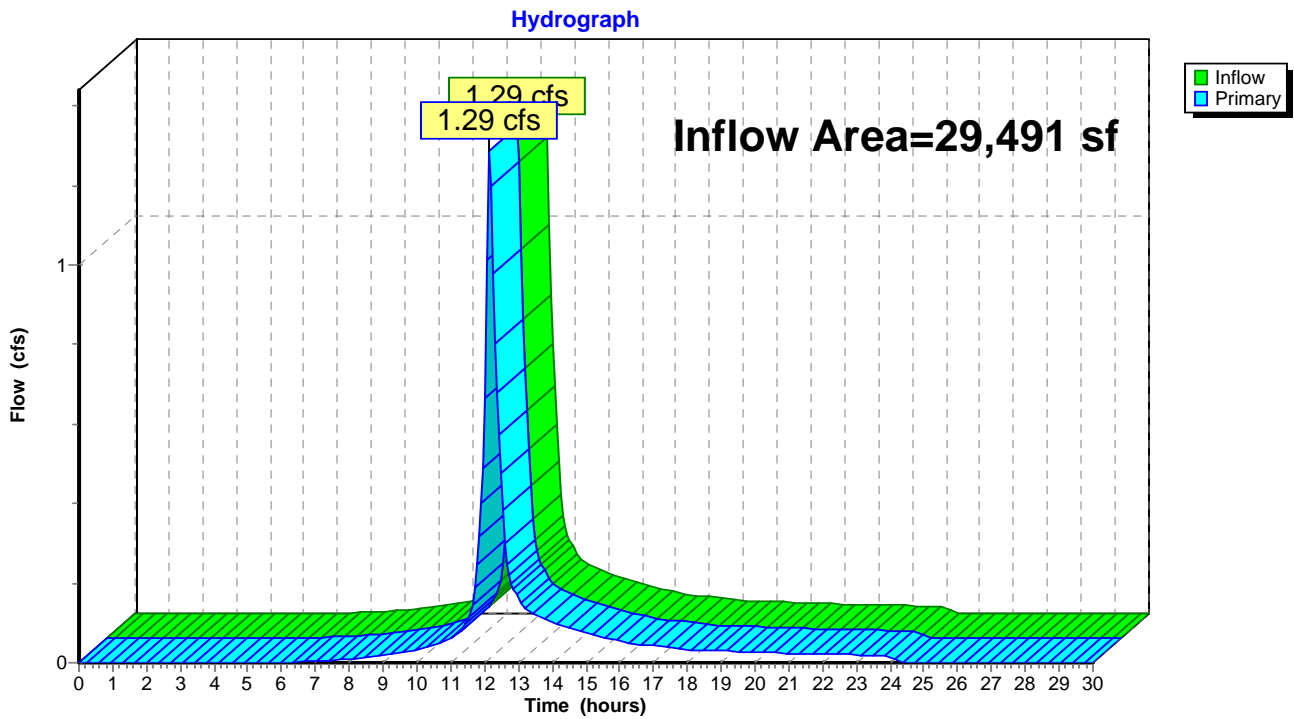

3082 Pre-construction

Type III 24-hr 10 Year Storm Rainfall=5.60"

Prepared by Ambit Engineering, Inc.

Printed 3/16/2020

HydroCAD® 10.00 s/n 00801 © 2013 HydroCAD Software Solutions LLC

Page 11

Time span=0.00-30.00 hrs, dt=0.06 hrs, 501 points x 5
Runoff by SCS TR-20 method, UH=SCS, Weighted-CN
Reach routing by Dyn-Stor-Ind method - Pond routing by Dyn-Stor-Ind method

Subcatchment ES1:

Runoff Area=10,903 sf 15.13% Impervious Runoff Depth=2.23"
Flow Length=515' Tc=5.5 min CN=67 Runoff=0.63 cfs 2,028 cf

Subcatchment OS1: Off Site

Runoff Area=18,588 sf 74.45% Impervious Runoff Depth=4.35"
Flow Length=722' Tc=10.6 min CN=89 Runoff=1.78 cfs 6,736 cf

Pond DP2: CB at corner of Cabot Street and McDonough Street

Inflow=2.34 cfs 8,764 cf
Primary=2.34 cfs 8,764 cf

Link DP1:

Inflow=2.34 cfs 8,764 cf
Primary=2.34 cfs 8,764 cf

Total Runoff Area = 29,491 sf Runoff Volume = 8,764 cf Average Runoff Depth = 3.57"
47.48% Pervious = 14,003 sf 52.52% Impervious = 15,488 sf

3082 Pre-construction

Type III 24-hr 10 Year Storm Rainfall=5.60"

Prepared by Ambit Engineering, Inc.

Printed 3/16/2020

HydroCAD® 10.00 s/n 00801 © 2013 HydroCAD Software Solutions LLC

Page 12

Summary for Subcatchment ES1:

Runoff = 0.63 cfs @ 12.09 hrs, Volume= 2,028 cf, Depth= 2.23"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-30.00 hrs, dt= 0.06 hrs
Type III 24-hr 10 Year Storm Rainfall=5.60"

Area (sf)	CN	Description
9,253	61	>75% Grass cover, Good, HSG B
1,000	98	Roofs, HSG B
650	98	Paved parking, HSG B
10,903	67	Weighted Average
9,253	61	84.87% Pervious Area
1,650	98	15.13% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
4.0	305	0.0328	1.27		Shallow Concentrated Flow, Short Grass Pasture Kv= 7.0 fps
1.5	210	0.0130	2.31		Shallow Concentrated Flow, Paved Kv= 20.3 fps
5.5	515	Total			

Subcatchment ES1:

Hydrograph

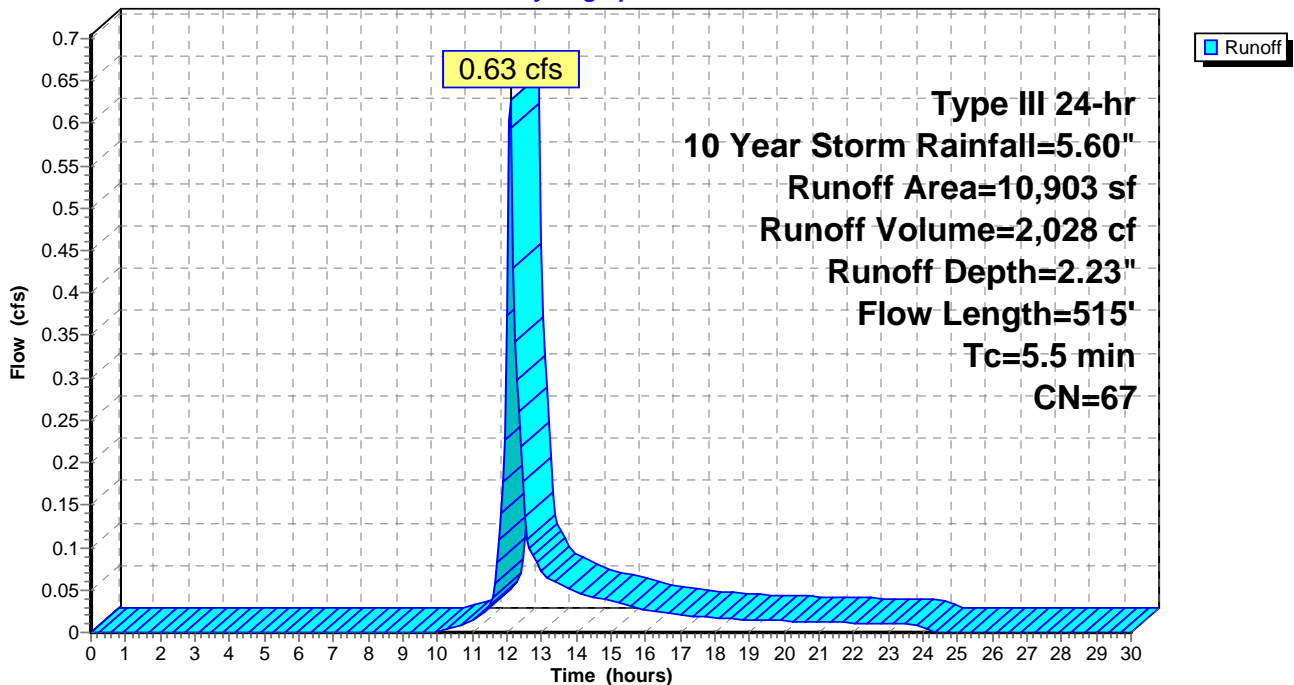

3082 Pre-construction

Type III 24-hr 10 Year Storm Rainfall=5.60"

Prepared by Ambit Engineering, Inc.

Printed 3/16/2020

HydroCAD® 10.00 s/n 00801 © 2013 HydroCAD Software Solutions LLC

Page 13

Summary for Subcatchment OS1: Off Site


Runoff = 1.78 cfs @ 12.14 hrs, Volume= 6,736 cf, Depth= 4.35"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-30.00 hrs, dt= 0.06 hrs
Type III 24-hr 10 Year Storm Rainfall=5.60"

Area (sf)	CN	Description
13,838	98	Unconnected roofs, HSG B
4,750	61	>75% Grass cover, Good, HSG B
18,588	89	Weighted Average
4,750	61	25.55% Pervious Area
13,838	98	74.45% Impervious Area
13,838		100.00% Unconnected

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
1.8	119	0.0252	1.11		Shallow Concentrated Flow, Short Grass Pasture Kv= 7.0 fps
2.8	42	0.0833	0.25		Sheet Flow, Grass: Short n= 0.150 P2= 3.21"
0.5	46	0.0326	1.43		Sheet Flow, Smooth surfaces n= 0.011 P2= 3.21"
4.0	305	0.0328	1.27		Shallow Concentrated Flow, Short Grass Pasture Kv= 7.0 fps
1.5	210	0.0130	2.31		Shallow Concentrated Flow, Paved Kv= 20.3 fps
10.6	722	Total			

Subcatchment OS1: Off Site

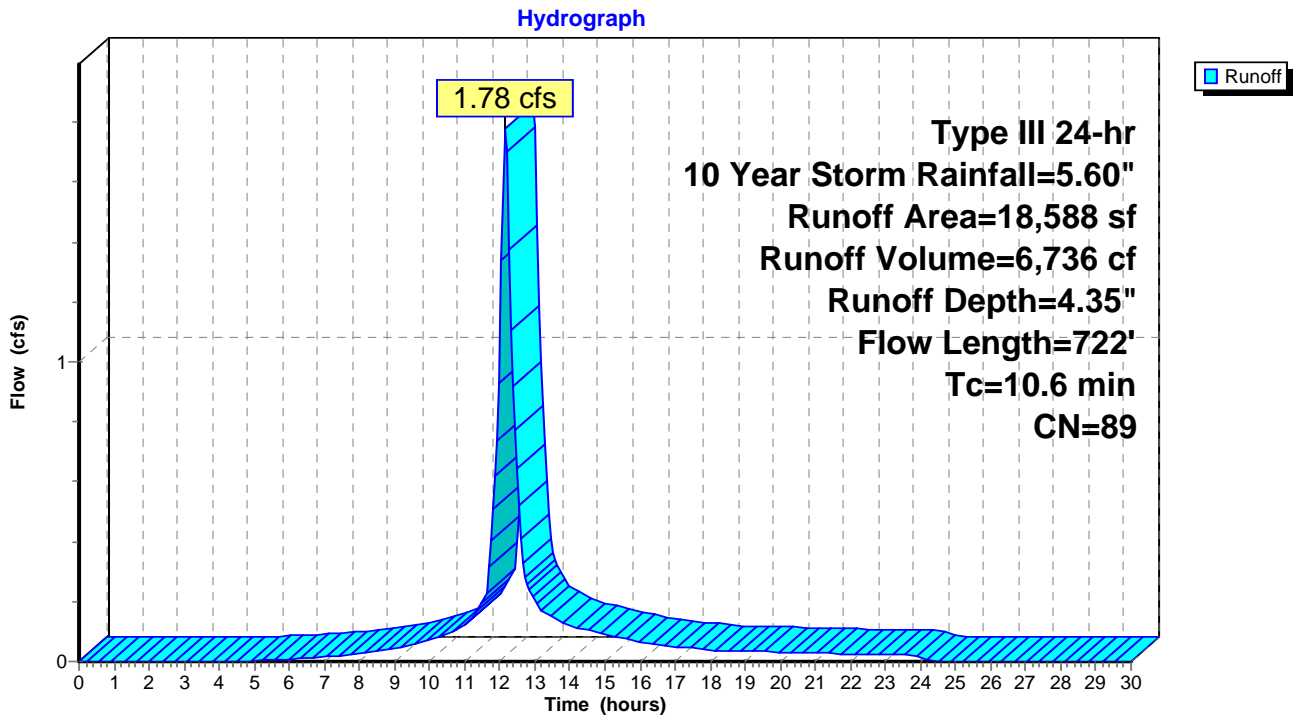


Summary for Pond DP2: CB at corner of Cabot Street and McDonough Street

Inflow Area = 29,491 sf, 52.52% Impervious, Inflow Depth = 3.57" for 10 Year Storm event
Inflow = 2.34 cfs @ 12.13 hrs, Volume= 8,764 cf
Primary = 2.34 cfs @ 12.13 hrs, Volume= 8,764 cf, Atten= 0%, Lag= 0.0 min

Routing by Dyn-Stor-Ind method, Time Span= 0.00-30.00 hrs, dt= 0.06 hrs / 5

Pond DP2: CB at corner of Cabot Street and McDonough Street

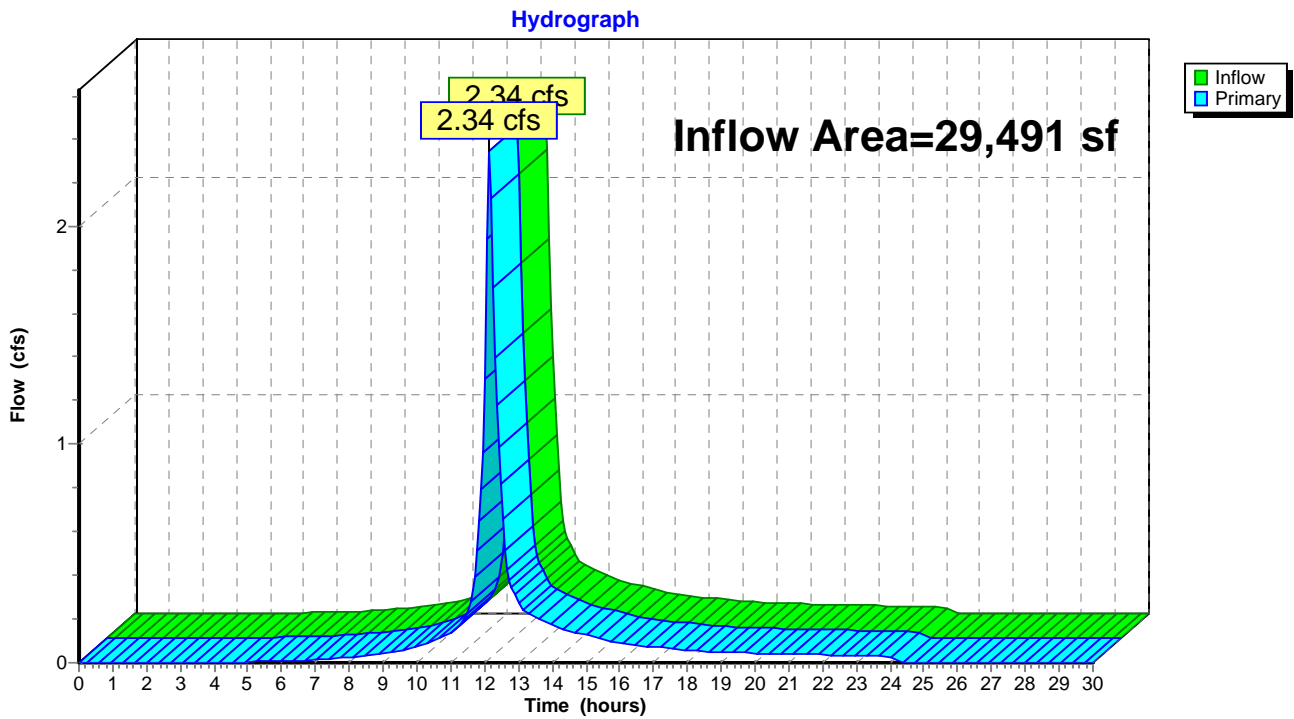


Summary for Link DP1:

Inflow Area = 29,491 sf, 52.52% Impervious, Inflow Depth = 3.57" for 10 Year Storm event
Inflow = 2.34 cfs @ 12.13 hrs, Volume= 8,764 cf
Primary = 2.34 cfs @ 12.13 hrs, Volume= 8,764 cf, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-30.00 hrs, dt= 0.06 hrs

Link DP1:

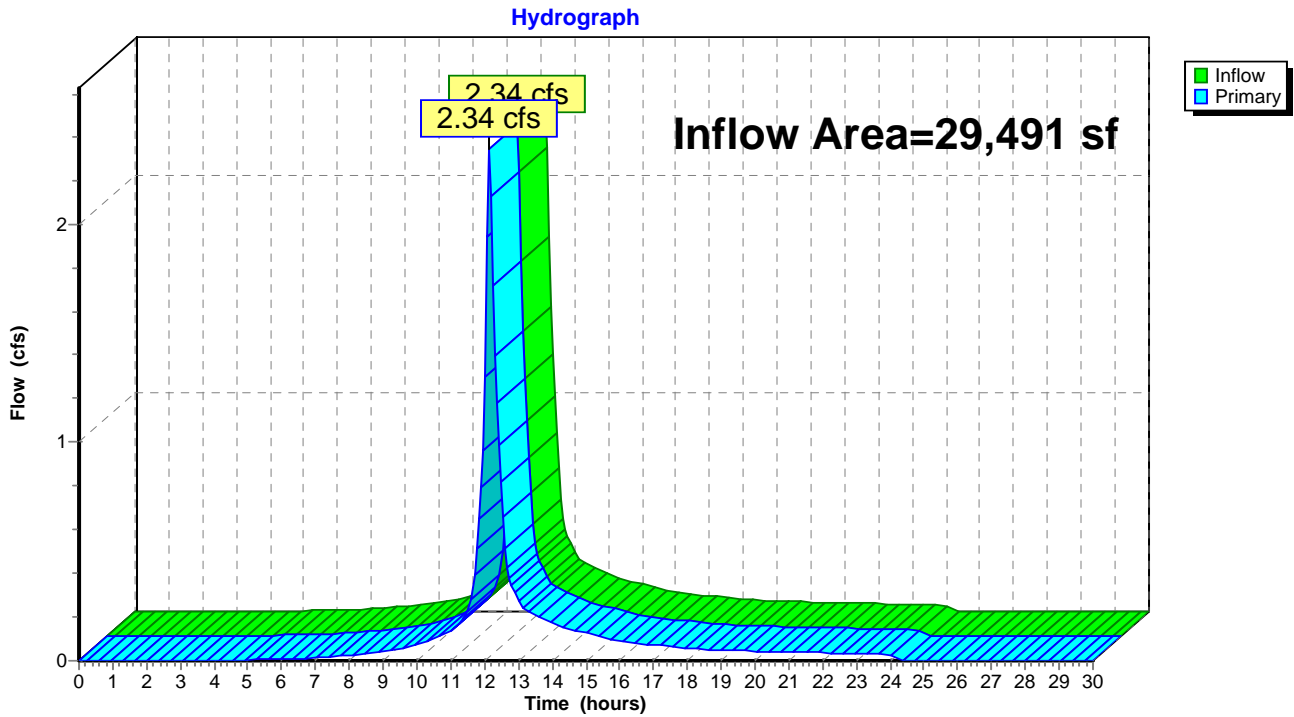

3082 Pre-construction

Type III 24-hr 25 Year Storm Rainfall=7.10"

Prepared by Ambit Engineering, Inc.

Printed 3/16/2020

HydroCAD® 10.00 s/n 00801 © 2013 HydroCAD Software Solutions LLC

Page 17

Time span=0.00-30.00 hrs, dt=0.06 hrs, 501 points x 5
Runoff by SCS TR-20 method, UH=SCS, Weighted-CN
Reach routing by Dyn-Stor-Ind method - Pond routing by Dyn-Stor-Ind method

Subcatchment ES1: Runoff Area=10,903 sf 15.13% Impervious Runoff Depth=3.39"
Flow Length=515' Tc=5.5 min CN=67 Runoff=0.97 cfs 3,077 cf

Subcatchment OS1: Off Site Runoff Area=18,588 sf 74.45% Impervious Runoff Depth=5.81"
Flow Length=722' Tc=10.6 min CN=89 Runoff=2.34 cfs 8,993 cf

Pond DP2: CB at corner of Cabot Street and McDonough Street Inflow=3.20 cfs 12,070 cf
Primary=3.20 cfs 12,070 cf

Link DP1: Inflow=3.20 cfs 12,070 cf
Primary=3.20 cfs 12,070 cf

Total Runoff Area = 29,491 sf Runoff Volume = 12,070 cf Average Runoff Depth = 4.91"
47.48% Pervious = 14,003 sf 52.52% Impervious = 15,488 sf

3082 Pre-construction

Prepared by Ambit Engineering, Inc.

HydroCAD® 10.00 s/n 00801 © 2013 HydroCAD Software Solutions LLC

Type III 24-hr 25 Year Storm Rainfall=7.10"

Printed 3/16/2020

Page 18

Summary for Subcatchment ES1:

Runoff = 0.97 cfs @ 12.08 hrs, Volume= 3,077 cf, Depth= 3.39"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-30.00 hrs, dt= 0.06 hrs
Type III 24-hr 25 Year Storm Rainfall=7.10"

Area (sf)	CN	Description
9,253	61	>75% Grass cover, Good, HSG B
1,000	98	Roofs, HSG B
650	98	Paved parking, HSG B
10,903	67	Weighted Average
9,253	61	84.87% Pervious Area
1,650	98	15.13% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
4.0	305	0.0328	1.27		Shallow Concentrated Flow, Short Grass Pasture Kv= 7.0 fps
1.5	210	0.0130	2.31		Shallow Concentrated Flow, Paved Kv= 20.3 fps
5.5	515	Total			

Subcatchment ES1:

Hydrograph

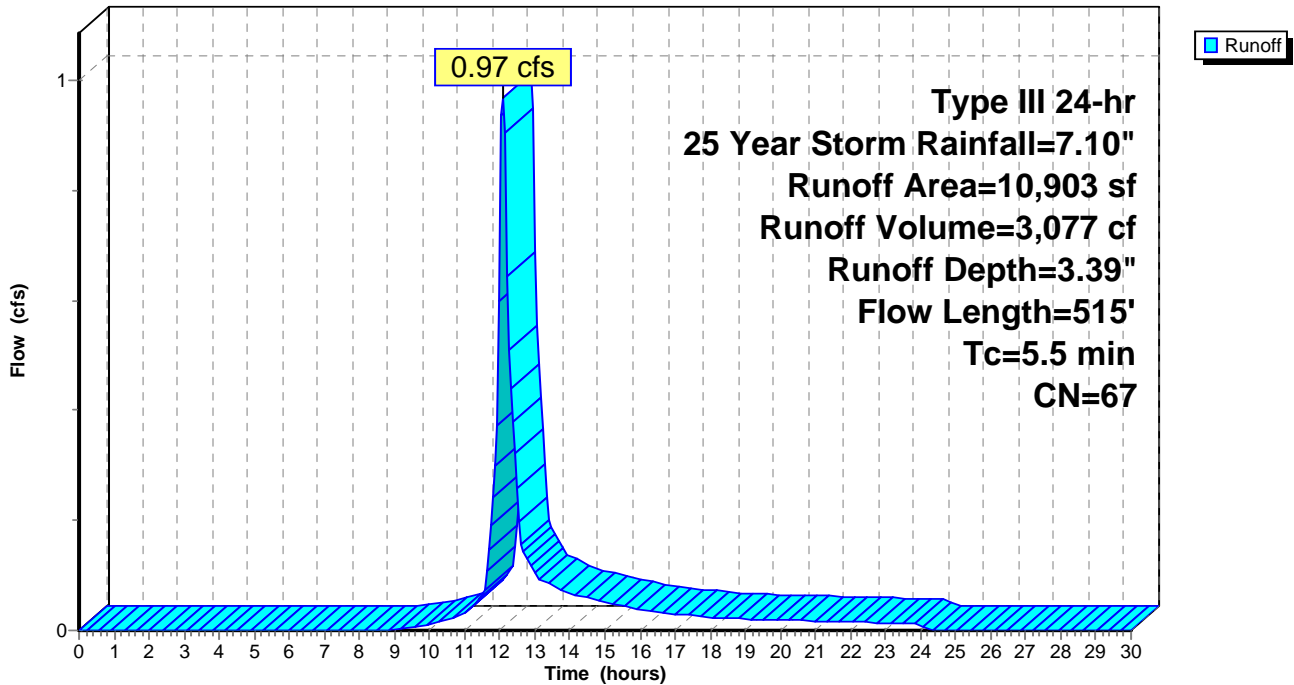

3082 Pre-construction

Type III 24-hr 25 Year Storm Rainfall=7.10"

Prepared by Ambit Engineering, Inc.

Printed 3/16/2020

HydroCAD® 10.00 s/n 00801 © 2013 HydroCAD Software Solutions LLC

Page 19

Summary for Subcatchment OS1: Off Site


Runoff = 2.34 cfs @ 12.14 hrs, Volume= 8,993 cf, Depth= 5.81"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-30.00 hrs, dt= 0.06 hrs
 Type III 24-hr 25 Year Storm Rainfall=7.10"

Area (sf)	CN	Description
13,838	98	Unconnected roofs, HSG B
4,750	61	>75% Grass cover, Good, HSG B
18,588	89	Weighted Average
4,750	61	25.55% Pervious Area
13,838	98	74.45% Impervious Area
13,838		100.00% Unconnected

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
1.8	119	0.0252	1.11		Shallow Concentrated Flow, Short Grass Pasture Kv= 7.0 fps
2.8	42	0.0833	0.25		Sheet Flow, Grass: Short n= 0.150 P2= 3.21"
0.5	46	0.0326	1.43		Sheet Flow, Smooth surfaces n= 0.011 P2= 3.21"
4.0	305	0.0328	1.27		Shallow Concentrated Flow, Short Grass Pasture Kv= 7.0 fps
1.5	210	0.0130	2.31		Shallow Concentrated Flow, Paved Kv= 20.3 fps
10.6	722	Total			

Subcatchment OS1: Off Site

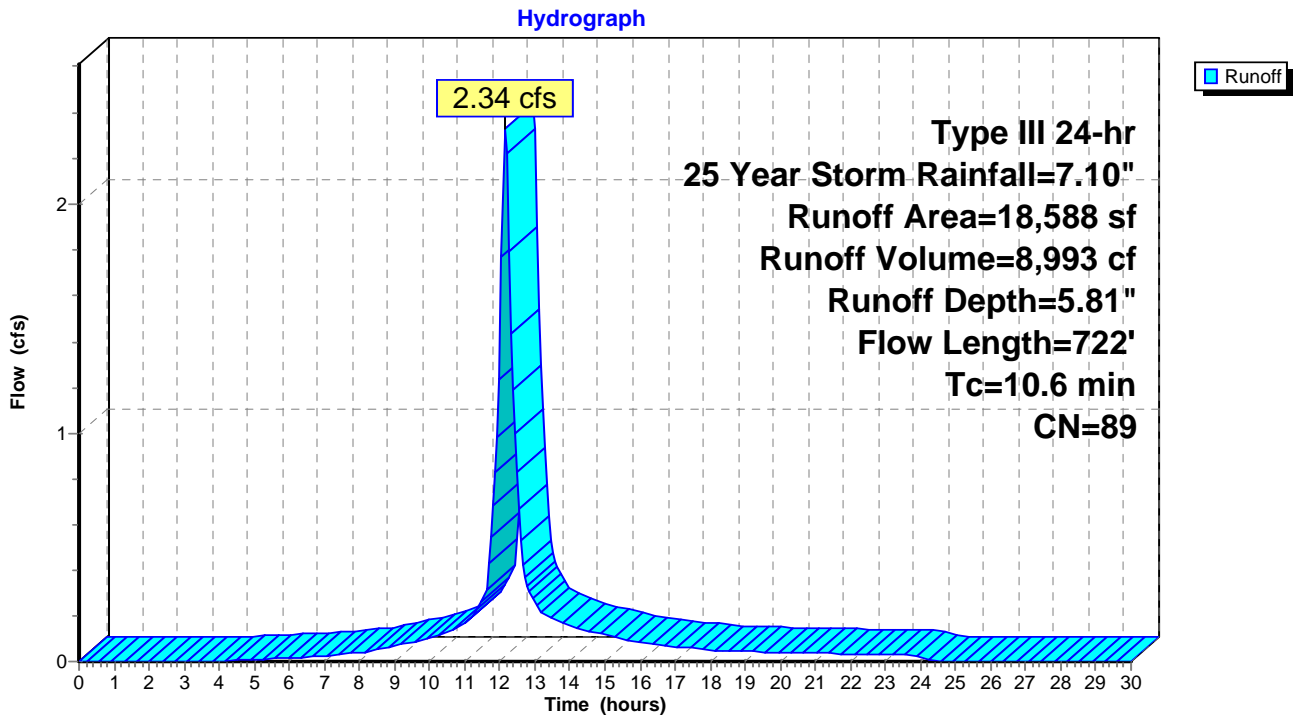


Summary for Pond DP2: CB at corner of Cabot Street and McDonough Street

Inflow Area = 29,491 sf, 52.52% Impervious, Inflow Depth = 4.91" for 25 Year Storm event
Inflow = 3.20 cfs @ 12.13 hrs, Volume= 12,070 cf
Primary = 3.20 cfs @ 12.13 hrs, Volume= 12,070 cf, Atten= 0%, Lag= 0.0 min

Routing by Dyn-Stor-Ind method, Time Span= 0.00-30.00 hrs, dt= 0.06 hrs / 5

Pond DP2: CB at corner of Cabot Street and McDonough Street

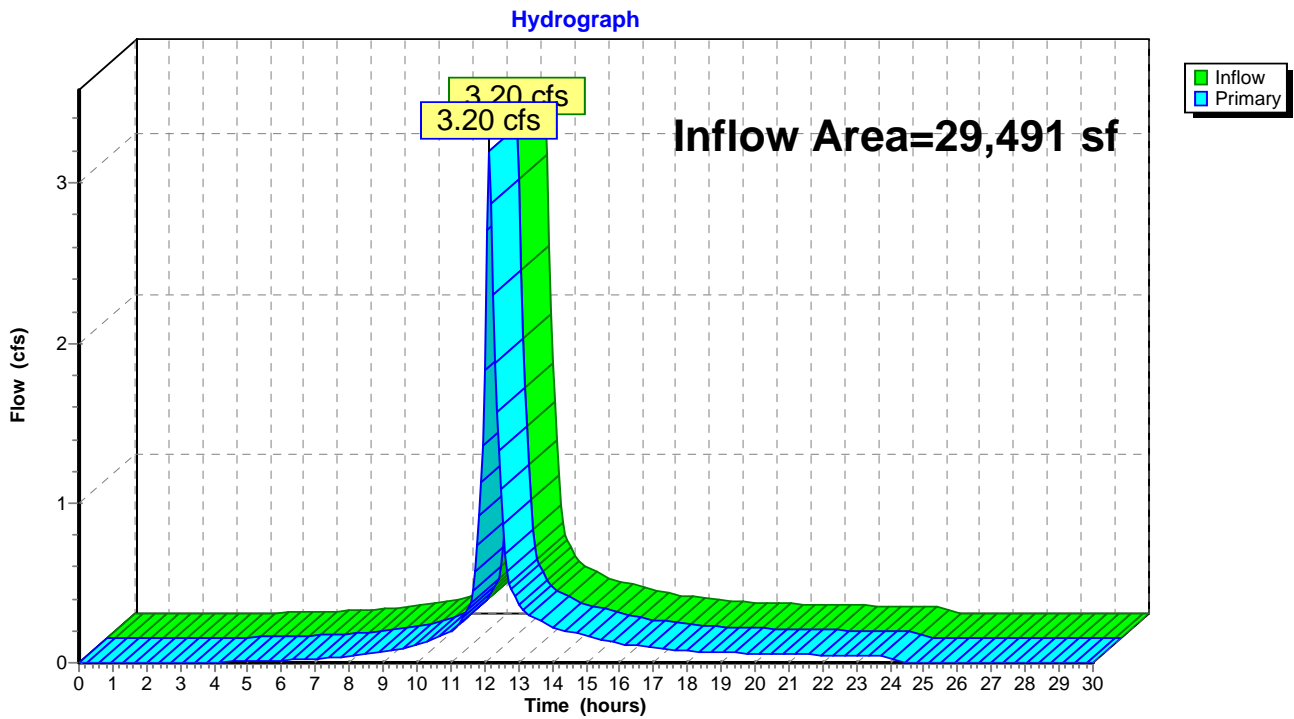


Summary for Link DP1:

Inflow Area = 29,491 sf, 52.52% Impervious, Inflow Depth = 4.91" for 25 Year Storm event
Inflow = 3.20 cfs @ 12.13 hrs, Volume= 12,070 cf
Primary = 3.20 cfs @ 12.13 hrs, Volume= 12,070 cf, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-30.00 hrs, dt= 0.06 hrs

Link DP1:

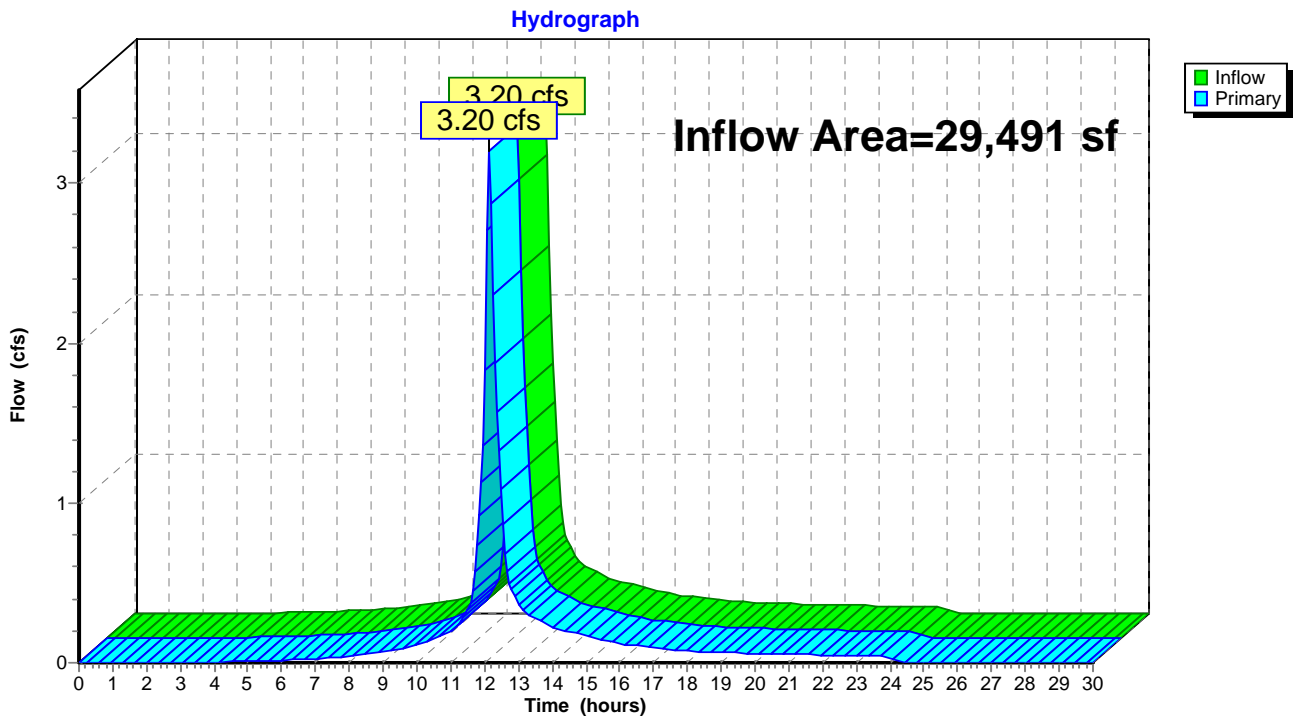

3082 Pre-construction

Type III 24-hr 50 Year Storm Rainfall=8.50"

Prepared by Ambit Engineering, Inc.

Printed 3/16/2020

HydroCAD® 10.00 s/n 00801 © 2013 HydroCAD Software Solutions LLC

Page 23

Time span=0.00-30.00 hrs, dt=0.06 hrs, 501 points x 5
Runoff by SCS TR-20 method, UH=SCS, Weighted-CN
Reach routing by Dyn-Stor-Ind method - Pond routing by Dyn-Stor-Ind method

Subcatchment ES1: Runoff Area=10,903 sf 15.13% Impervious Runoff Depth=4.54"
Flow Length=515' Tc=5.5 min CN=67 Runoff=1.31 cfs 4,125 cf

Subcatchment OS1: Off Site Runoff Area=18,588 sf 74.45% Impervious Runoff Depth=7.18"
Flow Length=722' Tc=10.6 min CN=89 Runoff=2.86 cfs 11,118 cf

Pond DP2: CB at corner of Cabot Street and McDonough Street Inflow=4.02 cfs 15,243 cf
Primary=4.02 cfs 15,243 cf

Link DP1: Inflow=4.02 cfs 15,243 cf
Primary=4.02 cfs 15,243 cf

Total Runoff Area = 29,491 sf Runoff Volume = 15,243 cf Average Runoff Depth = 6.20"
47.48% Pervious = 14,003 sf 52.52% Impervious = 15,488 sf

3082 Pre-construction

Prepared by Ambit Engineering, Inc.

HydroCAD® 10.00 s/n 00801 © 2013 HydroCAD Software Solutions LLC

Type III 24-hr 50 Year Storm Rainfall=8.50"

Printed 3/16/2020

Page 24

Summary for Subcatchment ES1:

Runoff = 1.31 cfs @ 12.08 hrs, Volume= 4,125 cf, Depth= 4.54"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-30.00 hrs, dt= 0.06 hrs
 Type III 24-hr 50 Year Storm Rainfall=8.50"

Area (sf)	CN	Description
9,253	61	>75% Grass cover, Good, HSG B
1,000	98	Roofs, HSG B
650	98	Paved parking, HSG B
10,903	67	Weighted Average
9,253	61	84.87% Pervious Area
1,650	98	15.13% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
4.0	305	0.0328	1.27		Shallow Concentrated Flow, Short Grass Pasture Kv= 7.0 fps
1.5	210	0.0130	2.31		Shallow Concentrated Flow, Paved Kv= 20.3 fps
5.5	515	Total			

Subcatchment ES1:

Hydrograph

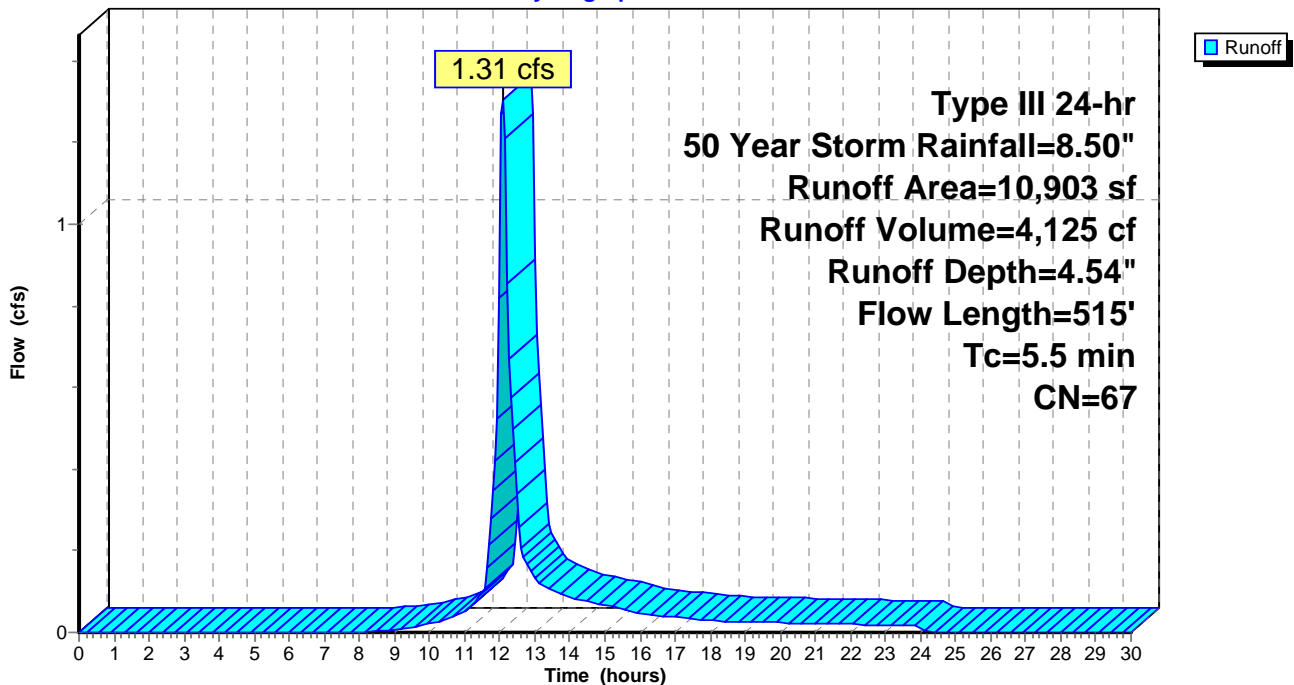

3082 Pre-construction

Type III 24-hr 50 Year Storm Rainfall=8.50"

Prepared by Ambit Engineering, Inc.

Printed 3/16/2020

HydroCAD® 10.00 s/n 00801 © 2013 HydroCAD Software Solutions LLC

Page 25

Summary for Subcatchment OS1: Off Site

Runoff = 2.86 cfs @ 12.14 hrs, Volume= 11,118 cf, Depth= 7.18"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-30.00 hrs, dt= 0.06 hrs
Type III 24-hr 50 Year Storm Rainfall=8.50"

Area (sf)	CN	Description
13,838	98	Unconnected roofs, HSG B
4,750	61	>75% Grass cover, Good, HSG B
18,588	89	Weighted Average
4,750	61	25.55% Pervious Area
13,838	98	74.45% Impervious Area
13,838		100.00% Unconnected

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
1.8	119	0.0252	1.11		Shallow Concentrated Flow, Short Grass Pasture Kv= 7.0 fps
2.8	42	0.0833	0.25		Sheet Flow, Grass: Short n= 0.150 P2= 3.21"
0.5	46	0.0326	1.43		Sheet Flow, Smooth surfaces n= 0.011 P2= 3.21"
4.0	305	0.0328	1.27		Shallow Concentrated Flow, Short Grass Pasture Kv= 7.0 fps
1.5	210	0.0130	2.31		Shallow Concentrated Flow, Paved Kv= 20.3 fps
10.6	722	Total			

Subcatchment OS1: Off Site

Hydrograph

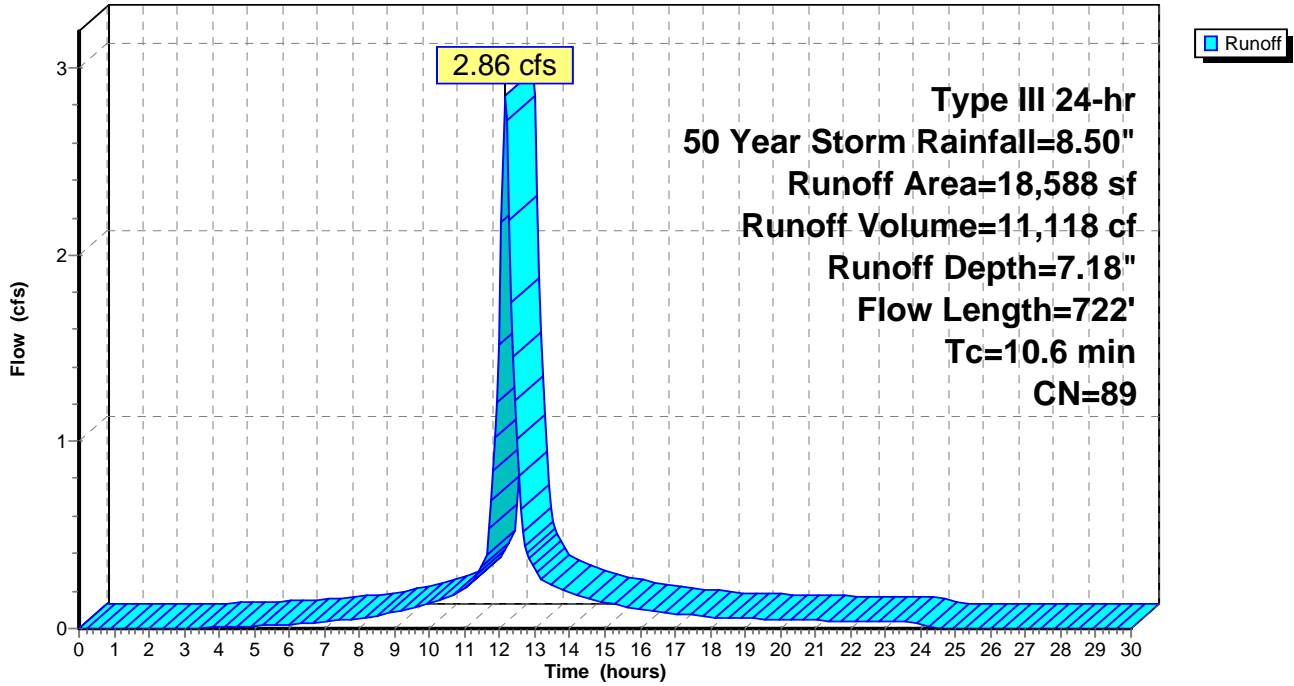


Summary for Pond DP2: CB at corner of Cabot Street and McDonough Street

Inflow Area = 29,491 sf, 52.52% Impervious, Inflow Depth = 6.20" for 50 Year Storm event
Inflow = 4.02 cfs @ 12.12 hrs, Volume= 15,243 cf
Primary = 4.02 cfs @ 12.12 hrs, Volume= 15,243 cf, Atten= 0%, Lag= 0.0 min

Routing by Dyn-Stor-Ind method, Time Span= 0.00-30.00 hrs, dt= 0.06 hrs / 5

Pond DP2: CB at corner of Cabot Street and McDonough Street

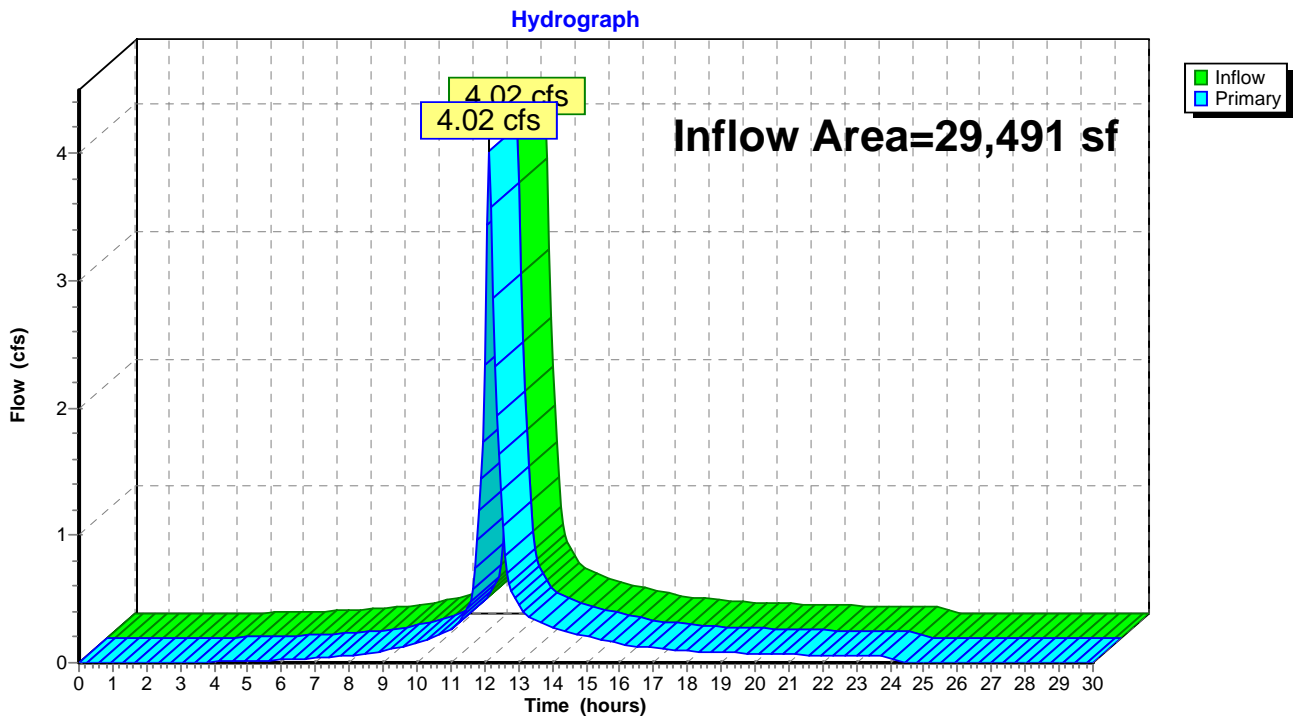



Summary for Link DP1:

Inflow Area = 29,491 sf, 52.52% Impervious, Inflow Depth = 6.20" for 50 Year Storm event
Inflow = 4.02 cfs @ 12.12 hrs, Volume= 15,243 cf
Primary = 4.02 cfs @ 12.12 hrs, Volume= 15,243 cf, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-30.00 hrs, dt= 0.06 hrs

Link DP1:

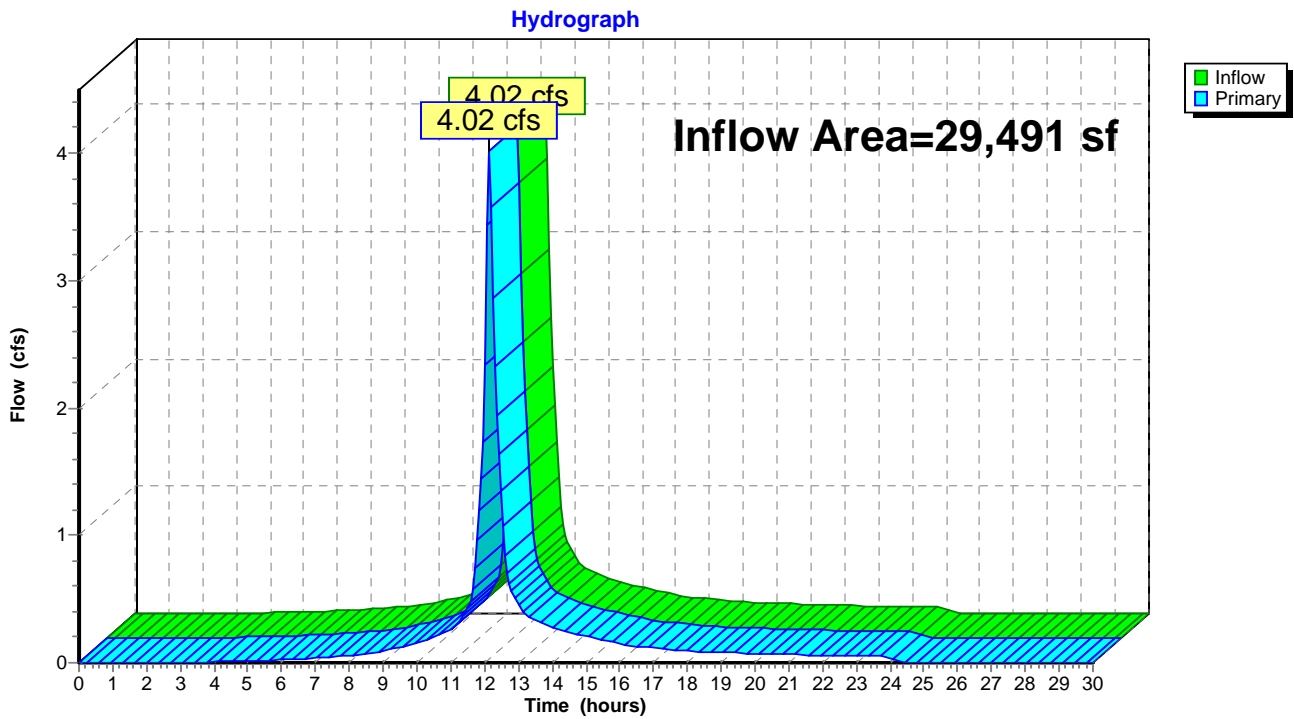

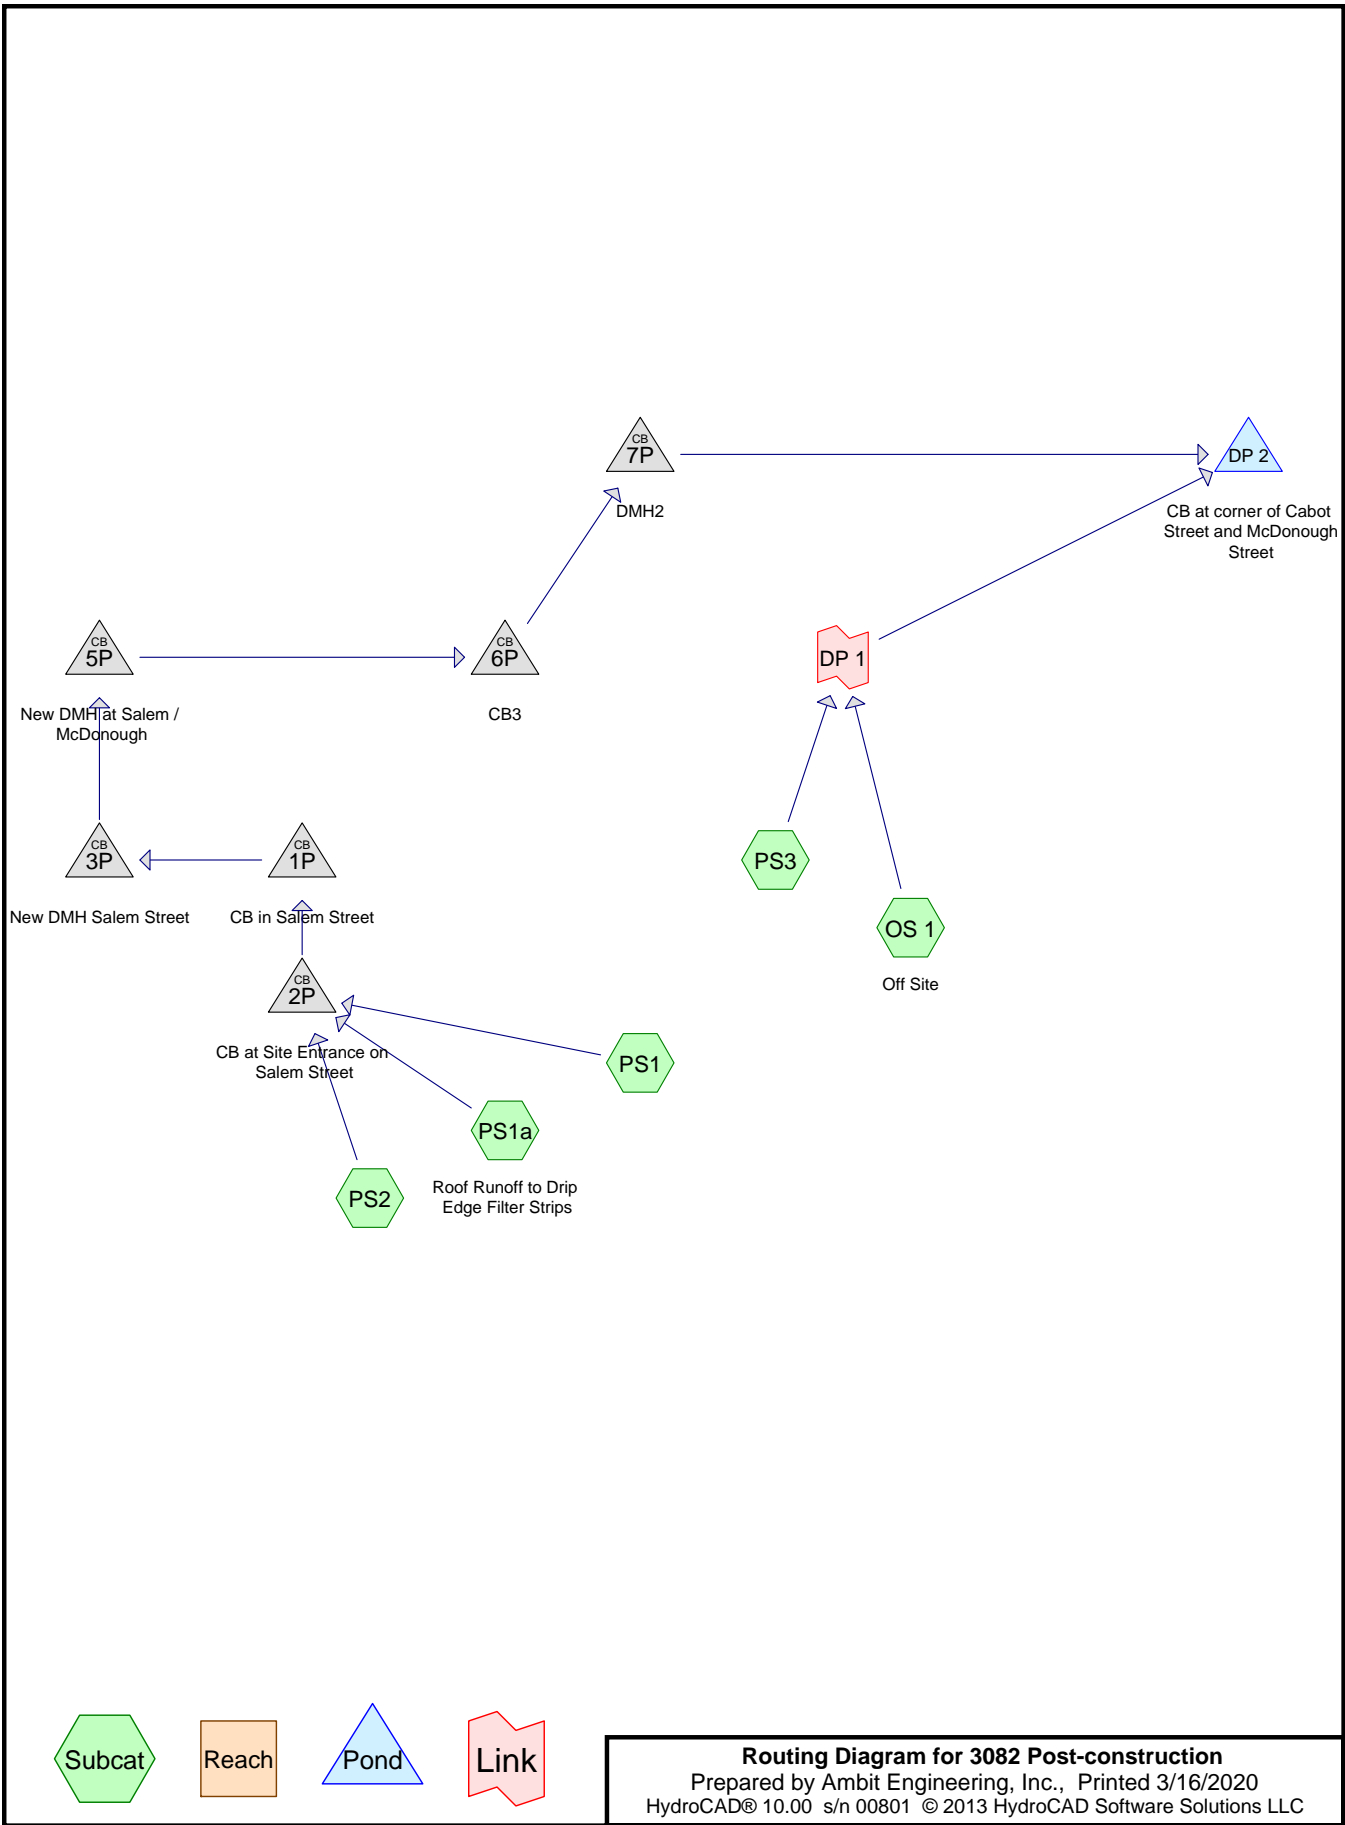

Routing Diagram for 3082 Post-construction
 Prepared by Ambit Engineering, Inc., Printed 3/16/2020
 HydroCAD® 10.00 s/n 00801 © 2013 HydroCAD Software Solutions LLC

3082 Post-construction

Prepared by Ambit Engineering, Inc.

HydroCAD® 10.00 s/n 00801 © 2013 HydroCAD Software Solutions LLC

Printed 3/16/2020

Page 2

Area Listing (selected nodes)

Area (sq-ft)	CN	Description (subcatchment-numbers)
10,849	61	>75% Grass cover, Good, HSG B (OS 1, PS1, PS2, PS3)
1,794	98	Paved parking, HSG B (PS1, PS2)
3,010	98	Roofs, HSG B (PS1a, PS2)
13,838	98	Unconnected roofs, HSG B (OS 1)
29,491	84	TOTAL AREA

3082 Post-construction

Prepared by Ambit Engineering, Inc.

HydroCAD® 10.00 s/n 00801 © 2013 HydroCAD Software Solutions LLC

Printed 3/16/2020

Page 3

Soil Listing (selected nodes)

Area (sq-ft)	Soil Group	Subcatchment Numbers
0	HSG A	
29,491	HSG B	OS 1, PS1, PS1a, PS2, PS3
0	HSG C	
0	HSG D	
0	Other	
29,491		TOTAL AREA

3082 Post-construction

Prepared by Ambit Engineering, Inc.

HydroCAD® 10.00 s/n 00801 © 2013 HydroCAD Software Solutions LLC

Printed 3/16/2020

Page 4

Ground Covers (selected nodes)

HSG-A (sq-ft)	HSG-B (sq-ft)	HSG-C (sq-ft)	HSG-D (sq-ft)	Other (sq-ft)	Total (sq-ft)	Ground Cover	Sub Num
0	10,849	0	0	0	10,849	>75% Grass cover, Good	
0	1,794	0	0	0	1,794	Paved parking	
0	3,010	0	0	0	3,010	Roofs	
0	13,838	0	0	0	13,838	Unconnected roofs	
0	29,491	0	0	0	29,491	TOTAL AREA	

3082 Post-construction

Prepared by Ambit Engineering, Inc.

HydroCAD® 10.00 s/n 00801 © 2013 HydroCAD Software Solutions LLC

Printed 3/16/2020

Page 5

Pipe Listing (selected nodes)

Line#	Node Number	In-Invert (feet)	Out-Invert (feet)	Length (feet)	Slope (ft/ft)	n	Diam/Width (inches)	Height (inches)	Inside-Fill (inches)
1	1P	15.18	15.13	9.0	0.0056	0.013	15.0	0.0	0.0
2	2P	18.40	15.28	36.0	0.0867	0.013	15.0	0.0	0.0
3	3P	15.03	11.80	97.0	0.0333	0.013	15.0	0.0	0.0
4	5P	11.78	11.50	15.0	0.0187	0.013	15.0	0.0	0.0
5	6P	11.82	10.56	32.0	0.0394	0.013	15.0	0.0	0.0
6	7P	10.57	0.00	200.0	0.0529	0.013	18.0	0.0	0.0

3082 Post-construction

Type III 24-hr 2 Year Storm Rainfall=3.69"

Prepared by Ambit Engineering, Inc.

Printed 3/16/2020

HydroCAD® 10.00 s/n 00801 © 2013 HydroCAD Software Solutions LLC

Page 6

Time span=0.00-30.00 hrs, dt=0.01 hrs, 3001 points
 Runoff by SCS TR-20 method, UH=SCS, Weighted-CN
 Reach routing by Stor-Ind+Trans method - Pond routing by Stor-Ind method

Subcatchment OS 1: Off Site Runoff Area=18,588 sf 74.45% Impervious Runoff Depth=2.53"
 Flow Length=722' Tc=10.8 min CN=89 Runoff=1.07 cfs 3,924 cf

Subcatchment PS1: Runoff Area=2,893 sf 48.81% Impervious Runoff Depth=1.71"
 Flow Length=143' Slope=0.0200 '/' Tc=0.8 min CN=79 Runoff=0.16 cfs 413 cf

Subcatchment PS1a: Roof Runoff to Drip Runoff Area=2,717 sf 100.00% Impervious Runoff Depth=3.46"
 Tc=10.0 min CN=98 Runoff=0.20 cfs 782 cf

Subcatchment PS2: Runoff Area=1,411 sf 47.84% Impervious Runoff Depth=1.71"
 Flow Length=89' Slope=0.0200 '/' Tc=1.1 min CN=79 Runoff=0.08 cfs 202 cf

Subcatchment PS3: Runoff Area=3,882 sf 0.00% Impervious Runoff Depth=0.66"
 Flow Length=552' Tc=6.3 min CN=61 Runoff=0.05 cfs 214 cf

Pond 1P: CB in Salem Street Peak Elev=15.53' Inflow=0.35 cfs 1,398 cf
 15.0" Round Culvert n=0.013 L=9.0' S=0.0056 '/' Outflow=0.35 cfs 1,398 cf

Pond 2P: CB at Site Entrance on Salem Street Peak Elev=18.71' Inflow=0.35 cfs 1,398 cf
 15.0" Round Culvert n=0.013 L=36.0' S=0.0867 '/' Outflow=0.35 cfs 1,398 cf

Pond 3P: New DMH Salem Street Peak Elev=15.34' Inflow=0.35 cfs 1,398 cf
 15.0" Round Culvert n=0.013 L=97.0' S=0.0333 '/' Outflow=0.35 cfs 1,398 cf

Pond 5P: New DMH at Salem / McDonough Peak Elev=12.09' Inflow=0.35 cfs 1,398 cf
 15.0" Round Culvert n=0.013 L=15.0' S=0.0187 '/' Outflow=0.35 cfs 1,398 cf

Pond 6P: CB3 Peak Elev=12.13' Inflow=0.35 cfs 1,398 cf
 15.0" Round Culvert n=0.013 L=32.0' S=0.0394 '/' Outflow=0.35 cfs 1,398 cf

Pond 7P: DMH2 Peak Elev=10.86' Inflow=0.35 cfs 1,398 cf
 18.0" Round Culvert n=0.013 L=200.0' S=0.0529 '/' Outflow=0.35 cfs 1,398 cf

Pond DP 2: CB at corner of Cabot Street and McDonough Street Inflow=1.41 cfs 5,535 cf
 Primary=1.41 cfs 5,535 cf

Link DP 1: Inflow=1.12 cfs 4,138 cf
 Primary=1.12 cfs 4,138 cf

Total Runoff Area = 29,491 sf Runoff Volume = 5,535 cf Average Runoff Depth = 2.25"
36.79% Pervious = 10,849 sf 63.21% Impervious = 18,642 sf

3082 Post-construction

Type III 24-hr 2 Year Storm Rainfall=3.69"

Prepared by Ambit Engineering, Inc.

Printed 3/16/2020

HydroCAD® 10.00 s/n 00801 © 2013 HydroCAD Software Solutions LLC

Page 7

Summary for Subcatchment OS 1: Off Site


Runoff = 1.07 cfs @ 12.15 hrs, Volume= 3,924 cf, Depth= 2.53"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-30.00 hrs, dt= 0.01 hrs
Type III 24-hr 2 Year Storm Rainfall=3.69"

Area (sf)	CN	Description
13,838	98	Unconnected roofs, HSG B
4,750	61	>75% Grass cover, Good, HSG B
18,588	89	Weighted Average
4,750		25.55% Pervious Area
13,838		74.45% Impervious Area
13,838		100.00% Unconnected

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
1.8	119	0.0252	1.11		Shallow Concentrated Flow, Short Grass Pasture Kv= 7.0 fps
0.6	46	0.0326	1.39		Sheet Flow, Smooth surfaces n= 0.011 P2= 3.00"
2.9	42	0.0833	0.25		Sheet Flow, Grass: Short n= 0.150 P2= 3.00"
4.0	305	0.0328	1.27		Shallow Concentrated Flow, Short Grass Pasture Kv= 7.0 fps
1.5	210	0.0130	2.31		Shallow Concentrated Flow, Paved Kv= 20.3 fps
10.8	722	Total			

Subcatchment OS 1: Off Site

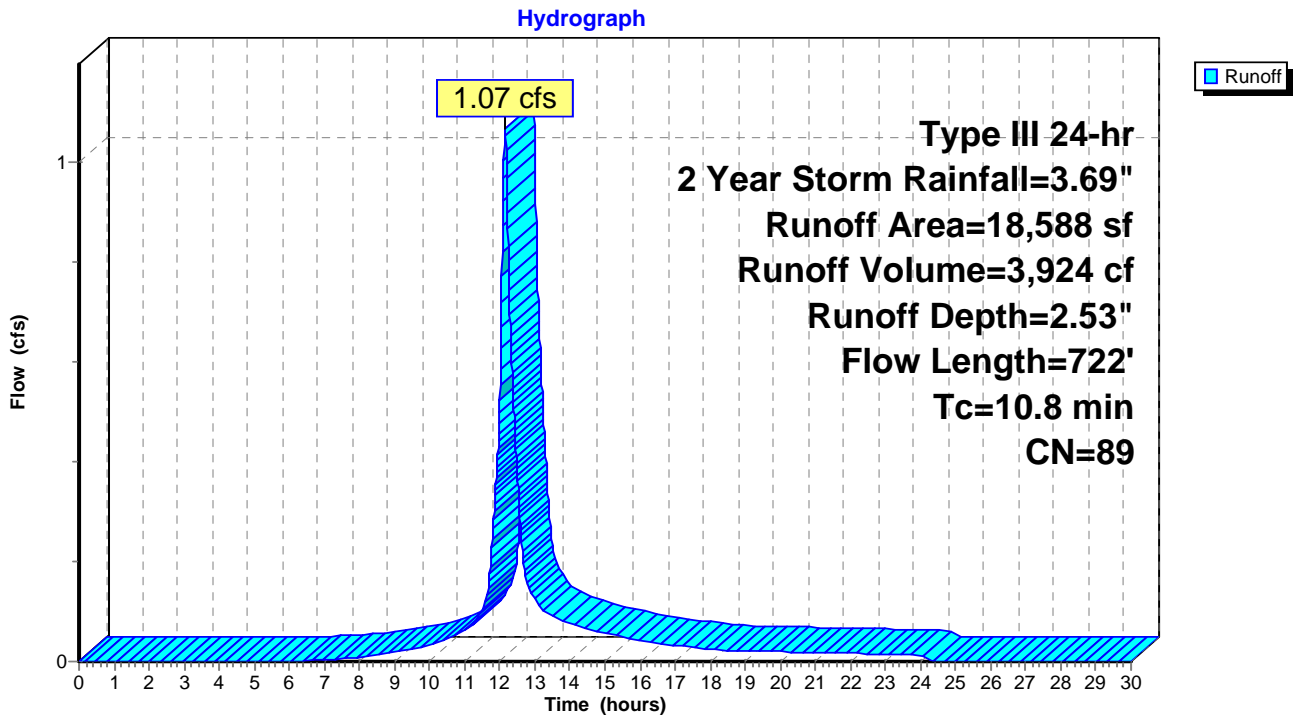

3082 Post-construction

Prepared by Ambit Engineering, Inc.

HydroCAD® 10.00 s/n 00801 © 2013 HydroCAD Software Solutions LLC

Type III 24-hr 2 Year Storm Rainfall=3.69"

Printed 3/16/2020

Page 9

Summary for Subcatchment PS1:


Runoff = 0.16 cfs @ 12.01 hrs, Volume= 413 cf, Depth= 1.71"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-30.00 hrs, dt= 0.01 hrs
Type III 24-hr 2 Year Storm Rainfall=3.69"

Area (sf)	CN	Description
1,481	61	>75% Grass cover, Good, HSG B
1,412	98	Paved parking, HSG B
2,893	79	Weighted Average
1,481		51.19% Pervious Area
1,412		48.81% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.8	143	0.0200	2.87		Shallow Concentrated Flow, Paved Kv= 20.3 fps

Subcatchment PS1:

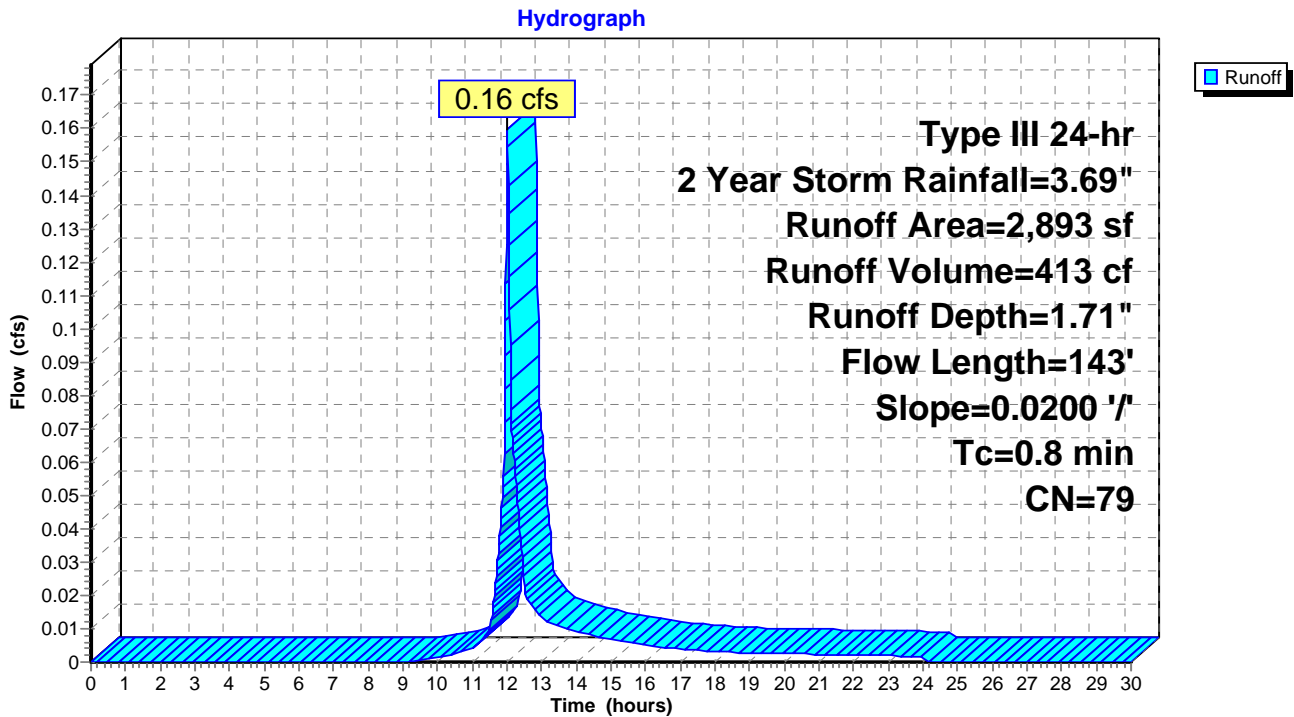

3082 Post-construction

Prepared by Ambit Engineering, Inc.

HydroCAD® 10.00 s/n 00801 © 2013 HydroCAD Software Solutions LLC

Type III 24-hr 2 Year Storm Rainfall=3.69"

Printed 3/16/2020

Page 10

Summary for Subcatchment PS1a: Roof Runoff to Drip Edge Filter Strips

Runoff = 0.20 cfs @ 12.13 hrs, Volume= 782 cf, Depth= 3.46"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-30.00 hrs, dt= 0.01 hrs
Type III 24-hr 2 Year Storm Rainfall=3.69"

Area (sf)	CN	Description
2,717	98	Roofs, HSG B
2,717		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
10.0					Direct Entry, Travel Time Through Filter Media

Subcatchment PS1a: Roof Runoff to Drip Edge Filter Strips

Hydrograph

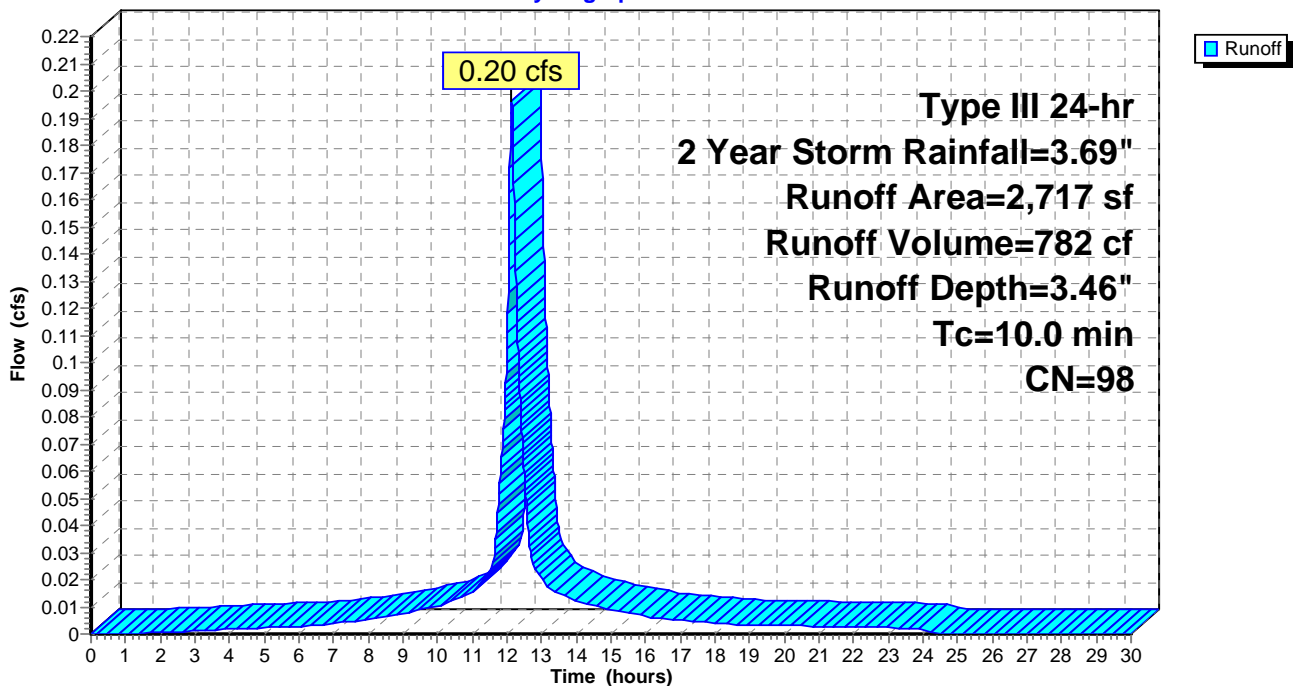

3082 Post-construction

Prepared by Ambit Engineering, Inc.

HydroCAD® 10.00 s/n 00801 © 2013 HydroCAD Software Solutions LLC

Type III 24-hr 2 Year Storm Rainfall=3.69"

Printed 3/16/2020

Page 11

Summary for Subcatchment PS2:

Runoff = 0.08 cfs @ 12.02 hrs, Volume= 202 cf, Depth= 1.71"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-30.00 hrs, dt= 0.01 hrs
Type III 24-hr 2 Year Storm Rainfall=3.69"

Area (sf)	CN	Description
382	98	Paved parking, HSG B
293	98	Roofs, HSG B
736	61	>75% Grass cover, Good, HSG B
1,411	79	Weighted Average
736		52.16% Pervious Area
675		47.84% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
1.1	89	0.0200	1.30		Sheet Flow, Smooth surfaces n= 0.011 P2= 3.00"

Subcatchment PS2:

Hydrograph

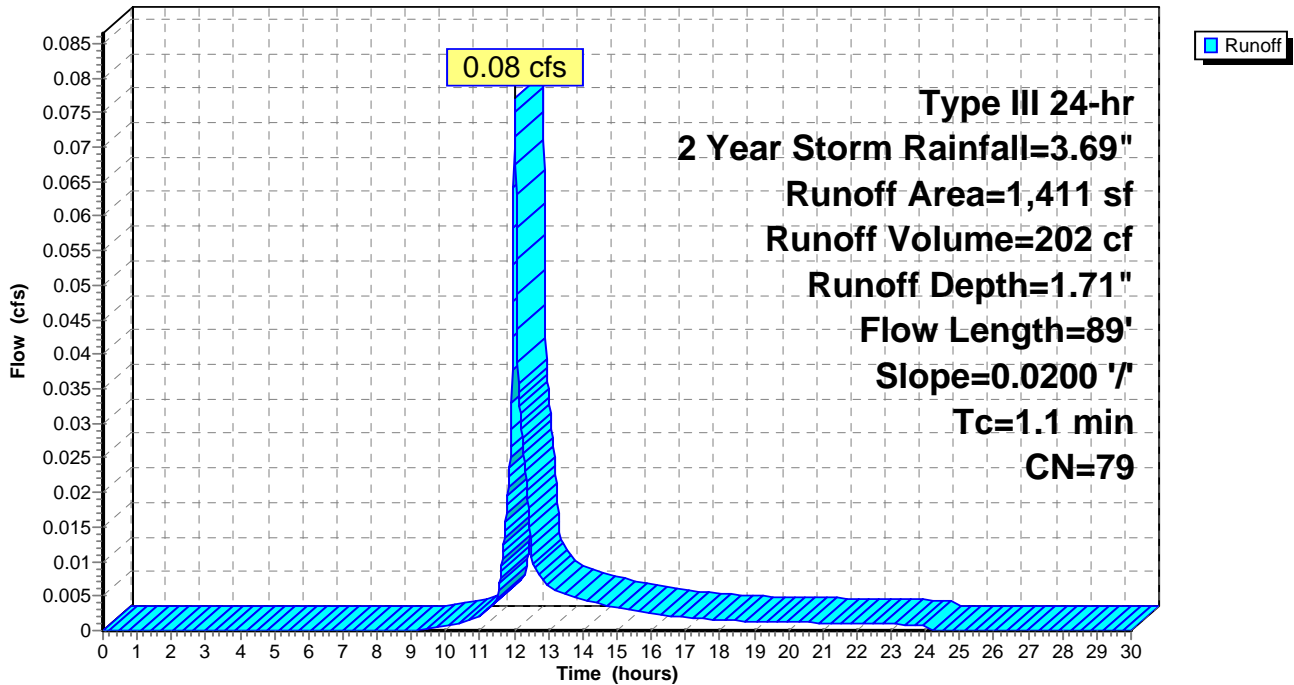

3082 Post-construction

Prepared by Ambit Engineering, Inc.

HydroCAD® 10.00 s/n 00801 © 2013 HydroCAD Software Solutions LLC

Type III 24-hr 2 Year Storm Rainfall=3.69"

Printed 3/16/2020

Page 12

Summary for Subcatchment PS3:

Runoff = 0.05 cfs @ 12.11 hrs, Volume= 214 cf, Depth= 0.66"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-30.00 hrs, dt= 0.01 hrs
Type III 24-hr 2 Year Storm Rainfall=3.69"

Area (sf)	CN	Description
3,882	61	>75% Grass cover, Good, HSG B
3,882		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
4.8	342	0.0292	1.20		Shallow Concentrated Flow, Short Grass Pasture Kv= 7.0 fps
1.5	210	0.0130	2.31		Shallow Concentrated Flow, Paved Kv= 20.3 fps
6.3	552	Total			

Subcatchment PS3:

Hydrograph

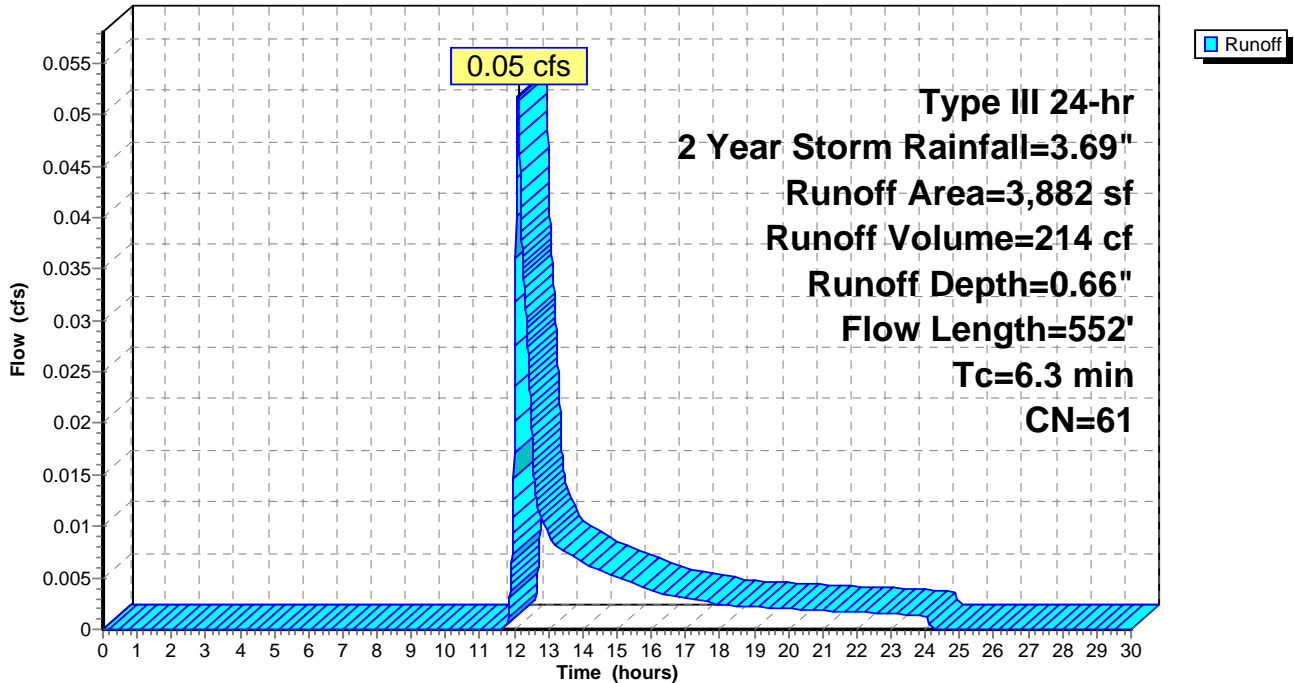

3082 Post-construction

Prepared by Ambit Engineering, Inc.

HydroCAD® 10.00 s/n 00801 © 2013 HydroCAD Software Solutions LLC

Type III 24-hr 2 Year Storm Rainfall=3.69"

Printed 3/16/2020

Page 13

Summary for Pond 1P: CB in Salem Street

Inflow Area = 7,021 sf, 68.42% Impervious, Inflow Depth = 2.39" for 2 Year Storm event
Inflow = 0.35 cfs @ 12.02 hrs, Volume= 1,398 cf
Outflow = 0.35 cfs @ 12.02 hrs, Volume= 1,398 cf, Atten= 0%, Lag= 0.0 min
Primary = 0.35 cfs @ 12.02 hrs, Volume= 1,398 cf


Routing by Stor-Ind method, Time Span= 0.00-30.00 hrs, dt= 0.01 hrs
Peak Elev= 15.53' @ 12.02 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	15.18'	15.0" Round Culvert L= 9.0' CPP, projecting, no headwall, Ke= 0.900 Inlet / Outlet Invert= 15.18' / 15.13' S= 0.0056 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 1.23 sf

Primary OutFlow Max=0.35 cfs @ 12.02 hrs HW=15.53' (Free Discharge)
←1=Culvert (Barrel Controls 0.35 cfs @ 1.90 fps)

Pond 1P: CB in Salem Street

Hydrograph

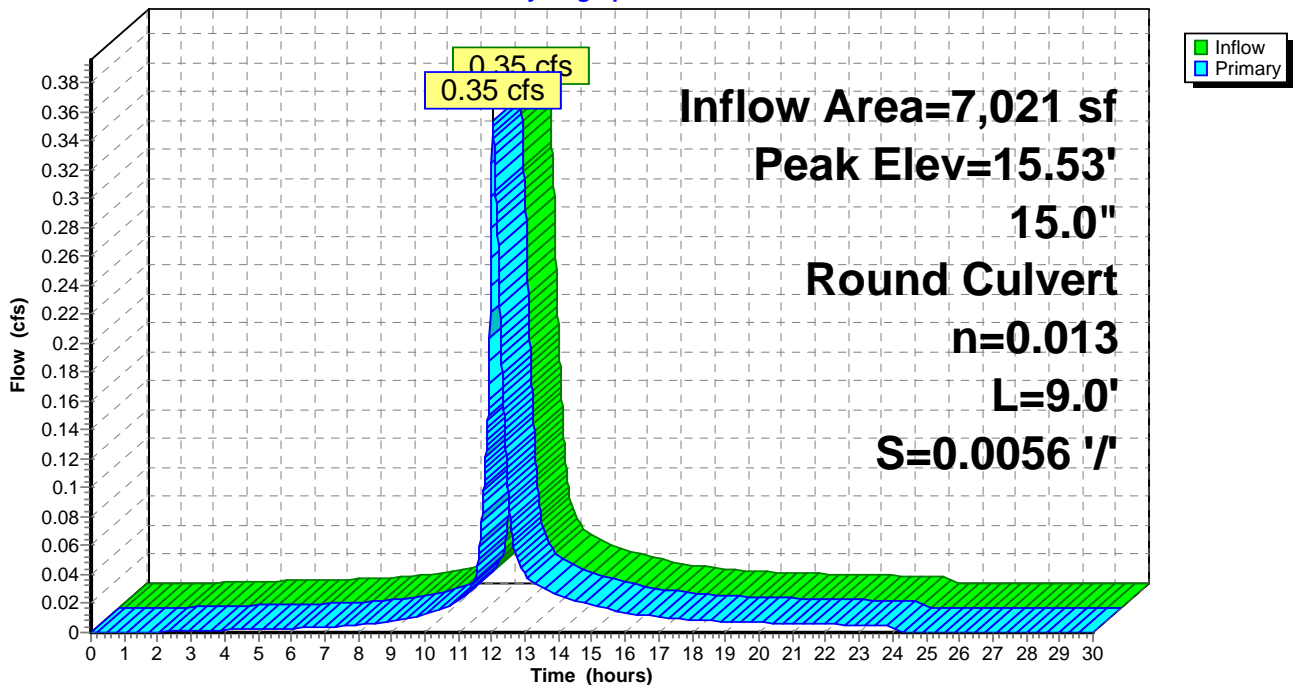

3082 Post-construction

Prepared by Ambit Engineering, Inc.

HydroCAD® 10.00 s/n 00801 © 2013 HydroCAD Software Solutions LLC

Type III 24-hr 2 Year Storm Rainfall=3.69"

Printed 3/16/2020

Page 14

Summary for Pond 2P: CB at Site Entrance on Salem Street

Inflow Area = 7,021 sf, 68.42% Impervious, Inflow Depth = 2.39" for 2 Year Storm event
 Inflow = 0.35 cfs @ 12.02 hrs, Volume= 1,398 cf
 Outflow = 0.35 cfs @ 12.02 hrs, Volume= 1,398 cf, Atten= 0%, Lag= 0.0 min
 Primary = 0.35 cfs @ 12.02 hrs, Volume= 1,398 cf


Routing by Stor-Ind method, Time Span= 0.00-30.00 hrs, dt= 0.01 hrs
 Peak Elev= 18.71' @ 12.02 hrs

Device #	Routing	Invert	Outlet Devices
#1	Primary	18.40'	15.0" Round Culvert L= 36.0' CPP, projecting, no headwall, Ke= 0.900 Inlet / Outlet Invert= 18.40' / 15.28' S= 0.0867 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 1.23 sf

Primary OutFlow Max=0.35 cfs @ 12.02 hrs HW=18.71' (Free Discharge)
 ←1=Culvert (Inlet Controls 0.35 cfs @ 1.49 fps)

Pond 2P: CB at Site Entrance on Salem Street

Hydrograph

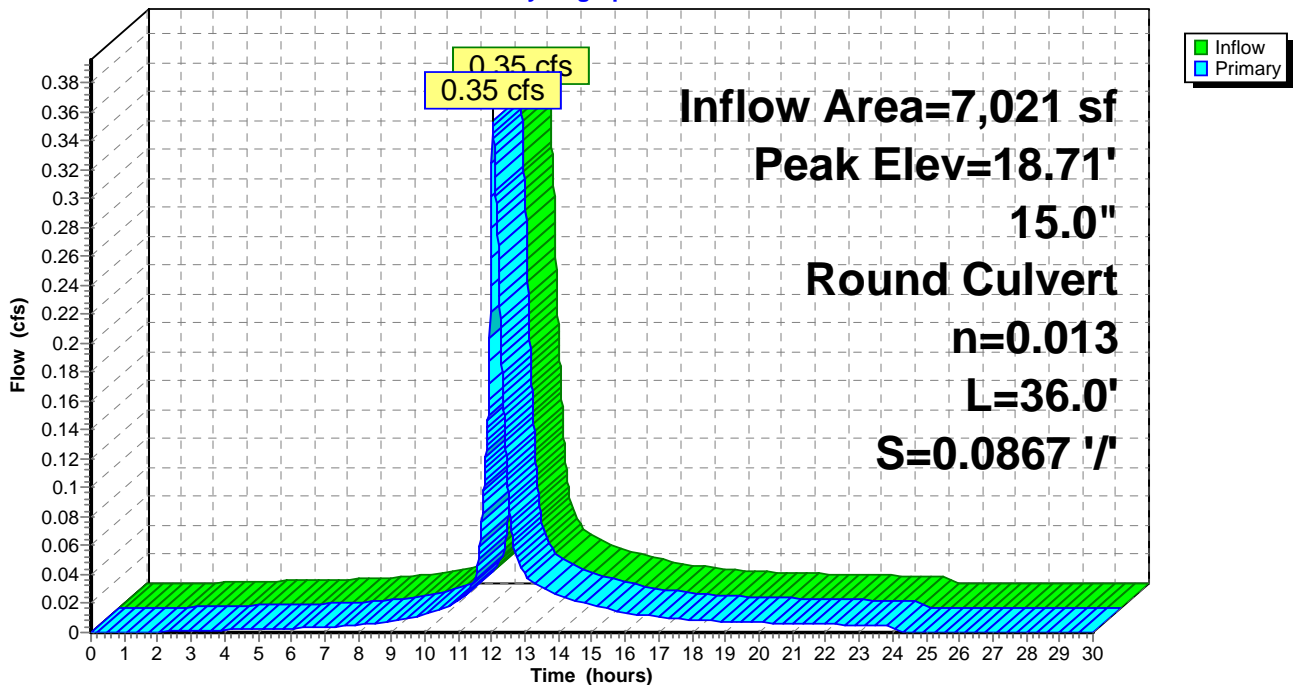

3082 Post-construction

Prepared by Ambit Engineering, Inc.

HydroCAD® 10.00 s/n 00801 © 2013 HydroCAD Software Solutions LLC

Type III 24-hr 2 Year Storm Rainfall=3.69"

Printed 3/16/2020

Page 15

Summary for Pond 3P: New DMH Salem Street

Inflow Area = 7,021 sf, 68.42% Impervious, Inflow Depth = 2.39" for 2 Year Storm event
 Inflow = 0.35 cfs @ 12.02 hrs, Volume= 1,398 cf
 Outflow = 0.35 cfs @ 12.02 hrs, Volume= 1,398 cf, Atten= 0%, Lag= 0.0 min
 Primary = 0.35 cfs @ 12.02 hrs, Volume= 1,398 cf


Routing by Stor-Ind method, Time Span= 0.00-30.00 hrs, dt= 0.01 hrs
 Peak Elev= 15.34' @ 12.02 hrs

Device #	Routing	Invert	Outlet Devices
#1	Primary	15.03'	15.0" Round Culvert L= 97.0' CPP, projecting, no headwall, Ke= 0.900 Inlet / Outlet Invert= 15.03' / 11.80' S= 0.0333 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 1.23 sf

Primary OutFlow Max=0.35 cfs @ 12.02 hrs HW=15.34' (Free Discharge)
 ←1=Culvert (Inlet Controls 0.35 cfs @ 1.49 fps)

Pond 3P: New DMH Salem Street

Hydrograph

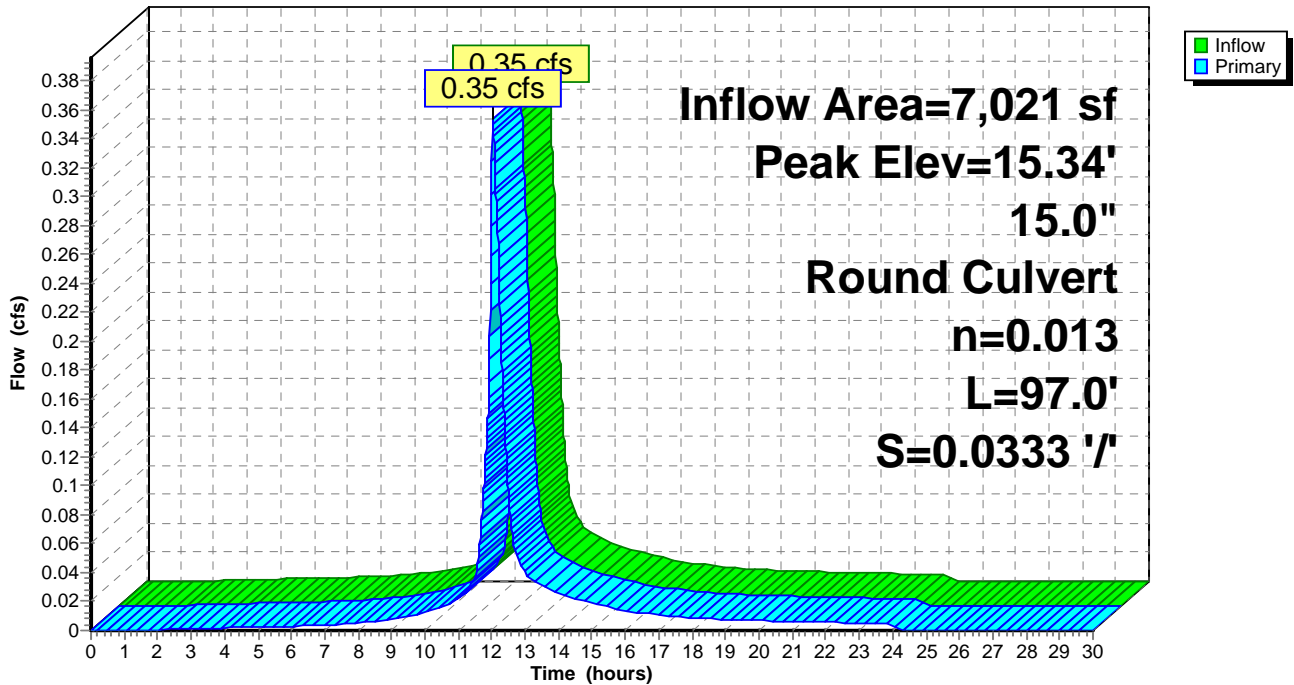

3082 Post-construction

Prepared by Ambit Engineering, Inc.

HydroCAD® 10.00 s/n 00801 © 2013 HydroCAD Software Solutions LLC

Type III 24-hr 2 Year Storm Rainfall=3.69"

Printed 3/16/2020

Page 16

Summary for Pond 5P: New DMH at Salem / McDonough


Inflow Area = 7,021 sf, 68.42% Impervious, Inflow Depth = 2.39" for 2 Year Storm event
Inflow = 0.35 cfs @ 12.02 hrs, Volume= 1,398 cf
Outflow = 0.35 cfs @ 12.02 hrs, Volume= 1,398 cf, Atten= 0%, Lag= 0.0 min
Primary = 0.35 cfs @ 12.02 hrs, Volume= 1,398 cf

Routing by Stor-Ind method, Time Span= 0.00-30.00 hrs, dt= 0.01 hrs
Peak Elev= 12.09' @ 12.02 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	11.78'	15.0" Round Culvert L= 15.0' CPP, projecting, no headwall, Ke= 0.900 Inlet / Outlet Invert= 11.78' / 11.50' S= 0.0187 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 1.23 sf

Primary OutFlow Max=0.35 cfs @ 12.02 hrs HW=12.09' (Free Discharge)
←1=Culvert (Inlet Controls 0.35 cfs @ 1.49 fps)

Pond 5P: New DMH at Salem / McDonough

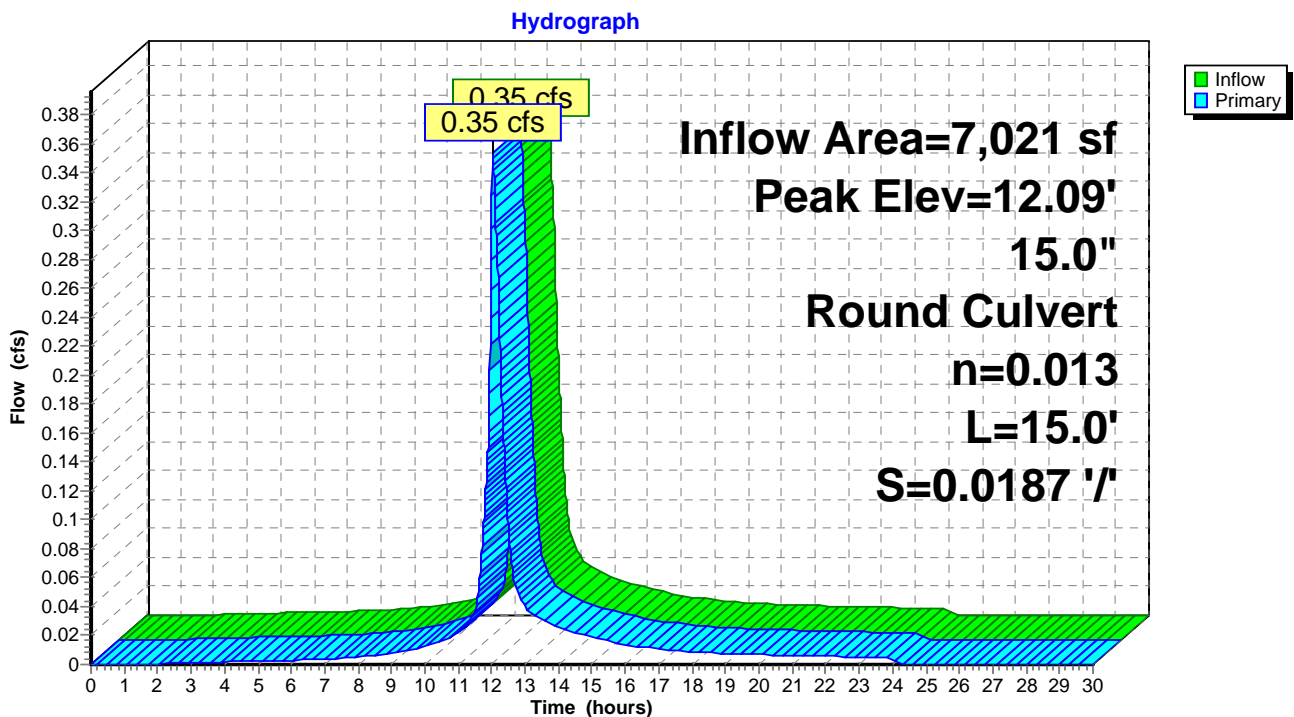

3082 Post-construction

Prepared by Ambit Engineering, Inc.

HydroCAD® 10.00 s/n 00801 © 2013 HydroCAD Software Solutions LLC

Type III 24-hr 2 Year Storm Rainfall=3.69"

Printed 3/16/2020

Page 17

Summary for Pond 6P: CB3

Inflow Area = 7,021 sf, 68.42% Impervious, Inflow Depth = 2.39" for 2 Year Storm event
 Inflow = 0.35 cfs @ 12.02 hrs, Volume= 1,398 cf
 Outflow = 0.35 cfs @ 12.02 hrs, Volume= 1,398 cf, Atten= 0%, Lag= 0.0 min
 Primary = 0.35 cfs @ 12.02 hrs, Volume= 1,398 cf


Routing by Stor-Ind method, Time Span= 0.00-30.00 hrs, dt= 0.01 hrs
 Peak Elev= 12.13' @ 12.02 hrs

Device #	Routing	Invert	Outlet Devices
#1	Primary	11.82'	15.0" Round Culvert L= 32.0' CPP, projecting, no headwall, Ke= 0.900 Inlet / Outlet Invert= 11.82' / 10.56' S= 0.0394 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 1.23 sf

Primary OutFlow Max=0.35 cfs @ 12.02 hrs HW=12.13' (Free Discharge)
 ←1=Culvert (Inlet Controls 0.35 cfs @ 1.49 fps)

Pond 6P: CB3

Hydrograph

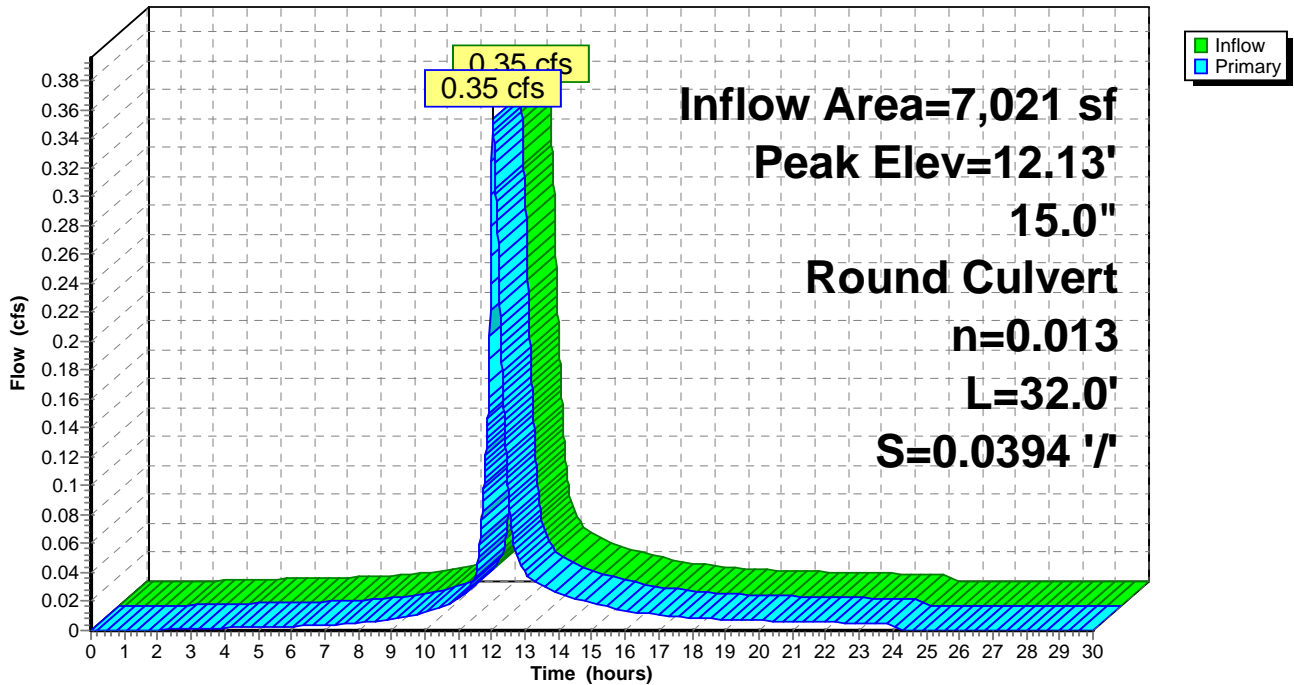

3082 Post-construction

Prepared by Ambit Engineering, Inc.

HydroCAD® 10.00 s/n 00801 © 2013 HydroCAD Software Solutions LLC

Type III 24-hr 2 Year Storm Rainfall=3.69"

Printed 3/16/2020

Page 18

Summary for Pond 7P: DMH2

Inflow Area = 7,021 sf, 68.42% Impervious, Inflow Depth = 2.39" for 2 Year Storm event
Inflow = 0.35 cfs @ 12.02 hrs, Volume= 1,398 cf
Outflow = 0.35 cfs @ 12.02 hrs, Volume= 1,398 cf, Atten= 0%, Lag= 0.0 min
Primary = 0.35 cfs @ 12.02 hrs, Volume= 1,398 cf


Routing by Stor-Ind method, Time Span= 0.00-30.00 hrs, dt= 0.01 hrs
Peak Elev= 10.86' @ 12.02 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	10.57'	18.0" Round Culvert L= 200.0' CPP, projecting, no headwall, Ke= 0.900 Inlet / Outlet Invert= 10.57' / 0.00' S= 0.0529 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 1.77 sf

Primary OutFlow Max=0.35 cfs @ 12.02 hrs HW=10.86' (Free Discharge)
←1=Culvert (Inlet Controls 0.35 cfs @ 1.45 fps)

Pond 7P: DMH2

Hydrograph

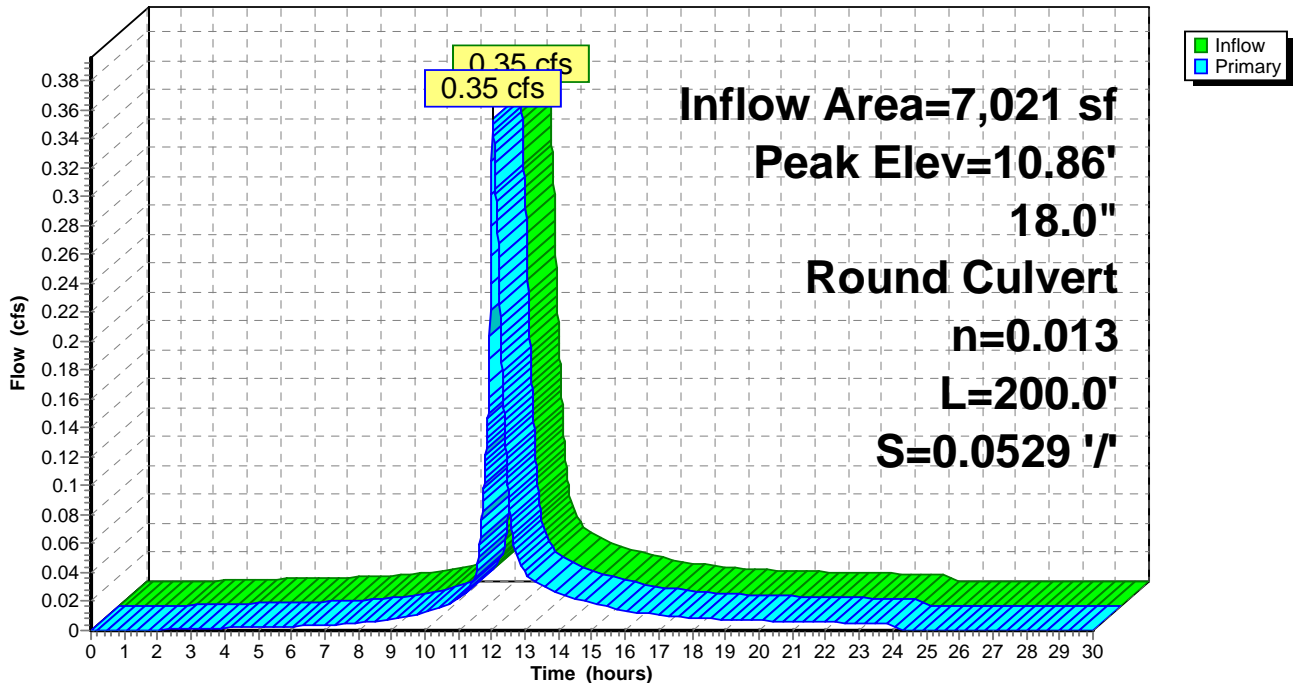

3082 Post-construction

Prepared by Ambit Engineering, Inc.

HydroCAD® 10.00 s/n 00801 © 2013 HydroCAD Software Solutions LLC

Type III 24-hr 2 Year Storm Rainfall=3.69"

Printed 3/16/2020


Page 19

Summary for Pond DP 2: CB at corner of Cabot Street and McDonough Street

Inflow Area = 29,491 sf, 63.21% Impervious, Inflow Depth = 2.25" for 2 Year Storm event
Inflow = 1.41 cfs @ 12.14 hrs, Volume= 5,535 cf
Primary = 1.41 cfs @ 12.14 hrs, Volume= 5,535 cf, Atten= 0%, Lag= 0.0 min

Routing by Stor-Ind method, Time Span= 0.00-30.00 hrs, dt= 0.01 hrs

Pond DP 2: CB at corner of Cabot Street and McDonough Street

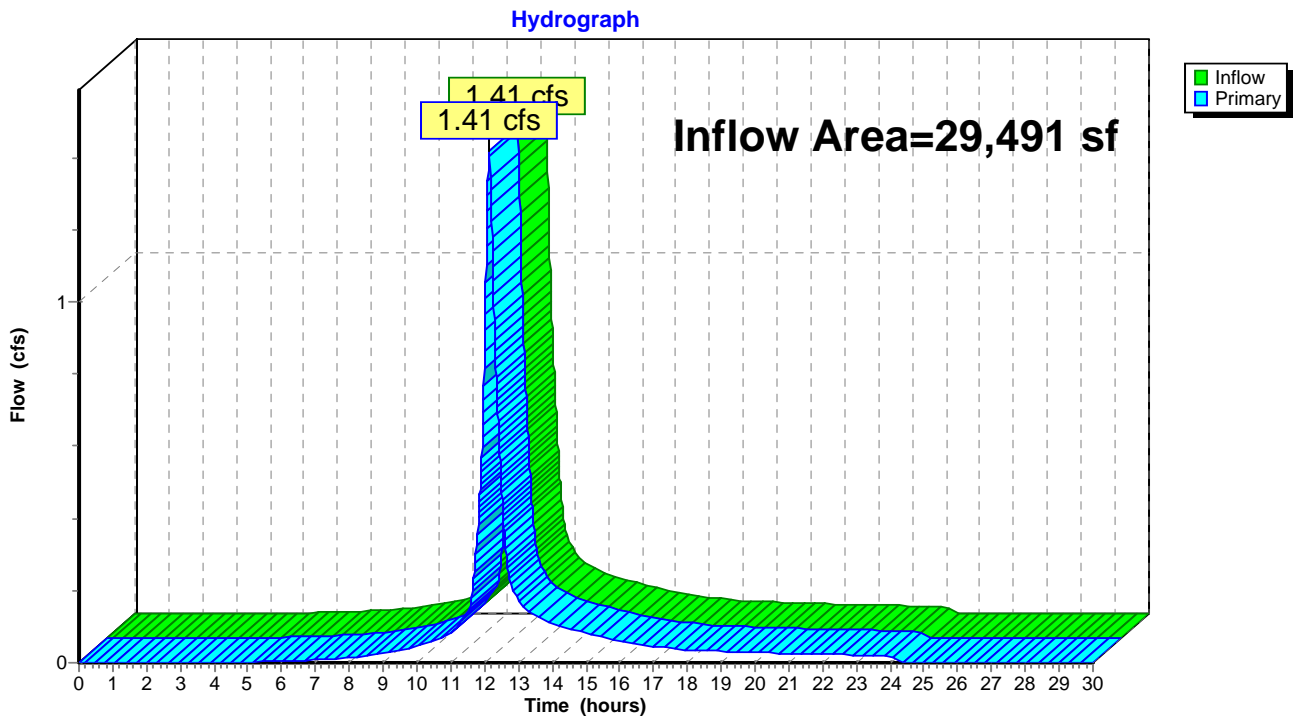


Summary for Link DP 1:

Inflow Area = 22,470 sf, 61.58% Impervious, Inflow Depth = 2.21" for 2 Year Storm event
Inflow = 1.12 cfs @ 12.15 hrs, Volume= 4,138 cf
Primary = 1.12 cfs @ 12.15 hrs, Volume= 4,138 cf, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-30.00 hrs, dt= 0.01 hrs

Link DP 1:

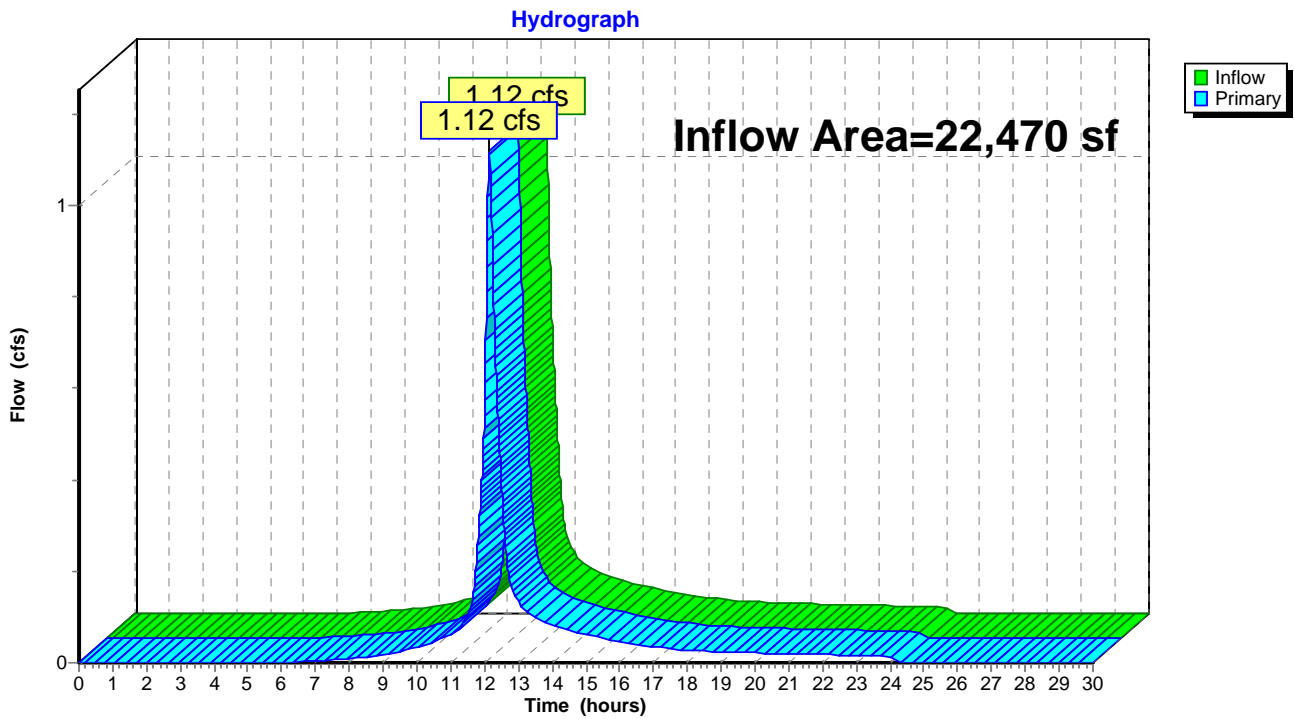

3082 Post-construction

Type III 24-hr 10 Year Storm Rainfall=5.60"

Prepared by Ambit Engineering, Inc.

Printed 3/16/2020

HydroCAD® 10.00 s/n 00801 © 2013 HydroCAD Software Solutions LLC

Page 21

Time span=0.00-30.00 hrs, dt=0.01 hrs, 3001 points
 Runoff by SCS TR-20 method, UH=SCS, Weighted-CN
 Reach routing by Stor-Ind+Trans method - Pond routing by Stor-Ind method

Subcatchment OS 1: Off Site Runoff Area=18,588 sf 74.45% Impervious Runoff Depth=4.35"
 Flow Length=722' Tc=10.8 min CN=89 Runoff=1.79 cfs 6,736 cf

Subcatchment PS1: Runoff Area=2,893 sf 48.81% Impervious Runoff Depth=3.32"
 Flow Length=143' Slope=0.0200 '/' Tc=0.8 min CN=79 Runoff=0.31 cfs 802 cf

Subcatchment PS1a: Roof Runoff to Drip Runoff Area=2,717 sf 100.00% Impervious Runoff Depth=5.36"
 Tc=10.0 min CN=98 Runoff=0.30 cfs 1,214 cf

Subcatchment PS2: Runoff Area=1,411 sf 47.84% Impervious Runoff Depth=3.32"
 Flow Length=89' Slope=0.0200 '/' Tc=1.1 min CN=79 Runoff=0.15 cfs 391 cf

Subcatchment PS3: Runoff Area=3,882 sf 0.00% Impervious Runoff Depth=1.74"
 Flow Length=552' Tc=6.3 min CN=61 Runoff=0.17 cfs 564 cf

Pond 1P: CB in Salem Street Peak Elev=15.66' Inflow=0.64 cfs 2,407 cf
 15.0" Round Culvert n=0.013 L=9.0' S=0.0056 '/' Outflow=0.64 cfs 2,407 cf

Pond 2P: CB at Site Entrance on Salem Street Peak Elev=18.82' Inflow=0.64 cfs 2,407 cf
 15.0" Round Culvert n=0.013 L=36.0' S=0.0867 '/' Outflow=0.64 cfs 2,407 cf

Pond 3P: New DMH Salem Street Peak Elev=15.45' Inflow=0.64 cfs 2,407 cf
 15.0" Round Culvert n=0.013 L=97.0' S=0.0333 '/' Outflow=0.64 cfs 2,407 cf

Pond 5P: New DMH at Salem / McDonough Peak Elev=12.20' Inflow=0.64 cfs 2,407 cf
 15.0" Round Culvert n=0.013 L=15.0' S=0.0187 '/' Outflow=0.64 cfs 2,407 cf

Pond 6P: CB3 Peak Elev=12.24' Inflow=0.64 cfs 2,407 cf
 15.0" Round Culvert n=0.013 L=32.0' S=0.0394 '/' Outflow=0.64 cfs 2,407 cf

Pond 7P: DMH2 Peak Elev=10.97' Inflow=0.64 cfs 2,407 cf
 18.0" Round Culvert n=0.013 L=200.0' S=0.0529 '/' Outflow=0.64 cfs 2,407 cf

Pond DP 2: CB at corner of Cabot Street and McDonough Street Inflow=2.44 cfs 9,706 cf
 Primary=2.44 cfs 9,706 cf

Link DP 1: Inflow=1.94 cfs 7,300 cf
 Primary=1.94 cfs 7,300 cf

Total Runoff Area = 29,491 sf Runoff Volume = 9,706 cf Average Runoff Depth = 3.95"
36.79% Pervious = 10,849 sf 63.21% Impervious = 18,642 sf

3082 Post-construction

Type III 24-hr 10 Year Storm Rainfall=5.60"

Prepared by Ambit Engineering, Inc.

Printed 3/16/2020

HydroCAD® 10.00 s/n 00801 © 2013 HydroCAD Software Solutions LLC

Page 22

Summary for Subcatchment OS 1: Off Site


Runoff = 1.79 cfs @ 12.15 hrs, Volume= 6,736 cf, Depth= 4.35"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-30.00 hrs, dt= 0.01 hrs
Type III 24-hr 10 Year Storm Rainfall=5.60"

Area (sf)	CN	Description
13,838	98	Unconnected roofs, HSG B
4,750	61	>75% Grass cover, Good, HSG B
18,588	89	Weighted Average
4,750		25.55% Pervious Area
13,838		74.45% Impervious Area
13,838		100.00% Unconnected

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
1.8	119	0.0252	1.11		Shallow Concentrated Flow, Short Grass Pasture Kv= 7.0 fps
0.6	46	0.0326	1.39		Sheet Flow, Smooth surfaces n= 0.011 P2= 3.00"
2.9	42	0.0833	0.25		Sheet Flow, Grass: Short n= 0.150 P2= 3.00"
4.0	305	0.0328	1.27		Shallow Concentrated Flow, Short Grass Pasture Kv= 7.0 fps
1.5	210	0.0130	2.31		Shallow Concentrated Flow, Paved Kv= 20.3 fps
10.8	722	Total			

Subcatchment OS 1: Off Site

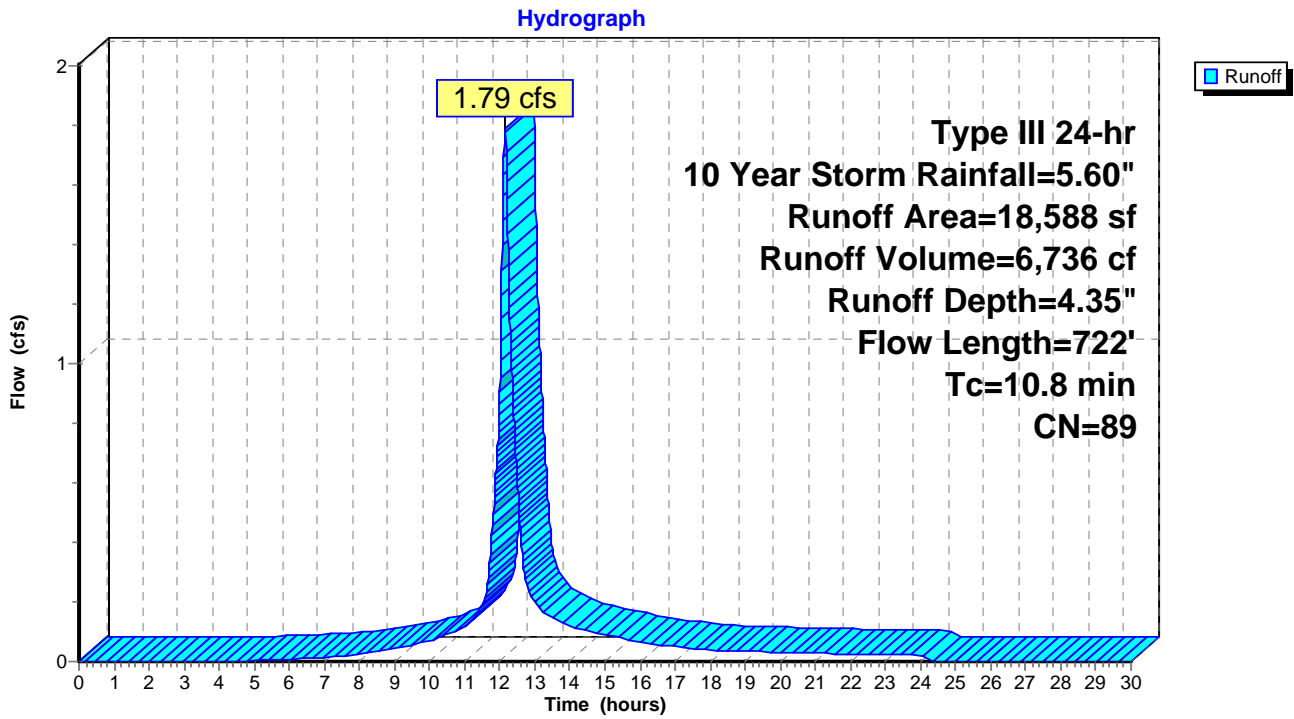

3082 Post-construction

Prepared by Ambit Engineering, Inc.

HydroCAD® 10.00 s/n 00801 © 2013 HydroCAD Software Solutions LLC

Type III 24-hr 10 Year Storm Rainfall=5.60"

Printed 3/16/2020

Page 24

Summary for Subcatchment PS1:


Runoff = 0.31 cfs @ 12.01 hrs, Volume= 802 cf, Depth= 3.32"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-30.00 hrs, dt= 0.01 hrs
Type III 24-hr 10 Year Storm Rainfall=5.60"

Area (sf)	CN	Description
1,481	61	>75% Grass cover, Good, HSG B
1,412	98	Paved parking, HSG B
2,893	79	Weighted Average
1,481		51.19% Pervious Area
1,412		48.81% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.8	143	0.0200	2.87		Shallow Concentrated Flow, Paved Kv= 20.3 fps

Subcatchment PS1:

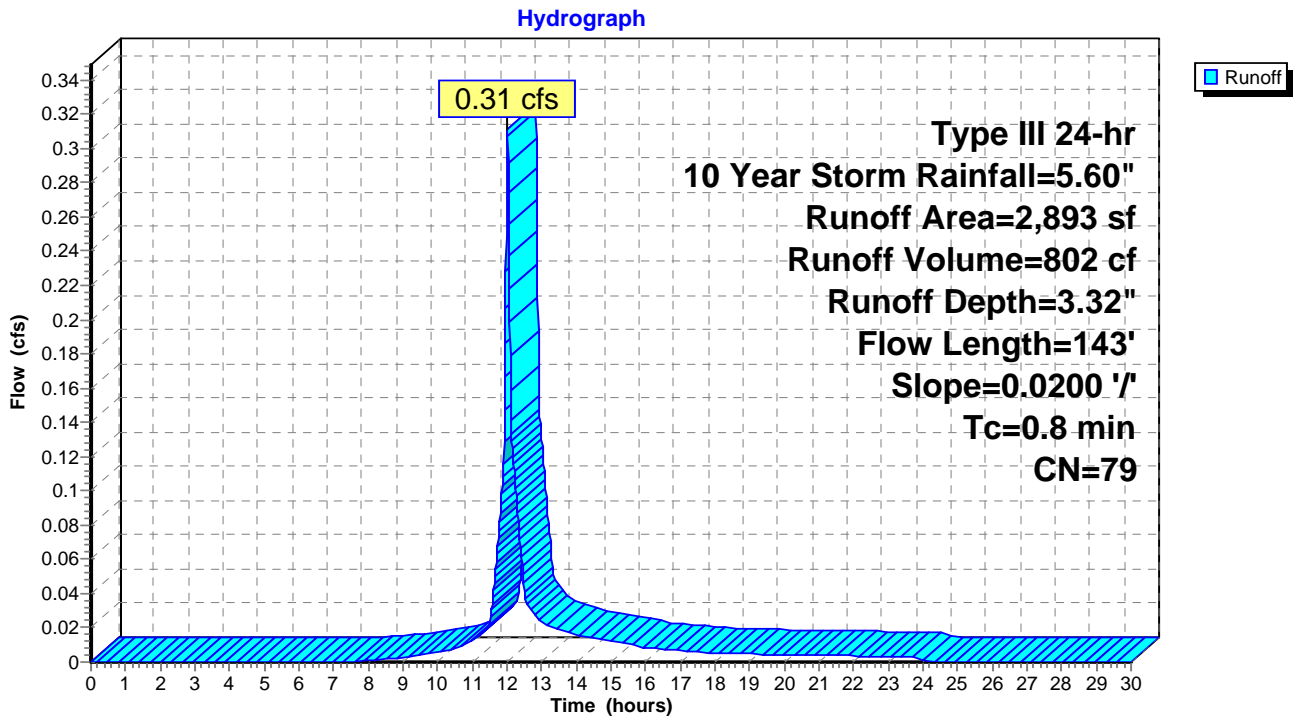

3082 Post-construction

Prepared by Ambit Engineering, Inc.

HydroCAD® 10.00 s/n 00801 © 2013 HydroCAD Software Solutions LLC

Type III 24-hr 10 Year Storm Rainfall=5.60"

Printed 3/16/2020

Page 25

Summary for Subcatchment PS1a: Roof Runoff to Drip Edge Filter Strips


Runoff = 0.30 cfs @ 12.13 hrs, Volume= 1,214 cf, Depth= 5.36"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-30.00 hrs, dt= 0.01 hrs
Type III 24-hr 10 Year Storm Rainfall=5.60"

Area (sf)	CN	Description
2,717	98	Roofs, HSG B
2,717		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
10.0					Direct Entry, Travel Time Through Filter Media

Subcatchment PS1a: Roof Runoff to Drip Edge Filter Strips

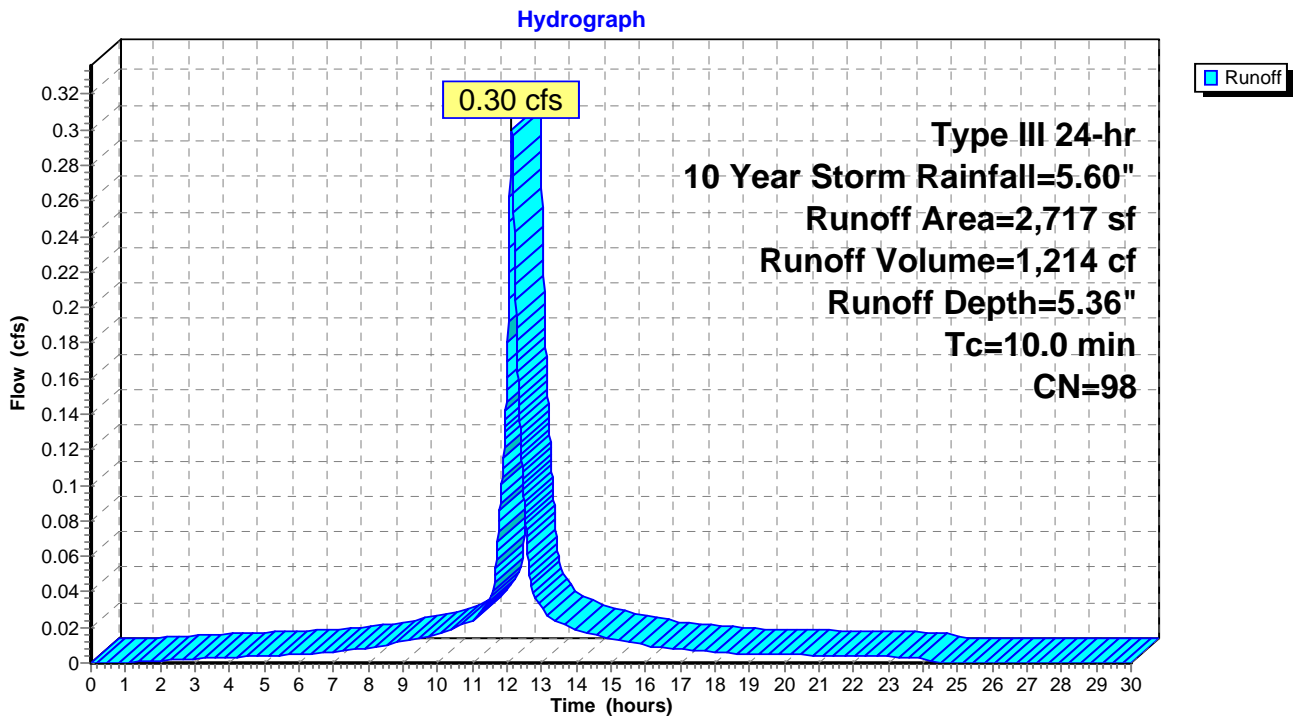

3082 Post-construction

Type III 24-hr 10 Year Storm Rainfall=5.60"

Prepared by Ambit Engineering, Inc.

Printed 3/16/2020

HydroCAD® 10.00 s/n 00801 © 2013 HydroCAD Software Solutions LLC

Page 26

Summary for Subcatchment PS2:

Runoff = 0.15 cfs @ 12.02 hrs, Volume= 391 cf, Depth= 3.32"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-30.00 hrs, dt= 0.01 hrs
Type III 24-hr 10 Year Storm Rainfall=5.60"

Area (sf)	CN	Description
382	98	Paved parking, HSG B
293	98	Roofs, HSG B
736	61	>75% Grass cover, Good, HSG B
1,411	79	Weighted Average
736		52.16% Pervious Area
675		47.84% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
1.1	89	0.0200	1.30		Sheet Flow, Smooth surfaces n= 0.011 P2= 3.00"

Subcatchment PS2:

Hydrograph

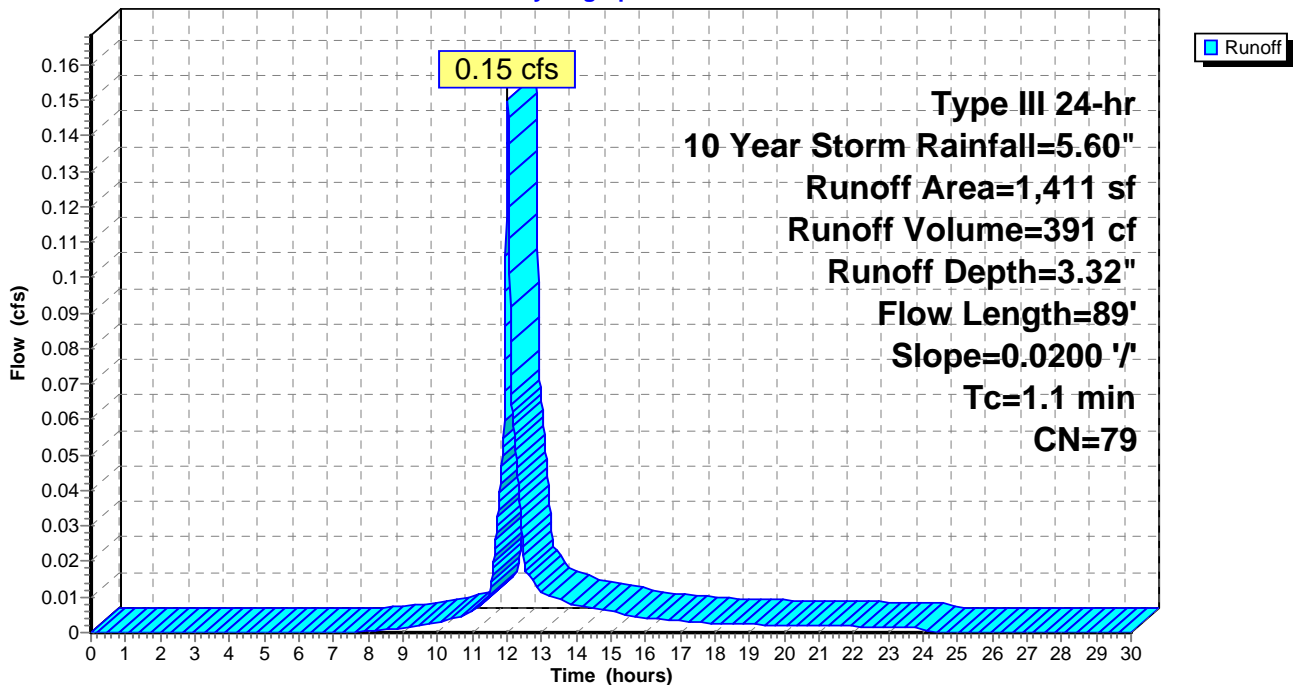

3082 Post-construction

Prepared by Ambit Engineering, Inc.

HydroCAD® 10.00 s/n 00801 © 2013 HydroCAD Software Solutions LLC

Type III 24-hr 10 Year Storm Rainfall=5.60"

Printed 3/16/2020

Page 27

Summary for Subcatchment PS3:

Runoff = 0.17 cfs @ 12.10 hrs, Volume= 564 cf, Depth= 1.74"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-30.00 hrs, dt= 0.01 hrs
Type III 24-hr 10 Year Storm Rainfall=5.60"

Area (sf)	CN	Description
3,882	61	>75% Grass cover, Good, HSG B
3,882		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
4.8	342	0.0292	1.20		Shallow Concentrated Flow, Short Grass Pasture Kv= 7.0 fps
1.5	210	0.0130	2.31		Shallow Concentrated Flow, Paved Kv= 20.3 fps
6.3	552	Total			

Subcatchment PS3:

Hydrograph

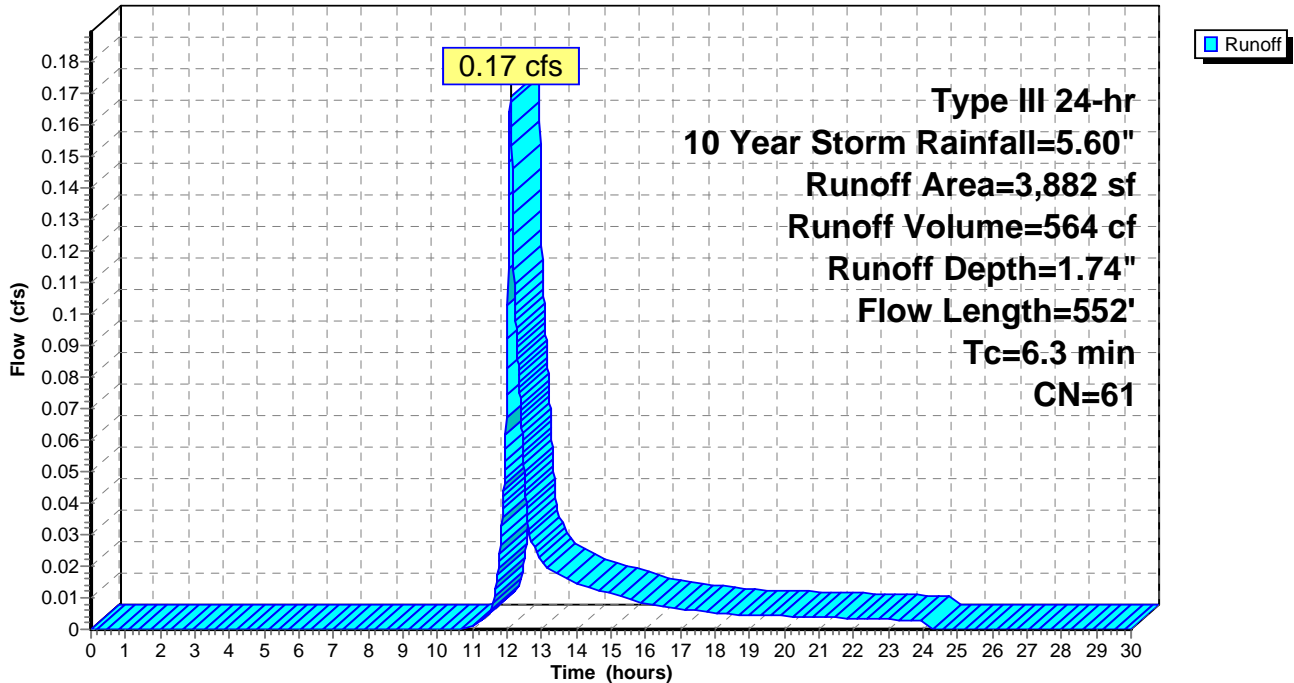

3082 Post-construction

Prepared by Ambit Engineering, Inc.

HydroCAD® 10.00 s/n 00801 © 2013 HydroCAD Software Solutions LLC

Type III 24-hr 10 Year Storm Rainfall=5.60"

Printed 3/16/2020

Page 28

Summary for Pond 1P: CB in Salem Street

Inflow Area = 7,021 sf, 68.42% Impervious, Inflow Depth = 4.11" for 10 Year Storm event
Inflow = 0.64 cfs @ 12.02 hrs, Volume= 2,407 cf
Outflow = 0.64 cfs @ 12.02 hrs, Volume= 2,407 cf, Atten= 0%, Lag= 0.0 min
Primary = 0.64 cfs @ 12.02 hrs, Volume= 2,407 cf


Routing by Stor-Ind method, Time Span= 0.00-30.00 hrs, dt= 0.01 hrs
Peak Elev= 15.66' @ 12.02 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	15.18'	15.0" Round Culvert L= 9.0' CPP, projecting, no headwall, Ke= 0.900 Inlet / Outlet Invert= 15.18' / 15.13' S= 0.0056 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 1.23 sf

Primary OutFlow Max=0.64 cfs @ 12.02 hrs HW=15.66' (Free Discharge)
←1=Culvert (Barrel Controls 0.64 cfs @ 2.19 fps)

Pond 1P: CB in Salem Street

Hydrograph

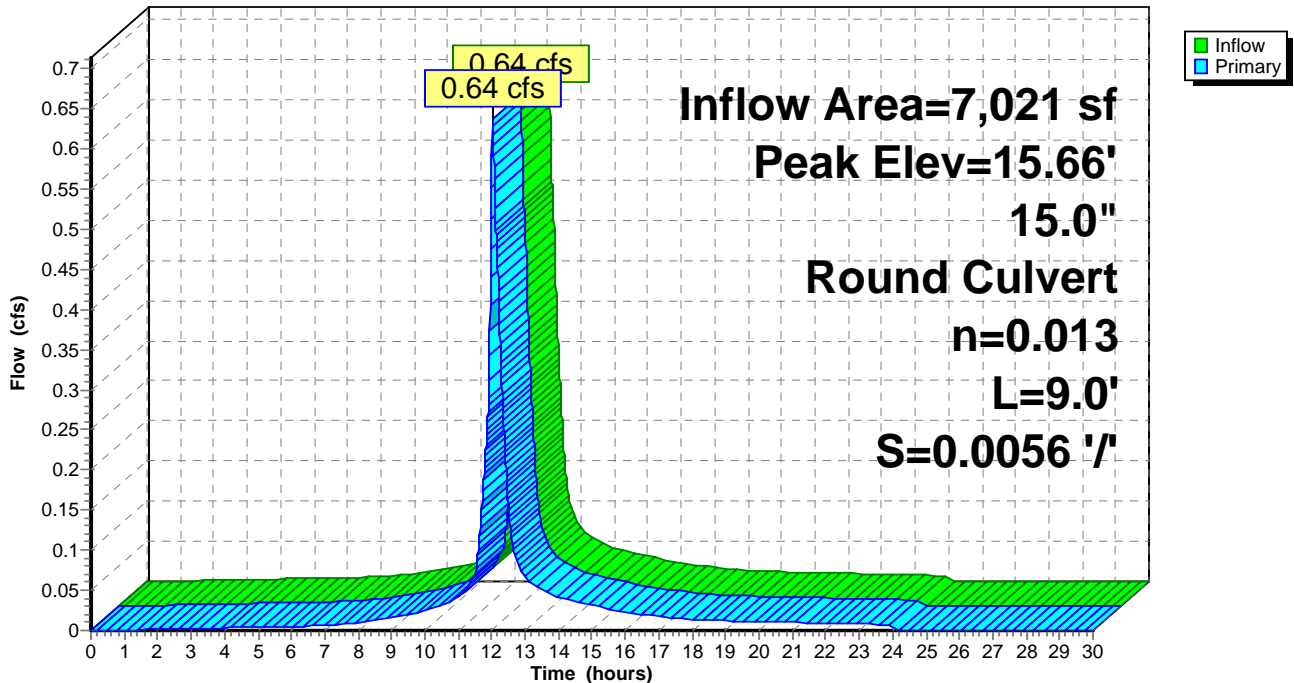

3082 Post-construction

Prepared by Ambit Engineering, Inc.

HydroCAD® 10.00 s/n 00801 © 2013 HydroCAD Software Solutions LLC

Type III 24-hr 10 Year Storm Rainfall=5.60"

Printed 3/16/2020

Page 29

Summary for Pond 2P: CB at Site Entrance on Salem Street


Inflow Area = 7,021 sf, 68.42% Impervious, Inflow Depth = 4.11" for 10 Year Storm event
Inflow = 0.64 cfs @ 12.02 hrs, Volume= 2,407 cf
Outflow = 0.64 cfs @ 12.02 hrs, Volume= 2,407 cf, Atten= 0%, Lag= 0.0 min
Primary = 0.64 cfs @ 12.02 hrs, Volume= 2,407 cf

Routing by Stor-Ind method, Time Span= 0.00-30.00 hrs, dt= 0.01 hrs
Peak Elev= 18.82' @ 12.02 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	18.40'	15.0" Round Culvert L= 36.0' CPP, projecting, no headwall, Ke= 0.900 Inlet / Outlet Invert= 18.40' / 15.28' S= 0.0867 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 1.23 sf

Primary OutFlow Max=0.64 cfs @ 12.02 hrs HW=18.82' (Free Discharge)
1=Culvert (Inlet Controls 0.64 cfs @ 1.75 fps)

Pond 2P: CB at Site Entrance on Salem Street

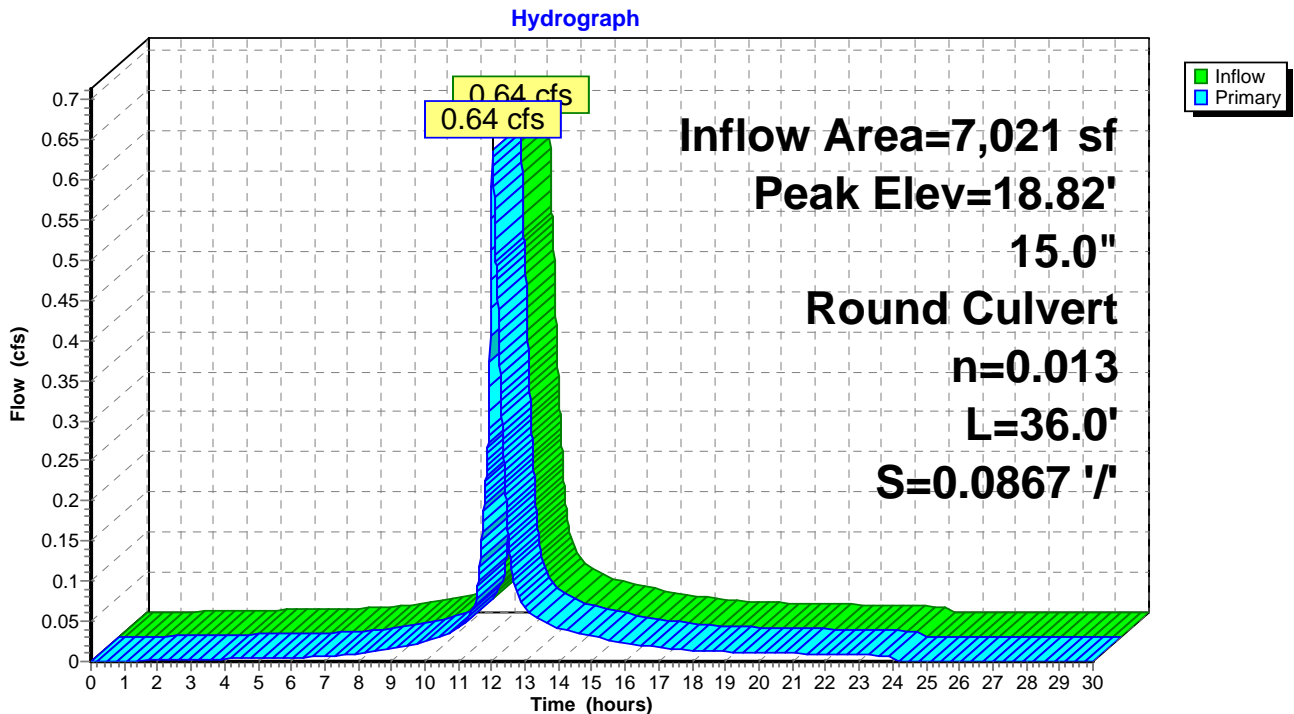

3082 Post-construction

Prepared by Ambit Engineering, Inc.

HydroCAD® 10.00 s/n 00801 © 2013 HydroCAD Software Solutions LLC

Type III 24-hr 10 Year Storm Rainfall=5.60"

Printed 3/16/2020

Page 30

Summary for Pond 3P: New DMH Salem Street

Inflow Area = 7,021 sf, 68.42% Impervious, Inflow Depth = 4.11" for 10 Year Storm event
Inflow = 0.64 cfs @ 12.02 hrs, Volume= 2,407 cf
Outflow = 0.64 cfs @ 12.02 hrs, Volume= 2,407 cf, Atten= 0%, Lag= 0.0 min
Primary = 0.64 cfs @ 12.02 hrs, Volume= 2,407 cf


Routing by Stor-Ind method, Time Span= 0.00-30.00 hrs, dt= 0.01 hrs
Peak Elev= 15.45' @ 12.02 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	15.03'	15.0" Round Culvert L= 97.0' CPP, projecting, no headwall, Ke= 0.900 Inlet / Outlet Invert= 15.03' / 11.80' S= 0.0333 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 1.23 sf

Primary OutFlow Max=0.64 cfs @ 12.02 hrs HW=15.45' (Free Discharge)
↑1=Culvert (Inlet Controls 0.64 cfs @ 1.75 fps)

Pond 3P: New DMH Salem Street

Hydrograph

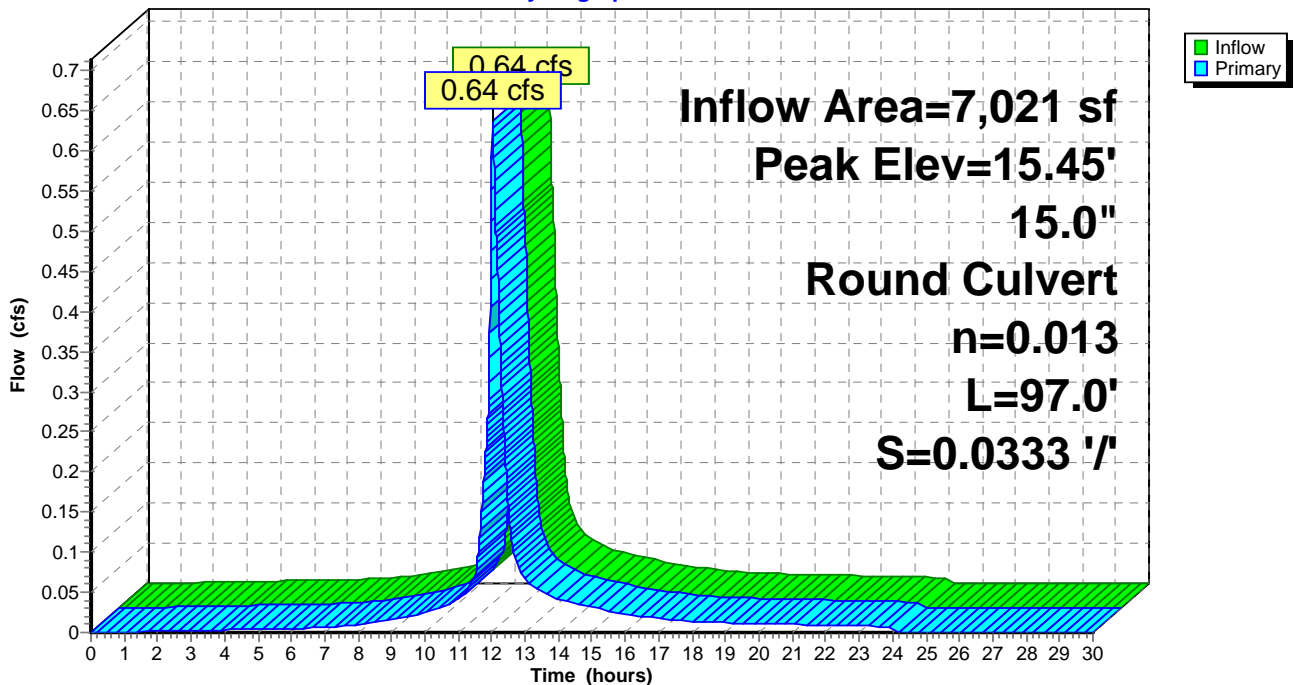

3082 Post-construction

Prepared by Ambit Engineering, Inc.

HydroCAD® 10.00 s/n 00801 © 2013 HydroCAD Software Solutions LLC

Type III 24-hr 10 Year Storm Rainfall=5.60"

Printed 3/16/2020

Page 31

Summary for Pond 5P: New DMH at Salem / McDonough


Inflow Area = 7,021 sf, 68.42% Impervious, Inflow Depth = 4.11" for 10 Year Storm event
 Inflow = 0.64 cfs @ 12.02 hrs, Volume= 2,407 cf
 Outflow = 0.64 cfs @ 12.02 hrs, Volume= 2,407 cf, Atten= 0%, Lag= 0.0 min
 Primary = 0.64 cfs @ 12.02 hrs, Volume= 2,407 cf

Routing by Stor-Ind method, Time Span= 0.00-30.00 hrs, dt= 0.01 hrs
 Peak Elev= 12.20' @ 12.02 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	11.78'	15.0" Round Culvert L= 15.0' CPP, projecting, no headwall, Ke= 0.900 Inlet / Outlet Invert= 11.78' / 11.50' S= 0.0187 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 1.23 sf

Primary OutFlow Max=0.64 cfs @ 12.02 hrs HW=12.20' (Free Discharge)
 ←1=Culvert (Inlet Controls 0.64 cfs @ 1.75 fps)

Pond 5P: New DMH at Salem / McDonough

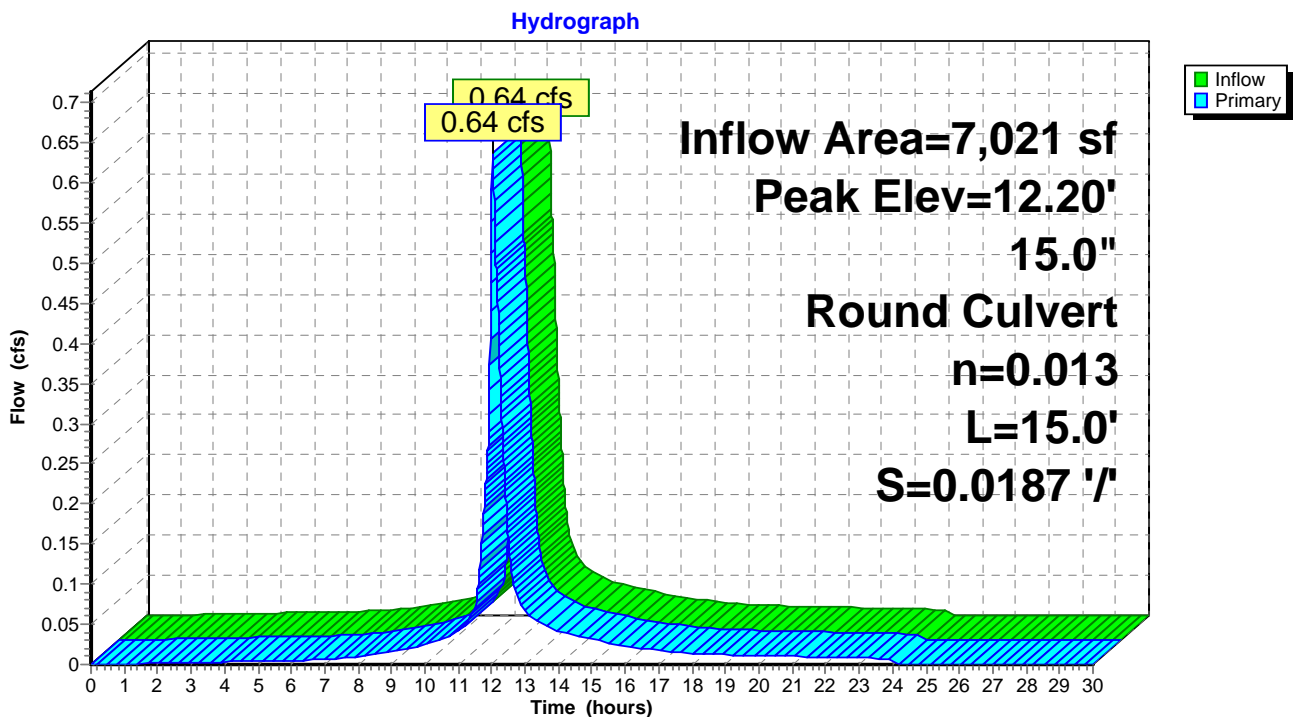

3082 Post-construction

Prepared by Ambit Engineering, Inc.

HydroCAD® 10.00 s/n 00801 © 2013 HydroCAD Software Solutions LLC

Type III 24-hr 10 Year Storm Rainfall=5.60"

Printed 3/16/2020

Page 32

Summary for Pond 6P: CB3

Inflow Area = 7,021 sf, 68.42% Impervious, Inflow Depth = 4.11" for 10 Year Storm event
Inflow = 0.64 cfs @ 12.02 hrs, Volume= 2,407 cf
Outflow = 0.64 cfs @ 12.02 hrs, Volume= 2,407 cf, Atten= 0%, Lag= 0.0 min
Primary = 0.64 cfs @ 12.02 hrs, Volume= 2,407 cf


Routing by Stor-Ind method, Time Span= 0.00-30.00 hrs, dt= 0.01 hrs
Peak Elev= 12.24' @ 12.02 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	11.82'	15.0" Round Culvert L= 32.0' CPP, projecting, no headwall, Ke= 0.900 Inlet / Outlet Invert= 11.82' / 10.56' S= 0.0394 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 1.23 sf

Primary OutFlow Max=0.64 cfs @ 12.02 hrs HW=12.24' (Free Discharge)
↑**1=Culvert** (Inlet Controls 0.64 cfs @ 1.75 fps)

Pond 6P: CB3

Hydrograph

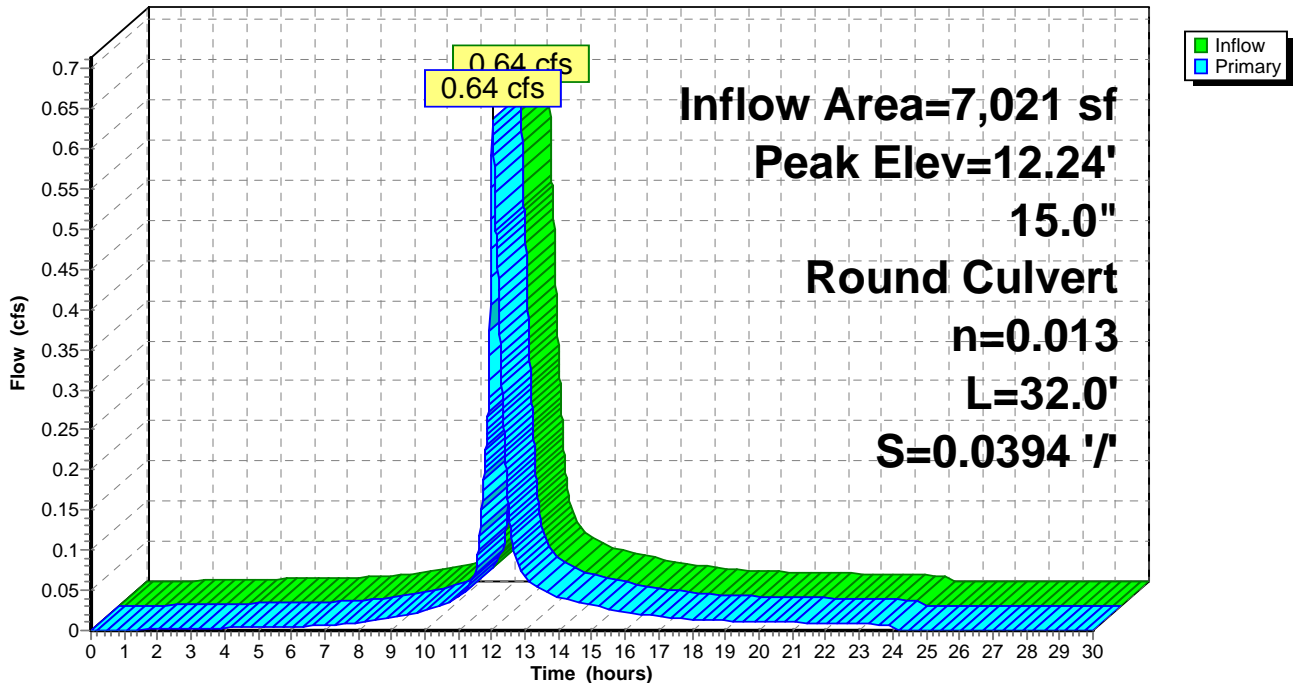

3082 Post-construction

Prepared by Ambit Engineering, Inc.

HydroCAD® 10.00 s/n 00801 © 2013 HydroCAD Software Solutions LLC

Type III 24-hr 10 Year Storm Rainfall=5.60"

Printed 3/16/2020

Page 33

Summary for Pond 7P: DMH2

Inflow Area = 7,021 sf, 68.42% Impervious, Inflow Depth = 4.11" for 10 Year Storm event
Inflow = 0.64 cfs @ 12.02 hrs, Volume= 2,407 cf
Outflow = 0.64 cfs @ 12.02 hrs, Volume= 2,407 cf, Atten= 0%, Lag= 0.0 min
Primary = 0.64 cfs @ 12.02 hrs, Volume= 2,407 cf


Routing by Stor-Ind method, Time Span= 0.00-30.00 hrs, dt= 0.01 hrs
Peak Elev= 10.97' @ 12.02 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	10.57'	18.0" Round Culvert L= 200.0' CPP, projecting, no headwall, Ke= 0.900 Inlet / Outlet Invert= 10.57' / 0.00' S= 0.0529 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 1.77 sf

Primary OutFlow Max=0.64 cfs @ 12.02 hrs HW=10.97' (Free Discharge)
1=Culvert (Inlet Controls 0.64 cfs @ 1.70 fps)

Pond 7P: DMH2

Hydrograph

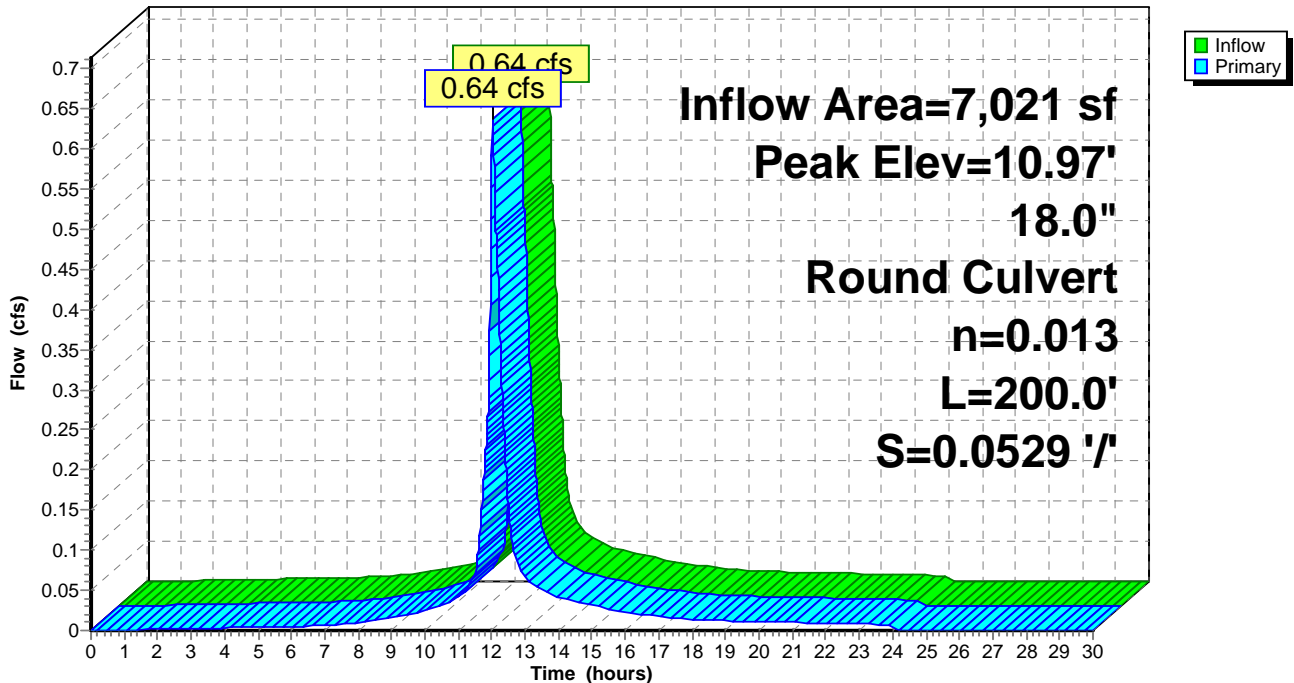


Summary for Pond DP 2: CB at corner of Cabot Street and McDonough Street

Inflow Area = 29,491 sf, 63.21% Impervious, Inflow Depth = 3.95" for 10 Year Storm event
Inflow = 2.44 cfs @ 12.14 hrs, Volume= 9,706 cf
Primary = 2.44 cfs @ 12.14 hrs, Volume= 9,706 cf, Atten= 0%, Lag= 0.0 min

Routing by Stor-Ind method, Time Span= 0.00-30.00 hrs, dt= 0.01 hrs

Pond DP 2: CB at corner of Cabot Street and McDonough Street

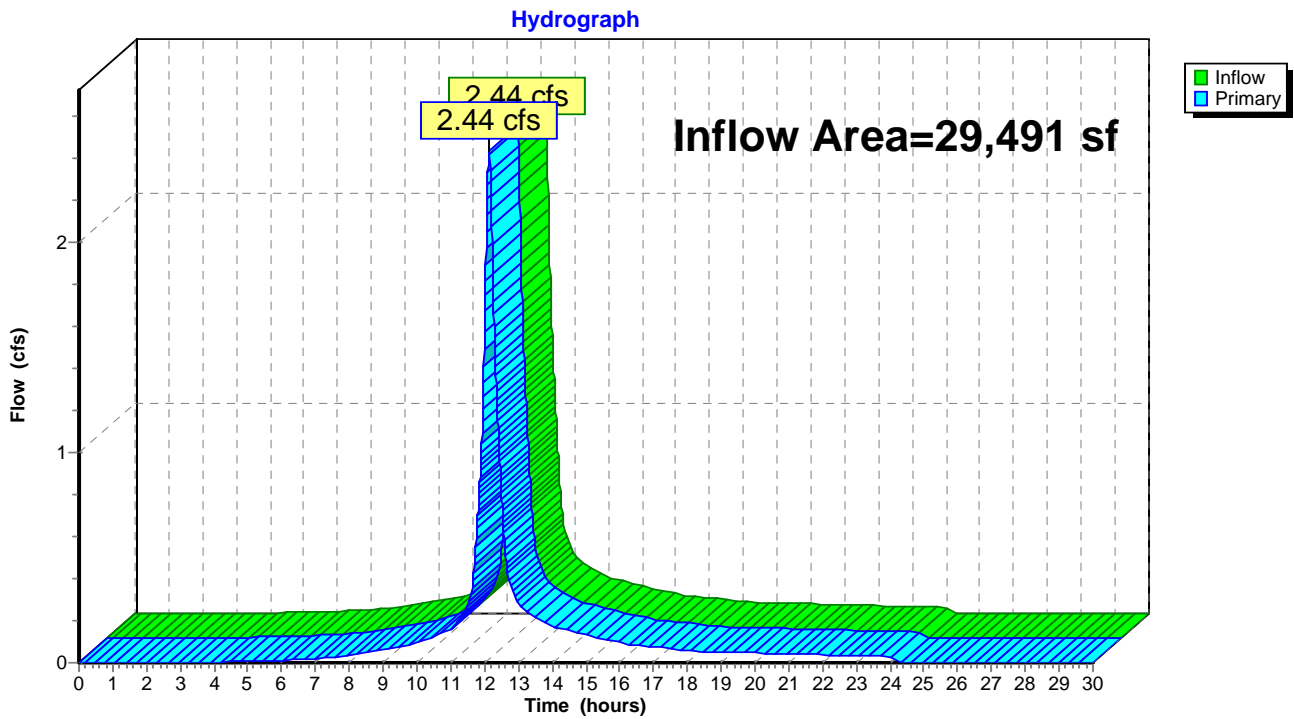


Summary for Link DP 1:

Inflow Area = 22,470 sf, 61.58% Impervious, Inflow Depth = 3.90" for 10 Year Storm event
Inflow = 1.94 cfs @ 12.14 hrs, Volume= 7,300 cf
Primary = 1.94 cfs @ 12.14 hrs, Volume= 7,300 cf, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-30.00 hrs, dt= 0.01 hrs

Link DP 1:

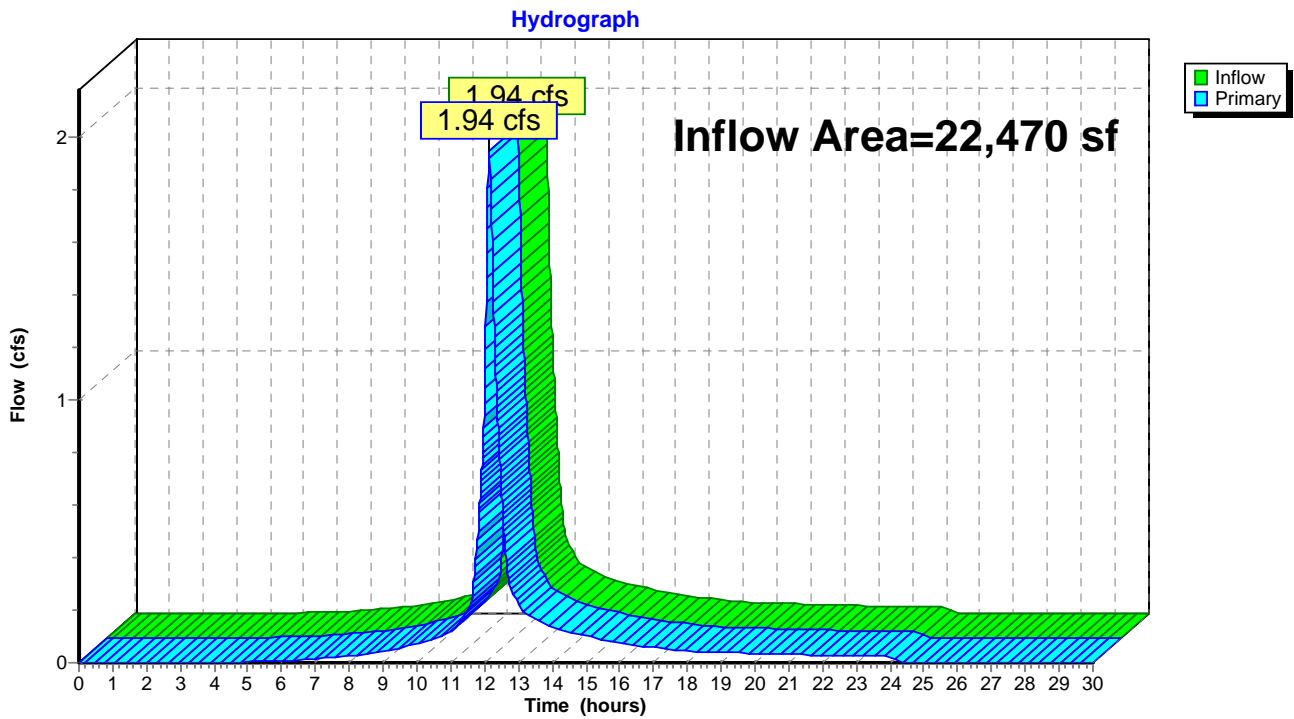

3082 Post-construction

Type III 24-hr 25 Year Storm Rainfall=7.10"

Prepared by Ambit Engineering, Inc.

Printed 3/16/2020

HydroCAD® 10.00 s/n 00801 © 2013 HydroCAD Software Solutions LLC

Page 36

Time span=0.00-30.00 hrs, dt=0.01 hrs, 3001 points
 Runoff by SCS TR-20 method, UH=SCS, Weighted-CN
 Reach routing by Stor-Ind+Trans method - Pond routing by Stor-Ind method

Subcatchment OS 1: Off Site Runoff Area=18,588 sf 74.45% Impervious Runoff Depth=5.81"
 Flow Length=722' Tc=10.8 min CN=89 Runoff=2.36 cfs 8,993 cf

Subcatchment PS1: Runoff Area=2,893 sf 48.81% Impervious Runoff Depth=4.68"
 Flow Length=143' Slope=0.0200 '/ Tc=0.8 min CN=79 Runoff=0.43 cfs 1,127 cf

Subcatchment PS1a: Roof Runoff to Drip Runoff Area=2,717 sf 100.00% Impervious Runoff Depth=6.86"
 Tc=10.0 min CN=98 Runoff=0.38 cfs 1,553 cf

Subcatchment PS2: Runoff Area=1,411 sf 47.84% Impervious Runoff Depth=4.68"
 Flow Length=89' Slope=0.0200 '/ Tc=1.1 min CN=79 Runoff=0.21 cfs 550 cf

Subcatchment PS3: Runoff Area=3,882 sf 0.00% Impervious Runoff Depth=2.77"
 Flow Length=552' Tc=6.3 min CN=61 Runoff=0.28 cfs 897 cf

Pond 1P: CB in Salem Street Peak Elev=15.75' Inflow=0.87 cfs 3,231 cf
 15.0" Round Culvert n=0.013 L=9.0' S=0.0056 '/ Outflow=0.87 cfs 3,231 cf

Pond 2P: CB at Site Entrance on Salem Street Peak Elev=18.90' Inflow=0.87 cfs 3,231 cf
 15.0" Round Culvert n=0.013 L=36.0' S=0.0867 '/ Outflow=0.87 cfs 3,231 cf

Pond 3P: New DMH Salem Street Peak Elev=15.53' Inflow=0.87 cfs 3,231 cf
 15.0" Round Culvert n=0.013 L=97.0' S=0.0333 '/ Outflow=0.87 cfs 3,231 cf

Pond 5P: New DMH at Salem / McDonough Peak Elev=12.28' Inflow=0.87 cfs 3,231 cf
 15.0" Round Culvert n=0.013 L=15.0' S=0.0187 '/ Outflow=0.87 cfs 3,231 cf

Pond 6P: CB3 Peak Elev=12.32' Inflow=0.87 cfs 3,231 cf
 15.0" Round Culvert n=0.013 L=32.0' S=0.0394 '/ Outflow=0.87 cfs 3,231 cf

Pond 7P: DMH2 Peak Elev=11.04' Inflow=0.87 cfs 3,231 cf
 18.0" Round Culvert n=0.013 L=200.0' S=0.0529 '/ Outflow=0.87 cfs 3,231 cf

Pond DP 2: CB at corner of Cabot Street and McDonough Street Inflow=3.25 cfs 13,121 cf
 Primary=3.25 cfs 13,121 cf

Link DP 1: Inflow=2.61 cfs 9,891 cf
 Primary=2.61 cfs 9,891 cf

Total Runoff Area = 29,491 sf Runoff Volume = 13,121 cf Average Runoff Depth = 5.34"
36.79% Pervious = 10,849 sf 63.21% Impervious = 18,642 sf

3082 Post-construction

Type III 24-hr 25 Year Storm Rainfall=7.10"

Prepared by Ambit Engineering, Inc.

Printed 3/16/2020

HydroCAD® 10.00 s/n 00801 © 2013 HydroCAD Software Solutions LLC

Page 37

Summary for Subcatchment OS 1: Off Site


Runoff = 2.36 cfs @ 12.14 hrs, Volume= 8,993 cf, Depth= 5.81"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-30.00 hrs, dt= 0.01 hrs
Type III 24-hr 25 Year Storm Rainfall=7.10"

Area (sf)	CN	Description
13,838	98	Unconnected roofs, HSG B
4,750	61	>75% Grass cover, Good, HSG B
18,588	89	Weighted Average
4,750		25.55% Pervious Area
13,838		74.45% Impervious Area
13,838		100.00% Unconnected

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
1.8	119	0.0252	1.11		Shallow Concentrated Flow, Short Grass Pasture Kv= 7.0 fps
0.6	46	0.0326	1.39		Sheet Flow, Smooth surfaces n= 0.011 P2= 3.00"
2.9	42	0.0833	0.25		Sheet Flow, Grass: Short n= 0.150 P2= 3.00"
4.0	305	0.0328	1.27		Shallow Concentrated Flow, Short Grass Pasture Kv= 7.0 fps
1.5	210	0.0130	2.31		Shallow Concentrated Flow, Paved Kv= 20.3 fps
10.8	722	Total			

Subcatchment OS 1: Off Site

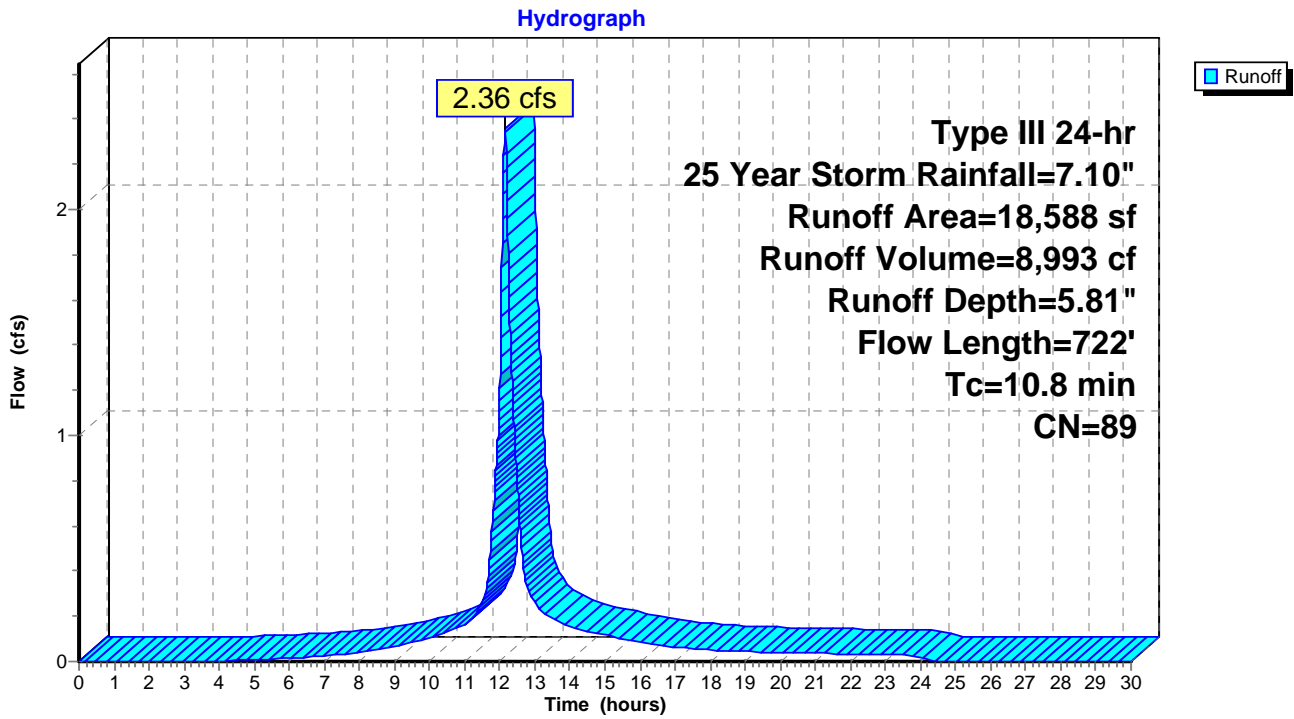

3082 Post-construction

Prepared by Ambit Engineering, Inc.

HydroCAD® 10.00 s/n 00801 © 2013 HydroCAD Software Solutions LLC

Type III 24-hr 25 Year Storm Rainfall=7.10"

Printed 3/16/2020

Page 39

Summary for Subcatchment PS1:

Runoff = 0.43 cfs @ 12.01 hrs, Volume= 1,127 cf, Depth= 4.68"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-30.00 hrs, dt= 0.01 hrs
 Type III 24-hr 25 Year Storm Rainfall=7.10"

Area (sf)	CN	Description
1,481	61	>75% Grass cover, Good, HSG B
1,412	98	Paved parking, HSG B
2,893	79	Weighted Average
1,481		51.19% Pervious Area
1,412		48.81% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.8	143	0.0200	2.87		Shallow Concentrated Flow, Paved Kv= 20.3 fps

Subcatchment PS1:

Hydrograph

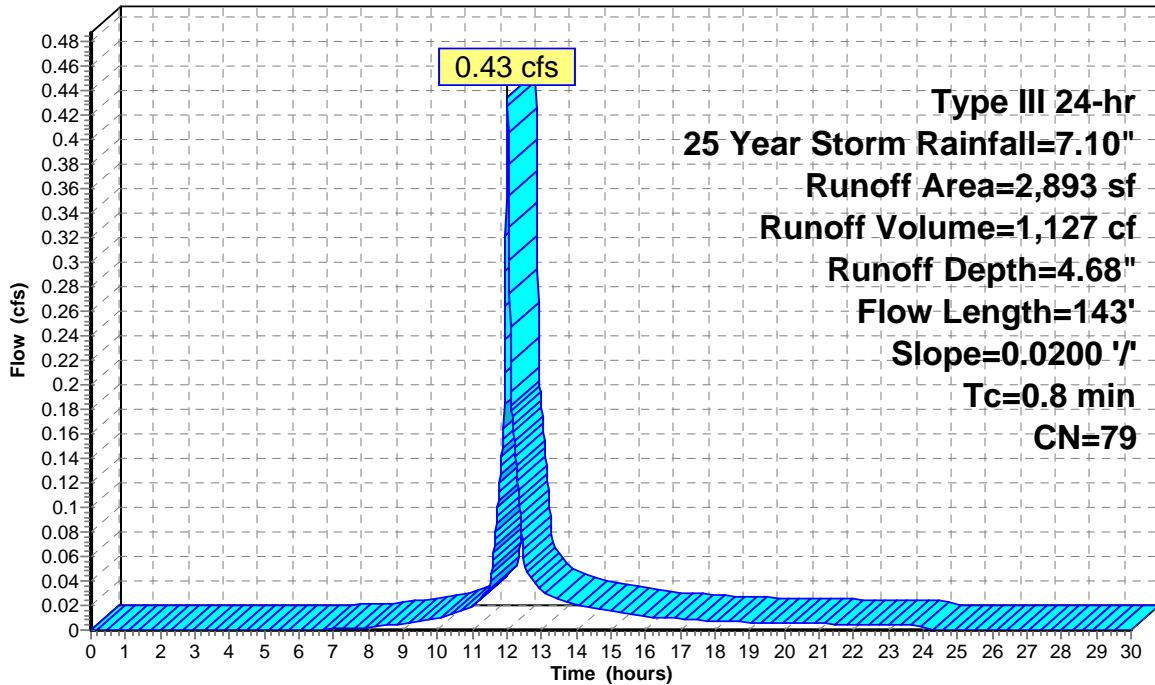

3082 Post-construction

Prepared by Ambit Engineering, Inc.

HydroCAD® 10.00 s/n 00801 © 2013 HydroCAD Software Solutions LLC

Type III 24-hr 25 Year Storm Rainfall=7.10"

Printed 3/16/2020

Page 40

Summary for Subcatchment PS1a: Roof Runoff to Drip Edge Filter Strips


Runoff = 0.38 cfs @ 12.13 hrs, Volume= 1,553 cf, Depth= 6.86"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-30.00 hrs, dt= 0.01 hrs
Type III 24-hr 25 Year Storm Rainfall=7.10"

Area (sf)	CN	Description
2,717	98	Roofs, HSG B
2,717		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
10.0					Direct Entry, Travel Time Through Filter Media

Subcatchment PS1a: Roof Runoff to Drip Edge Filter Strips

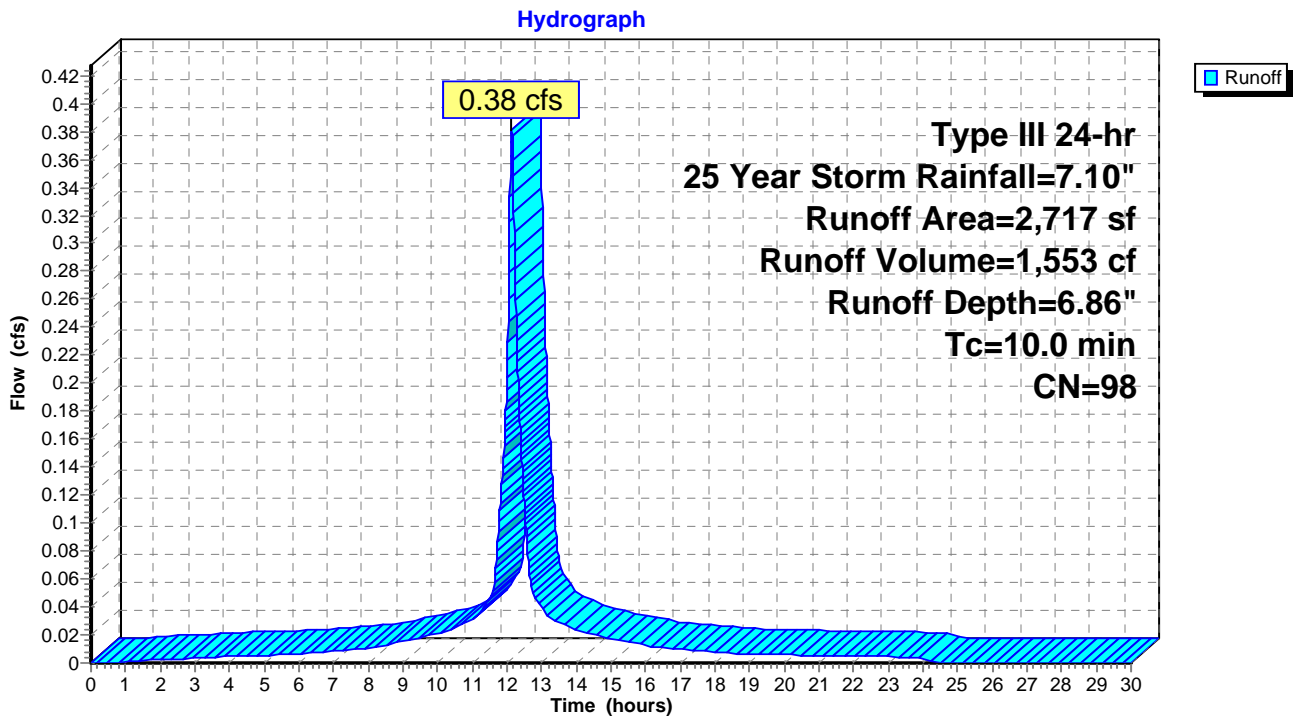

3082 Post-construction

Prepared by Ambit Engineering, Inc.

HydroCAD® 10.00 s/n 00801 © 2013 HydroCAD Software Solutions LLC

Type III 24-hr 25 Year Storm Rainfall=7.10"

Printed 3/16/2020

Page 41

Summary for Subcatchment PS2:

Runoff = 0.21 cfs @ 12.02 hrs, Volume= 550 cf, Depth= 4.68"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-30.00 hrs, dt= 0.01 hrs
 Type III 24-hr 25 Year Storm Rainfall=7.10"

Area (sf)	CN	Description
382	98	Paved parking, HSG B
293	98	Roofs, HSG B
736	61	>75% Grass cover, Good, HSG B
1,411	79	Weighted Average
736		52.16% Pervious Area
675		47.84% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
1.1	89	0.0200	1.30		Sheet Flow, Smooth surfaces n= 0.011 P2= 3.00"

Subcatchment PS2:

Hydrograph

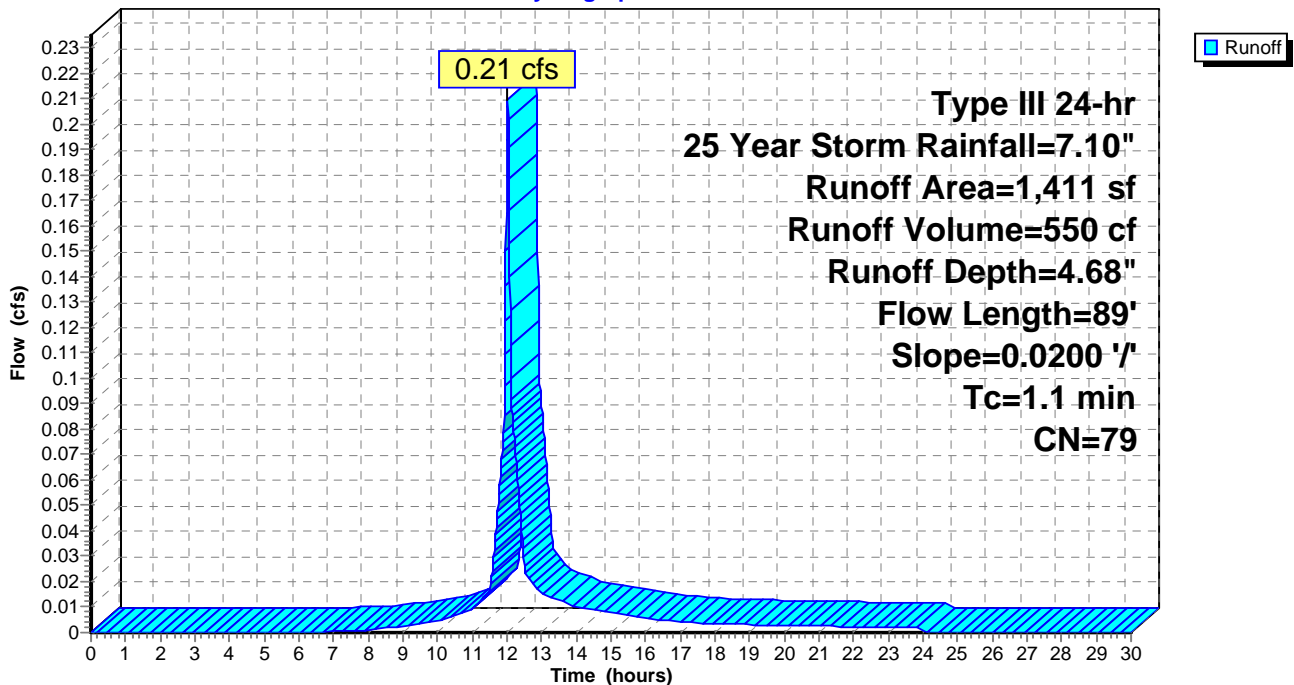

3082 Post-construction

Prepared by Ambit Engineering, Inc.

HydroCAD® 10.00 s/n 00801 © 2013 HydroCAD Software Solutions LLC

Type III 24-hr 25 Year Storm Rainfall=7.10"

Printed 3/16/2020

Page 42

Summary for Subcatchment PS3:

Runoff = 0.28 cfs @ 12.10 hrs, Volume= 897 cf, Depth= 2.77"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-30.00 hrs, dt= 0.01 hrs
Type III 24-hr 25 Year Storm Rainfall=7.10"

Area (sf)	CN	Description
3,882	61	>75% Grass cover, Good, HSG B
3,882		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
4.8	342	0.0292	1.20		Shallow Concentrated Flow, Short Grass Pasture Kv= 7.0 fps
1.5	210	0.0130	2.31		Shallow Concentrated Flow, Paved Kv= 20.3 fps
6.3	552	Total			

Subcatchment PS3:

Hydrograph

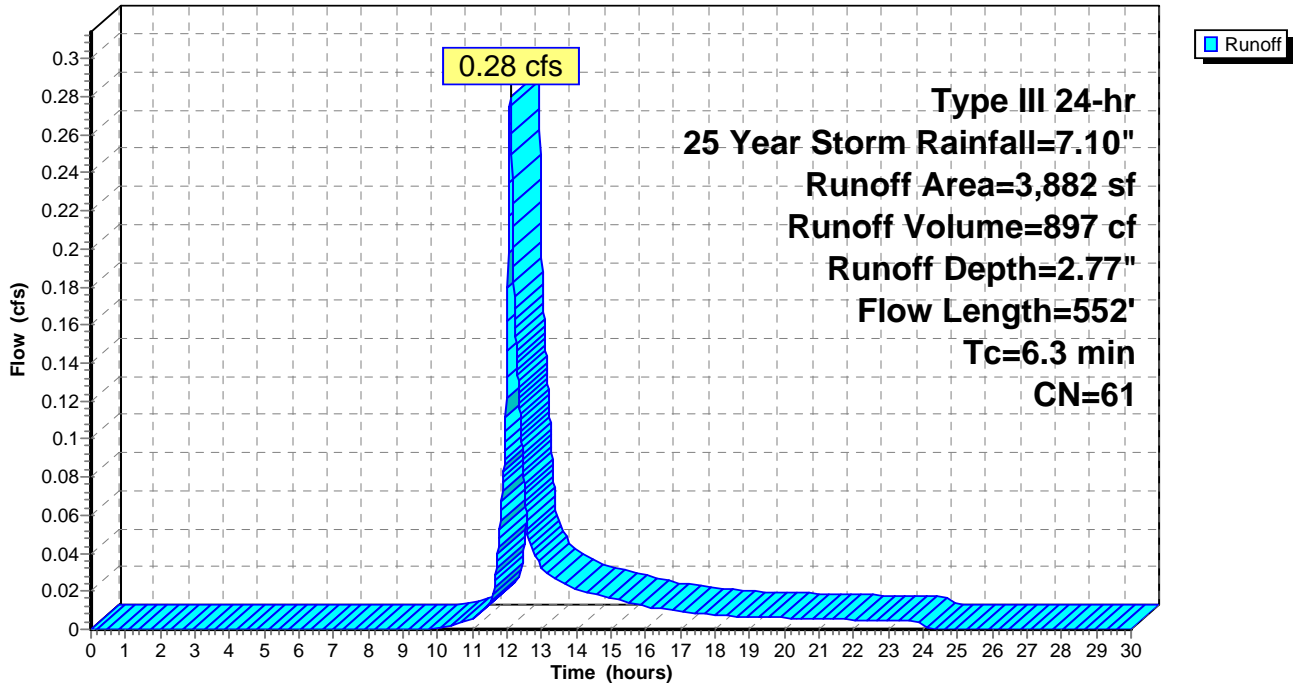

3082 Post-construction

Prepared by Ambit Engineering, Inc.

HydroCAD® 10.00 s/n 00801 © 2013 HydroCAD Software Solutions LLC

Type III 24-hr 25 Year Storm Rainfall=7.10"

Printed 3/16/2020

Page 43

Summary for Pond 1P: CB in Salem Street

Inflow Area = 7,021 sf, 68.42% Impervious, Inflow Depth = 5.52" for 25 Year Storm event
Inflow = 0.87 cfs @ 12.02 hrs, Volume= 3,231 cf
Outflow = 0.87 cfs @ 12.02 hrs, Volume= 3,231 cf, Atten= 0%, Lag= 0.0 min
Primary = 0.87 cfs @ 12.02 hrs, Volume= 3,231 cf


Routing by Stor-Ind method, Time Span= 0.00-30.00 hrs, dt= 0.01 hrs
Peak Elev= 15.75' @ 12.02 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	15.18'	15.0" Round Culvert L= 9.0' CPP, projecting, no headwall, Ke= 0.900 Inlet / Outlet Invert= 15.18' / 15.13' S= 0.0056 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 1.23 sf

Primary OutFlow Max=0.86 cfs @ 12.02 hrs HW=15.74' (Free Discharge)
←1=Culvert (Barrel Controls 0.86 cfs @ 2.36 fps)

Pond 1P: CB in Salem Street

Hydrograph

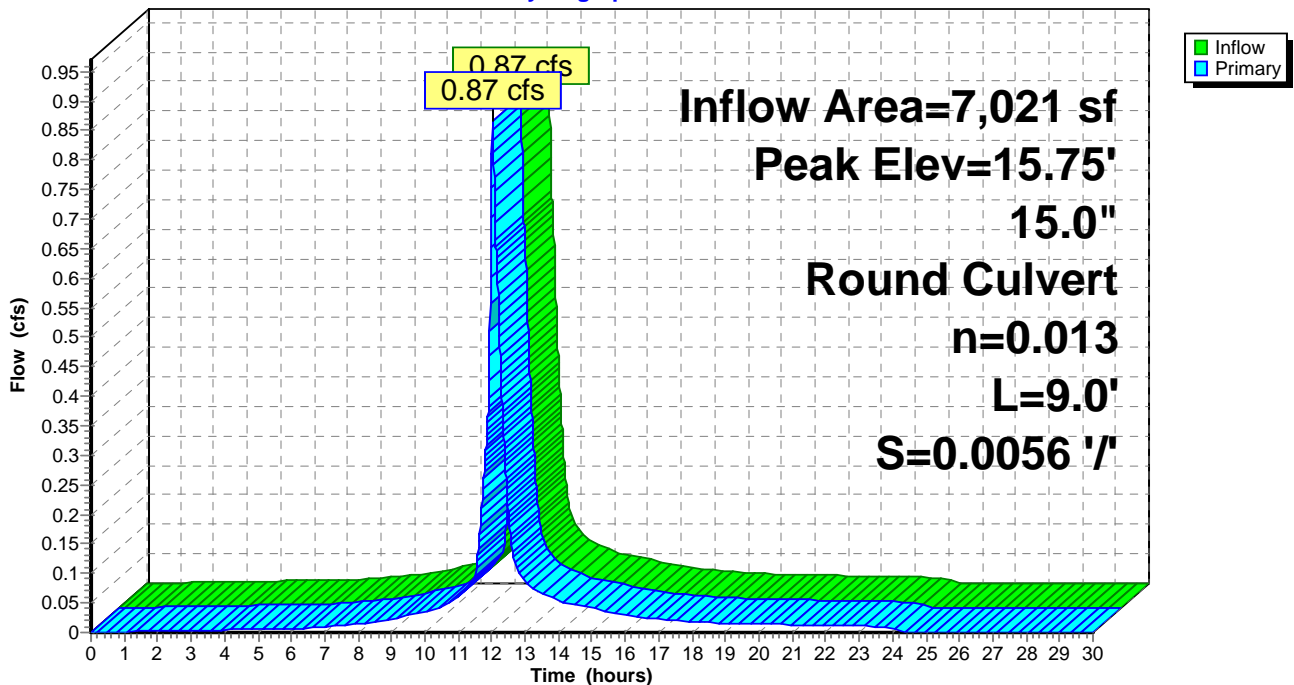

3082 Post-construction

Prepared by Ambit Engineering, Inc.

HydroCAD® 10.00 s/n 00801 © 2013 HydroCAD Software Solutions LLC

Type III 24-hr 25 Year Storm Rainfall=7.10"

Printed 3/16/2020

Page 44

Summary for Pond 2P: CB at Site Entrance on Salem Street


Inflow Area = 7,021 sf, 68.42% Impervious, Inflow Depth = 5.52" for 25 Year Storm event
 Inflow = 0.87 cfs @ 12.02 hrs, Volume= 3,231 cf
 Outflow = 0.87 cfs @ 12.02 hrs, Volume= 3,231 cf, Atten= 0%, Lag= 0.0 min
 Primary = 0.87 cfs @ 12.02 hrs, Volume= 3,231 cf

Routing by Stor-Ind method, Time Span= 0.00-30.00 hrs, dt= 0.01 hrs
 Peak Elev= 18.90' @ 12.02 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	18.40'	15.0" Round Culvert L= 36.0' CPP, projecting, no headwall, Ke= 0.900 Inlet / Outlet Invert= 18.40' / 15.28' S= 0.0867 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 1.23 sf

Primary OutFlow Max=0.86 cfs @ 12.02 hrs HW=18.90' (Free Discharge)
 ←1=Culvert (Inlet Controls 0.86 cfs @ 1.90 fps)

Pond 2P: CB at Site Entrance on Salem Street

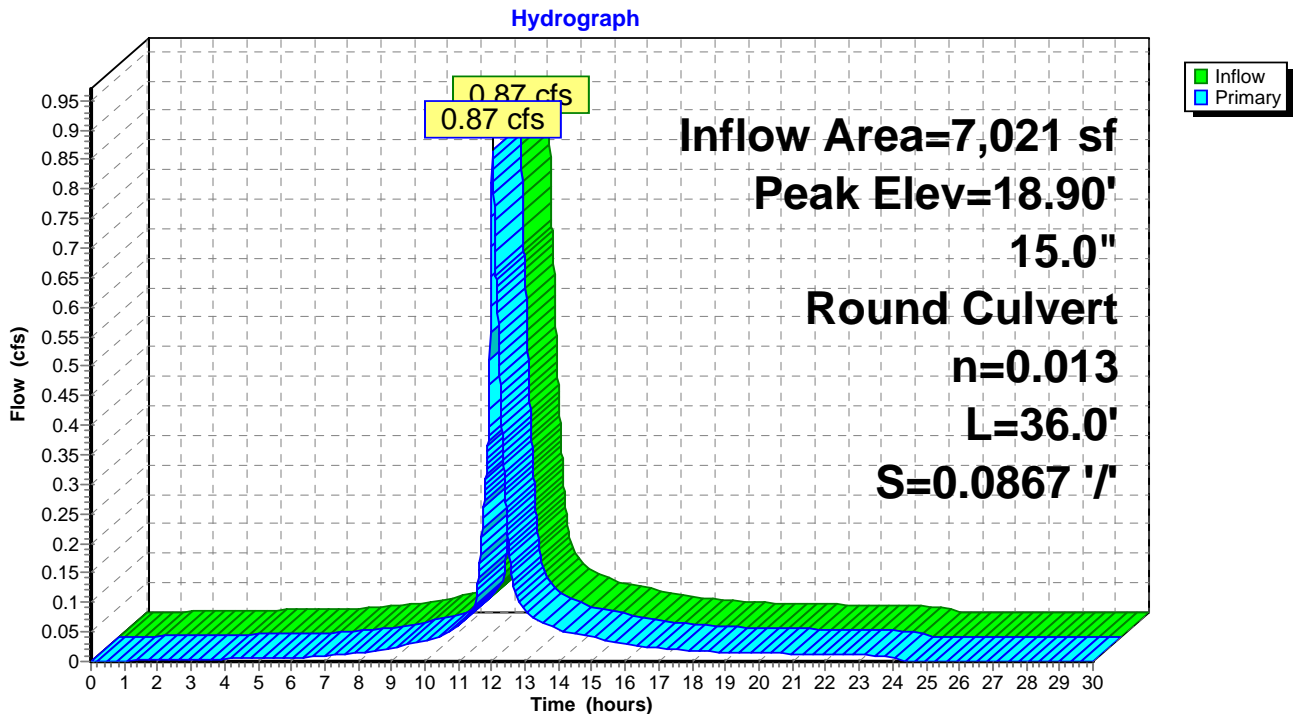

3082 Post-construction

Prepared by Ambit Engineering, Inc.

HydroCAD® 10.00 s/n 00801 © 2013 HydroCAD Software Solutions LLC

Type III 24-hr 25 Year Storm Rainfall=7.10"

Printed 3/16/2020

Page 45

Summary for Pond 3P: New DMH Salem Street

Inflow Area = 7,021 sf, 68.42% Impervious, Inflow Depth = 5.52" for 25 Year Storm event
 Inflow = 0.87 cfs @ 12.02 hrs, Volume= 3,231 cf
 Outflow = 0.87 cfs @ 12.02 hrs, Volume= 3,231 cf, Atten= 0%, Lag= 0.0 min
 Primary = 0.87 cfs @ 12.02 hrs, Volume= 3,231 cf


Routing by Stor-Ind method, Time Span= 0.00-30.00 hrs, dt= 0.01 hrs
 Peak Elev= 15.53' @ 12.02 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	15.03'	15.0" Round Culvert L= 97.0' CPP, projecting, no headwall, Ke= 0.900 Inlet / Outlet Invert= 15.03' / 11.80' S= 0.0333 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 1.23 sf

Primary OutFlow Max=0.86 cfs @ 12.02 hrs HW=15.53' (Free Discharge)
 ←**1=Culvert** (Inlet Controls 0.86 cfs @ 1.90 fps)

Pond 3P: New DMH Salem Street

Hydrograph

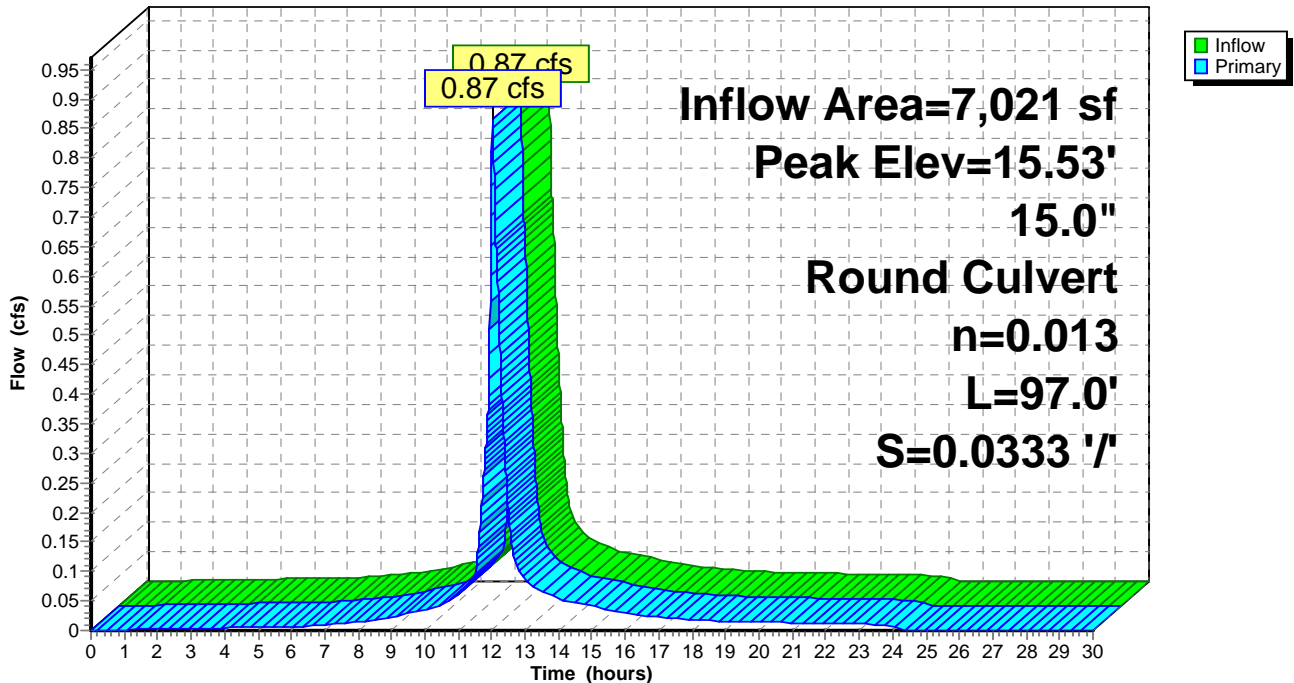

3082 Post-construction

Prepared by Ambit Engineering, Inc.

HydroCAD® 10.00 s/n 00801 © 2013 HydroCAD Software Solutions LLC

Type III 24-hr 25 Year Storm Rainfall=7.10"

Printed 3/16/2020

Page 46

Summary for Pond 5P: New DMH at Salem / McDonough


Inflow Area = 7,021 sf, 68.42% Impervious, Inflow Depth = 5.52" for 25 Year Storm event
 Inflow = 0.87 cfs @ 12.02 hrs, Volume= 3,231 cf
 Outflow = 0.87 cfs @ 12.02 hrs, Volume= 3,231 cf, Atten= 0%, Lag= 0.0 min
 Primary = 0.87 cfs @ 12.02 hrs, Volume= 3,231 cf

Routing by Stor-Ind method, Time Span= 0.00-30.00 hrs, dt= 0.01 hrs
 Peak Elev= 12.28' @ 12.02 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	11.78'	15.0" Round Culvert L= 15.0' CPP, projecting, no headwall, Ke= 0.900 Inlet / Outlet Invert= 11.78' / 11.50' S= 0.0187 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 1.23 sf

Primary OutFlow Max=0.86 cfs @ 12.02 hrs HW=12.28' (Free Discharge)
 ←1=Culvert (Inlet Controls 0.86 cfs @ 1.90 fps)

Pond 5P: New DMH at Salem / McDonough

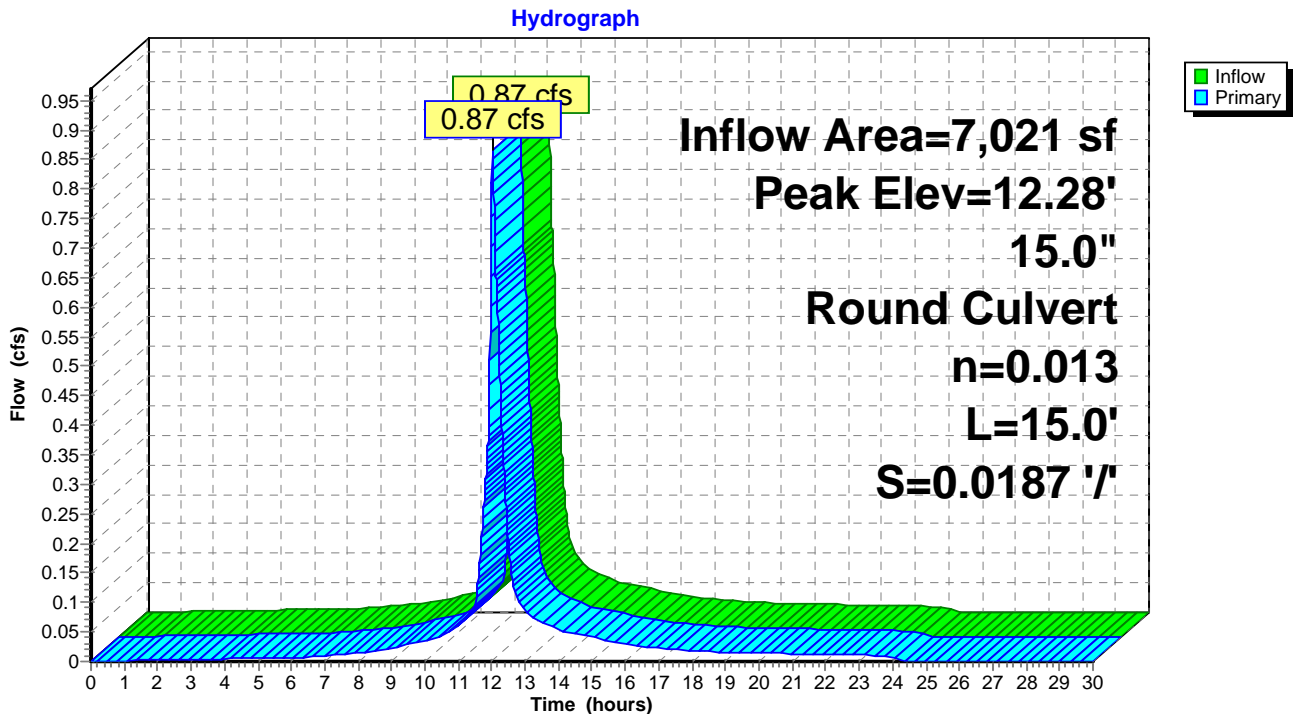

3082 Post-construction

Prepared by Ambit Engineering, Inc.

HydroCAD® 10.00 s/n 00801 © 2013 HydroCAD Software Solutions LLC

Type III 24-hr 25 Year Storm Rainfall=7.10"

Printed 3/16/2020

Page 47

Summary for Pond 6P: CB3

Inflow Area = 7,021 sf, 68.42% Impervious, Inflow Depth = 5.52" for 25 Year Storm event
Inflow = 0.87 cfs @ 12.02 hrs, Volume= 3,231 cf
Outflow = 0.87 cfs @ 12.02 hrs, Volume= 3,231 cf, Atten= 0%, Lag= 0.0 min
Primary = 0.87 cfs @ 12.02 hrs, Volume= 3,231 cf


Routing by Stor-Ind method, Time Span= 0.00-30.00 hrs, dt= 0.01 hrs
Peak Elev= 12.32' @ 12.02 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	11.82'	15.0" Round Culvert L= 32.0' CPP, projecting, no headwall, Ke= 0.900 Inlet / Outlet Invert= 11.82' / 10.56' S= 0.0394 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 1.23 sf

Primary OutFlow Max=0.86 cfs @ 12.02 hrs HW=12.32' (Free Discharge)
←1=Culvert (Inlet Controls 0.86 cfs @ 1.90 fps)

Pond 6P: CB3

Hydrograph

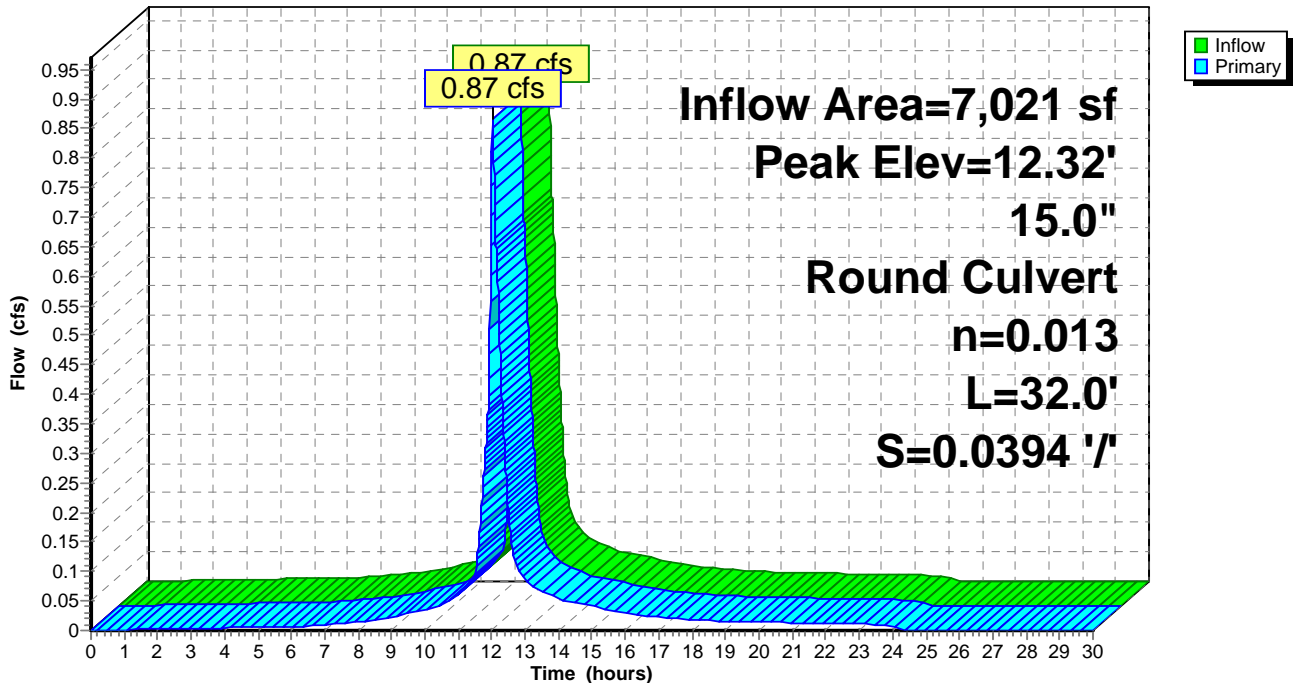

3082 Post-construction

Prepared by Ambit Engineering, Inc.

HydroCAD® 10.00 s/n 00801 © 2013 HydroCAD Software Solutions LLC

Type III 24-hr 25 Year Storm Rainfall=7.10"

Printed 3/16/2020

Page 48

Summary for Pond 7P: DMH2

Inflow Area = 7,021 sf, 68.42% Impervious, Inflow Depth = 5.52" for 25 Year Storm event
Inflow = 0.87 cfs @ 12.02 hrs, Volume= 3,231 cf
Outflow = 0.87 cfs @ 12.02 hrs, Volume= 3,231 cf, Atten= 0%, Lag= 0.0 min
Primary = 0.87 cfs @ 12.02 hrs, Volume= 3,231 cf


Routing by Stor-Ind method, Time Span= 0.00-30.00 hrs, dt= 0.01 hrs
Peak Elev= 11.04' @ 12.02 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	10.57'	18.0" Round Culvert L= 200.0' CPP, projecting, no headwall, Ke= 0.900 Inlet / Outlet Invert= 10.57' / 0.00' S= 0.0529 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 1.77 sf

Primary OutFlow Max=0.86 cfs @ 12.02 hrs HW=11.04' (Free Discharge)
←1=Culvert (Inlet Controls 0.86 cfs @ 1.84 fps)

Pond 7P: DMH2

Hydrograph

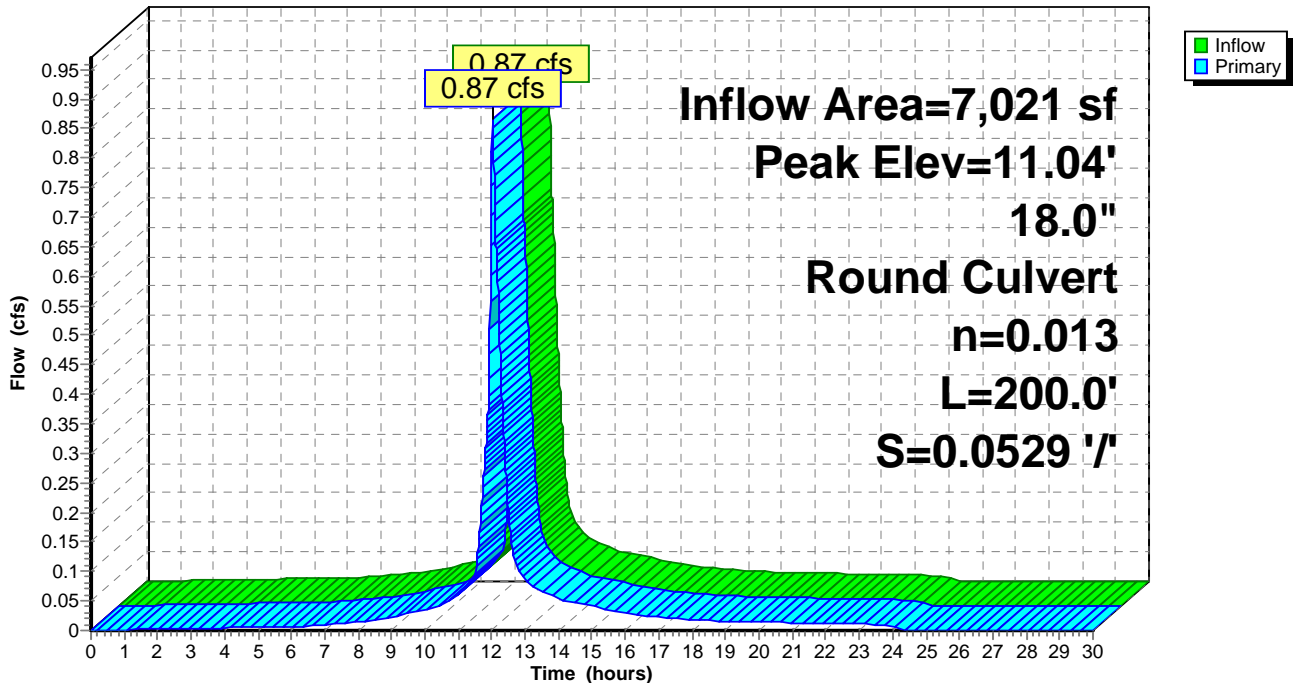

3082 Post-construction

Prepared by Ambit Engineering, Inc.

HydroCAD® 10.00 s/n 00801 © 2013 HydroCAD Software Solutions LLC

Type III 24-hr 25 Year Storm Rainfall=7.10"

Printed 3/16/2020


Page 49

Summary for Pond DP 2: CB at corner of Cabot Street and McDonough Street

Inflow Area = 29,491 sf, 63.21% Impervious, Inflow Depth = 5.34" for 25 Year Storm event
Inflow = 3.25 cfs @ 12.13 hrs, Volume= 13,121 cf
Primary = 3.25 cfs @ 12.13 hrs, Volume= 13,121 cf, Atten= 0%, Lag= 0.0 min

Routing by Stor-Ind method, Time Span= 0.00-30.00 hrs, dt= 0.01 hrs

Pond DP 2: CB at corner of Cabot Street and McDonough Street

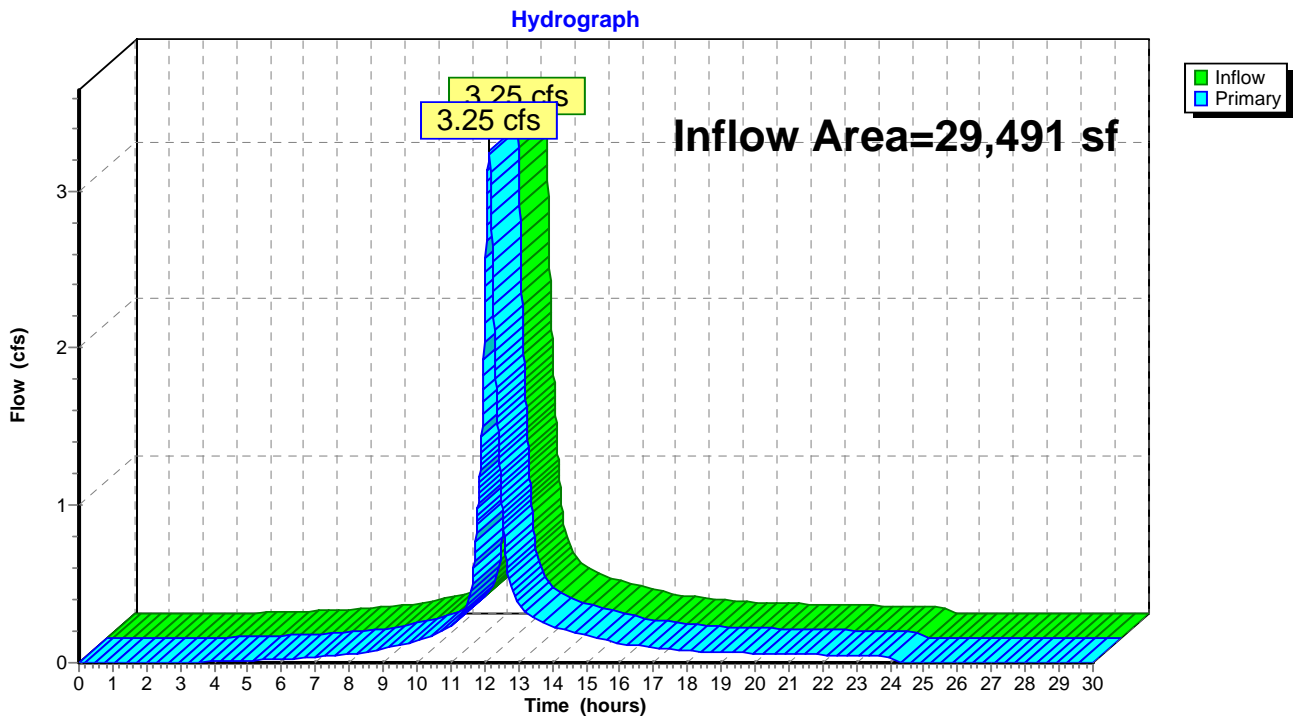


Summary for Link DP 1:

Inflow Area = 22,470 sf, 61.58% Impervious, Inflow Depth = 5.28" for 25 Year Storm event
Inflow = 2.61 cfs @ 12.14 hrs, Volume= 9,891 cf
Primary = 2.61 cfs @ 12.14 hrs, Volume= 9,891 cf, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-30.00 hrs, dt= 0.01 hrs

Link DP 1:

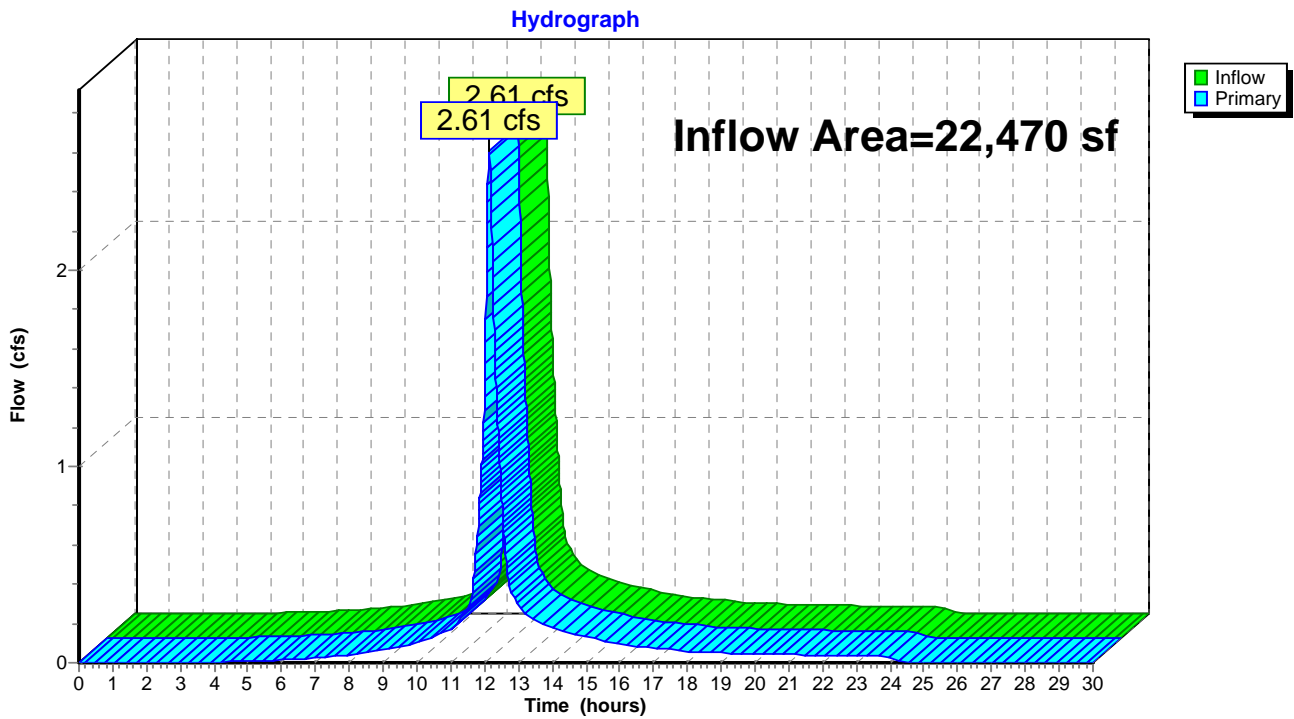

3082 Post-construction

Type III 24-hr 50 Year Storm Rainfall=8.50"

Prepared by Ambit Engineering, Inc.

Printed 3/16/2020

HydroCAD® 10.00 s/n 00801 © 2013 HydroCAD Software Solutions LLC

Page 51

Time span=0.00-30.00 hrs, dt=0.01 hrs, 3001 points
 Runoff by SCS TR-20 method, UH=SCS, Weighted-CN
 Reach routing by Stor-Ind+Trans method - Pond routing by Stor-Ind method

Subcatchment OS 1: Off Site Runoff Area=18,588 sf 74.45% Impervious Runoff Depth=7.18"
 Flow Length=722' Tc=10.8 min CN=89 Runoff=2.88 cfs 11,118 cf

Subcatchment PS1: Runoff Area=2,893 sf 48.81% Impervious Runoff Depth=5.98"
 Flow Length=143' Slope=0.0200 '/ Tc=0.8 min CN=79 Runoff=0.55 cfs 1,440 cf

Subcatchment PS1a: Roof Runoff to Drip Runoff Area=2,717 sf 100.00% Impervious Runoff Depth=8.26"
 Tc=10.0 min CN=98 Runoff=0.46 cfs 1,870 cf

Subcatchment PS2: Runoff Area=1,411 sf 47.84% Impervious Runoff Depth=5.98"
 Flow Length=89' Slope=0.0200 '/ Tc=1.1 min CN=79 Runoff=0.27 cfs 703 cf

Subcatchment PS3: Runoff Area=3,882 sf 0.00% Impervious Runoff Depth=3.83"
 Flow Length=552' Tc=6.3 min CN=61 Runoff=0.39 cfs 1,239 cf

Pond 1P: CB in Salem Street Peak Elev=15.82' Inflow=1.08 cfs 4,013 cf
 15.0" Round Culvert n=0.013 L=9.0' S=0.0056 '/ Outflow=1.08 cfs 4,013 cf

Pond 2P: CB at Site Entrance on Salem Street Peak Elev=18.96' Inflow=1.08 cfs 4,013 cf
 15.0" Round Culvert n=0.013 L=36.0' S=0.0867 '/ Outflow=1.08 cfs 4,013 cf

Pond 3P: New DMH Salem Street Peak Elev=15.59' Inflow=1.08 cfs 4,013 cf
 15.0" Round Culvert n=0.013 L=97.0' S=0.0333 '/ Outflow=1.08 cfs 4,013 cf

Pond 5P: New DMH at Salem / McDonough Peak Elev=12.34' Inflow=1.08 cfs 4,013 cf
 15.0" Round Culvert n=0.013 L=15.0' S=0.0187 '/ Outflow=1.08 cfs 4,013 cf

Pond 6P: CB3 Peak Elev=12.38' Inflow=1.08 cfs 4,013 cf
 15.0" Round Culvert n=0.013 L=32.0' S=0.0394 '/ Outflow=1.08 cfs 4,013 cf

Pond 7P: DMH2 Peak Elev=11.10' Inflow=1.08 cfs 4,013 cf
 18.0" Round Culvert n=0.013 L=200.0' S=0.0529 '/ Outflow=1.08 cfs 4,013 cf

Pond DP 2: CB at corner of Cabot Street and McDonough Street Inflow=4.02 cfs 16,371 cf
 Primary=4.02 cfs 16,371 cf

Link DP 1: Inflow=3.23 cfs 12,358 cf
 Primary=3.23 cfs 12,358 cf

Total Runoff Area = 29,491 sf Runoff Volume = 16,371 cf Average Runoff Depth = 6.66"
36.79% Pervious = 10,849 sf 63.21% Impervious = 18,642 sf

3082 Post-construction

Type III 24-hr 50 Year Storm Rainfall=8.50"

Prepared by Ambit Engineering, Inc.

Printed 3/16/2020

HydroCAD® 10.00 s/n 00801 © 2013 HydroCAD Software Solutions LLC

Page 52

Summary for Subcatchment OS 1: Off Site

Runoff = 2.88 cfs @ 12.14 hrs, Volume= 11,118 cf, Depth= 7.18"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-30.00 hrs, dt= 0.01 hrs
 Type III 24-hr 50 Year Storm Rainfall=8.50"

Area (sf)	CN	Description
13,838	98	Unconnected roofs, HSG B
4,750	61	>75% Grass cover, Good, HSG B
18,588	89	Weighted Average
4,750		25.55% Pervious Area
13,838		74.45% Impervious Area
13,838		100.00% Unconnected

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
1.8	119	0.0252	1.11		Shallow Concentrated Flow, Short Grass Pasture Kv= 7.0 fps
0.6	46	0.0326	1.39		Sheet Flow, Smooth surfaces n= 0.011 P2= 3.00"
2.9	42	0.0833	0.25		Sheet Flow, Grass: Short n= 0.150 P2= 3.00"
4.0	305	0.0328	1.27		Shallow Concentrated Flow, Short Grass Pasture Kv= 7.0 fps
1.5	210	0.0130	2.31		Shallow Concentrated Flow, Paved Kv= 20.3 fps
10.8	722	Total			

Subcatchment OS 1: Off Site

Hydrograph

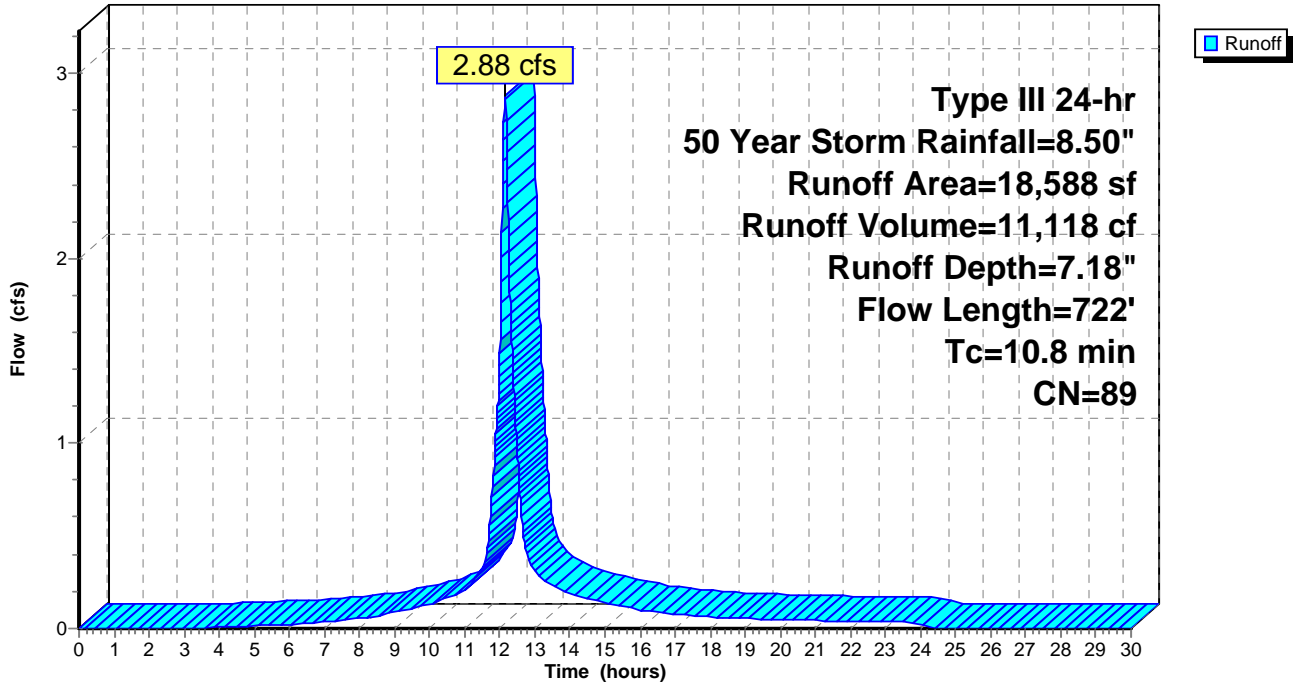

3082 Post-construction

Prepared by Ambit Engineering, Inc.

HydroCAD® 10.00 s/n 00801 © 2013 HydroCAD Software Solutions LLC

Type III 24-hr 50 Year Storm Rainfall=8.50"

Printed 3/16/2020

Page 54

Summary for Subcatchment PS1:


Runoff = 0.55 cfs @ 12.01 hrs, Volume= 1,440 cf, Depth= 5.98"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-30.00 hrs, dt= 0.01 hrs
Type III 24-hr 50 Year Storm Rainfall=8.50"

Area (sf)	CN	Description
1,481	61	>75% Grass cover, Good, HSG B
1,412	98	Paved parking, HSG B
2,893	79	Weighted Average
1,481		51.19% Pervious Area
1,412		48.81% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
0.8	143	0.0200	2.87		Shallow Concentrated Flow, Paved Kv= 20.3 fps

Subcatchment PS1:

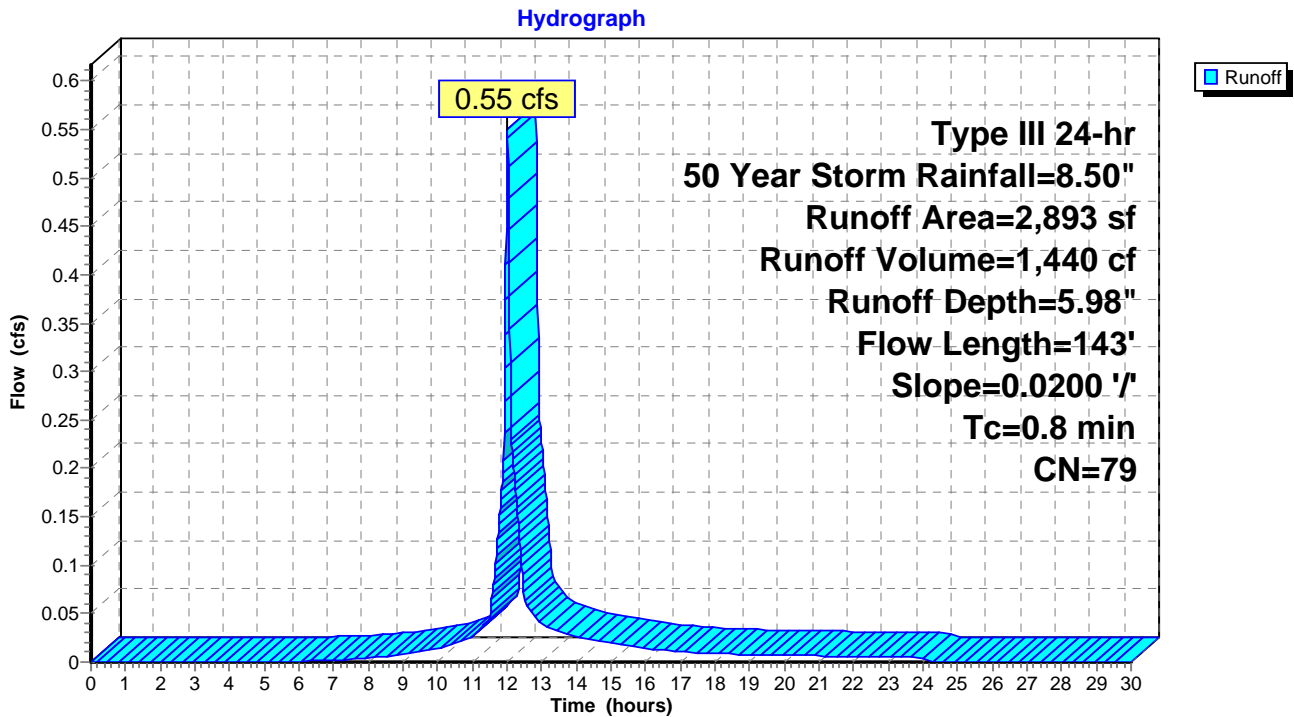

3082 Post-construction

Prepared by Ambit Engineering, Inc.

HydroCAD® 10.00 s/n 00801 © 2013 HydroCAD Software Solutions LLC

Type III 24-hr 50 Year Storm Rainfall=8.50"

Printed 3/16/2020

Page 55

Summary for Subcatchment PS1a: Roof Runoff to Drip Edge Filter Strips

Runoff = 0.46 cfs @ 12.13 hrs, Volume= 1,870 cf, Depth= 8.26"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-30.00 hrs, dt= 0.01 hrs
Type III 24-hr 50 Year Storm Rainfall=8.50"

Area (sf)	CN	Description
2,717	98	Roofs, HSG B
2,717		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
10.0					Direct Entry, Travel Time Through Filter Media

Subcatchment PS1a: Roof Runoff to Drip Edge Filter Strips

Hydrograph

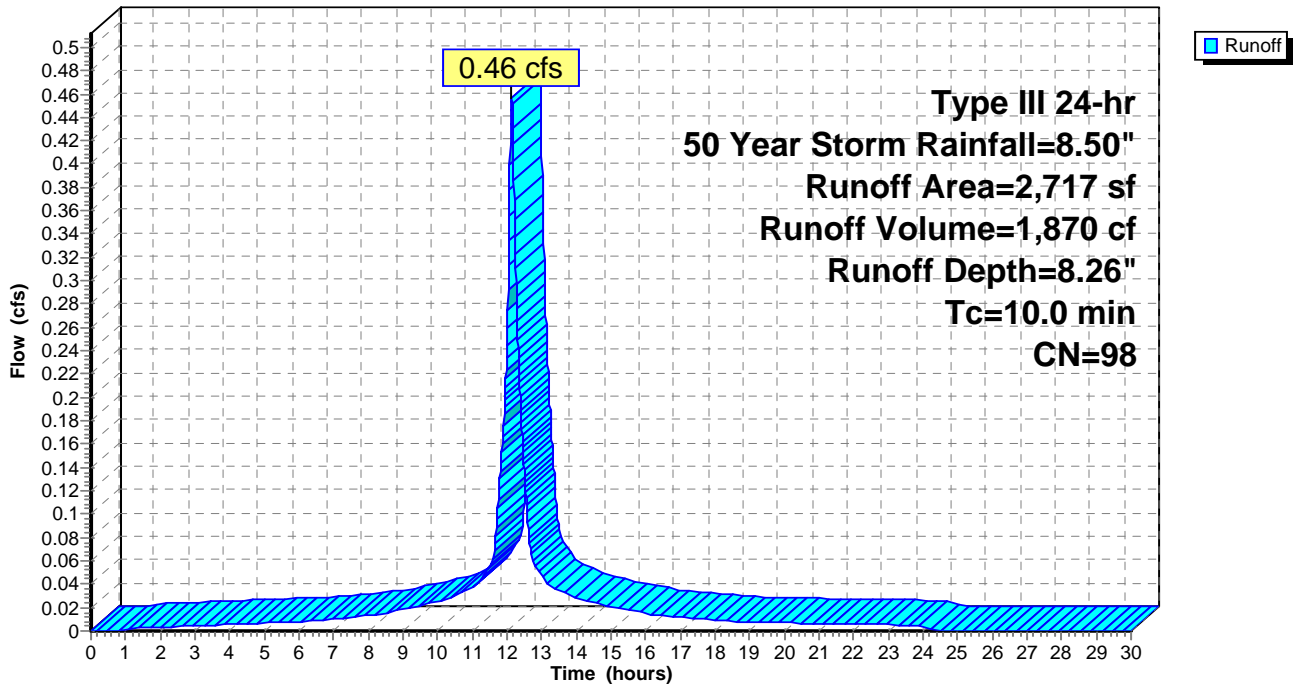

3082 Post-construction

Prepared by Ambit Engineering, Inc.

HydroCAD® 10.00 s/n 00801 © 2013 HydroCAD Software Solutions LLC

Type III 24-hr 50 Year Storm Rainfall=8.50"

Printed 3/16/2020

Page 56

Summary for Subcatchment PS2:


Runoff = 0.27 cfs @ 12.02 hrs, Volume= 703 cf, Depth= 5.98"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-30.00 hrs, dt= 0.01 hrs
Type III 24-hr 50 Year Storm Rainfall=8.50"

Area (sf)	CN	Description
382	98	Paved parking, HSG B
293	98	Roofs, HSG B
736	61	>75% Grass cover, Good, HSG B
1,411	79	Weighted Average
736		52.16% Pervious Area
675		47.84% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
1.1	89	0.0200	1.30		Sheet Flow, Smooth surfaces n= 0.011 P2= 3.00"

Subcatchment PS2:

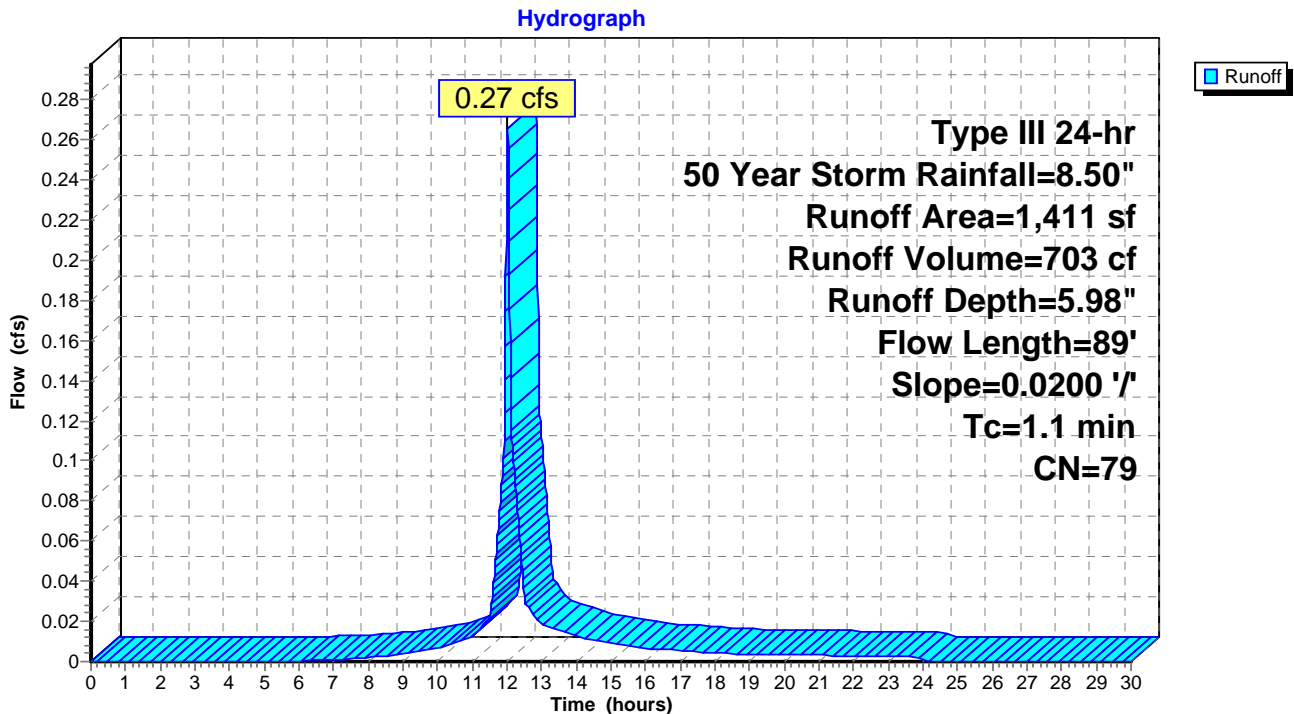

3082 Post-construction

Prepared by Ambit Engineering, Inc.

HydroCAD® 10.00 s/n 00801 © 2013 HydroCAD Software Solutions LLC

Type III 24-hr 50 Year Storm Rainfall=8.50"

Printed 3/16/2020

Page 57

Summary for Subcatchment PS3:

Runoff = 0.39 cfs @ 12.10 hrs, Volume= 1,239 cf, Depth= 3.83"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-30.00 hrs, dt= 0.01 hrs
Type III 24-hr 50 Year Storm Rainfall=8.50"

Area (sf)	CN	Description
3,882	61	>75% Grass cover, Good, HSG B
3,882		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
4.8	342	0.0292	1.20		Shallow Concentrated Flow, Short Grass Pasture Kv= 7.0 fps
1.5	210	0.0130	2.31		Shallow Concentrated Flow, Paved Kv= 20.3 fps
6.3	552	Total			

Subcatchment PS3:

Hydrograph

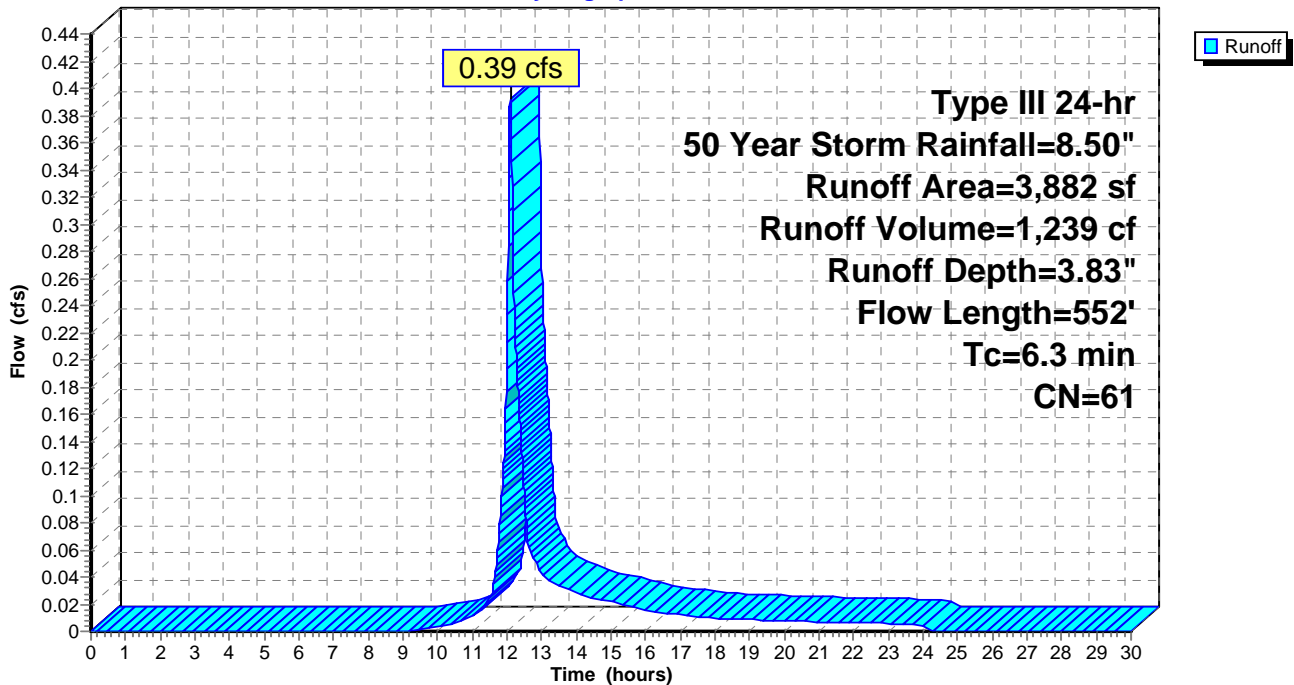

3082 Post-construction

Prepared by Ambit Engineering, Inc.

HydroCAD® 10.00 s/n 00801 © 2013 HydroCAD Software Solutions LLC

Type III 24-hr 50 Year Storm Rainfall=8.50"

Printed 3/16/2020

Page 58

Summary for Pond 1P: CB in Salem Street


Inflow Area = 7,021 sf, 68.42% Impervious, Inflow Depth = 6.86" for 50 Year Storm event
Inflow = 1.08 cfs @ 12.02 hrs, Volume= 4,013 cf
Outflow = 1.08 cfs @ 12.02 hrs, Volume= 4,013 cf, Atten= 0%, Lag= 0.0 min
Primary = 1.08 cfs @ 12.02 hrs, Volume= 4,013 cf

Routing by Stor-Ind method, Time Span= 0.00-30.00 hrs, dt= 0.01 hrs
Peak Elev= 15.82' @ 12.02 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	15.18'	15.0" Round Culvert L= 9.0' CPP, projecting, no headwall, Ke= 0.900 Inlet / Outlet Invert= 15.18' / 15.13' S= 0.0056 1' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 1.23 sf

Primary OutFlow Max=1.08 cfs @ 12.02 hrs HW=15.82' (Free Discharge)
←1=Culvert (Barrel Controls 1.08 cfs @ 2.49 fps)

Pond 1P: CB in Salem Street

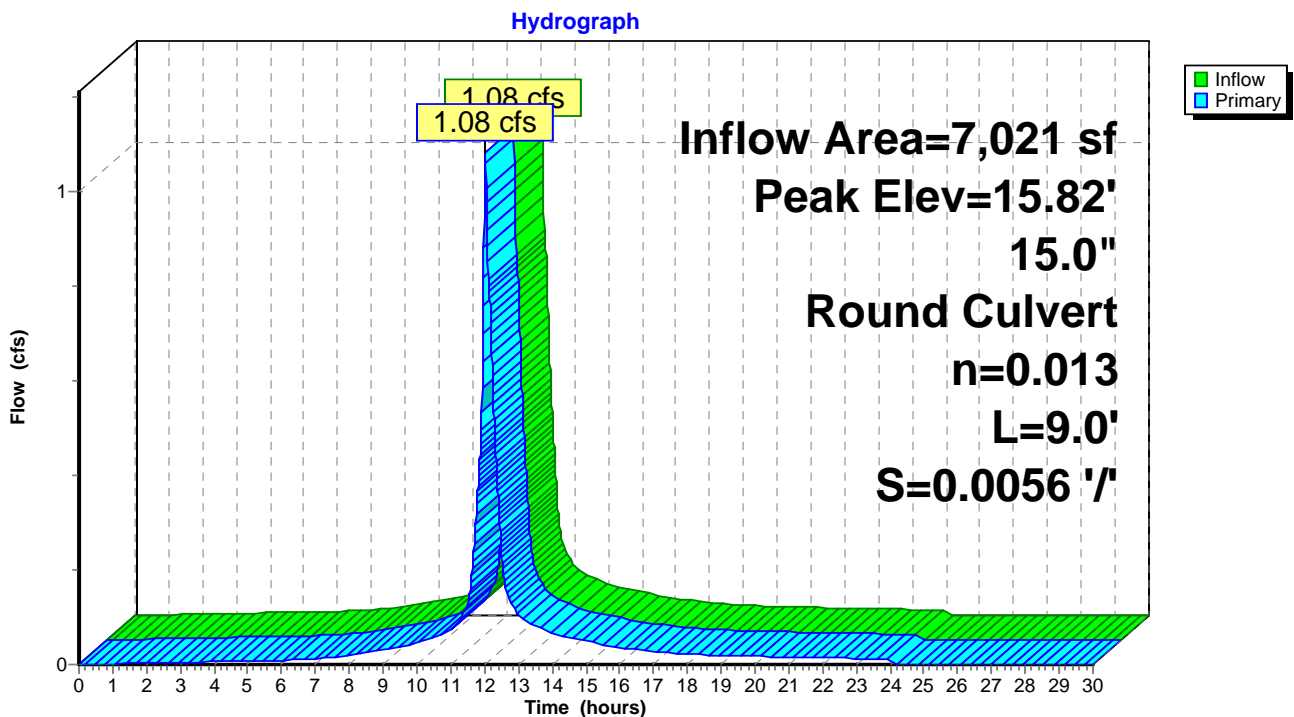

3082 Post-construction

Prepared by Ambit Engineering, Inc.

HydroCAD® 10.00 s/n 00801 © 2013 HydroCAD Software Solutions LLC

Type III 24-hr 50 Year Storm Rainfall=8.50"

Printed 3/16/2020

Page 59

Summary for Pond 2P: CB at Site Entrance on Salem Street


Inflow Area = 7,021 sf, 68.42% Impervious, Inflow Depth = 6.86" for 50 Year Storm event
 Inflow = 1.08 cfs @ 12.02 hrs, Volume= 4,013 cf
 Outflow = 1.08 cfs @ 12.02 hrs, Volume= 4,013 cf, Atten= 0%, Lag= 0.0 min
 Primary = 1.08 cfs @ 12.02 hrs, Volume= 4,013 cf

Routing by Stor-Ind method, Time Span= 0.00-30.00 hrs, dt= 0.01 hrs
 Peak Elev= 18.96' @ 12.02 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	18.40'	15.0" Round Culvert L= 36.0' CPP, projecting, no headwall, Ke= 0.900 Inlet / Outlet Invert= 18.40' / 15.28' S= 0.0867 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 1.23 sf

Primary OutFlow Max=1.08 cfs @ 12.02 hrs HW=18.96' (Free Discharge)
 ←1=Culvert (Inlet Controls 1.08 cfs @ 2.02 fps)

Pond 2P: CB at Site Entrance on Salem Street

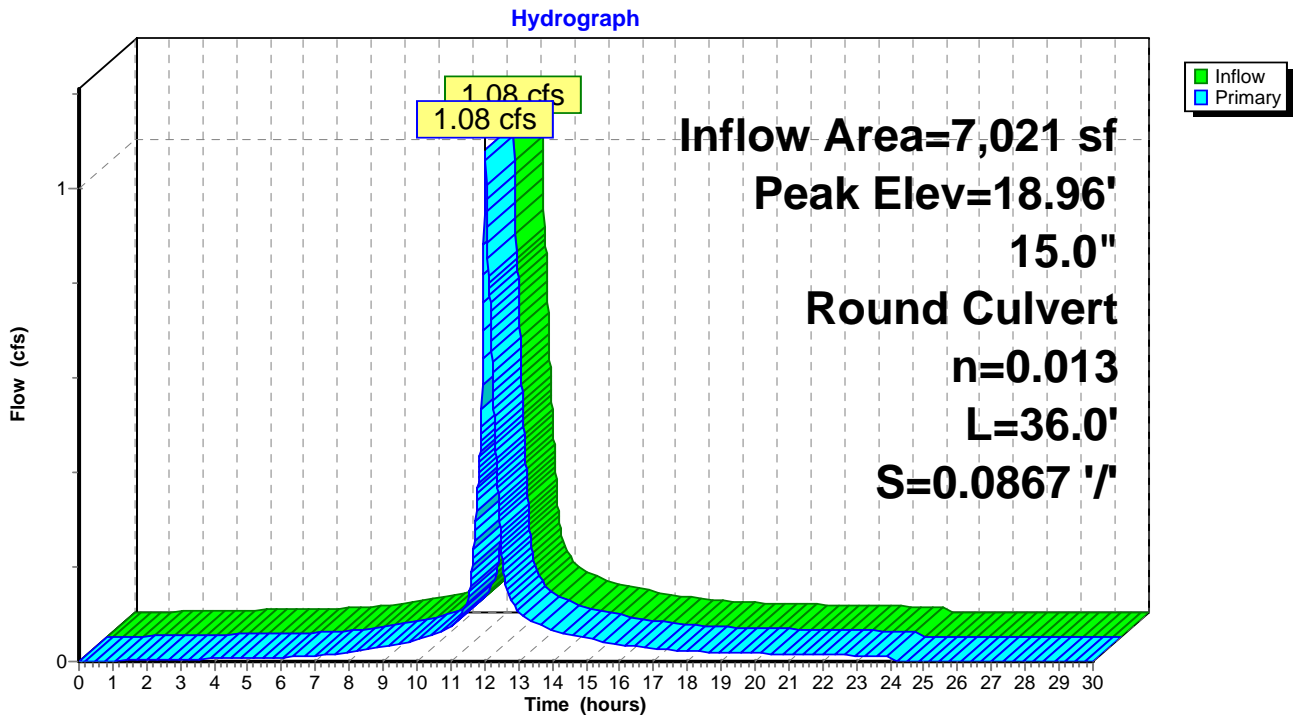

3082 Post-construction

Prepared by Ambit Engineering, Inc.

HydroCAD® 10.00 s/n 00801 © 2013 HydroCAD Software Solutions LLC

Type III 24-hr 50 Year Storm Rainfall=8.50"

Printed 3/16/2020

Page 60

Summary for Pond 3P: New DMH Salem Street


Inflow Area = 7,021 sf, 68.42% Impervious, Inflow Depth = 6.86" for 50 Year Storm event
 Inflow = 1.08 cfs @ 12.02 hrs, Volume= 4,013 cf
 Outflow = 1.08 cfs @ 12.02 hrs, Volume= 4,013 cf, Atten= 0%, Lag= 0.0 min
 Primary = 1.08 cfs @ 12.02 hrs, Volume= 4,013 cf

Routing by Stor-Ind method, Time Span= 0.00-30.00 hrs, dt= 0.01 hrs
 Peak Elev= 15.59' @ 12.02 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	15.03'	15.0" Round Culvert L= 97.0' CPP, projecting, no headwall, Ke= 0.900 Inlet / Outlet Invert= 15.03' / 11.80' S= 0.0333 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 1.23 sf

Primary OutFlow Max=1.08 cfs @ 12.02 hrs HW=15.59' (Free Discharge)
 ←1=Culvert (Inlet Controls 1.08 cfs @ 2.02 fps)

Pond 3P: New DMH Salem Street

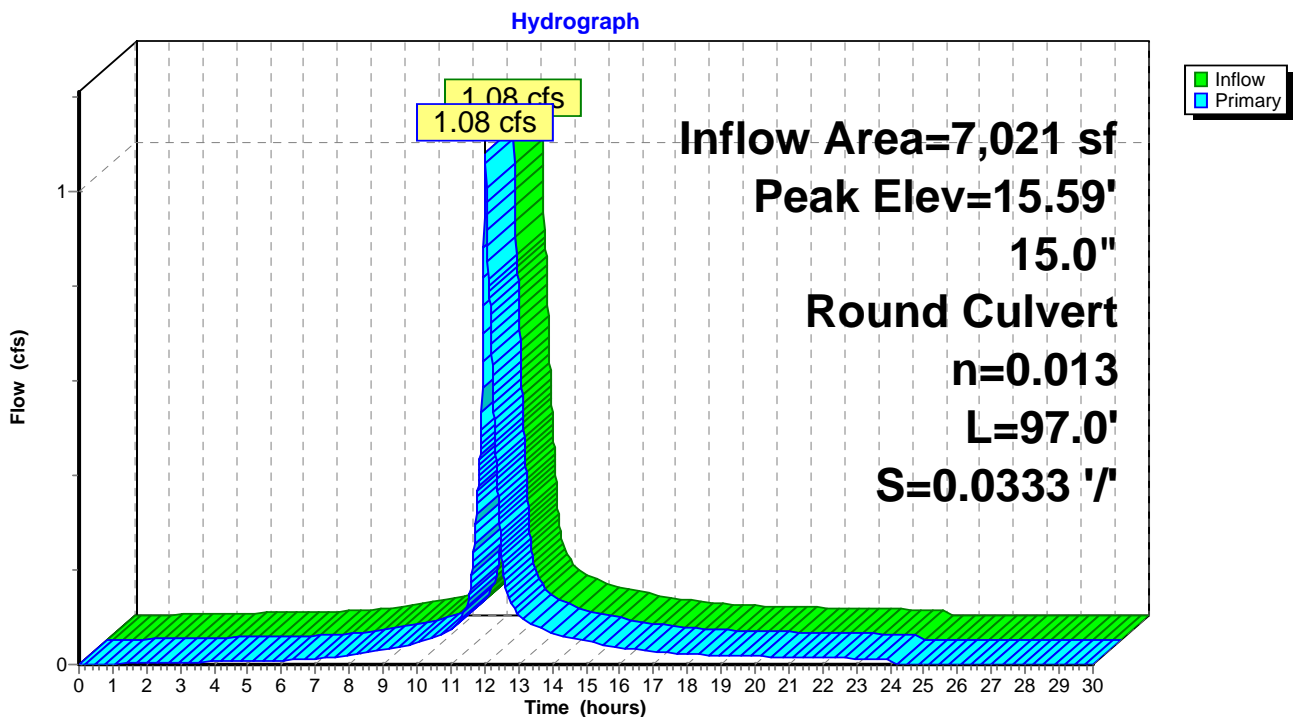

3082 Post-construction

Prepared by Ambit Engineering, Inc.

HydroCAD® 10.00 s/n 00801 © 2013 HydroCAD Software Solutions LLC

Type III 24-hr 50 Year Storm Rainfall=8.50"

Printed 3/16/2020

Page 61

Summary for Pond 5P: New DMH at Salem / McDonough


Inflow Area = 7,021 sf, 68.42% Impervious, Inflow Depth = 6.86" for 50 Year Storm event
Inflow = 1.08 cfs @ 12.02 hrs, Volume= 4,013 cf
Outflow = 1.08 cfs @ 12.02 hrs, Volume= 4,013 cf, Atten= 0%, Lag= 0.0 min
Primary = 1.08 cfs @ 12.02 hrs, Volume= 4,013 cf

Routing by Stor-Ind method, Time Span= 0.00-30.00 hrs, dt= 0.01 hrs
Peak Elev= 12.34' @ 12.02 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	11.78'	15.0" Round Culvert L= 15.0' CPP, projecting, no headwall, Ke= 0.900 Inlet / Outlet Invert= 11.78' / 11.50' S= 0.0187 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 1.23 sf

Primary OutFlow Max=1.08 cfs @ 12.02 hrs HW=12.34' (Free Discharge)
↑**1=Culvert** (Inlet Controls 1.08 cfs @ 2.02 fps)

Pond 5P: New DMH at Salem / McDonough

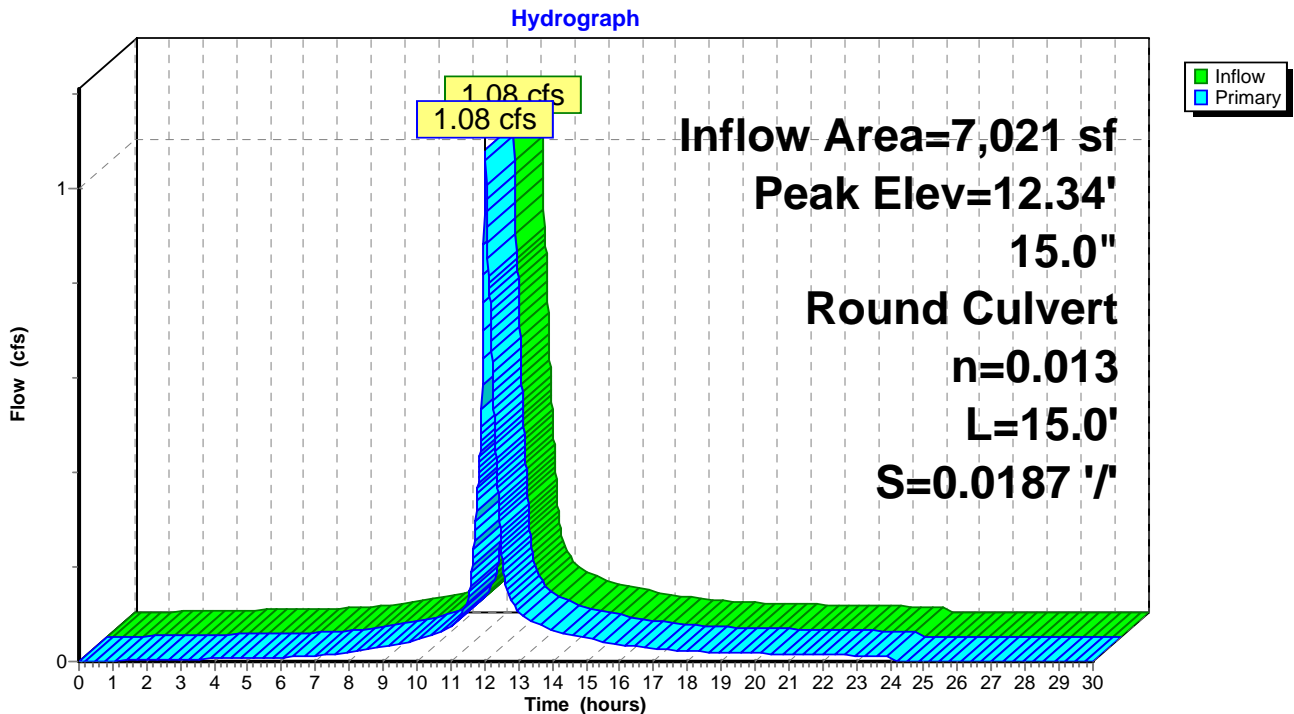

3082 Post-construction

Prepared by Ambit Engineering, Inc.

HydroCAD® 10.00 s/n 00801 © 2013 HydroCAD Software Solutions LLC

Type III 24-hr 50 Year Storm Rainfall=8.50"

Printed 3/16/2020

Page 62

Summary for Pond 6P: CB3

Inflow Area = 7,021 sf, 68.42% Impervious, Inflow Depth = 6.86" for 50 Year Storm event
Inflow = 1.08 cfs @ 12.02 hrs, Volume= 4,013 cf
Outflow = 1.08 cfs @ 12.02 hrs, Volume= 4,013 cf, Atten= 0%, Lag= 0.0 min
Primary = 1.08 cfs @ 12.02 hrs, Volume= 4,013 cf


Routing by Stor-Ind method, Time Span= 0.00-30.00 hrs, dt= 0.01 hrs
Peak Elev= 12.38' @ 12.02 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	11.82'	15.0" Round Culvert L= 32.0' CPP, projecting, no headwall, Ke= 0.900 Inlet / Outlet Invert= 11.82' / 10.56' S= 0.0394 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 1.23 sf

Primary OutFlow Max=1.08 cfs @ 12.02 hrs HW=12.38' (Free Discharge)
↑**1=Culvert** (Inlet Controls 1.08 cfs @ 2.02 fps)

Pond 6P: CB3

Hydrograph

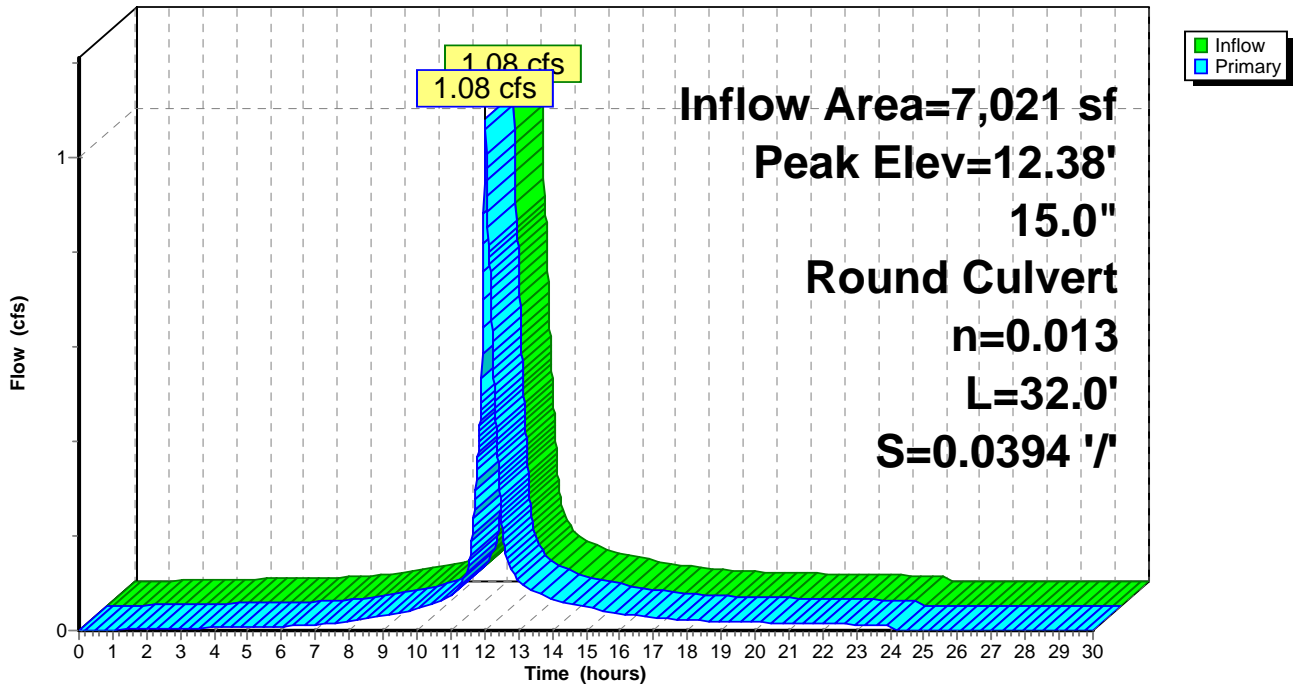

3082 Post-construction

Prepared by Ambit Engineering, Inc.

HydroCAD® 10.00 s/n 00801 © 2013 HydroCAD Software Solutions LLC

Type III 24-hr 50 Year Storm Rainfall=8.50"

Printed 3/16/2020

Page 63

Summary for Pond 7P: DMH2

Inflow Area = 7,021 sf, 68.42% Impervious, Inflow Depth = 6.86" for 50 Year Storm event
Inflow = 1.08 cfs @ 12.02 hrs, Volume= 4,013 cf
Outflow = 1.08 cfs @ 12.02 hrs, Volume= 4,013 cf, Atten= 0%, Lag= 0.0 min
Primary = 1.08 cfs @ 12.02 hrs, Volume= 4,013 cf


Routing by Stor-Ind method, Time Span= 0.00-30.00 hrs, dt= 0.01 hrs
Peak Elev= 11.10' @ 12.02 hrs

Device	Routing	Invert	Outlet Devices
#1	Primary	10.57'	18.0" Round Culvert L= 200.0' CPP, projecting, no headwall, Ke= 0.900 Inlet / Outlet Invert= 10.57' / 0.00' S= 0.0529 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 1.77 sf

Primary OutFlow Max=1.08 cfs @ 12.02 hrs HW=11.10' (Free Discharge)
↑**1=Culvert** (Inlet Controls 1.08 cfs @ 1.95 fps)

Pond 7P: DMH2

Hydrograph

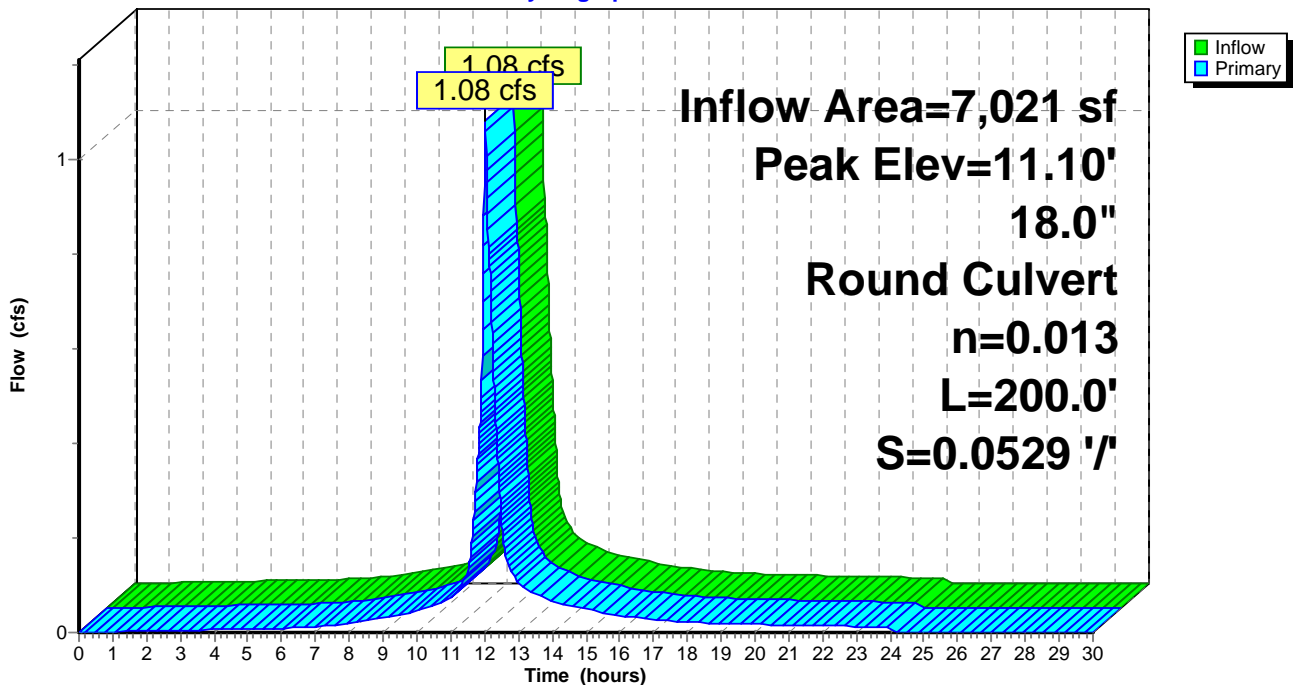

3082 Post-construction

Prepared by Ambit Engineering, Inc.

HydroCAD® 10.00 s/n 00801 © 2013 HydroCAD Software Solutions LLC

Type III 24-hr 50 Year Storm Rainfall=8.50"

Printed 3/16/2020


Page 64

Summary for Pond DP 2: CB at corner of Cabot Street and McDonough Street

Inflow Area = 29,491 sf, 63.21% Impervious, Inflow Depth = 6.66" for 50 Year Storm event
Inflow = 4.02 cfs @ 12.13 hrs, Volume= 16,371 cf
Primary = 4.02 cfs @ 12.13 hrs, Volume= 16,371 cf, Atten= 0%, Lag= 0.0 min

Routing by Stor-Ind method, Time Span= 0.00-30.00 hrs, dt= 0.01 hrs

Pond DP 2: CB at corner of Cabot Street and McDonough Street

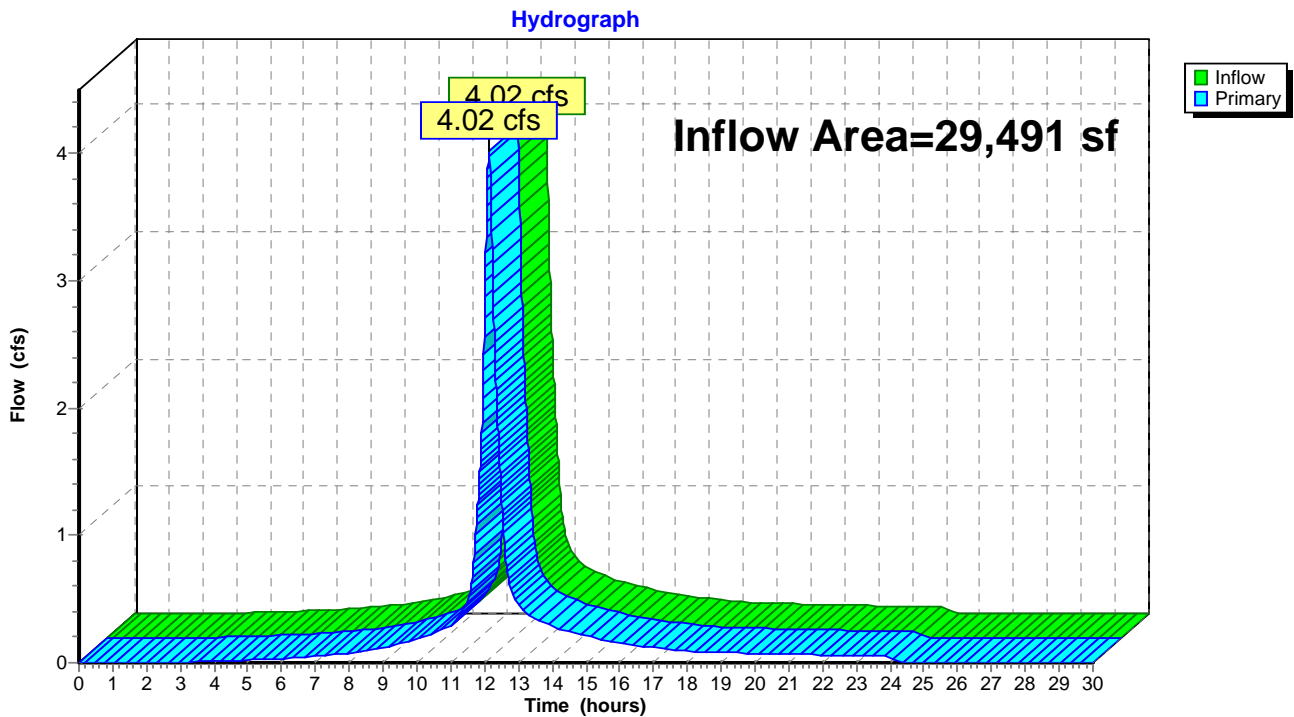

3082 Post-construction

Prepared by Ambit Engineering, Inc.

HydroCAD® 10.00 s/n 00801 © 2013 HydroCAD Software Solutions LLC

Type III 24-hr 50 Year Storm Rainfall=8.50"

Printed 3/16/2020


Page 65

Summary for Link DP 1:

Inflow Area = 22,470 sf, 61.58% Impervious, Inflow Depth = 6.60" for 50 Year Storm event
Inflow = 3.23 cfs @ 12.14 hrs, Volume= 12,358 cf
Primary = 3.23 cfs @ 12.14 hrs, Volume= 12,358 cf, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-30.00 hrs, dt= 0.01 hrs

Link DP 1:

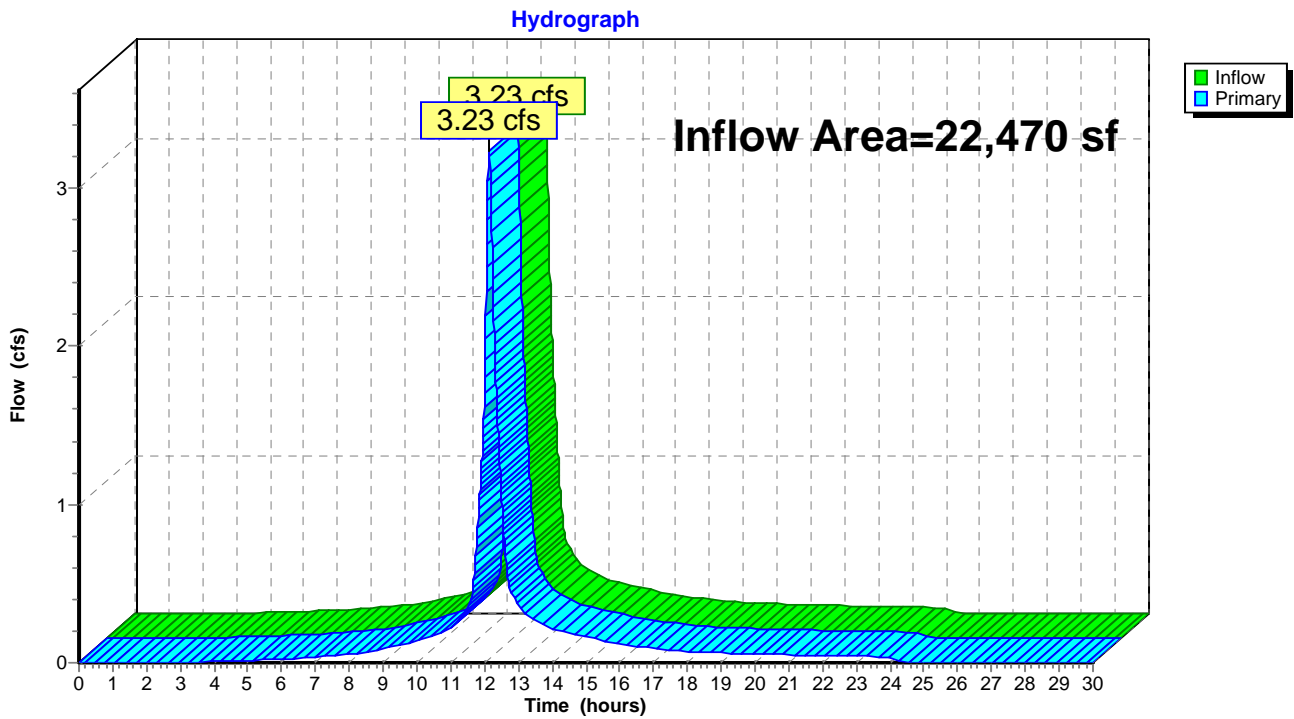

APPENDIX D
SOIL SURVEY INFORMATION



United States
Department of
Agriculture

NRCS

Natural
Resources
Conservation
Service

A product of the National
Cooperative Soil Survey,
a joint effort of the United
States Department of
Agriculture and other
Federal agencies, State
agencies including the
Agricultural Experiment
Stations, and local
participants

Custom Soil Resource Report for Rockingham County, New Hampshire



Preface

Soil surveys contain information that affects land use planning in survey areas. They highlight soil limitations that affect various land uses and provide information about the properties of the soils in the survey areas. Soil surveys are designed for many different users, including farmers, ranchers, foresters, agronomists, urban planners, community officials, engineers, developers, builders, and home buyers. Also, conservationists, teachers, students, and specialists in recreation, waste disposal, and pollution control can use the surveys to help them understand, protect, or enhance the environment.

Various land use regulations of Federal, State, and local governments may impose special restrictions on land use or land treatment. Soil surveys identify soil properties that are used in making various land use or land treatment decisions. The information is intended to help the land users identify and reduce the effects of soil limitations on various land uses. The landowner or user is responsible for identifying and complying with existing laws and regulations.

Although soil survey information can be used for general farm, local, and wider area planning, onsite investigation is needed to supplement this information in some cases. Examples include soil quality assessments (<http://www.nrcs.usda.gov/wps/portal/nrcs/main/soils/health/>) and certain conservation and engineering applications. For more detailed information, contact your local USDA Service Center (<https://offices.sc.egov.usda.gov/locator/app?agency=nrcs>) or your NRCS State Soil Scientist (http://www.nrcs.usda.gov/wps/portal/nrcs/detail/soils/contactus/?cid=nrcs142p2_053951).

Great differences in soil properties can occur within short distances. Some soils are seasonally wet or subject to flooding. Some are too unstable to be used as a foundation for buildings or roads. Clayey or wet soils are poorly suited to use as septic tank absorption fields. A high water table makes a soil poorly suited to basements or underground installations.

The National Cooperative Soil Survey is a joint effort of the United States Department of Agriculture and other Federal agencies, State agencies including the Agricultural Experiment Stations, and local agencies. The Natural Resources Conservation Service (NRCS) has leadership for the Federal part of the National Cooperative Soil Survey.

Information about soils is updated periodically. Updated information is available through the NRCS Web Soil Survey, the site for official soil survey information.

The U.S. Department of Agriculture (USDA) prohibits discrimination in all its programs and activities on the basis of race, color, national origin, age, disability, and where applicable, sex, marital status, familial status, parental status, religion, sexual orientation, genetic information, political beliefs, reprisal, or because all or a part of an individual's income is derived from any public assistance program. (Not all prohibited bases apply to all programs.) Persons with disabilities who require

alternative means for communication of program information (Braille, large print, audiotape, etc.) should contact USDA's TARGET Center at (202) 720-2600 (voice and TDD). To file a complaint of discrimination, write to USDA, Director, Office of Civil Rights, 1400 Independence Avenue, S.W., Washington, D.C. 20250-9410 or call (800) 795-3272 (voice) or (202) 720-6382 (TDD). USDA is an equal opportunity provider and employer.

Contents

Preface	2
How Soil Surveys Are Made	5
Soil Map	8
Soil Map.....	9
Legend.....	10
Map Unit Legend.....	11
Map Unit Descriptions.....	11
Rockingham County, New Hampshire.....	13
699—Urban land.....	13
799—Urban land-Canton complex, 3 to 15 percent slopes.....	13
References	15

How Soil Surveys Are Made

Soil surveys are made to provide information about the soils and miscellaneous areas in a specific area. They include a description of the soils and miscellaneous areas and their location on the landscape and tables that show soil properties and limitations affecting various uses. Soil scientists observed the steepness, length, and shape of the slopes; the general pattern of drainage; the kinds of crops and native plants; and the kinds of bedrock. They observed and described many soil profiles. A soil profile is the sequence of natural layers, or horizons, in a soil. The profile extends from the surface down into the unconsolidated material in which the soil formed or from the surface down to bedrock. The unconsolidated material is devoid of roots and other living organisms and has not been changed by other biological activity.

Currently, soils are mapped according to the boundaries of major land resource areas (MLRAs). MLRAs are geographically associated land resource units that share common characteristics related to physiography, geology, climate, water resources, soils, biological resources, and land uses (USDA, 2006). Soil survey areas typically consist of parts of one or more MLRA.

The soils and miscellaneous areas in a survey area occur in an orderly pattern that is related to the geology, landforms, relief, climate, and natural vegetation of the area. Each kind of soil and miscellaneous area is associated with a particular kind of landform or with a segment of the landform. By observing the soils and miscellaneous areas in the survey area and relating their position to specific segments of the landform, a soil scientist develops a concept, or model, of how they were formed. Thus, during mapping, this model enables the soil scientist to predict with a considerable degree of accuracy the kind of soil or miscellaneous area at a specific location on the landscape.

Commonly, individual soils on the landscape merge into one another as their characteristics gradually change. To construct an accurate soil map, however, soil scientists must determine the boundaries between the soils. They can observe only a limited number of soil profiles. Nevertheless, these observations, supplemented by an understanding of the soil-vegetation-landscape relationship, are sufficient to verify predictions of the kinds of soil in an area and to determine the boundaries.

Soil scientists recorded the characteristics of the soil profiles that they studied. They noted soil color, texture, size and shape of soil aggregates, kind and amount of rock fragments, distribution of plant roots, reaction, and other features that enable them to identify soils. After describing the soils in the survey area and determining their properties, the soil scientists assigned the soils to taxonomic classes (units). Taxonomic classes are concepts. Each taxonomic class has a set of soil characteristics with precisely defined limits. The classes are used as a basis for comparison to classify soils systematically. Soil taxonomy, the system of taxonomic classification used in the United States, is based mainly on the kind and character of soil properties and the arrangement of horizons within the profile. After the soil

Custom Soil Resource Report

scientists classified and named the soils in the survey area, they compared the individual soils with similar soils in the same taxonomic class in other areas so that they could confirm data and assemble additional data based on experience and research.

The objective of soil mapping is not to delineate pure map unit components; the objective is to separate the landscape into landforms or landform segments that have similar use and management requirements. Each map unit is defined by a unique combination of soil components and/or miscellaneous areas in predictable proportions. Some components may be highly contrasting to the other components of the map unit. The presence of minor components in a map unit in no way diminishes the usefulness or accuracy of the data. The delineation of such landforms and landform segments on the map provides sufficient information for the development of resource plans. If intensive use of small areas is planned, onsite investigation is needed to define and locate the soils and miscellaneous areas.

Soil scientists make many field observations in the process of producing a soil map. The frequency of observation is dependent upon several factors, including scale of mapping, intensity of mapping, design of map units, complexity of the landscape, and experience of the soil scientist. Observations are made to test and refine the soil-landscape model and predictions and to verify the classification of the soils at specific locations. Once the soil-landscape model is refined, a significantly smaller number of measurements of individual soil properties are made and recorded. These measurements may include field measurements, such as those for color, depth to bedrock, and texture, and laboratory measurements, such as those for content of sand, silt, clay, salt, and other components. Properties of each soil typically vary from one point to another across the landscape.

Observations for map unit components are aggregated to develop ranges of characteristics for the components. The aggregated values are presented. Direct measurements do not exist for every property presented for every map unit component. Values for some properties are estimated from combinations of other properties.

While a soil survey is in progress, samples of some of the soils in the area generally are collected for laboratory analyses and for engineering tests. Soil scientists interpret the data from these analyses and tests as well as the field-observed characteristics and the soil properties to determine the expected behavior of the soils under different uses. Interpretations for all of the soils are field tested through observation of the soils in different uses and under different levels of management. Some interpretations are modified to fit local conditions, and some new interpretations are developed to meet local needs. Data are assembled from other sources, such as research information, production records, and field experience of specialists. For example, data on crop yields under defined levels of management are assembled from farm records and from field or plot experiments on the same kinds of soil.

Predictions about soil behavior are based not only on soil properties but also on such variables as climate and biological activity. Soil conditions are predictable over long periods of time, but they are not predictable from year to year. For example, soil scientists can predict with a fairly high degree of accuracy that a given soil will have a high water table within certain depths in most years, but they cannot predict that a high water table will always be at a specific level in the soil on a specific date.

After soil scientists located and identified the significant natural bodies of soil in the survey area, they drew the boundaries of these bodies on aerial photographs and


Custom Soil Resource Report

identified each as a specific map unit. Aerial photographs show trees, buildings, fields, roads, and rivers, all of which help in locating boundaries accurately.


Soil Map

The soil map section includes the soil map for the defined area of interest, a list of soil map units on the map and extent of each map unit, and cartographic symbols displayed on the map. Also presented are various metadata about data used to produce the map, and a description of each soil map unit.

Custom Soil Resource Report Soil Map

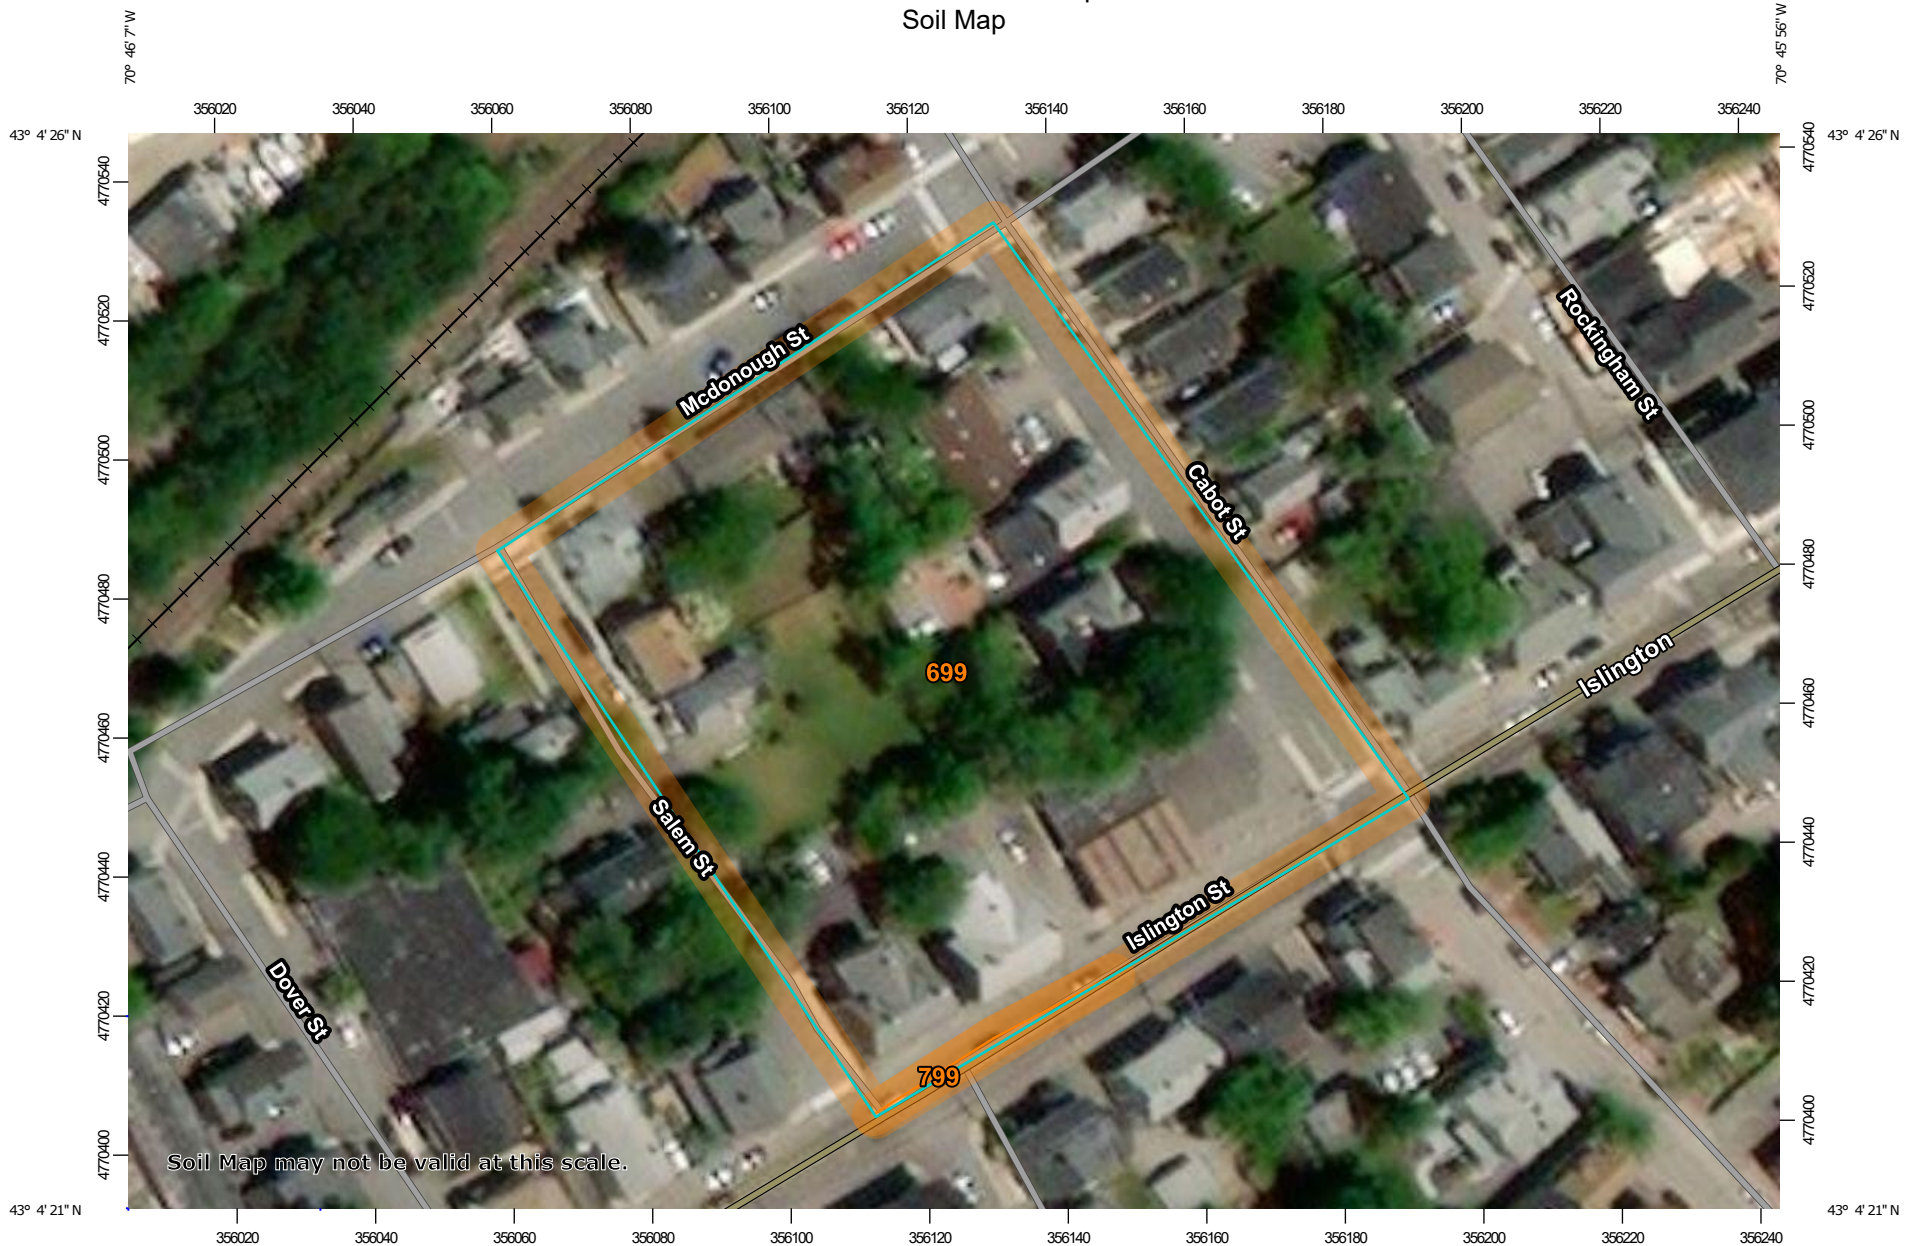

Map Scale: 1:1,090 if printed on A landscape (11" x 8.5") sheet.




Map projection: Web Mercator Corner coordinates: WGS84 Edge tics: UTM Zone 19N WGS84



MAP LEGEND

Area of Interest (AOI)

 Area of Interest (AOI)

Soils

 Soil Map Unit Polygons

 Soil Map Unit Lines


 Soil Map Unit Points

Special Point Features






-  Blowout
-  Borrow Pit
-  Clay Spot
-  Closed Depression
-  Gravel Pit
-  Gravelly Spot
-  Landfill
-  Lava Flow
-  Marsh or swamp
-  Mine or Quarry
-  Miscellaneous Water
-  Perennial Water
-  Rock Outcrop
-  Saline Spot
-  Sandy Spot
-  Severely Eroded Spot
-  Sinkhole
-  Slide or Slip
-  Sodic Spot

-  Spoil Area
-  Stony Spot
-  Very Stony Spot
-  Wet Spot
-  Other
-  Special Line Features


Water Features

 Streams and Canals

Transportation

-  Rails
-  Interstate Highways
-  US Routes
-  Major Roads
-  Local Roads

Background

 Aerial Photography

MAP INFORMATION

The soil surveys that comprise your AOI were mapped at 1:24,000.

Warning: Soil Map may not be valid at this scale.

Enlargement of maps beyond the scale of mapping can cause misunderstanding of the detail of mapping and accuracy of soil line placement. The maps do not show the small areas of contrasting soils that could have been shown at a more detailed scale.

Please rely on the bar scale on each map sheet for map measurements.

Source of Map: Natural Resources Conservation Service
 Web Soil Survey URL:
 Coordinate System: Web Mercator (EPSG:3857)

Maps from the Web Soil Survey are based on the Web Mercator projection, which preserves direction and shape but distorts distance and area. A projection that preserves area, such as the Albers equal-area conic projection, should be used if more accurate calculations of distance or area are required.

This product is generated from the USDA-NRCS certified data as of the version date(s) listed below.

Soil Survey Area: Rockingham County, New Hampshire
 Survey Area Data: Version 21, Sep 16, 2019

Soil map units are labeled (as space allows) for map scales 1:50,000 or larger.

Date(s) aerial images were photographed: Dec 31, 2009—Sep 9, 2017

The orthophoto or other base map on which the soil lines were compiled and digitized probably differs from the background imagery displayed on these maps. As a result, some minor shifting of map unit boundaries may be evident.

Map Unit Legend

Map Unit Symbol	Map Unit Name	Acres in AOI	Percent of AOI
699	Urban land	2.2	99.7%
799	Urban land-Canton complex, 3 to 15 percent slopes	0.0	0.3%
Totals for Area of Interest		2.2	100.0%

Map Unit Descriptions

The map units delineated on the detailed soil maps in a soil survey represent the soils or miscellaneous areas in the survey area. The map unit descriptions, along with the maps, can be used to determine the composition and properties of a unit.

A map unit delineation on a soil map represents an area dominated by one or more major kinds of soil or miscellaneous areas. A map unit is identified and named according to the taxonomic classification of the dominant soils. Within a taxonomic class there are precisely defined limits for the properties of the soils. On the landscape, however, the soils are natural phenomena, and they have the characteristic variability of all natural phenomena. Thus, the range of some observed properties may extend beyond the limits defined for a taxonomic class. Areas of soils of a single taxonomic class rarely, if ever, can be mapped without including areas of other taxonomic classes. Consequently, every map unit is made up of the soils or miscellaneous areas for which it is named and some minor components that belong to taxonomic classes other than those of the major soils.

Most minor soils have properties similar to those of the dominant soil or soils in the map unit, and thus they do not affect use and management. These are called noncontrasting, or similar, components. They may or may not be mentioned in a particular map unit description. Other minor components, however, have properties and behavioral characteristics divergent enough to affect use or to require different management. These are called contrasting, or dissimilar, components. They generally are in small areas and could not be mapped separately because of the scale used. Some small areas of strongly contrasting soils or miscellaneous areas are identified by a special symbol on the maps. If included in the database for a given area, the contrasting minor components are identified in the map unit descriptions along with some characteristics of each. A few areas of minor components may not have been observed, and consequently they are not mentioned in the descriptions, especially where the pattern was so complex that it was impractical to make enough observations to identify all the soils and miscellaneous areas on the landscape.

The presence of minor components in a map unit in no way diminishes the usefulness or accuracy of the data. The objective of mapping is not to delineate pure taxonomic classes but rather to separate the landscape into landforms or landform segments that have similar use and management requirements. The delineation of such segments on the map provides sufficient information for the development of resource plans. If intensive use of small areas is planned, however,

Custom Soil Resource Report

onsite investigation is needed to define and locate the soils and miscellaneous areas.

An identifying symbol precedes the map unit name in the map unit descriptions. Each description includes general facts about the unit and gives important soil properties and qualities.

Soils that have profiles that are almost alike make up a *soil series*. Except for differences in texture of the surface layer, all the soils of a series have major horizons that are similar in composition, thickness, and arrangement.

Soils of one series can differ in texture of the surface layer, slope, stoniness, salinity, degree of erosion, and other characteristics that affect their use. On the basis of such differences, a soil series is divided into *soil phases*. Most of the areas shown on the detailed soil maps are phases of soil series. The name of a soil phase commonly indicates a feature that affects use or management. For example, Alpha silt loam, 0 to 2 percent slopes, is a phase of the Alpha series.

Some map units are made up of two or more major soils or miscellaneous areas. These map units are complexes, associations, or undifferentiated groups.

A *complex* consists of two or more soils or miscellaneous areas in such an intricate pattern or in such small areas that they cannot be shown separately on the maps. The pattern and proportion of the soils or miscellaneous areas are somewhat similar in all areas. Alpha-Beta complex, 0 to 6 percent slopes, is an example.

An *association* is made up of two or more geographically associated soils or miscellaneous areas that are shown as one unit on the maps. Because of present or anticipated uses of the map units in the survey area, it was not considered practical or necessary to map the soils or miscellaneous areas separately. The pattern and relative proportion of the soils or miscellaneous areas are somewhat similar. Alpha-Beta association, 0 to 2 percent slopes, is an example.

An *undifferentiated group* is made up of two or more soils or miscellaneous areas that could be mapped individually but are mapped as one unit because similar interpretations can be made for use and management. The pattern and proportion of the soils or miscellaneous areas in a mapped area are not uniform. An area can be made up of only one of the major soils or miscellaneous areas, or it can be made up of all of them. Alpha and Beta soils, 0 to 2 percent slopes, is an example.

Some surveys include *miscellaneous areas*. Such areas have little or no soil material and support little or no vegetation. Rock outcrop is an example.

Rockingham County, New Hampshire

699—Urban land

Map Unit Composition

Urban land: 85 percent

Minor components: 15 percent

Estimates are based on observations, descriptions, and transects of the mapunit.

Minor Components

Not named

Percent of map unit: 15 percent

Hydric soil rating: No

799—Urban land-Canton complex, 3 to 15 percent slopes

Map Unit Setting

National map unit symbol: 9cq0

Elevation: 0 to 1,000 feet

Mean annual precipitation: 42 to 46 inches

Mean annual air temperature: 45 to 48 degrees F

Frost-free period: 120 to 160 days

Farmland classification: Not prime farmland

Map Unit Composition

Urban land: 55 percent

Canton and similar soils: 20 percent

Minor components: 25 percent

Estimates are based on observations, descriptions, and transects of the mapunit.

Description of Canton

Setting

Parent material: Till

Typical profile

H1 - 0 to 5 inches: gravelly fine sandy loam

H2 - 5 to 21 inches: gravelly fine sandy loam

H3 - 21 to 60 inches: loamy sand

Properties and qualities

Slope: 3 to 8 percent

Depth to restrictive feature: More than 80 inches

Natural drainage class: Well drained

Runoff class: Low

Capacity of the most limiting layer to transmit water (Ksat): High (2.00 to 6.00 in/hr)

Depth to water table: More than 80 inches

Frequency of flooding: None

Frequency of ponding: None

Available water storage in profile: Low (about 5.3 inches)

Custom Soil Resource Report

Interpretive groups

Land capability classification (irrigated): None specified

Land capability classification (nonirrigated): 2e

Hydrologic Soil Group: A

Hydric soil rating: No

Minor Components

Udorthents

Percent of map unit: 5 percent

Hydric soil rating: No

Squamscott and scitico

Percent of map unit: 4 percent

Landform: Marine terraces

Hydric soil rating: Yes

Boxford and eldridge

Percent of map unit: 4 percent

Hydric soil rating: No

Chatfield

Percent of map unit: 4 percent

Hydric soil rating: No

Scituate and newfields

Percent of map unit: 4 percent

Hydric soil rating: No

Walpole

Percent of map unit: 4 percent

Landform: Depressions

Hydric soil rating: Yes

References

- American Association of State Highway and Transportation Officials (AASHTO). 2004. Standard specifications for transportation materials and methods of sampling and testing. 24th edition.
- American Society for Testing and Materials (ASTM). 2005. Standard classification of soils for engineering purposes. ASTM Standard D2487-00.
- Cowardin, L.M., V. Carter, F.C. Golet, and E.T. LaRoe. 1979. Classification of wetlands and deep-water habitats of the United States. U.S. Fish and Wildlife Service FWS/OBS-79/31.
- Federal Register. July 13, 1994. Changes in hydric soils of the United States.
- Federal Register. September 18, 2002. Hydric soils of the United States.
- Hurt, G.W., and L.M. Vasilas, editors. Version 6.0, 2006. Field indicators of hydric soils in the United States.
- National Research Council. 1995. Wetlands: Characteristics and boundaries.
- Soil Survey Division Staff. 1993. Soil survey manual. Soil Conservation Service. U.S. Department of Agriculture Handbook 18. http://www.nrcs.usda.gov/wps/portal/nrcs/detail/national/soils/?cid=nrcs142p2_054262
- Soil Survey Staff. 1999. Soil taxonomy: A basic system of soil classification for making and interpreting soil surveys. 2nd edition. Natural Resources Conservation Service, U.S. Department of Agriculture Handbook 436. http://www.nrcs.usda.gov/wps/portal/nrcs/detail/national/soils/?cid=nrcs142p2_053577
- Soil Survey Staff. 2010. Keys to soil taxonomy. 11th edition. U.S. Department of Agriculture, Natural Resources Conservation Service. http://www.nrcs.usda.gov/wps/portal/nrcs/detail/national/soils/?cid=nrcs142p2_053580
- Tiner, R.W., Jr. 1985. Wetlands of Delaware. U.S. Fish and Wildlife Service and Delaware Department of Natural Resources and Environmental Control, Wetlands Section.
- United States Army Corps of Engineers, Environmental Laboratory. 1987. Corps of Engineers wetlands delineation manual. Waterways Experiment Station Technical Report Y-87-1.
- United States Department of Agriculture, Natural Resources Conservation Service. National forestry manual. http://www.nrcs.usda.gov/wps/portal/nrcs/detail/soils/home/?cid=nrcs142p2_053374
- United States Department of Agriculture, Natural Resources Conservation Service. National range and pasture handbook. <http://www.nrcs.usda.gov/wps/portal/nrcs/detail/national/landuse/rangepasture/?cid=stelprdb1043084>

Custom Soil Resource Report

United States Department of Agriculture, Natural Resources Conservation Service. National soil survey handbook, title 430-VI. http://www.nrcs.usda.gov/wps/portal/nrcs/detail/soils/scientists/?cid=nrcs142p2_054242

United States Department of Agriculture, Natural Resources Conservation Service. 2006. Land resource regions and major land resource areas of the United States, the Caribbean, and the Pacific Basin. U.S. Department of Agriculture Handbook 296. http://www.nrcs.usda.gov/wps/portal/nrcs/detail/national/soils/?cid=nrcs142p2_053624

United States Department of Agriculture, Soil Conservation Service. 1961. Land capability classification. U.S. Department of Agriculture Handbook 210. http://www.nrcs.usda.gov/Internet/FSE_DOCUMENTS/nrcs142p2_052290.pdf

APPENDIX E
FEMA FIRM MAP

To obtain more detailed information in areas where **Base Flood Elevations (BFEs)** and/or **Floodways** have been determined, users are encouraged to consult the Flood Profiles, Floodway Data and/or Summary of Stillwater Elevations tables contained within the Flood Insurance Study (FIS) report that accompanies this FIRM. Users should be aware that BFEs shown on the FIRM represent rounded whole-foot elevations. These BFEs are intended for flood insurance rating purposes only and should not be used as the sole source of flood elevation information. Accordingly, flood elevation data presented in the FIS report should be utilized in conjunction with the FIRM for purposes of construction and/or floodplain management.

Coastal Base Flood Elevations shown on this map apply only landward of 0' National Geodetic Vertical Datum of 1929 (NGVD 29). Users of this FIRM should be aware that coastal flood elevations are also provided in the Summary of Stillwater Elevations tables in the Flood Insurance Study report for this jurisdiction. Elevations shown in the Summary of Stillwater Elevations tables should be used for construction and/or floodplain management purposes when they are higher than the elevations shown on this FIRM.

Boundaries of the **floodways** were computed at cross sections and interpolated between cross sections. The floodways were based on hydraulic considerations with regard to requirements of the National Flood Insurance Program. Floodway widths and other pertinent floodway data are provided in the Flood Insurance Study report for this jurisdiction.

Certain areas not in Special Flood Hazard Areas may be protected by **flood control structures**. Refer to Section 2.4 "Flood Protection Measures" of the Flood Insurance Study report for information on flood control structures in this jurisdiction.

The **projection** used in the preparation of this map was New Hampshire State Plane, FIPSZONE 2800. The **horizontal datum** was NAD 83, GRS80 spheroid. Differences in datum, spheroid, projection or State Plane zones used in the production of FIRMs for adjacent jurisdictions may result in slight positional differences in map features across jurisdiction boundaries. These differences do not affect the accuracy of this FIRM.

Flood elevations on this map are referenced to the National Geodetic Vertical Datum of 1929. These flood elevations must be compared to structure and ground elevations referenced to the same **vertical datum**. For information regarding conversion between the National Geodetic Vertical Datum of 1929 and the North American Vertical Datum of 1988, visit the National Geodetic Survey website at www.ngs.noaa.gov or contact the National Geodetic Survey at the following address:

Spatial Reference System Division
National Geodetic Survey, NOAA
Silver Spring Metro Center
1215 East-West Highway
Silver Spring, Maryland 20910
(301) 713-3191

To obtain current elevation, description, and/or location information for **bench marks** shown on this map, please contact the Information Services Branch of the National Geodetic Survey at (301) 713-3242, or visit their website at www.ngs.noaa.gov.

Base map information shown on this FIRM was derived from U.S. Geological Survey Digital Orthophoto Quadrangles (DOQs) produced at a scale of 1:12,000 from photography dated 1998 or later.

This map reflects more detailed and up-to-date **stream channel configurations** than those shown on the previous FIRM for this jurisdiction. The floodplains and floodways that were transferred from the previous FIRM may have been adjusted to conform to these new stream channel configurations. As a result, the Flood Profiles and Floodway Data tables in the Flood Insurance Study report (which contains authoritative hydraulic data) may reflect stream channel distances that differ from what is shown on this map.

Corporate limits shown on this map are based on the best data available at the time of publication. Because changes due to annexations or de-annexations may have occurred after this map was published, map users should contact appropriate community officials to verify current corporate limit locations.

Please refer to the separately printed **Map Index** for an overview map of the county showing the layout of map panels; community map repository addresses; and a Listing of Communities table containing National Flood Insurance Program dates for each community as well as a listing of the panels on which each community is located.

Contact the **FEMA Map Service Center** at 1-800-358-9616 for information on available products associated with this FIRM. Available products may include previously issued Letters of Map Change, a Flood Insurance Study report, and/or digital versions of this map. The FEMA Map Service Center may also be reached by Fax at 1-800-358-9620 and their website at www.fema.gov/mfc.

If you have **questions about this map** or questions concerning the National Flood Insurance Program in general, please call 1-877-FEMA MAP (1-877-336-2627) or visit the FEMA website at www.fema.gov.


43° 05' 37.5"

215000 FT

JOINS PANEL 0260

210000 FT

43° 03' 45"

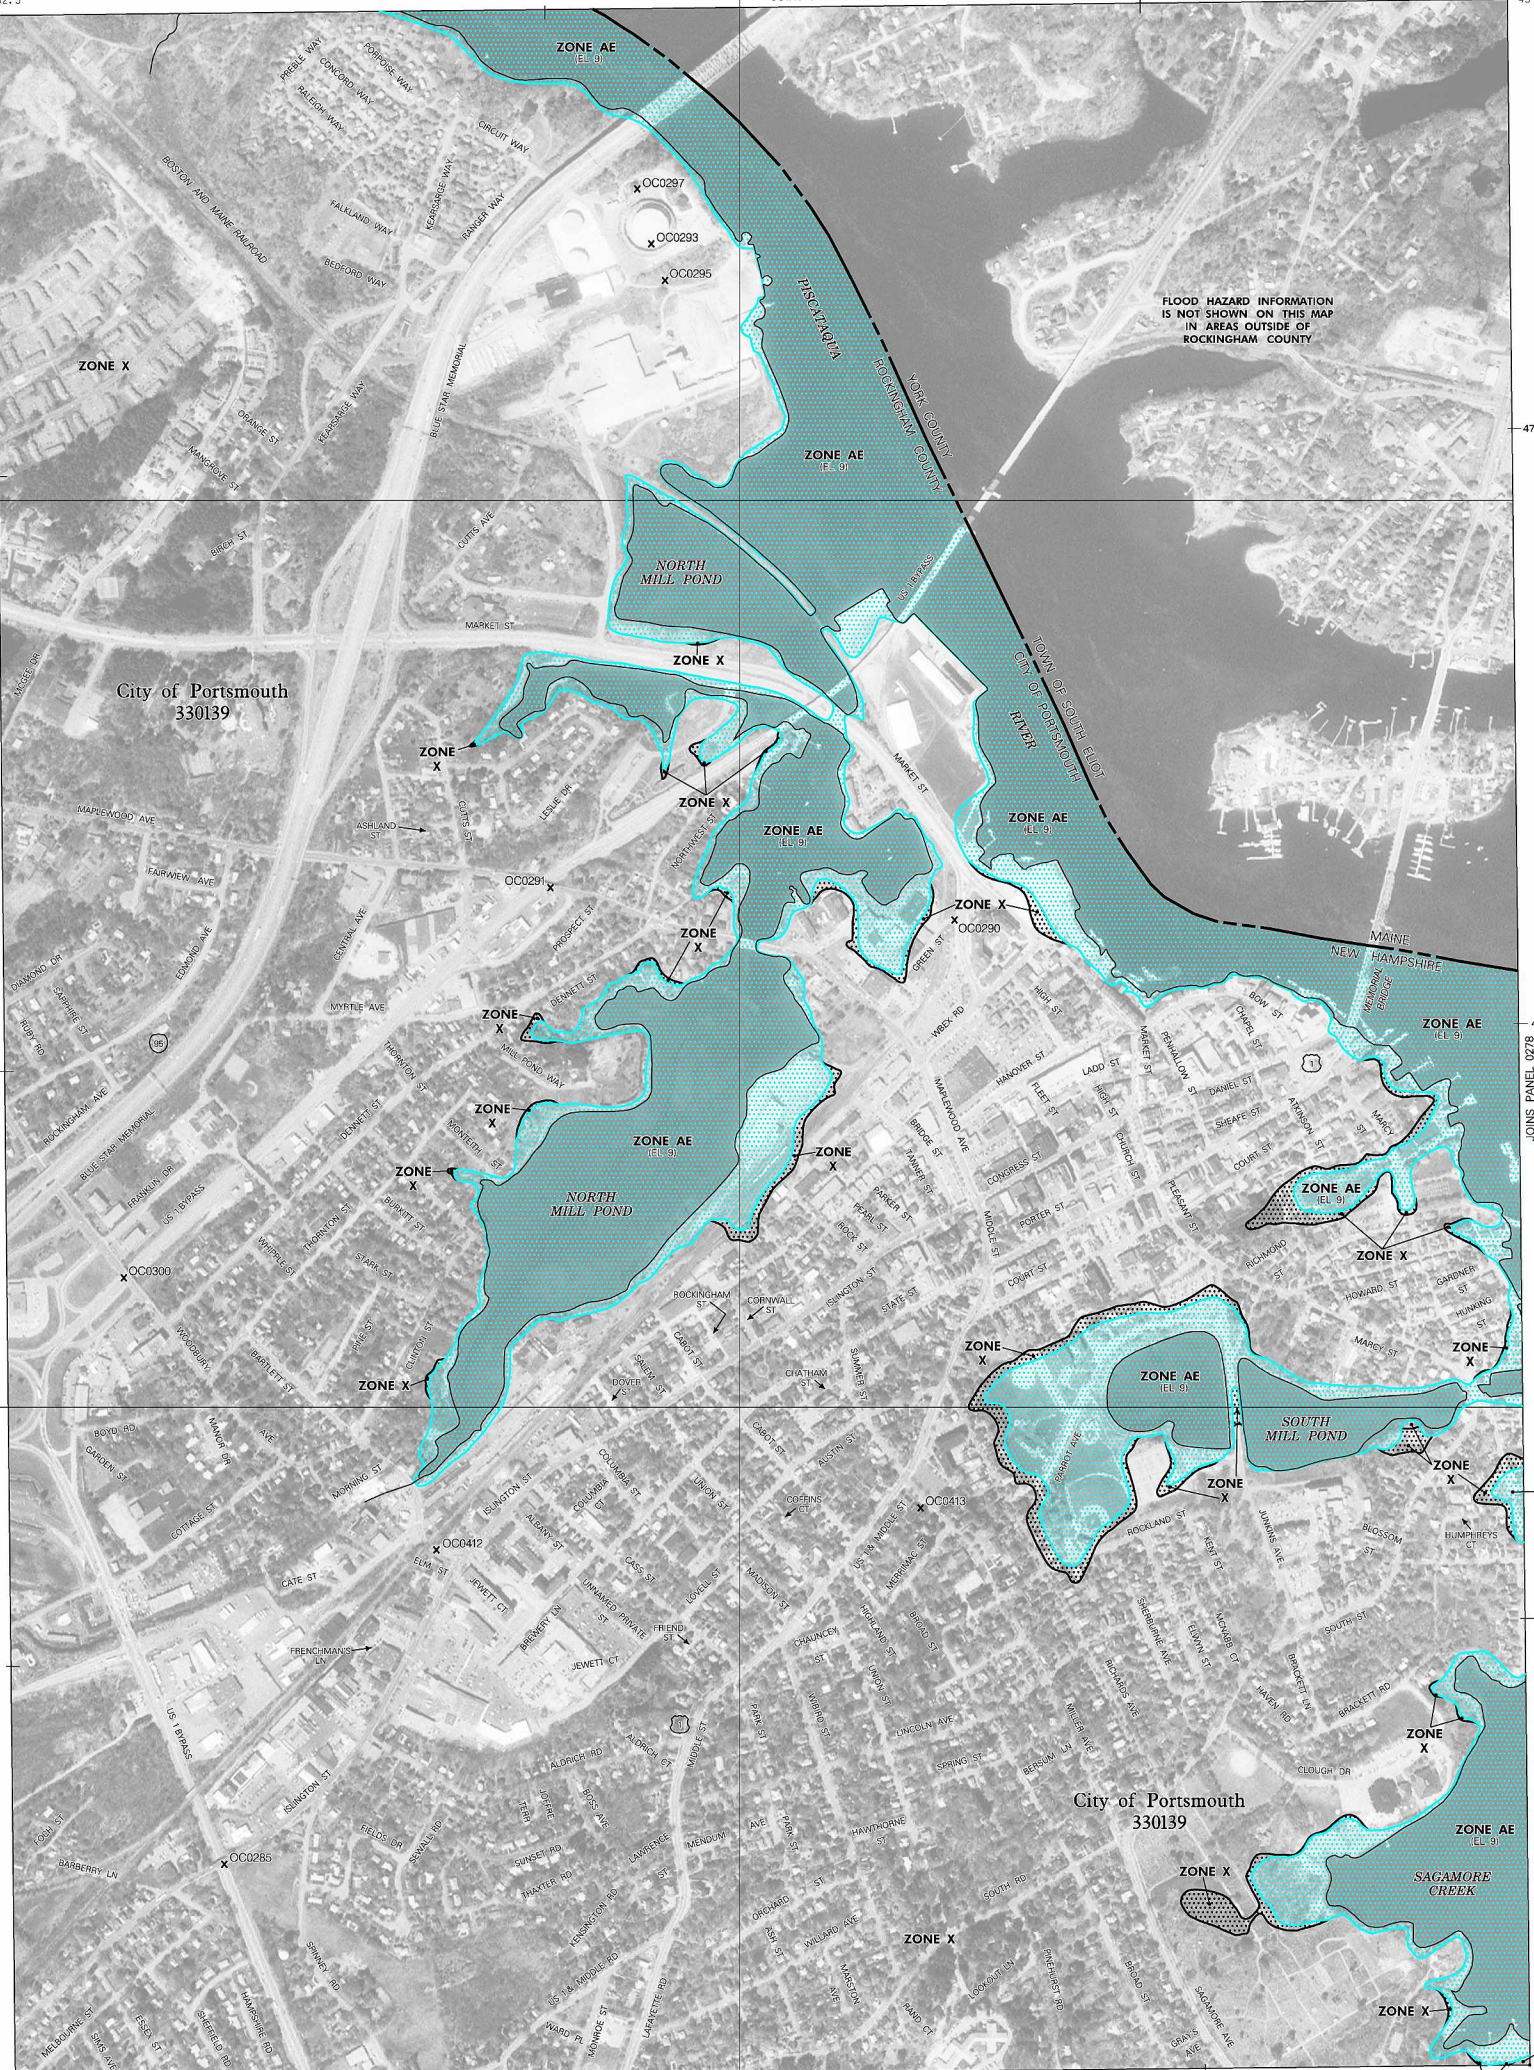

70° 45' 00"

4772000 M

JOINS PANEL 0278

4770000 M

70° 45' 00"

- ZONE A** No Base Flood Elevations determined.
- ZONE AE** Base Flood Elevations determined.
- ZONE AH** Flood depths of 1 to 3 feet (usually areas of ponding); Base Flood Elevations determined.
- ZONE AO** Flood depths of 1 to 3 feet (usually sheet flow on sloping terrain); average depths determined. For areas of alluvial fan flooding, velocities also determined.
- ZONE AR** Special Flood Hazard Area formerly protected from the 1% annual chance flood. ZONE AR indicates that the former flood control system is being restored to provide protection from the 1% annual chance or greater flood.
- ZONE A99** Area to be protected from 1% annual chance flood by a Federal flood protection system under construction; no Base Flood Elevations determined.
- ZONE V** Coastal flood zone with velocity hazard (wave action); no Base Flood Elevations determined.
- ZONE VE** Coastal flood zone with velocity hazard (wave action); Base Flood Elevations determined.

- FLOODWAY AREAS IN ZONE AE**
- OTHER FLOOD AREAS**
- ZONE X** Areas of 0.2% annual chance flood; areas of 1% annual chance flood with average depths of less than 1 foot or with drainage areas less than 1 square mile; and areas protected by levees from 1% annual chance flood.
- OTHER AREAS**
- ZONE D** Areas determined to be outside the 0.2% annual chance floodplain.
- ZONE X** Areas in which flood hazards are undetermined, but possible.
- COASTAL BARRIER RESOURCES SYSTEM (CBRS) AREAS**
- OTHERWISE PROTECTED AREAS (OPAs)**


- 1% annual chance floodplain boundary
- 0.2% annual chance floodplain boundary
- Floodway boundary
- Zone D boundary
- CBRS and OPA boundary
- Boundary dividing Special Flood Hazard Areas of different Base Flood Elevations, flood depths or flood velocities.
- Base Flood Elevation line and value; elevation in feet* (EL 987)
- Base Flood Elevation value where uniform within zone; elevation in feet*

- *Referenced to the National Geodetic Vertical Datum of 1929
- Cross section line
- Transect line
- 97° 07' 30", 32° 22' 30" Geographic coordinates referenced to the North American Datum of 1983 (NAD 83)
- 4276000 M 1000-meter Universal Transverse Mercator grid tick values, zone 19
- 600000 FT 5000-foot grid: New Hampshire State Plane coordinate system, (FIPSZONE 2800), Transverse Mercator projection.
- DX5510 Bench mark (see explanation in Notes to Users section of this FIRM panel)
- M1.5 River Mile

MAP REPOSITORY
Refer to listing of Map Repositories on Map Index

EFFECTIVE DATE OF COUNTYWIDE FLOOD INSURANCE RATE MAP
MAY 17, 2005

EFFECTIVE DATE(S) OF REVISION(S) TO THIS PANEL



JOINS PANEL 0259E

FIRM
FLOOD INSURANCE RATE MAP
ROCKINGHAM COUNTY,
NEW HAMPSHIRE
(ALL JURISDICTIONS)

PANEL 259 OF 681
(SEE MAP INDEX FOR FIRM PANEL LAYOUT)

CONTAINS:

COMMUNITY	NUMBER	PANEL	SUFFIX
PORTSMOUTH, CITY OF	330139	0259	E

Notice to User: The **Map Number** shown below should be used when placing map orders. The **Community Number** shown above should be used on insurance applications for the subject community.

MAP NUMBER
33015C0259E
EFFECTIVE DATE

APPENDIX F
INSPECTION & MAINTENANCE PLAN

STORMWATER INSPECTION & MAINTENANCE PLAN

FOR

BONZA BUILDERS, LLC

Proposed Residential Redevelopment

41 Salem Street

Portsmouth, NH

Introduction

The intent of this plan is to provide Bonz Builders, LLC (herein referred to as “owner”) with a list of procedures that document the inspection and maintenance requirements of the stormwater management system for this development. Specifically, the drip edge soil filters and associated structures on the project site (collectively referred to as the “Stormwater Management System”).

The following inspection and maintenance program is necessary to keep the stormwater management system functioning properly. These measures will also help minimize potential environmental impacts. By following the enclosed procedures, the owner will be able to maintain the functional design of the stormwater management system and maximize its ability to remove sediment and other contaminants from site generated stormwater runoff.

Annual Report

The owner shall prepare an annual Inspection & Maintenance Report. The report shall include a summary of the system’s maintenance and repair by transmission of the Inspection & Maintenance Log and other information as required. A copy of the report shall be delivered annually to the City of Portsmouth Code Enforcement Officer.

Inspection & Maintenance Checklist/Log

The following pages contain a Stormwater Management System Inspection & Maintenance Checklist and a blank copy of the Stormwater Management System Inspection & Maintenance Log. These forms are provided to the owner as a guideline for performing the inspection and maintenance of the Stormwater Management System. This is a guideline and should be periodically reviewed for conformance with current practice and standards.

STORMWATER MANAGEMENT SYSTEM COMPONENTS

The Stormwater Management System is designed to mitigate both the quantity and quality of site-generated stormwater runoff. As a result, the design includes the following elements:

Non-Structural BMP's

Non-Structural best management practices (BMP's) include temporary and permanent measures that typically require less labor and capital inputs and are intended to provide protection against erosion of soils. Examples of non-structural BMP's on this project include but are not limited to: temporary and permanent mulching, temporary and permanent grass cover, trees, shrubs and ground covers, miscellaneous landscape plantings, dust control, tree protection, topsoiling, sediment barriers, and a stabilized construction entrance.

Structural BMP's

Structural BMP's are more labor and capital-intensive structures or installations that require more specialized personnel to install. Examples on this project include but are not limited to: storm drains, the drip edge soil filters and associated structures, and the infiltration trench system.

Inspection and Maintenance Requirements

The following summarizes the inspection and maintenance requirements for the various BMP's that may be found on this project.

- 1. Grassed areas:** After each rain event of 0.5" or more during a 24-hour period, inspect grassed areas for signs of disturbance, such as erosion. If damaged areas are discovered, immediately repair the damage. Repairs may include adding new topsoil, lime, seed, fertilizer and mulch.
- 2. Plantings:** Planting and landscaping (trees, shrubs) shall be monitored bi-monthly during the first year to insure viability and vigorous growth. Replace dead or dying vegetation with new stock and make adjustments to the conditions that caused the dead or dying vegetation. During dryer times of the year, provide weekly watering or irrigation during the establishment period of the first year. Make the necessary adjustments to ensure long-term health of the vegetated covers, i.e. provide more permanent mulch or compost or other means of protection.
- 3. Catch Basins and Storm Drains:** Monitor drain inlets for excessive accumulation of sediments or missing stone/riprap. Remove sediments as required.
- 4. Roofline Drip Edge Filter Strip:** After acceptance of the Filter, perform the following inspections on a semi-annual basis or after significant rainfall events (10-year, 24 hour storms, or back to back 2 year, 24 hour storms):
 - a.** Monitor Filter for 72 hours following a rain storm. If the Filter fails to fully drain within this period time, the engineered soil may have become plugged. Inspect for other causes of blockage. If it's determined that the soil has become plugged and is no longer functioning as engineered, then replacement of soils shall be required. Contractor shall use care in removing soil around foundations.
 - b.** Monitor for excessive or concentrated accumulations of debris, or excessive erosion. Remove debris as required.

Invasive Species

The site should be monitored during construction for the presence of any invasive species. Such growth should be removed and disposed properly.

Stormwater Management System

Inspection & Maintenance Checklist for Post Construction Condition—for Bonza Builders, LLC, 41 Salem Street, Portsmouth, NH

BMP/System Component	Minimum Inspection Frequency	Minimum Inspection Requirements	Maintenance/Cleanout Threshold
Closed Drainage System			
Drainage Pipes	Yearly	<i>Check for sediment clogging, or soiled runoff.</i>	Clean entire drainage system and remove all sediments if discovered in piping.
Roofline Drip Edge Soil Filter	2 X Annually	<i>Keep filter surface clean</i>	Remove any weeds, trash, debris and accumulated sediment. If filter does not drain within 72 hours following a rain event, a qualified professional should assess the condition of the facility to determine restoration measures.
Annual Report	Yearly	<i>Prepare Annual Report, including all Inspection & Maintenance Logs. Provide to Town (if required).</i>	N/A

Stormwater Management System Maintenance Summary

Inspection & Maintenance Log—for Bonza Builders, LLC, 41 Salem Street, Portsmouth, NH

BMP/System Component	Date Inspected	Inspector	Problems Noted, Required Maintenance <i>(List Items/Comments)</i>	Date of Maintenance	Performed By


Data Sheets

- NOTES:**
- 1) PARCEL IS SHOWN ON THE CITY OF PORTSMOUTH ASSESSOR'S MAP 144 AS LOT 31.
 - 2) OWNER OF RECORD:
 BONZA BUILDERS, LLC
 79 EXETER ROAD
 NORTH HAMPTON, NH 03862
 6056/205
 - 3) PARCEL IS LOCATED IN THE GENERAL RESIDENCE C (GRC) ZONING DISTRICT.

- NOTES:**
- 1) THIS PLAN IS INTENDED FOR RUNOFF ANALYSIS ONLY AND SHALL NOT BE USED FOR CONSTRUCTION.
 - 2) THE CONTRACTOR SHALL NOTIFY DIG SAFE AT 1-888-DIG-SAFE (1-888-344-7233) AT LEAST 72 HOURS PRIOR TO COMMENCING ANY EXCAVATION ON PUBLIC OR PRIVATE PROPERTY.
 - 3) UNDERGROUND UTILITY LOCATIONS ARE BASED UPON BEST AVAILABLE EVIDENCE AND ARE NOT FIELD VERIFIED. LOCATING AND PROTECTING ANY ABOVEGROUND OR UNDERGROUND UTILITIES IS THE SOLE RESPONSIBILITY OF THE CONTRACTOR AND/OR THE OWNER. UTILITY CONFLICTS SHOULD BE REPORTED AT ONCE TO THE DESIGN ENGINEER.
 - 4) CONTRACTOR SHALL INSTALL AND MAINTAIN EROSION CONTROL MEASURES IN ACCORDANCE WITH THE "NEW HAMPSHIRE STORMWATER MANUAL, VOLUME 3, EROSION AND SEDIMENT CONTROLS DURING CONSTRUCTION. (NHDES DECEMBER 2008).

**SITE DEVELOPMENT
 41 SALEM STREET
 PORTSMOUTH, N.H.**

0	ISSUED FOR COMMENT	3/18/20
NO.	DESCRIPTION	DATE
REVISIONS		


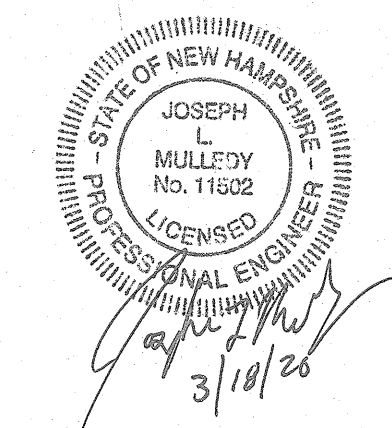


SCALE: 1" = 10' MARCH 2020

**PLAN OF EXISTING
 SUBCATCHMENTS** **W1**


LEGEND

EXISTING	PROPOSED	
D	D	STORM DRAIN
X-X	X-X	SILT FENCE
100	100	CONTOUR
97x3	98x0	SPOT ELEVATION
---	---	EDGE OF PAVEMENT (EP)
---	---	SUBCATCHMENT LINE
6	600	SUBCATCHMENT NUMBER
1234	1234	AREA IN SQUARE FEET
WOODS	WOODS	DESCRIPTION OF COVER
6	600	POND (DESIGN MODEL)
6	600	REACH (DESIGN MODEL)
→	→	DRAINAGE VECTOR
---	---	EDGE OF WOODS / TREES
CB	CB	CATCH BASIN
DMH	DMH	DRAIN MANHOLE
W	W	WELL
EL.	EL.	ELEVATION
EP	EP	EDGE OF PAVEMENT
FF	FF	FINISHED FLOOR
INV	INV	INVERT
TBM	TBM	TEMPORARY BENCH MARK
TYP	TYP	TYPICAL
HSG	HSG	HYDROLOGIC SOIL GROUP
SF	SF	SHEET FLOW
SCF	SCF	SHALLOW CONCENTRATED FLOW
CHANNEL	CHANNEL	CHANNEL FLOW

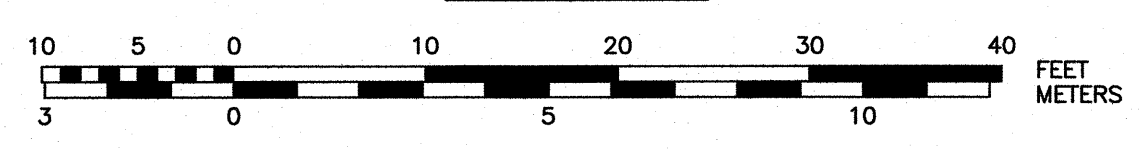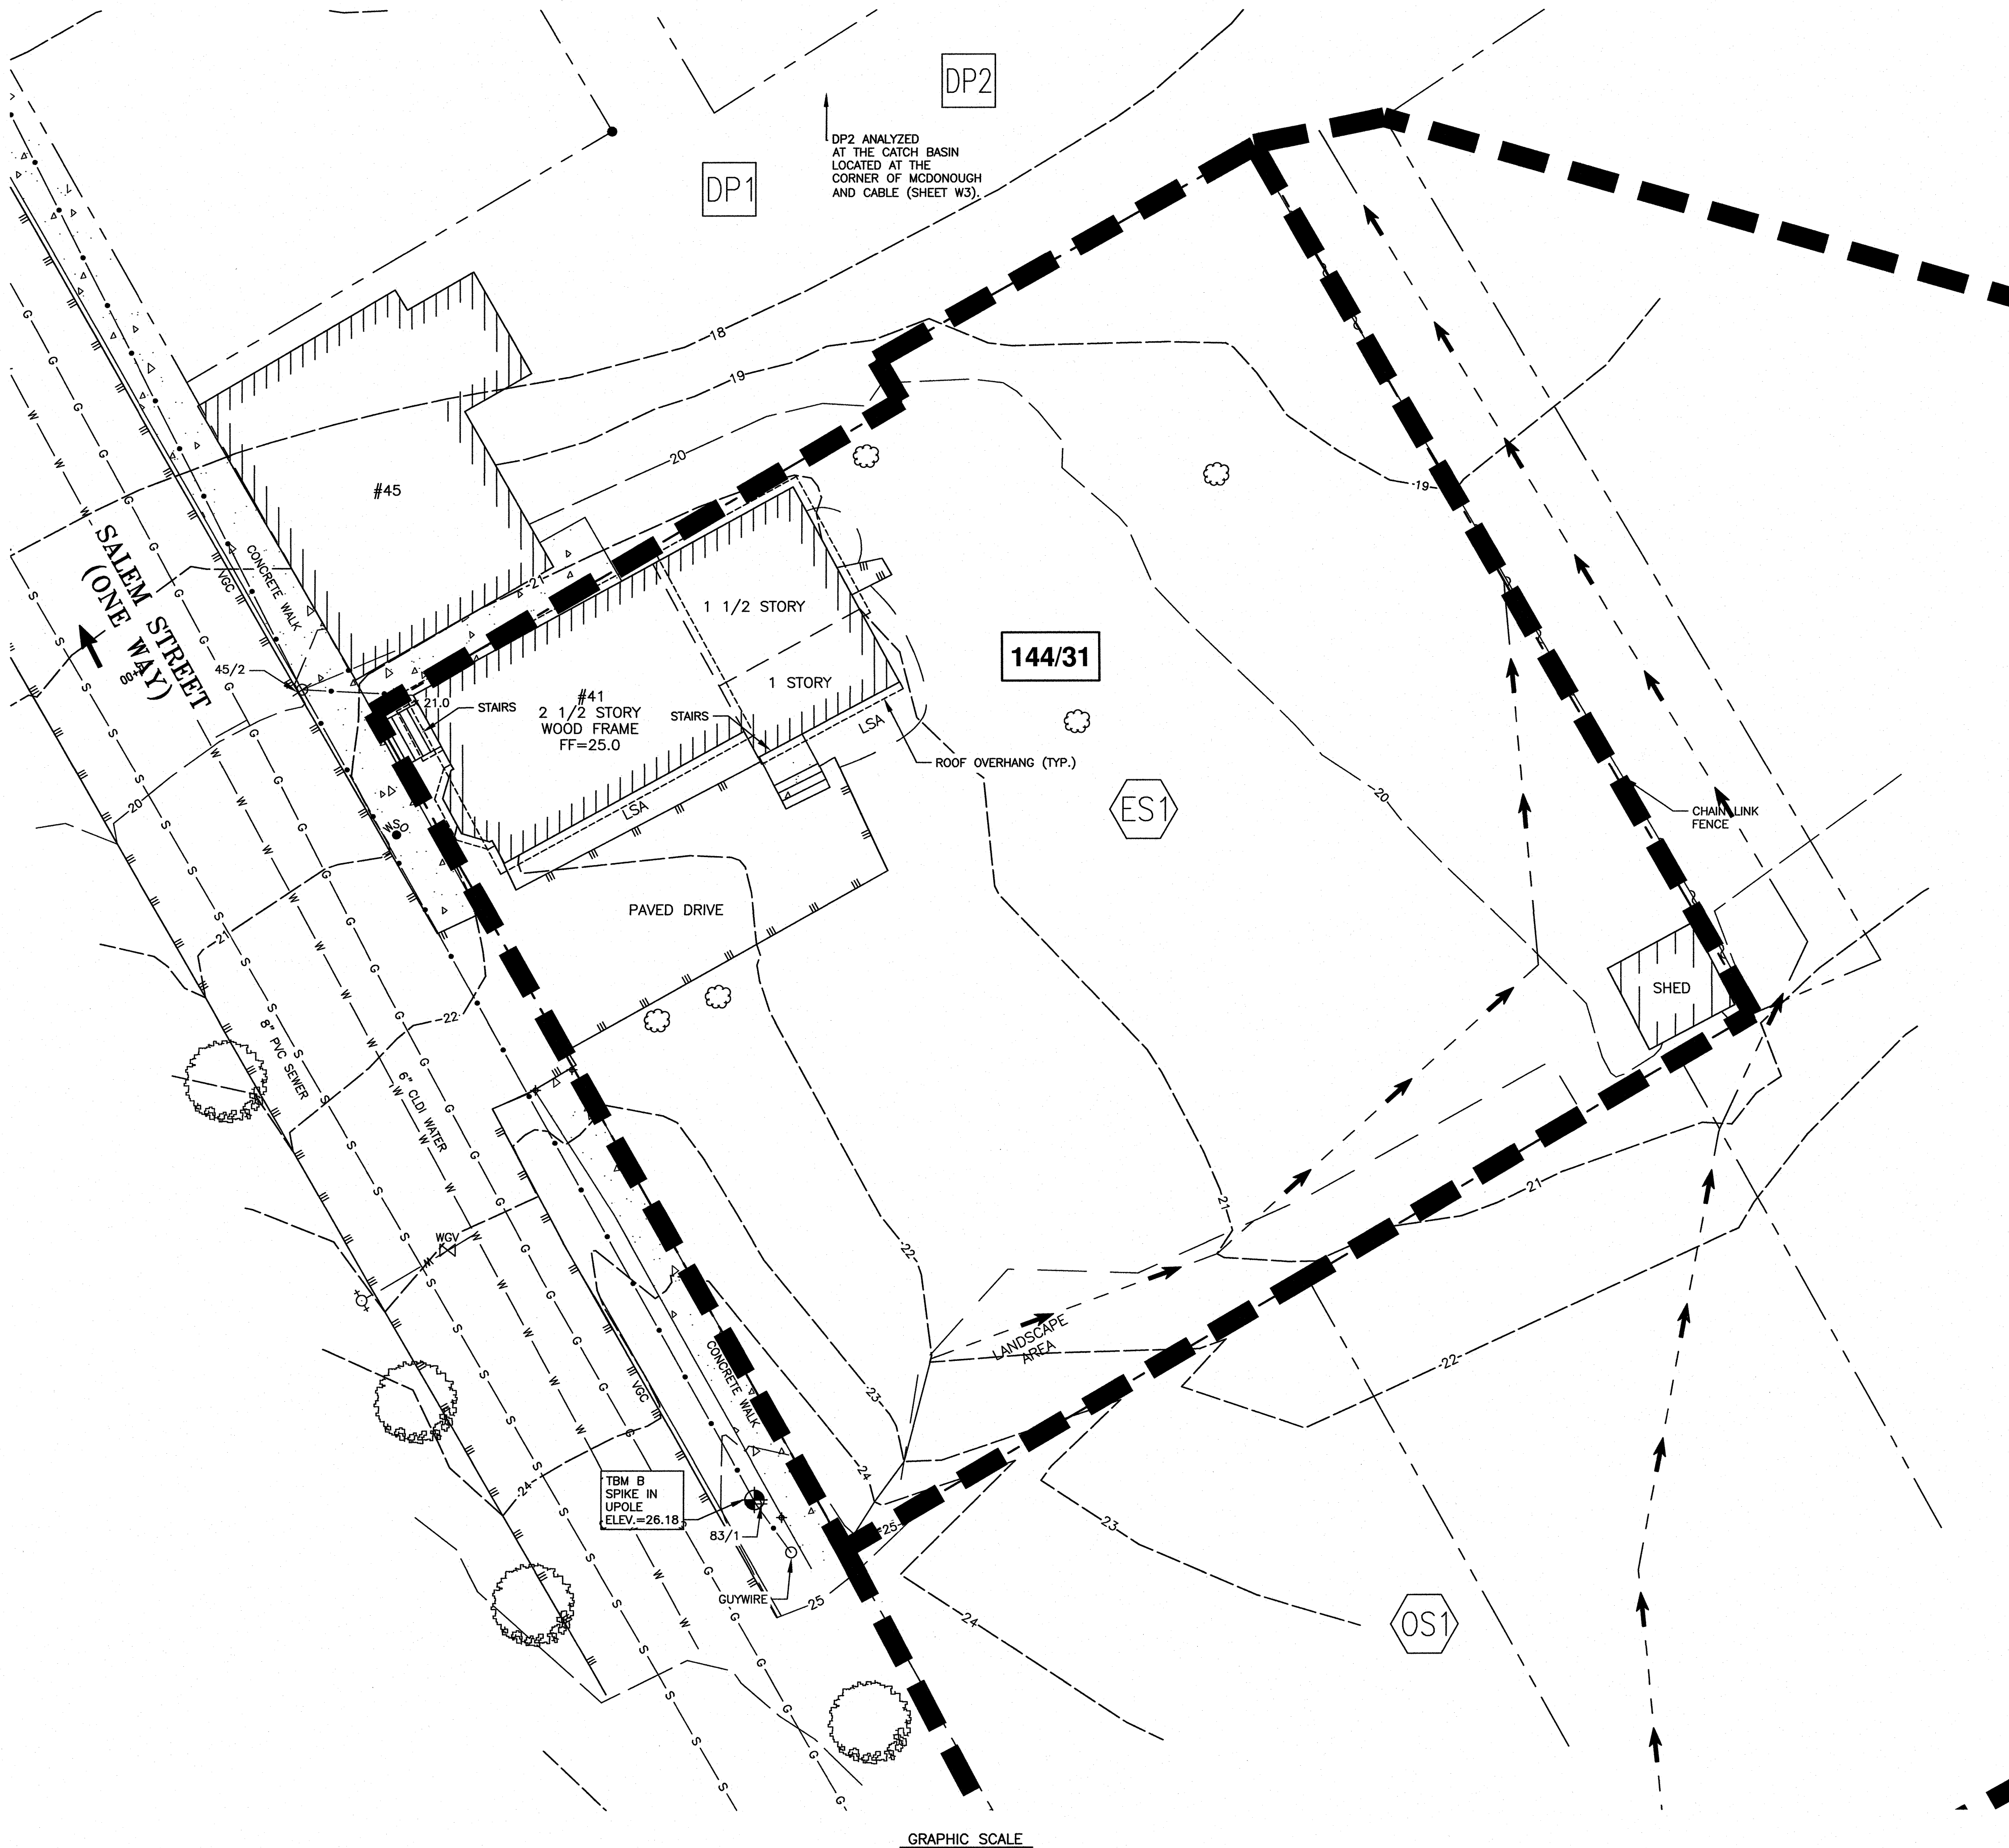

LEGEND

EXISTING	PROPOSED	
D	D	STORM DRAIN
X X	X X	SILT FENCE
100	100	CONTOUR
97x3	98x0	SPOT ELEVATION
		EDGE OF PAVEMENT (EP)
		SUBCATCHMENT LINE
6	600	SUBCATCHMENT NUMBER
1234	1234	AREA IN SQUARE FEET
WOODS	WOODS	DESCRIPTION OF COVER
6	600	POND (DESIGN MODEL)
6	600	REACH (DESIGN MODEL)
		DRAINAGE VECTOR
		EDGE OF WOODS / TREES
CB	CB	CATCH BASIN
DMH	DMH	DRAIN MANHOLE
W	W	WELL
EL.	EL.	ELEVATION
EP	EP	EDGE OF PAVEMENT
FF	FF	FINISHED FLOOR
INV	INV	INVERT
TBM	TBM	TEMPORARY BENCH MARK

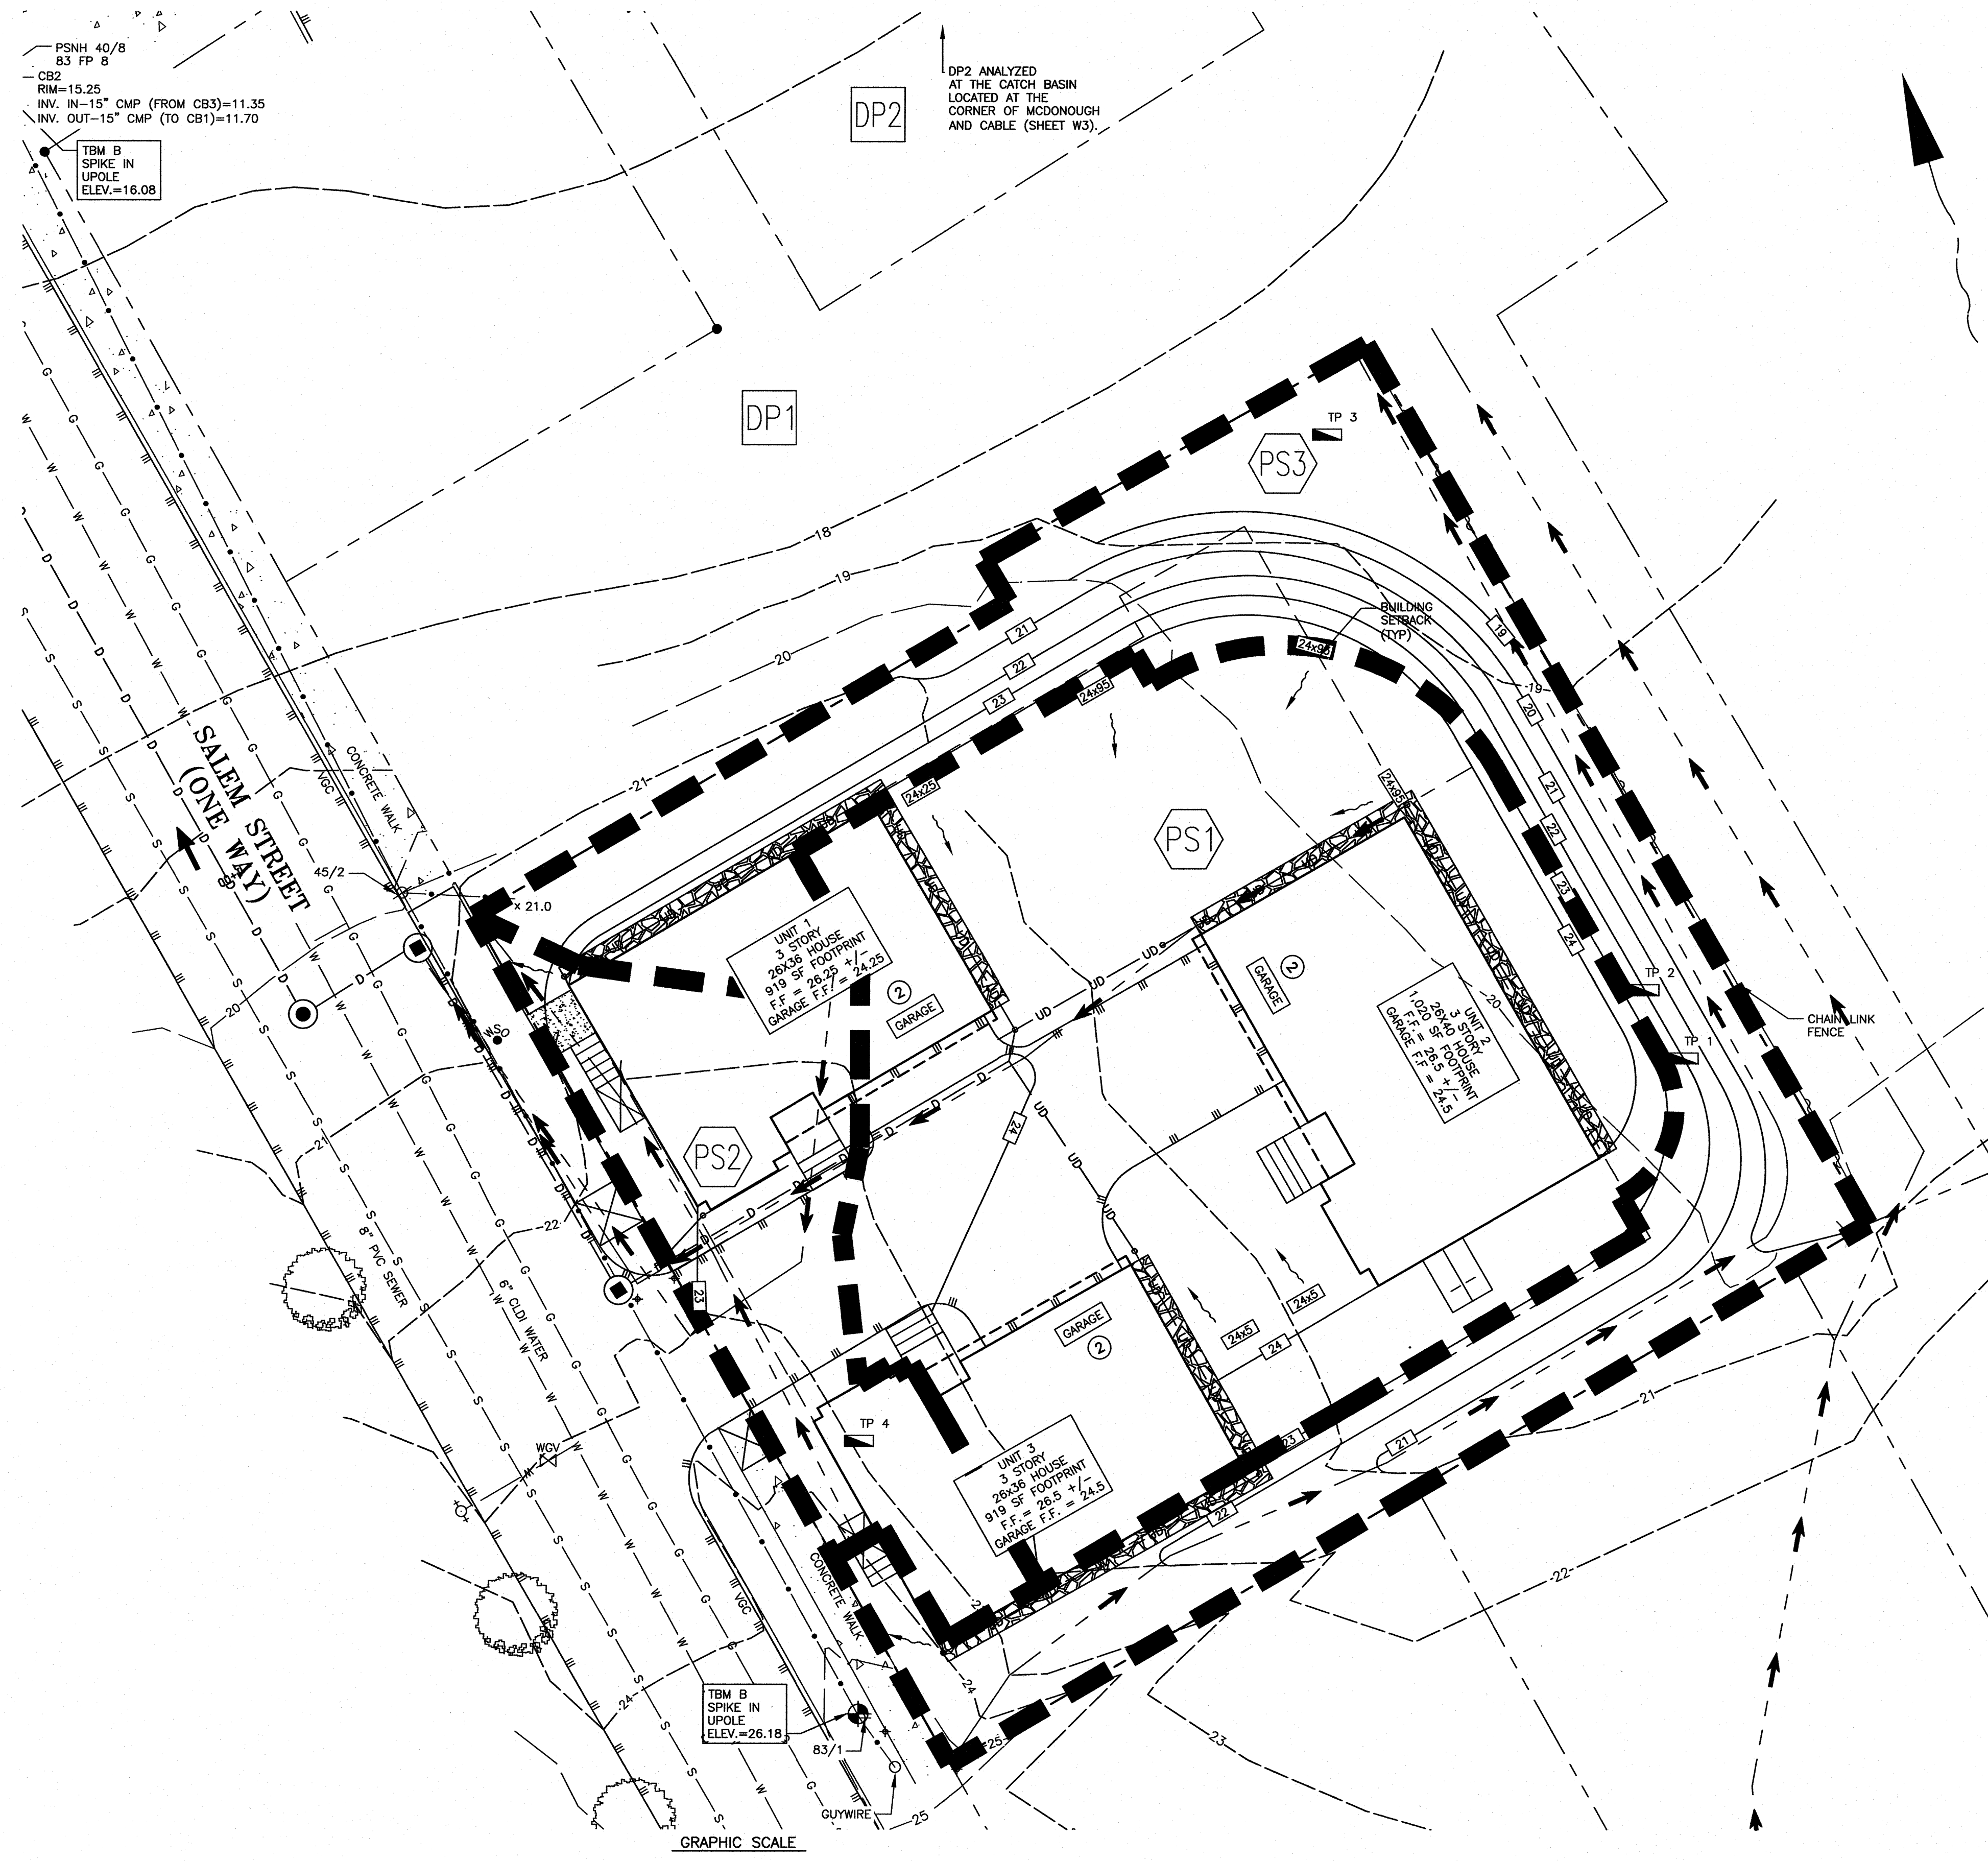

AMBIT ENGINEERING, INC.
Civil Engineers & Land Surveyors
200 Griffin Road - Unit 3
Portsmouth, N.H. 03801-7114
Tel (603) 430-9282
Fax (603) 436-2315

- NOTES:**
- 1) THIS PLAN IS INTENDED FOR RUNOFF ANALYSIS ONLY AND SHALL NOT BE USED FOR CONSTRUCTION.
 - 2) THE CONTRACTOR SHALL NOTIFY DIG SAFE AT 1-888-DIG-SAFE (1-888-344-7233) AT LEAST 72 HOURS PRIOR TO COMMENCING ANY EXCAVATION ON PUBLIC OR PRIVATE PROPERTY.
 - 3) UNDERGROUND UTILITY LOCATIONS ARE BASED UPON BEST AVAILABLE EVIDENCE AND ARE NOT FIELD VERIFIED. LOCATING AND PROTECTING ANY ABOVEGROUND OR UNDERGROUND UTILITIES IS THE SOLE RESPONSIBILITY OF THE CONTRACTOR AND/OR THE OWNER. UTILITY CONFLICTS SHOULD BE REPORTED AT ONCE TO THE DESIGN ENGINEER.
 - 4) CONTRACTOR SHALL INSTALL AND MAINTAIN EROSION CONTROL MEASURES IN ACCORDANCE WITH THE "NEW HAMPSHIRE STORMWATER MANUAL, VOLUME 3, EROSION AND SEDIMENT CONTROLS DURING CONSTRUCTION. (NHDES DECEMBER 2008).

**SITE DEVELOPMENT
41 SALEM STREET
PORTSMOUTH, N.H.**

NO.	DESCRIPTION	DATE
0	ISSUED FOR COMMENT	3/18/20

STATE OF NEW HAMPSHIRE
JOSEPH L. MULLENDY
No. 11502
LICENSED PROFESSIONAL ENGINEER
3/18/20

SCALE: 1" = 10' MARCH 2020

**PLAN OF PROPOSED
SUBCATCHMENTS**


W2



AMBIT ENGINEERING, INC.
 Civil Engineers & Land Surveyors
 200 Griffin Road - Unit 3
 Portsmouth, N.H. 03801-7114
 Tel (603) 430-9282
 Fax (603) 436-2315

LEGEND

EXISTING	PROPOSED	
		STORM DRAIN
		SILT FENCE
		CONTOUR
		SPOT ELEVATION
		EDGE OF PAVEMENT (EP)
		SUBCATCHMENT LINE
		SUBCATCHMENT NUMBER
		AREA IN SQUARE FEET
		DESCRIPTION OF COVER
		POND (DESIGN MODEL)
		REACH (DESIGN MODEL)
		DRAINAGE VECTOR
		EDGE OF WOODS / TREES
		CATCH BASIN
		DRAIN MANHOLE
		WELL
		ELEVATION
		EDGE OF PAVEMENT
		FINISHED FLOOR
		INVERT
		TEMPORARY BENCH MARK
		TYPICAL
		Tc PATH
		HYDROLOGIC SOIL GROUP
		SHEET FLOW
		SHALLOW CONCENTRATED FLOW
		CHANNEL FLOW

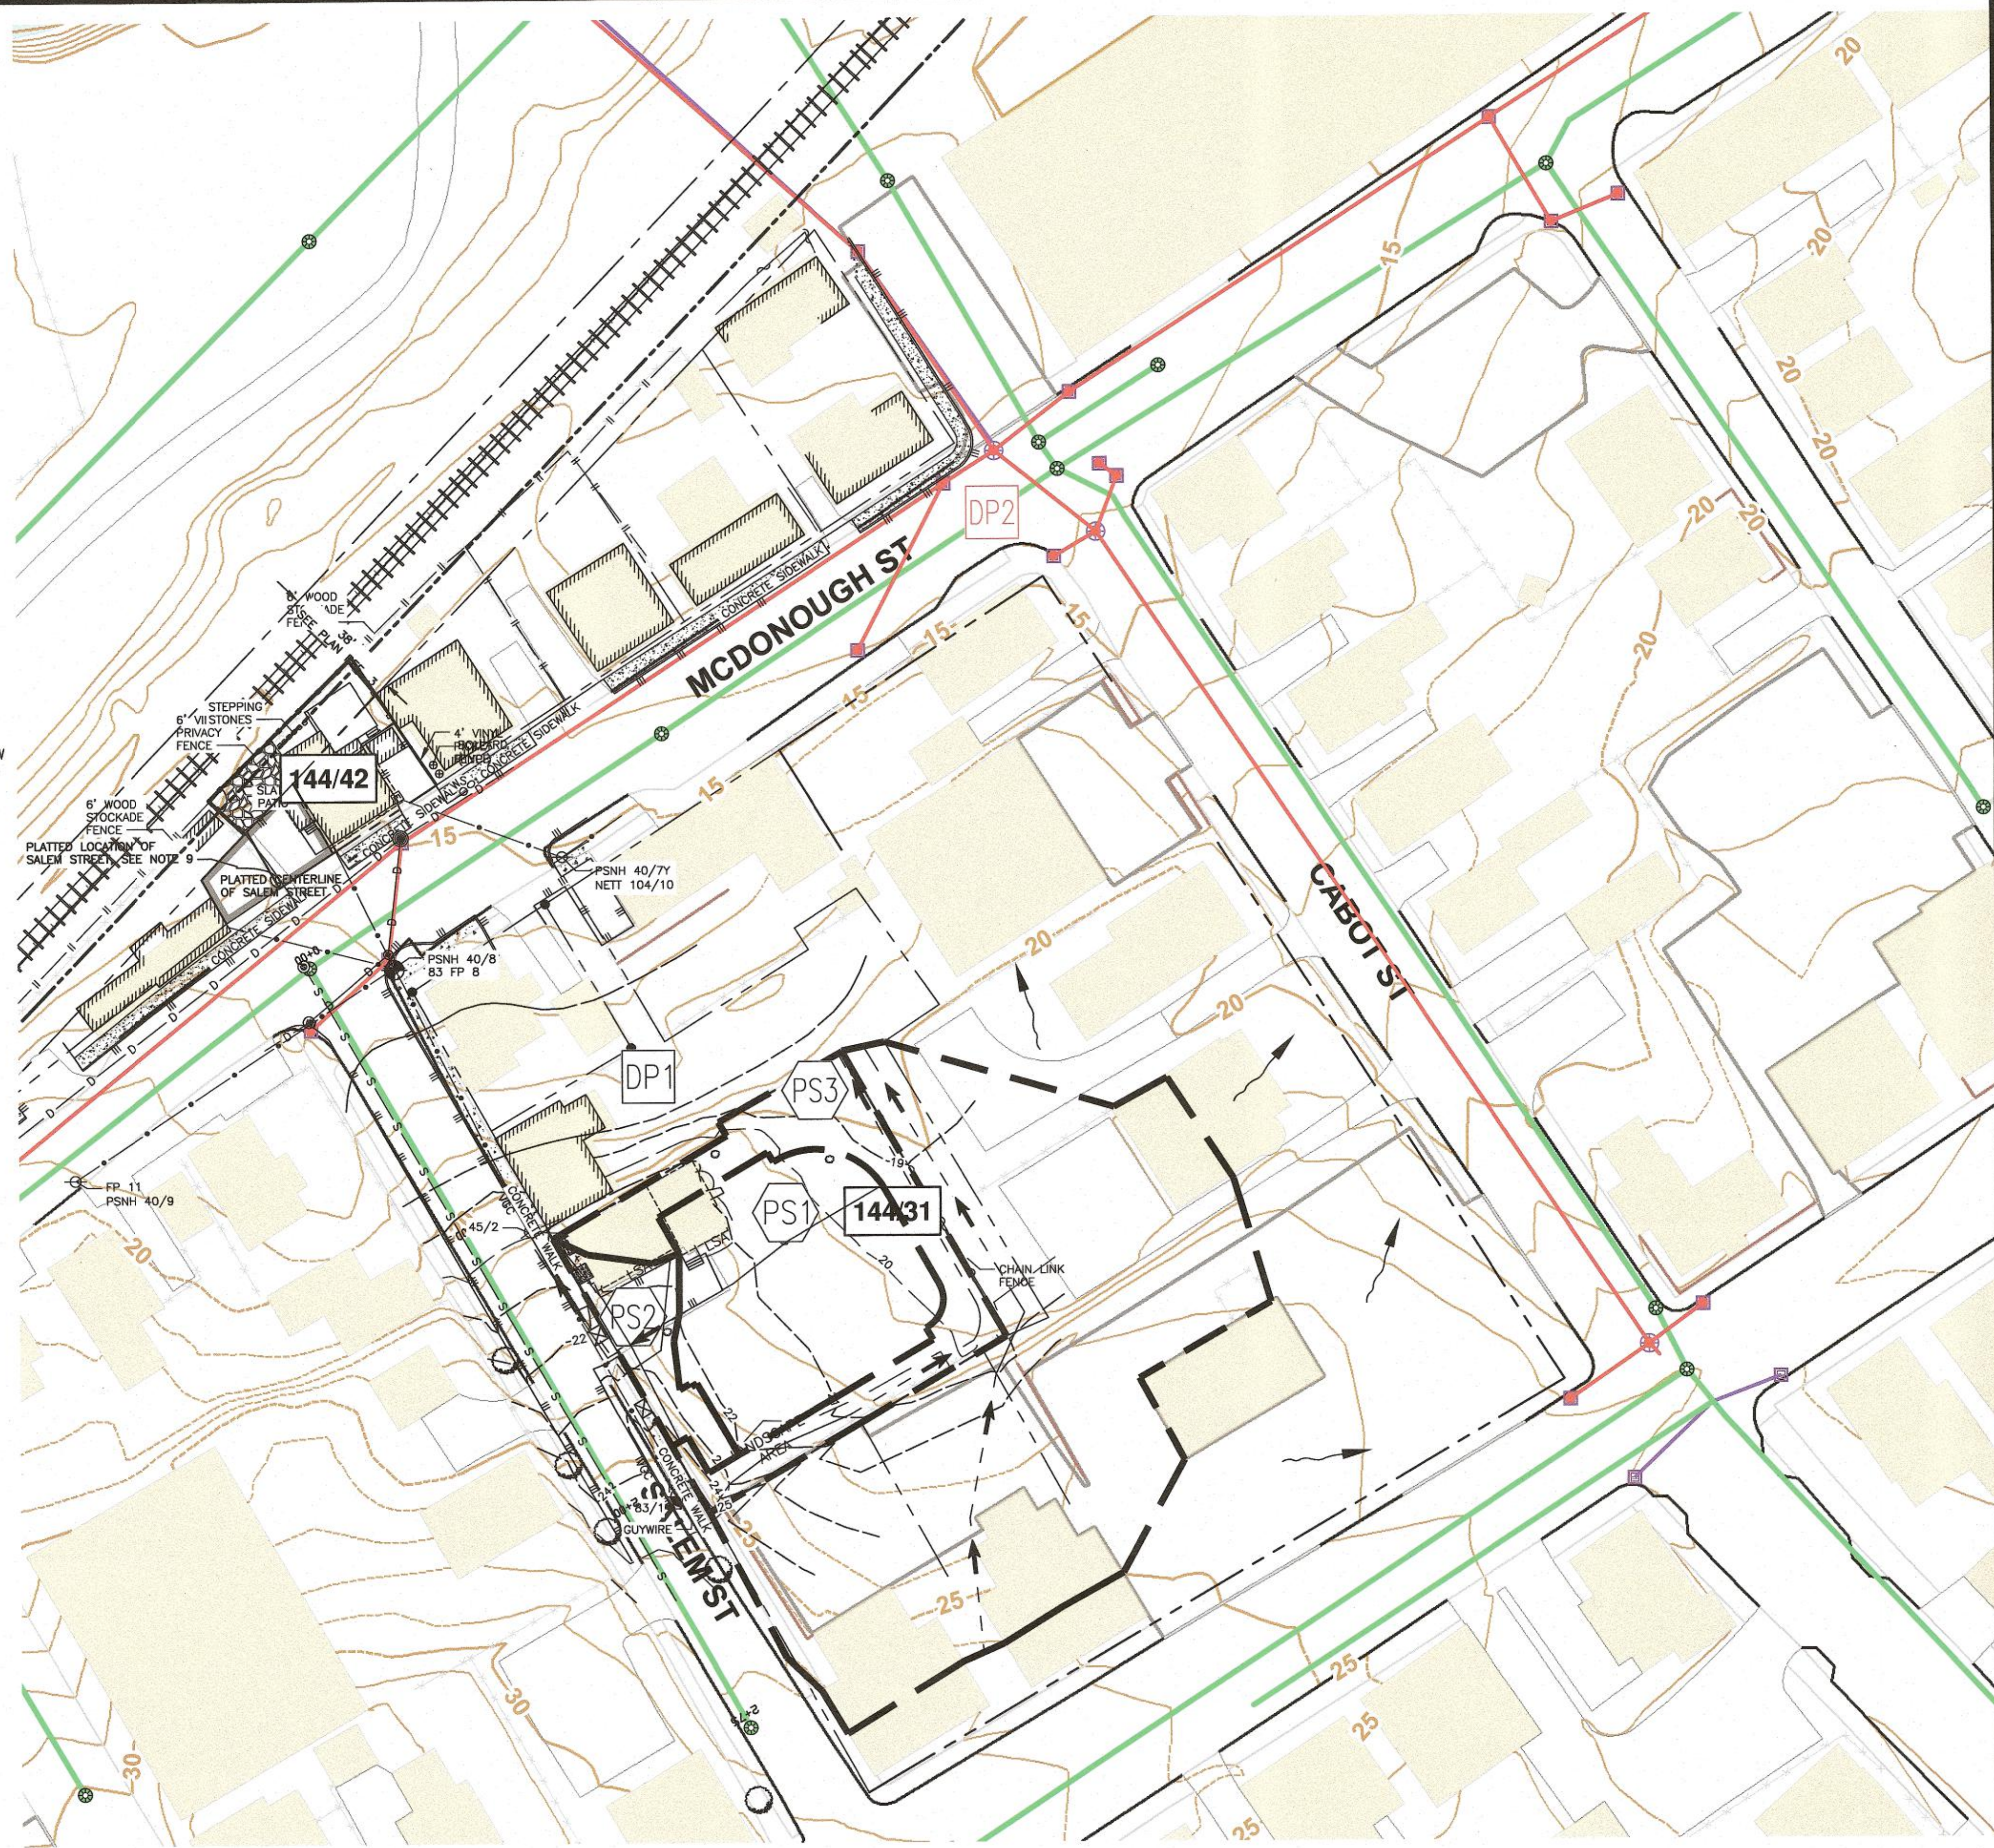

NOTES:

- 1) PARCEL IS SHOWN ON THE CITY OF PORTSMOUTH ASSESSOR'S MAP 144 AS LOT 31.
- 2) OWNER OF RECORD:
 BONZA BUILDERS, LLC
 79 EXETER ROAD
 NORTH HAMPTON, NH 03862
 6056/205
- 3) PARCEL IS LOCATED IN THE GENERAL RESIDENCE C (GRC) ZONING DISTRICT.

NOTES:

- 1) THIS PLAN IS INTENDED FOR RUNOFF ANALYSIS ONLY AND SHALL NOT BE USED FOR CONSTRUCTION.
- 2) THE CONTRACTOR SHALL NOTIFY DIG SAFE AT 1-888-DIG-SAFE (1-888-344-7233) AT LEAST 72 HOURS PRIOR TO COMMENCING ANY EXCAVATION ON PUBLIC OR PRIVATE PROPERTY.
- 3) UNDERGROUND UTILITY LOCATIONS ARE BASED UPON BEST AVAILABLE EVIDENCE AND ARE NOT FIELD VERIFIED. LOCATING AND PROTECTING ANY ABOVEGROUND OR UNDERGROUND UTILITIES IS THE SOLE RESPONSIBILITY OF THE CONTRACTOR AND/OR THE OWNER. UTILITY CONFLICTS SHOULD BE REPORTED AT ONCE TO THE DESIGN ENGINEER.
- 4) CONTRACTOR SHALL INSTALL AND MAINTAIN EROSION CONTROL MEASURES IN ACCORDANCE WITH THE "NEW HAMPSHIRE STORMWATER MANUAL, VOLUME 3, EROSION AND SEDIMENT CONTROLS DURING CONSTRUCTION. (NHDES DECEMBER 2008).


**SITE DEVELOPMENT
 41 SALEM STREET
 PORTSMOUTH, N.H.**

NO.	DESCRIPTION	DATE
0	ISSUED FOR COMMENT	3/18/20
REVISIONS		



SCALE: 1" = 30' MARCH 2020

PLAN OF OFFSITE SUBCATCHMENTS **W3**

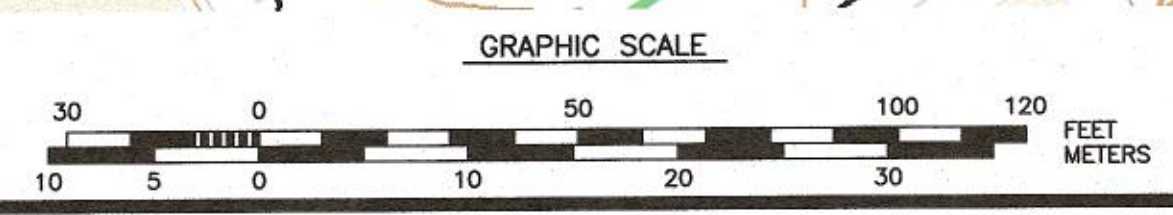

11/20/2019 10:00 AM 11/20/2019 Site Development/Plans & Specifications SET 201.dwg