

Storm Water Pollution Prevention Plan
For
Portsmouth Public Works Facility
680 Peverly Hill Road
Portsmouth, NH 03801




City of Portsmouth, NH

January 2009

Certification (modify to include criteria in Section 2.1.4.4)

I certify under penalty of law that this document and all attachments were prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gathered and evaluated the information contained therein. Based on my inquiry of the person or persons who manage the system, or those persons directly responsible for gathering the information, the information contained is, to the best of my knowledge and belief, true, accurate, and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations.

Engineer: Steven F. Parkinson, P.E.

Signature: 

Registration Number: 4750

Date: 1/2/09

TABLE OF CONTENTS

	Page
1 FACILITY OWNER & OPERATOR	1
2 FACILITY CONTACT(S)	1
3 STORM WATER POLLUTION PREVENTION TEAM	1
4 FACILITY DESCRIPTION	2
5 SITE DRAINAGE PATTERNS	4
6 RECEIVING WATERS WETLANDS & IMPAIRED WATERS	5
7 SUMMARY OF AVAILABLE STORM WATER SAMPLING DATA	5
8 POTENTIAL STORM WATER CONTAMINANTS	5
9 STORM WATER BMPS / CONTROL MEASURES	9
10 RECORD KEEPING & RECORDING	12
11 FACILITY INSPECTION & MONITORING PLAN	13
12 REVIEW OF DATA	15
13 ANNUAL REPORT	16
14 TRAINING	16
15 ENDANGERED SPECIES	16
16 HISTORICAL PLACES	16

APPENDIXES

A	Drainage Plan for Portsmouth Public Works Facility
B	Letters to and from Regulatory Authorities Regarding Endangered Species and Critical Habitat
C	Letters to and from Regulatory Authorities Regarding Historical Resources
D	Routine Facility Inspection Form
E	Visual Assessment Form
F	Annual Report

1 – FACILITY OWNER and OPERATOR:

Facility Owner, Address, and Telephone

City of Portsmouth
1 Junkins Avenue
Portsmouth, NH 03801
(603) 431-2000

Facility Operator, Address, and Telephone

Department of Public Works
Recycling Center
680 Peverly Hill Road
Portsmouth, NH 03801
(603) 427-1530

2 – FACILITY CONTACT:

<u>Name</u>	<u>Title</u>	<u>Telephone</u>
Steve Parkinson, P.E.	Director of Public Works	(603) 766-1420
Silke Psula	Solid Waste Coordinator	(603) 766-1454

3 – STORM WATER POLLUTION PREVENTION TEAM

The Storm Water Pollution Prevention Team is a group of municipal employees, who will develop, implement, maintain and revise the storm water pollution prevention program at the Recycling Center (DPW) Facility. These employees are on site and most familiar with the facility and its operations.

Collectively, the Storm Water Pollution Prevention Team is responsible for the following:

- Implementing the Stormwater Industrial permit and pollution prevention plan requirements;
- Defining and agreeing upon an appropriate set of goals for the facility storm water management program;
- Staying abreast of facility operations and determine whether any changes must be made to the Stormwater Pollution Prevention Plan to stay in compliance with Federal Stormwater Pollution prevention requirements;
- Maintaining a clear line of communication between facility personnel and management to ensure a cooperative partnership.

The SWPPP team for this facility is:

Public Works Director

- Sets policy in accord with the storm water pollution prevention regulations
- Signatory authority; overall responsible for the plan.

Solid Waste Coordinator

- Designated SWPPP Coordinator
- Write, review, revise SWPPP
- Coordinate plan development and implementation
- Keep records
- Ensure reports submitted
- Evaluate other existing environmental management plans (i.e. SPCC) for consistency and coordination
- Facilitate implementation of BMPs

Public Works Deputy Director

- Coordinate and ensure consistency of City projects in accord with stormwater pollution prevention regulations and City's SWPPP

General Foreman – Highway Div.

- Responsible for following the preventive maintenance program
- Implementing BMPs within scope of authority

Highway Foreman – Highway Div.

- Responsible for following the preventive maintenance program
- Implementing BMPs within scope of authority

4 – FACILITY DESCRIPTION

The Portsmouth Public Works Facility is located at 680 Peverly Hill Road in the City of Portsmouth, New Hampshire. The Facility is situated on 8.3 acres and is approximately 80% impervious. It is comprised of various operations, including an Office Complex, Vehicle Maintenance Facility, Recycling Center, Fuel Distribution Depot, Salt Storage Shed, and Materials Storage. The facility was built during the year 1999 with operations commencing in January of 2000.

The Office Complex, Maintenance Facility, and Vehicle Barn are located in one building.

Vehicle Maintenance Facility

The Vehicle Maintenance Facility is divided into 2 adjoining sections, comprised of a working garage and vehicle barn, and services the entire Public Works and Water/Sewer Department fleet. The facility maintains regular working hours of 7:30 AM to 3:30 PM, Monday through Friday. During emergency operations, the facility is operating 24 hours per day.

The garage is where vehicles are repaired and serviced. In the garage there is a designated area for the storage of oil drums, solvents, and antifreeze. Likewise, used motor oil and anti-freeze is collected and stored in a designated area within the garage.

The vehicle barn is primarily for equipment storage and parking vehicles at the end of the workday.

Recycling Center

The Recycling Center is approximately 32,000 square feet and sits on a paved bituminous surface. The area is enclosed by an 8' high fence. The Center is in its infantile stages, having been formalized January 2003. Plans are being discussed to develop the site in order to address the needs of the community it serves and ensure compliance with Storm Water Phase II and other regulatory requirements.

The Center accepts only municipal solid waste and recyclable material from private residents of the community and stores less than 30 tons per day at the site. No commercial waste is collected, stored or processed at this Center. The Center accepts material for recycling, (i.e. cardboard, paper and commingle) wood waste, scrap metal, tires, electronics and bulky waste. There is also a *Do-It-Yourself* Used Oil Recycling Program and anti-freeze drop off service managed at the Center as well as a collection site for fluorescent light bulbs. Yard waste is also received at the Recycling Center.

Fuel Distribution Depot

There are two underground storage tanks, with associated pumps, that service the Public Works, School Department, Portsmouth Housing Authority, Police, Fire, and Water and Sewer Department vehicles. The facility receives product via private tanker trucks chosen through an annual bid process. This facility is permitted by the New Hampshire DES Waste Management Division (Facility Identification Number 0113665.) At this time no Stage II Vapor recovery is required under existing rules.

Salt Storage Shed

The salt storage shed is an independent structure located behind the Public Works facility and next to the Fuel Distribution Depot and Recycling Center. The structure was built during the winter year 2000 with completion in May 2001. Its approximate capacity is 500 tons. During the winter season, the City may go through 4,000 plus tons of salt.

Materials Storage

Materials, such as loam, gravel sand and spoils pile, and inventory, such as hydrants, pipes, valves, catch basin components are stored on the far end of the salt shed. The inventory consists of large pieces and therefore, while there is exposure to storm water, contamination of the run off is minimal to none.

5 – SITE DRAINAGE PATTERNS

Precipitation in calendar year 2008 was 63.07”.

Drainage Map

Appendix A “Drainage Plan Portsmouth Public Works Facility” depicts the Facility and drainage patterns.

Drainage Pattern for Fuel Distribution Depot (D-01)

The Fuel Distribution Depot is protected from storm water by a canopy. The area is located to the east of the Recycling Center and to the north of the Salt Shed. Storm water sheet flows to the north across a bituminous surface and then travels to the west down the Public Works access road. Eventually sheet flows off site into an old gravel pit to the west of the Public Works Facility. During times of heavy run-off storm water that does not soak into the gravel eventually makes its way through a series of ponds and into the headwaters of the Sagamore Creek.

Drainage Pattern for Recycling Center (D-02)

Storm water run-off from the Recycling Center sheet flows to the north and west exiting the site into an old gravel pit located to the west of the Public Works Facility.

Drainage Pattern for Vehicle Maintenance Facility (D-03)

The area directly to the south and behind the Vehicle Maintenance Facility is a paved bituminous surface that allows storm water to sheet flow to the south and away from the building. Storm water currently sheet flows into a grassy area and then off site.

Drainage Pattern for the Employee Parking Lot (D-04)

Employees park in the northeast corner of the Public Works Facility. This is a paved area with a closed drainage system bound by slope granite curb. Storm water is collected in the system by catch basins and conveyed to two different locations. One basin leads to an outfall to the north of the Facility crosses under Peverly Hill Road where it sheet flows down an embankment and across a grassy area. Through a series of connecting catch basins, it is carried to a detention pond. The other leads to the west, down Peverly Hill Road to a grassy area. At the opposite end of the grassy area, its picked up by another catch basin and carried into a detention pond. Ultimately, both detention ponds connect to the Sagamore Creek.

Stormwater Run-On

There is one location of run-on of stormwater from adjacent properties. The run-on is minor; a small portion on the South-west boundary of the property, behind the vehicle maintenance facility and material storage via swale. A swale runs parallel to the property line for approximately 150’, crosses over the Public Works facility property line and connects less than 15’ to a pipe/culvert. (numbered 7749).

6 - RECEIVING WATERS, WETLANDS AND IMPAIRED WATERS

In New Hampshire, water quality standards are used to protect the state's surface waters. Standards consist of three parts:

1. Designated uses, such as fishing or swimming;
2. Numerical or narrative criteria to protect the designated uses; and
3. An anti-degradation policy, which maintains existing high quality water that exceeds the criteria. Criteria are established by statute (<http://www.gencourt.state.nh.us/rsa/html/L/485-A/485-A-8.htm>) and by administrative rules (http://www.des.state.nh.us/rules/desadmin_list.htm).

Stormwater from the Public Works Facility / Recycling Center does not directly discharge into a receiving waterbody. It discharges through catch basins, stormwater detention ponds, grassy areas; ultimately discharging to Sagamore Creek, which discharges to Little Harbor.

Sagamore Creek (NHRIV600031001-03) is classified as Class B. It is impaired for pH and E. coli,. However, as of 2009, no TMDL has been determined for this waterbody. Therefore the Public Works Facility does not have a WLA ascribed. Stormwater exposure to E. coli and pH is minimal at the Public Works Facility / Recycling Center.

The Sagamore Creek is connected and flows into Little Harbor. A TMDL for bacteria has been established for Little Harbor.

7 - SUMMARY OF AVAILABLE STORM WATER SAMPLING DATA

All sampling data is maintained at the facility and retained for a period of three (3) years. Cross reference section 10 Record Keeping & Recording.

Sampling data was not collected during the previous permit term. Sampling is scheduled in accord with the 2008 Permit term. See section 11.

8 – POTENTIAL STORM WATER CONTAMINANTS

This section identifies significant materials located at the Public Works facility that may potentially contaminate storm water.

Potential Areas for Storm Water Contamination

The following potential source areas of storm water contamination were identified and evaluated:

Vehicle Maintenance Facility: All work relative to this area is performed under cover and as such there is no impact to storm water runoff. Vehicle overflow of parking or storage from the vehicle barn is temporarily located behind the Vehicle Maintenance facility. Automotive fluids are necessary for the operation of the vehicles. As such,

there is limited potential for certain automotive fluids to be leaked and exposed to storm water. Similarly, automotive fluids from the employee parking lot may also effect storm water run-off. The employee parking lot is located in front of the garage.

Recycling Center: As previously described, recyclables, bulky waste, scrap metal, scrap wood, and yard waste are accepted at the Center. BMPs such as collecting waste material in enclosed containers, in roll-off containers (to keep the solids off the ground) and berming the yard waste pile are already in place. The used-oil collection container is double walled. However, metals and yard waste present potential contaminants. Best management practices in place will continually be reviewed and improved upon to mitigate contamination.

Fuel Distribution Depot: The Fuel Distribution Depot is protected from storm water by a canopy. However, gasoline or diesel from overfills can potentially contaminate storm water from this area. The tanks are equipped with ball floats and overflow shutoff valves as well as overspill containment devices to mitigate potential pollution. Spill kits are on site to clean up accidental over-fueling of vehicles. The adjacent area has a paved bituminous surface as well as a concrete pad.

Materials Storage: Various piles of aggregate, street sweepings, catch basin cleanings, and loam are stockpiled and may be exposed to storm water. The resulting storm water may have suspended solids. Best management practices are in place to mitigate contamination.

Salt Storage: There is a salt storage shed on the Facility, noted on the map, Appendix A, in drainage area D-03. Salt delivered from a private hauler dumps the salt material directly into the salt shed. The stock pile of salt is not exposed directly to rain or snow fall. Track-out of salt may occur. BMPs are incorporated to minimize stormwater pollution. (See section 9.) The salt shed is a part of the routine visual inspection.

a. SIGNIFICANT MATERIAL INVENTORY

Listed below is a summary of products, which have potential to contaminate storm water runoff.

Table 1 - Significant Material Inventory

Trade Name Material	Chemical/Physical Description	Storm Water Pollutant
Lubricants	Black/brown oily liquid	Oil and grease
Hydraulic fluids	Brown oily hydrocarbon	Mineral oil
Brake fluid	Ethylene glycol-based liquid	Ethylene glycol
Transmission fluid	Red liquid	Mineral oil, glycol, heavy metals, petroleum distillates

Gasoline	Colorless, pale brown or pink Petroleum hydrocarbon	Benzene, ethyl benzene, toluene, xylene, MBTE
Motor oil	Clear, amber liquid petroleum hydrocarbon	Mineral oil, petroleum distillates

Table 1 - Significant Material Inventory (continued)

Trade Name Material	Chemical/Physical Description	Storm Water Pollutant
Diesel fuel	Clear, blue-green to yellow liquid	Petroleum distillate, oil & grease, naphthalene, xylene
Antifreeze/coolant	Clear green/yellow liquid	Ethylene glycol, propylene glycol heavy metals (copper, lead, zinc)
Windshield washer	Clear blue liquid	Ammonia, methanol
Vehicle wash waste water	Water	Oil & grease, solids
Battery Acid	White Translucent liquid or gel	Sulfuric Acid
Lead acid batteries	Clear, slightly yellow liquid	Sulfuric acid and lead sulfate
Rust	Reddish solid	Iron oxides
Loam / Yard Waste		Suspended solid and high BOD
Sand		Suspended solid
Miscellaneous paint		

Table 2 - Locations of Potential Sources of Storm Water Contamination

Drainage Area	Potential Stormwater Contamination Point	Potential Pollutant	Potential Problem
D-01	Fuel Distribution Depot	Automobile Fluids	Leaking fluids from vehicles; over spills from fueling operations; ruptured tank..
D-02	Recycling Center	Metals Suspended Solids Oil Anti-Freeze Mercury Yard Waste	Leachate from containers; run-off from waste piles.

**Table 2 - Locations of Potential Sources of Storm Water Contamination
(continued)**

D-03	Vehicle Maintenance Facility	Oil Product Used Oil Parts Cleaner Anti-Freeze General Automobile Fluids Suspended Solids in vehicle wash water	Leaking from vehicles during maintenance operations. Ruptured primary or secondary containment. Overfill of clogged floor drains.
D-03	Salt Storage Shed	Salt	Salt improperly loaded, overfill on DPW vehicles accumulating at entrance of salt shed.
D-03	Materials Storage	Suspended Solids	Loam, gravel, street sweepings run-off during heavy storms.
D-04	Employee Parking Lot	Automobile Fluids	Leaking fluids from employee vehicles in the parking area.

The facility's Spill Prevention Control and Countermeasure (SPCC) Plan provides details on the oil storage capacity of the used motor oil container, the inside oil storage tank and storage room, and the gasoline and diesel storage. Further, the SPCC details the potential of the spill volume, the spill directions and rates. To avoid duplication and potential conflict of information, the SPCC is herein cross-referenced.

b. HISTORIC SPILL and LEAK RECORD

There is no known past spill history associated with this facility. Cross reference is made to the SPCC which details criteria of a spill and the response efforts.

c. NON-STORM WATER DISCHARGES

The Portsmouth Public Works Facility was constructed in 1999 modifying an existing contractor maintenance facility and adding a two-story office complex. All modifications to date have attempted to minimize storm water impacts to receiving waters and catchment areas. The following activities are allowable non-storm water discharges:

- Water from landscape/irrigation systems. Discharge from this system flows into the employee parking lot (D-04).
- Any ground water collected from the drainage system and discharged to the main outfall located east of the facility and across Peverly Hill Road.

9 – STORM WATER BMPs / CONTROL MEASURES

The following best management practices (BMPs), structural and non-structural, are in place to address the above identified potential and existing sources of stormwater contamination and achieve non-numeric effluent limits.

Good House Keeping

Drainage Area	BMP
D-01 D-03 D-04	Street sweeping is performed at the Public Works Facility on a quarterly basis, with specific attention given to the employee parking lot, the fuel depot and in front of the salt shed.
D-01 D-02 D-03	Catch basins inspected and cleaned when necessary (see also Visual Inspections Table)
D-03	Combustible materials, such as the parts cleaner container, are stored in airtight metal containers.
D-03	Work practices require employees to use drip pans when working on all vehicles in the garage. Any incidental spills/drips are cleaned immediately and removed as required.
D-03	The loam and gravel piles are enclosed in a bin to contain run off of materials and minimize contamination of storm water runoff. The spoils pile is contained on a pervious surface where any potential storm water runoff is contained and percolates into the ground. Therefore, contamination to surface water is minimal.
D-03	An attendant mans the Recycling Center to ensure waste and recyclable material from primarily non-industrial and residential sources is accepted. Materials such as engine parts, which are not part of municipal solid waste, are rejected.
D-03	Litter control performed at the Recycling Center monthly.
D-03	Oil/water separator [in Vehicle Maintenance Facility] to be cleaned semi-annually.
D-02	The cardboard, paper and commingle waste is collected and stored in enclosed containers. Therefore, storm water run off is not contaminated with suspended solids. Roll-off containers are provided for the wood waste, bulky waste and scrap metal. These containers are open top. However, some mitigating factors prevent storm water contamination. Primarily these containers are new and have no holes or leaks. Further, the waste that is collected in these

	<p>containers are large pieces of solid material, i.e. large pieces of lumber or wood pallets, wooden stool, or mattresses, box spring, kitchen sink, etc. Therefore, while there is exposure to storm water, contamination of the run off is minimal to none. Nonetheless, recognizing the Agency concern with aluminum, copper, iron, lead and zinc while the scrap metal container is not being used, it will be covered with a tarp.</p> <p>The roll off container for the tires and electronics is completely enclosed; subsequently there is no contamination of the storm water.</p> <p>As previously noted, yard waste is accepted at the Center. The material is separated and stockpiled into 2 categories, brush and leaves/grass clippings. The piles are enclosed by concrete blocks to contain run off of materials. Approximately 3 times a year the brush pile is chipped and hauled away. Best management practice of berming the wood chip pile with a silt fence or other appropriate means during chipping operations will be coordinated with the wood-chipping contractor.</p>
D-03	Within the designated area, the drums are seated on pallets with secondary spill containment. Drums are located inside, under cover.
D-03	The used motor-oil is stored in a primary containment area and surrounded by a secondary containment unit, which is made of concrete block and coated with a special impervious urethane sealant. To date, no significant spills or leaks occurred from the primary or secondary containment units.

Salt Storage Pile

D-03	Delivery of the salt is from a private hauler, who dumps the salt material directly into the salt shed. Salt is loaded into public works vehicles for de-icing operations directly outside of the salt shed. The stockpile of salt is never exposed directly to rain or snow fall. However track-out of salt may occur and this area will be inspected as part of the Routine Visual Inspections.
------	---

Preventive Maintenance

Drainage Area	BMP
D-02	The used oil container is a steel double walled container with an opening at the top to provide for pouring the oil into. This opening is covered with a lid. Therefore, there is no storm water contamination from this source. There is a spill kit on site and the attendant working at the Center has a dip stick to measure the volume in the container in order to avoid overflow and routine emptying of the container. A certified used oil recycler hauls the oil away. (The contractor is required to work in accord DOT requirements when loading and hauling of this material.)
D-01	The Portsmouth Public Works Fuel Distribution Depot is protected from storm water by a canopy.

D-01	<p>Tank #1 is a 12,000 gallon double walled Sti-p3 steel diesel underground storage tank (UST) with dimensions of 96" x 32'. Tank #2 is a 5,000 gallon double walled Sti-p3 steel gasoline UST with dimensions of 72" x 23'-10". Both tanks are equipped with a Veedor Root liquid dry annular spill sensors connected to a Veedor Root TLS-300C-2 console/reader. The tanks are also equipped with an automatic tank gauge (Model 847390-107) connected to the same reader. The fill pipes are equipped with Pemeco spill containment structures (Model 111) with a five gallon capacity. Overfill protection is achieved through the use of OPW ball floats (Model 53VML-0160) and overfill flow shut-off valves (Model 53VML-0160) giving a 90% volume restriction. All tank monitoring and overfill/spill equipment conform to Env-Ws 411.26 and Env-Ws 411.35. Product is pumped through GASBOY fuel pumps connected to a fleet key GASBOY Terminal key reader. This facility is unmanned and managed through a computer located in the Public Works Dispatch office. Both tanks are reconciled monthly comparing fuel usage with deliveries in conformance with Env-Ws 411.11. Reconciliation records are kept for a minimum of three years in the Engineering Division.</p> <p>When filling vehicles with gasoline or diesel fuel, the automated keys are programmed for the capacity of each vehicle, thereby limiting potential for spill.</p>
D-03	Vehicles receive 3,000 mile check up
D-04	Catch basins in this system have sumps.

Routine [Quarterly] Facility Inspections

Drainage Area	BMP
D-03	Salt shed are to be inspected for track –out of salt.
D-03	Recycling Center to be inspected for litter.
D-03	The oil/water separator to be inspected and cleaned regularly with waste material taken to the Pierce Island Wastewater Treatment Plant. (See also Good Housekeeping)
D-03	The two hydrodynamic separators to be inspected.
D-02 D-03 D-04	Catch basins to be inspected and cleaned when necessary. (See also Good Housekeeping).
D-04	System outfall is inspected quarterly for signs of contamination.

Spill Prevention and Response

Drainage Area	BMP
D-01 D-02 D-03	Spill kits are on site at fuel distribution depot, garage and Recycling Center
	The Public Works Facility has an SPCC Plan.

Erosion and Sedimentation Controls

Drainage Area	BMP
D-01 D-02 D-03 D-04	The majority of the Public Works facility is paved. Historic observations have shown no areas that are prone to erosion.
D-02	A permanent grassy swell will be installed on the west side of the Recycling Center to receive and treat storm water exiting this site.

Employee Training

Drainage Area	BMP
D-01 D-02 D-03	All personnel working at this facility will be trained on the location and use of clean-up materials.

Management of Runoff

Drainage Area	BMP
D-03	Two stormwater separators are installed at the Facility; one at the north-east corner of the property, the other at the south-east corner of the property. The storm separators are designed to remove sediment, oil and grease from the stormwater run-off. Catch basins connected to the storm separator are cleaned 1X/yr.

Vehicle and Equipment Washwater Requirement

Drainage Area	BMP
D-03	To keep contaminants and other pollutants out of the City's water/sewer system there are no floor drains in the garage. To keep contaminants and other pollutants from surface water, policy was established prohibiting washing of vehicles in the garage. At this time, there are no cracks in the garage floor that would allow spills to drain into the ground and effect ground water.
D-03	There are two floor drains in the vehicle barn. One is located on the southeast side; the other is located at the northwest side of the building. The vehicle barn floor is pitched toward these basins. The basins are connected to an oil/water separator, which is connected to the municipal sanitary sewer system. The vehicle barn is the sole designated location where vehicles are permitted to be washed.

10 – RECORD KEEPING AND RECORDING

The Storm Water Pollution Prevention Plan will be maintained at the DPW facility for the duration of the general permit. The Plan will be reviewed annually by the Storm Water Pollution Prevention Team.

All monitoring data per Parts 6.2 and 6.3 of the Industrial MSGP and section 12.4 of this SWPPP, shall be submitted to the EPA using the eNOI system

(www.epa.gov/npdes/eNOI) no later than 30 days after receiving the laboratory results of the monitoring.

If the eNOI cannot be accessed, paper reporting by the same deadline is allowed. Part 7.6.1 of the Industrial MSGP provides mailing addresses.

Documents, including but not limited to, monitoring, inspections, reports, shall be retained for a period of at least 3 years from the date of the permit's expiration or termination.

11 - FACILITY INSPECTION & MONITORING PLAN

11.1 Routine Facility Inspections

Routine facility inspections of all areas where industrial materials or activities are exposed to stormwater and of all stormwater control measures are to be conducted quarterly.

Inspections shall be performed when the facility is operating and at least once during the calendar year, the inspection shall be conducted when a stormwater discharge is occurring.

Inspections shall be conducted by "Qualified Personnel" as defined in the 2008 Industrial MSGP – those who possess the knowledge and skills to assess conditions and activities that could impact stormwater quality at the facility and who can evaluate the effectiveness of the control measures. In addition, at least one member of the SWPPP team shall also participate.

Per Part 4.1 of the 2008 MSGP, the following areas are to be inspected:

Scrap Recycling and Waste Recycling Facility (Sector N): areas where waste is generated, received, stored, treated, or disposed of and that are exposed to precipitation or stormwater run-off. For purposes of this (DPW Facilities Plan) this includes, but is not limited to the Recycling Center and all operations within.

Land Transportation and Warehousing (Sector P): Collocated industrial activity/operations that are exposed to precipitation or stormwater run-off. This includes the Fuel Distribution Depot; the Salt Storage Shed and loading area; the Materials Storage area; the Vehicle Maintenance Facility and storage areas for vehicles/equipment awaiting maintenance.

The form provided in Appendix D shall be used to document the Facility Inspection. Completed Inspection forms shall be maintained, for a minimum of three (3) years, on-site with this SWPPP.

11.2 Quarterly Visual Assessment

Quarterly visual assessments are samples collected, each quarter of the permit term, with the intent of assessing water quality characteristics, such as color, odor, floating solids, oil sheen, foam, etc.. The visual inspection shall be conducted on each of the outfalls at the Facility and is intended to be representative of stormwater discharge.

The form provided in Appendix E shall be used to document the Visual Assessment. Completed forms shall be maintained, for a minimum of three (3) years, on-site with this SWPPP.

11.3 Comprehensive Site Inspection

Comprehensive Site Inspections shall be conducted annually beginning with the period authorization to discharge is granted under the Permit (i.e. one year: September 29, 2008 – September 29, 2009). The inspection shall cover all areas of the Facility as described in this SWPPP as having potential pollutant source to precipitation and stormwater run-off. This includes the Recycling Center and all operations within; the Fuel Distribution Depot; the Salt Storage Shed and loading area; the Materials Storage area; the Vehicle Maintenance Facility and storage areas for vehicles/equipment awaiting maintenance.

The inspection shall include a review of monitoring data collected (the routine and visual inspection records) as well as impaired waters monitoring as per Section 11.4 of this SWPPP (Cross reference Part 6.2 of the 2008 MSGP.)

11.4 Required Monitoring

The 2008 MSGP includes five (5) types of required analytical monitoring.

a) Quarterly benchmark monitoring

Table 8.N-1 of the Permit exempts source separated recycling from quarterly bench mark monitoring.

b) Annual effluent limitations guidelines monitoring.

There are no effluent limitations guidelines for Scrap Metal Waste Recycling, Sector N, or Land Transportation and Warehousing, Sector P, covered under the MSGP 2008.

c) State or Tribal specific monitoring.

There are no additional State of Tribal monitoring provisions for Scrap Metal Waste Recycling, Sector N, or Land Transportation and Warehousing, Sector P, covered under the MSGP 2008.

d) Impaired waters monitoring

The Department of Public Works Facility, through a series of catch basins, stormwater detention ponds, grassy areas, ultimately discharges to the Sagamore Creek (Waterbody Id NHRIV600031001-03). There is no TMDL yet established for the Sagamore Creek. However the Sagamore Creek is listed on the 303(d) list for these impairments and the facility has potential to discharge them. The listed impairments are pH and Escherichia coli. Although a TMDL has not been established, monitoring shall be conducted once per year at each outfall discharging stormwater into the Sagamore Creek. Monitoring shall begin the firstfull quarter following April 1, 2009 or the date of discharge authorization, whichever comes later.

If the pollutant(s) for Sagamore Creek's impairment is not detected above natural background levels after the first year, pollutant monitoring is not required. Proper documentation justifying this shall be written and maintained.

Exceedances of the discharge standards will require this SWPPP to be re-evaluated to determine if concentrations can be reduced through implementing additional BMPs.

e) Other monitoring as required by EPA

There are no additional State of Tribal monitoring provisions for Scrap Metal Waste Recycling, Sector N, or Land Transportation and Warehousing, Sector P, covered under the MSGP 2008.

12 – REVIEW OF DATA

The SWPPP is a “living” document and is required to be updated and/or modified as necessary. The SWPPP shall be reviewed and modified when:

- An authorized release or discharge (i.e. spill or leak) occurs at the facility.
- A discharge violates a numeric effluent limit.
- The Operator becomes aware, or EPA determines, that control measures are not stringent enough for the discharge to meet applicable water quality standards.
- An inspection or evaluation of the facility by EPA, or the State, determines that modifications to the control measures are necessary to meet the non-numeric effluent limits in the permit.
- The Operator determines in the routine facility inspection, quarterly visual assessment or comprehensive site inspection that control measures are not being properly operated and maintained.

13 – ANNUAL REPORT

An Annual Report shall be submitted to the EPA. The EPA provides and strongly recommends using the form provided in the September 29, 2008 Industrial MSGP Appendix I and duplicated in this SWPPP in Appendix F.

14 - TRAINING

The employee training program will be updated and modified to include education regarding storm water pollution prevention regulations and initiatives taken by this facility. The training will discuss the components of the written plan as well as BMPs and procedures to be performed in accord with NPDES Storm Water Phase II requirements. Hands-on training will include spill prevention and response, good housekeeping, proper material handling, proper storage, washing, and inspection procedures.

15 – ENDANGERED SPECIES

Appendix B contains copies of letters to the U.S. Fish & Wildlife Service, New Hampshire Fish and Game, and NHHI-DRED documenting the request to evaluate this facility for the presence of endangered species or critical habitat. Response letters are also included.




The United States Department of the Interior Fish and Wildlife Service indicates there are no federally listed or proposed, threatened, or endangered species under the jurisdiction of the U.S. Fish and Game Service in the facility area. However, there are species identified by the State or other local authorities as endangered and threatened species in proximity to the site:

- ♦ Plant Species: Salt-Marsh Gerardia (*Agalinis maritima*). This species is listed on the State of NH Heritage list but not listed on the Federal list.
- ♦ Natural Community: Gulf of Maine Salt Marsh. This natural community is not listed on the State of NH Endangered or threatened species list nor is it listed on the Federal list. However, it is considered to be rare enough to be tracked by the NH Heritage Inventory.

16 – HISTORIC PLACES

Appendix C is a letter to the New Hampshire Division of Historical Resources documenting the request to evaluate this facility for the possibility the site is a national historic site. In summary, the Historical Resources confirmed the facility will have no adverse effect on historic properties or districts near the area.

- ### Legend
- DPW Parcel
 - DPW Drainage Area
 - Building
 - Drainage Path
 - Continuing Pipe
 - Catchbasin
 - Drain Manhole
 - Outfall/Culvert End
 - Flow Path (overland or still water)
 - Pipe/Culvert
 - Swale/Stream
 - Drainage Downstream from DPW
 - 10' Contour
 - 2' Contour
 - Intermittent Stream
 - Shoreline
 - Open Water
 - Wetland
 - Curbs, Sidewalks, etc.
 - Fences, Gates, etc.

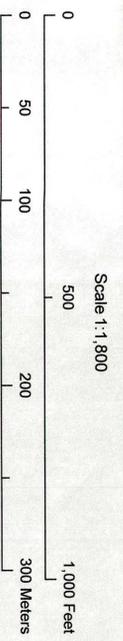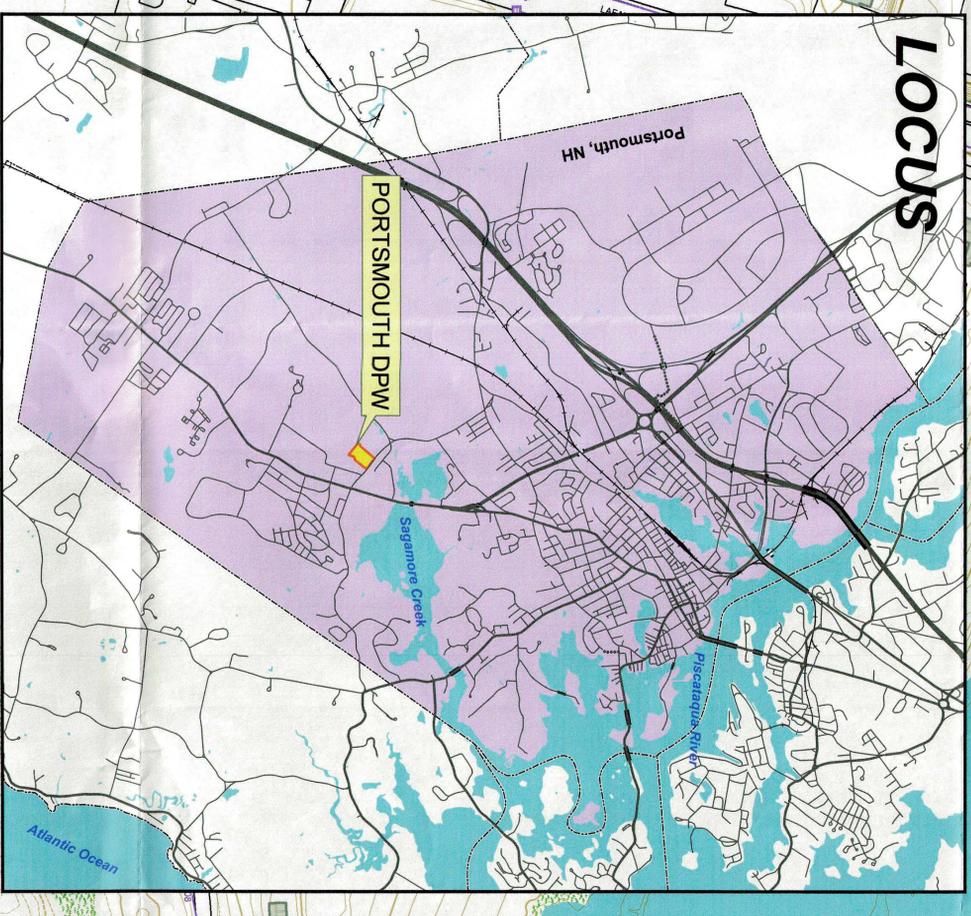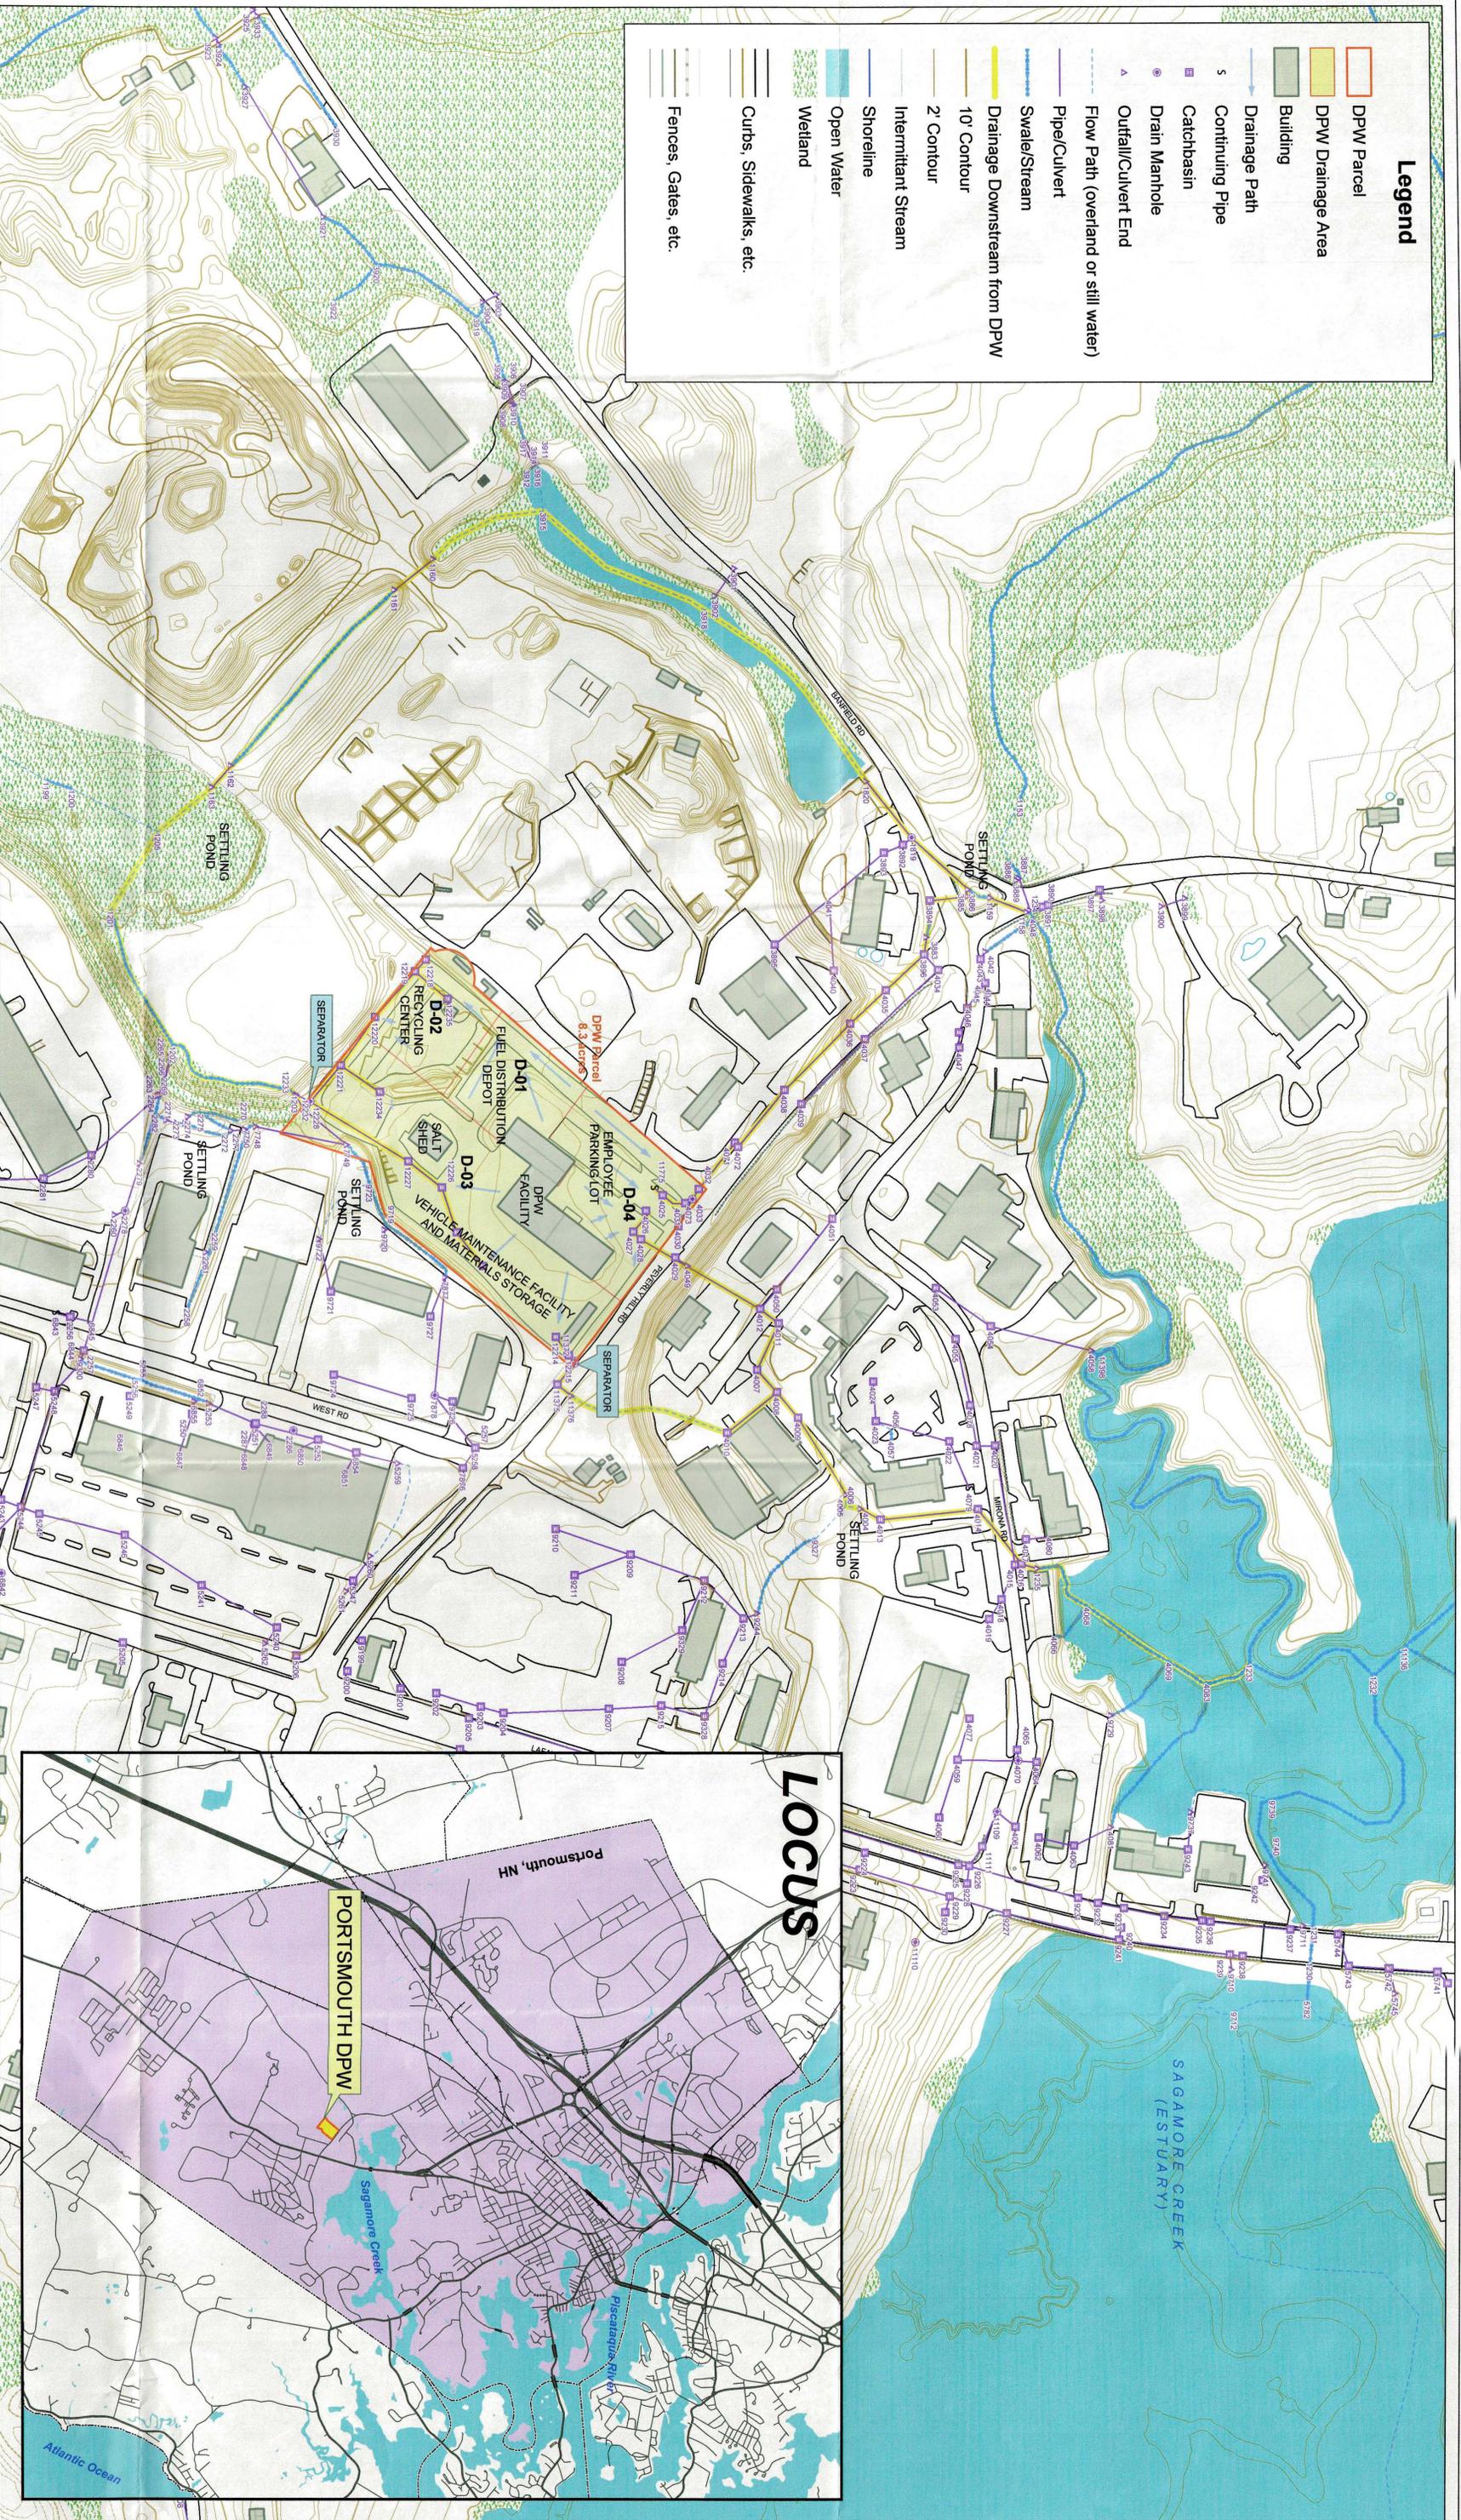

Drainage from Public Works Building Portsmouth, New Hampshire

Map prepared by Portsmouth Department of Public Works, 18 December 2009
Map document: U:\Projects\0173 Stormwater\02\08\DWES_DPW_02.mxd

APPENDIX B

Letters to and from Regulatory Authorities regarding
Endangered Species and Critical Habitat



United States Department of the Interior



FISH AND WILDLIFE SERVICE
New England Field Office
70 Commercial Street, Suite 300
Concord, New Hampshire 03301-5087

September 13, 2005

Reference: Project Location
NOI, NPDES stormwater discharge Portsmouth, NH

Silke Psula
Public Works Department
680 Peverly Hill Road
Portsmouth, NH 03801

Dear Ms. Psula:

This responds to your recent correspondence requesting information on the presence of federally-listed and/or proposed endangered or threatened species in relation to the proposed activity(ies) referenced above.

Based on information currently available to us, no federally-listed or proposed, threatened or endangered species or critical habitat under the jurisdiction of the U.S. Fish and Wildlife Service are known to occur in the project area(s). Preparation of a Biological Assessment or further consultation with us under Section 7 of the Endangered Species Act is not required.

This concludes our review of listed species and critical habitat in the project location(s) and environs referenced above. No further Endangered Species Act coordination of this type is necessary for a period of one year from the date of this letter, unless additional information on listed or proposed species becomes available.

Thank you for your coordination. Please contact us at 603-223-2541 if we can be of further assistance.

Sincerely yours,

Michael J. Amaral
Endangered Species Specialist
New England Field Office



PUBLIC WORKS DEPARTMENT

CITY OF PORTSMOUTH

680 Peverly Hill Road
Portsmouth N.H. 03801
(603) 427-1530 FAX (603) 427-1539

August 10 2005

Phil Morrison
US Fish and Wildlife Service
70 Commercial Street, Suite 300
Concord, New Hampshire 03301

Re: National Pollutant Discharge Elimination System Phase II

Dear Mr. Morrison,

The City of Portsmouth is updating its Notice of Intent (NOI) per the EPA-National Pollutant Elimination Discharge System Phase II regulations. Under the current rules, the City must determine if storm water discharges may adversely impact listed endangered or threatened species, any critical habitats *and* essential fish habitat. The City had previously requested your assistance in identifying listed endangered or threatened species and any critical habitats, but omitted essential fish habitat.

On February 21, 2003, your department provided the requested information. **We are now requesting your assistance in making a determination of potential impacts to essential fish habitat.** To avoid duplication of work a copy of your response is enclosed.

The City has the following regulated facilities:

Department of Public Works, 680 Peverly Hill Rd
Pease Tradeport Wastewater Treatment Facility, Pease Tradeport
Pierce Island Wastewater Treatment Facility, Pierce Island

Further, the City has identified specific bodies of water that have outfalls for storm water. **We request your assistance in making a determination of potential impacts to listed endangered or threatened species, any critical habitats and essential fish habitat for the following water bodies.**

Lower Piscataqua River
Sagamore Creek
North Mill Pond
South Mill Pond
Pickering Brook
Little Harbor
Hodgsons Brook
Lower Newfield Brook/Upper Hodgson Brook
Lower Grafton



United States Department of the Interior



FISH AND WILDLIFE SERVICE
New England Field Office
70 Commercial Street, Suite 300
Concord, New Hampshire 03301-5087

RE: Storm Water Pollution Prevention Plan
Portsmouth, New Hampshire

February 21, 2003

Tom Richter
City of Portsmouth Public Works Department
680 Peverly Hill Road
Portsmouth, NH 03801

Dear Mr. Richter:

This responds to your January 22, 2003 letter requesting information on the presence of federally-listed and proposed, endangered or threatened species in relation your Storm Water Pollution Prevention Plan for Portsmouth New Hampshire. Our comments are provided in accordance with Section 7 of the Endangered Species Act (ESA) of 1973, as amended (16 U.S.C. 1531-1543).

Based on information currently available to us, no federally-listed or proposed, threatened or endangered species under the jurisdiction of the U.S. Fish and Wildlife Service are known to occur in the project area, with the exception of occasional transient bald eagles (*Haliaeetus leucocephalus*). Preparation of a Biological Assessment or further consultation with us under Section 7 of the Endangered Species Act is not required. Should additional information on listed or proposed species becomes available, this determination may be reconsidered.

Thank you for your cooperation. Please contact me at 603-223-2541 if we can be of further assistance.

Sincerely yours,

Andrew Major
Wildlife Biologist
New England Field Office

Memo



NH Natural Heritage Bureau

To: Silke Psula, City of Portsmouth
Public Works Department
680 Peverly Hill Road
Portsmouth NH 03801

From: Heather Herrmann, NH Natural Heritage

Date: 8/16/2005

Re: Review by NH Natural Heritage Bureau of request dated 8/10/2005
NHB File ID: 5114
Project type: NPDES update

Town: Portsmouth
Location: Dept Public Works, 680 Peverly Hill Rd

I have searched our database for records of rare species and exemplary natural communities near the area identified in your request, with the following results. A species not listed by the state or the federal government as Threatened (T) or Endangered (E) has either been identified as a species of special concern in NH (W), or is rare enough in the state to be tracked by NH Heritage even though it has not yet been added to the official state list. An asterisk (*) indicates that the most recent report for that occurrence was more than 20 years ago.

Natural Community	State	Federal	Notes
High salt marsh	--	--	Threats to these communities are primarily alterations to the hydrology of the wetland (such as ditching or tidal restrictions that might affect the sheet flow of tidal waters across the intertidal flat) and increased input of nutrients and pollutants in
Plant species	State	Federal	Notes
Dwarf Glasswort (<i>Salicornia bigelovii</i>)	E	--	Threats are primarily alterations to the hydrology of the wetland, such as ditching or tidal restrictions that might affect the sheet flow of tidal waters across the intertidal flat, activities that eliminate plants, and increased input of nutrients and pollutants in storm runoff.
Salt-marsh Gerardia (<i>Agalinis maritima</i>)	T	--	A wildflower that grows in very shallow, briefly flooded forb pannes in the high salt marsh. Threats are primarily alterations to the hydrology of the wetland (such as ditching or tidal restrictions that might affect the sheet flow of tidal waters across the intertidal flat), activities that eliminate plants, and increased input of nutrients and pollutants in storm runoff.

A negative result (no record in our database) does not mean that a sensitive species is not present. Our data can only tell you of known occurrences, based on information gathered by qualified biologists and reported to our office. However, many areas have never been surveyed, or have only been surveyed for certain species. For some purposes, including legal requirements for state wetland permits, the fact that no species of concern are known to be present is sufficient. However, an on-site survey would provide better information on what species and communities are indeed present.


NHB: 5114



NH Natural Heritage Bureau

Known locations of rare species and exemplary natural communities

Note: Mapped locations are not always exact. Occurrences that are not in the vicinity of the project are not shown.

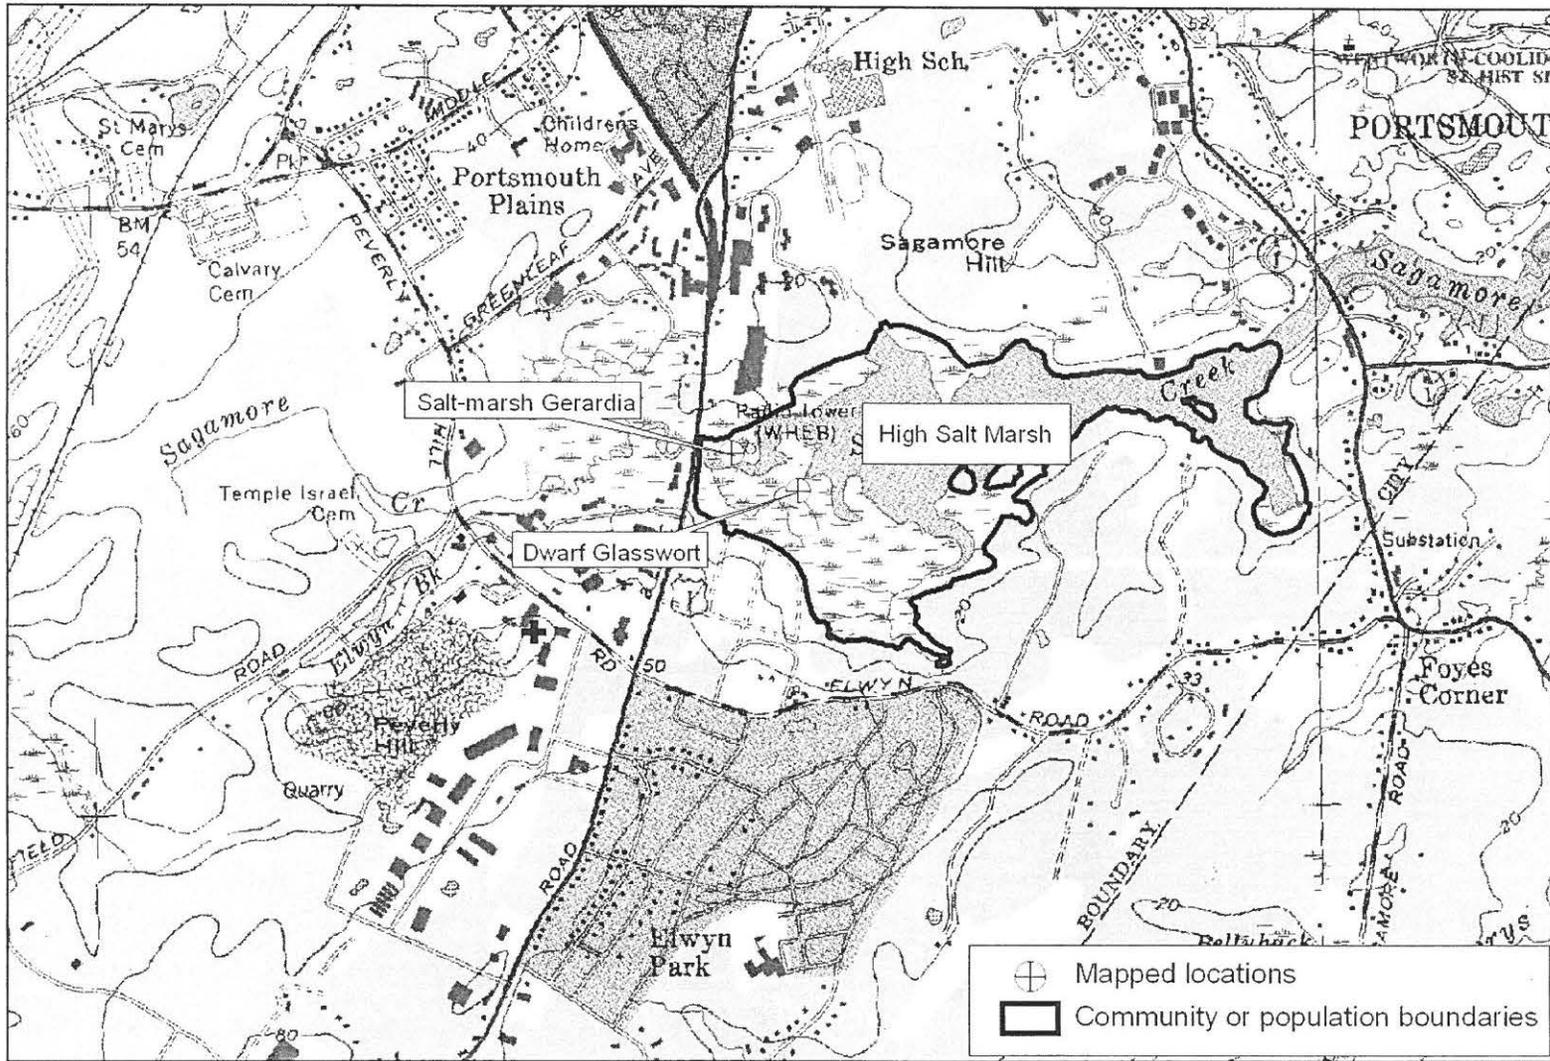

0.25 0 0.25 0.5 0.75 1 Miles

*Historical record

New Hampshire Natural Heritage Bureau - Community Record

High salt marsh

Legal Status

Federal: Not listed
State: Not listed

Conservation Status

Global: Not ranked (need more information)
State: Rare or uncommon

Description at this Location

Conservation Rank: Good quality, condition and lanscape context ('B' on a scale of A-D).
Comments on Rank:

Detailed Description: 1997: Dominated by the perennial grass *Spartina patens* (salt-meadow cord-grass). Covered more area than the low salt marsh. This zone had the highest species richness within the high marsh and included *Solidago sempervirens* (seaside goldenrod), *Festuca rubra* (red fescue), *Hierochloe odorata* (sweet grass), *Elytrigia repens* (quack-grass), *Ligusticum scoticum* (Scotch lovage), *Panicum virg atum* (switch-grass), *Aster novi-belgii* (New York aster), *Teucrium canadensis* (germander), *Sanguisorba canadensis* (Canadian burnet), *Spartina pectinata* (fresh-water cord-grass), *Carex hormathodes* (necklace sedge), and *Juncus arcticus* var. *littoralis* (shore rush). *Distichlis spicata* mixed with *S. patens*, growing at similar elevations on the high marsh or dominated in of the wetter, more poorly drained areas with *Triglochin maritimum* (arrow-grass). Some of these *Triglochin* (forb) pannes supported large numbers of the rare plants *Agalinis maritima* (salt-marsh gerardia) and *Salicornia bigelovii* (dwarf glasswort). *Spartina alterniflora* (short form) pannes occurred on less firm peat soils and appeared to be somewhat deeper, often larger, and saturated or flooded for longer periods than forb pannes.

General Area: 1997: Sagamore Creek is a relatively diverse, sizable, and significant estuary supporting good quality estuarine habitat. Three small, fair quality brackish marshes occurred landward of the high salt marsh. Low salt marsh, tidal creek bottoms, a saline/brackish intertidal flat, and an undifferentiated saline/brackish subtidal channel/bay bottom occur toward the channel. A population of *Puccinellia paupercula* var. *alaskana* (Alaskan goose-grass) was found on the cobbly shore of one of two "salt marsh islands" in the estuary. These islands were covered by hemlock-beech-oak-pine forest. Moderate residential and commercial development occurs particularly around the western lobe where Route 1 crosses the estuary. Estuarine tidal flow was evaluated as adequate for the salt marsh west of Route 1 and unaffected for the remainder of the marsh (USDA Soil Conservation Service 1994).

Location

Survey Site Name: Sagamore Creek
Conservation Land:

County: Rockingham	USGS quad(s): Portsmouth (4307017)
Town(s): Portsmouth	Lat, Long: 430259N, 0704537W
Size: 169.5 acres	Elevation: 4 feet

Precision: Within (but not necessarily restricted to) the area indicated on the map.

Directions: Park at Urban Forestry Center on Elwyn Road.

Dates documented

First observation: 1997-06-18

Last observation: 1997-06-18

Nichols, Bill. 1997. Field survey to Sagamore Creek on June 18.

Nichols, William F. 2000. Ecological Assessment of Selected Towns in New Hampshire's Coastal Zone. Prepared by NH Natural Heritage Inventory. Concord, NH.

New Hampshire Natural Heritage Bureau - Plant Record

Dwarf Glasswort*Salicornia bigelovii***Legal Status**

Federal: Not listed
 State: Listed Endangered

Conservation Status

Global: Demonstrably widespread, abundant, and secure
 State: Critically imperiled due to rarity or vulnerability

Description at this Location

Conservation Rank: Good quality, condition and lanscape context ('B' on a scale of A-D).

Comments on Rank:

Detailed Description: 1997: More than 3,000 plants on north shore, and 200-400 on the south shore. 1983: (North of Urban Forestry Center) 20 by 20 foot area. Old (last years) inflorescences with new growth, ca. 2 cm in height, none flowering. Specimen at UNH. 1973: (North shore) ca. 101-1000 plants with seeds dispersing. Specimen S.N. at NHA.

General Area: 1997: Triglochin forb pannes on the high salt marsh. Associated dominants were Triglochin maritimum (arrow-grass), Distichlis spicata (spike-grass), Spartina alterniflora (smooth cord- grass), and S. patens (salt-meadow cord-grass). Salicornia europaea (common glasswort) also present. 1973: 0-10 feet, flat, full sun, wet mud, surrounded by Spartina (cord-grass) species. In salt marsh. Marsh pannes on green.

Comments: This occurrence may have been impacted by 1995/96 Dept. of Transportation bridge replacement project. Several colonies (1983) Coastal Zone Report, Bertrand and Dunlop (1983); F.D. Richardson, NH Water Resources Board (1973).

Location

Survey Site Name: Sagamore Creek
 Conservation Land: Multiple

County: Rockingham
 Town(s): Portsmouth
 Size: 16.2 acres

USGS quad(s): Portsmouth (4307017)
 Lat, Long: 430310N, 0704544W
 Elevation: 10 feet

Precision: Within (but not necessarily restricted to) the area indicated on the map.

Directions: Three known sites: (1) Rte 1 and Sagamore Creek, south of Sagamore Creek and east of Rte 1. Wet panne about 30 yards from Rte 1 between 2 telephone poles. Just above State of NH Urban Forestry Center; (2) north shore of Sagamore Creek on either side of small tributary, southwest of Sagamore Hill; (3) south shore of Sagamore Creek ca. 0.5 miles ESE of Rte 1 bridge.

Dates documented

First observation: 1973
 Last observation: 1997-06-18

Straus, C. 1983. Field survey to Portsmouth, Sagamore Creek for *Salicornia bigelovii*, on October 12.

Nichols, William F. 2000. Ecological Assessment of Selected Towns in New Hampshire's Coastal Zone. Prepared by NH Natural Heritage Inventory. Concord, NH.

New Hampshire Natural Heritage Bureau - Plant Record

Salt-marsh Gerardia*Agalinis maritima***Legal Status**

Federal: Not listed
 State: Listed Threatened

Conservation Status

Global: Demonstrably widespread, abundant, and secure
 State: Imperiled due to rarity or vulnerability

Description at this Location

Conservation Rank: Good quality, condition and lanscape context ('B' on a scale of A-D).

Comments on Rank:

Detailed Description: 1997: Over 1,000 plants estimated in the area. 1982: Dunlop and Bertrand specimen at NHA. 50+ plants scattered in wet pannes with *Spartina patens* (salt-meadow cord-grass). All flowering plants. 1961: Harris specimen in NEBC.

General Area: 1997: Triglochin (forb) pannes were very shallow, briefly flooded, moderately vegetated depressions typically dominated by Triglochin maritimum (arrow grass). Other common species included spike-grass, salt marsh rush, salt-meadow cord-grass, and smooth cord-grass (short form). Less frequent species were *Plantago maritima* (salt marsh plantain), *Limonium carolinianum* (sea lavender), *Atriplex hastata* (halberd-leaved orach), *Glaux maritima* (sea milkwort), *Puccinellia maritima* (seaside alkali-grass), and silver-weed. Forb pannes also provided habitat for *Salicornia bigelovii* (Bigelow's glasswort) and the state-endangered *Pluchea odorata* (marsh-fleabane). 1982: 0-10 feet, flat, full sun, damp woods, disturbed soil and saltmarsh.

Comments: 1997: Sections of marsh to west need to be surveyed. 1982: This occurrence may have been impacted by 1995/96 Department of Transportation bridge replacement project. Plants easy to find on right date.

Location

Survey Site Name: Sagamore Creek

Conservation Land: Sagamore Creek Land. Town of Portsmouth (FO)

County: Rockingham

USGS quad(s): Portsmouth (4307017)

Town(s): Portsmouth

Lat, Long: 430310N, 0704556W

Size: 4.7 acres

Elevation: 10 feet

Precision: Within (but not necessarily restricted to) the area indicated on the map.

Directions: Intersection of Sagamore Creek and Rte 1A. North edge of creek, east of Rte 1.

Dates documented

First observation: 1961

Last observation: 1997-06-18

Nichols, Bill. 1997. Field survey to Sagamore Creek on June 18.

Dunlop D.T., G.E. Crow & T.J. Bertrand. 1983. Coastal Endangered Plant Inventory: A Report on the Seabrook Dunes, its Vegetation and Flora. University of New Hampshire, Durham, N.H. 34 pp.



PUBLIC WORKS DEPARTMENT

CITY OF PORTSMOUTH

680 Peverly Hill Road

Portsmouth N.H. 03801

(603) 427-1530 FAX (603) 427-1539

January 22, 2003

US Fish and Wildlife Service
70 Commercial Street
Suite 300
Concord, NH 03301
Attn: Phil Morrison

Dear Mr. Morrison:

The City of Portsmouth is currently preparing its Storm Water Pollution Prevention Plan as required under EPA-National Pollutant Elimination Discharge System Phase II regulations. Under current rules the city must determine if stormwater discharges from our regulated facilities impact listed endangered or threatened species or any critical habitats. The three facilities in question are as follows:

Portsmouth Public Works Facility
680 Peverly Hill Road

Pease Tradeport Wastewater Treatment Facility
Pease Tradeport

Peirce Island Wastewater Treatment Facility
Peirce Island

The City requests your help in making this determination so that we may modify our stormwater management plan to provide maximum protection of the environment. A locus plan is attached to assist you. If you have any questions regarding this request please call me at 603-766-1412.

Sincerely,

Tom Richter
Engineering Technician



PUBLIC WORKS DEPARTMENT

CITY OF PORTSMOUTH

680 Peverly Hill Road

Portsmouth N.H. 03801

(603) 427-1530 FAX (603) 427-1539

August 10 2005

Sara Cairns
NH Natural Heritage Inventory
1726 Pembroke Road
P.O. Box 1856
Concord, New Hampshire 03302-1856

Re: National Pollutant Discharge Elimination System Phase II

Dear Ms. Cairns,

The City of Portsmouth is updating its Notice of Intent (NOI) per the EPA-National Pollutant Elimination Discharge System Phase II regulations. Under the current rules, the City must determine if storm water discharges may adversely impact listed endangered or threatened species, any critical habitats *and* essential fish habitat. The City had previously requested your assistance in identifying listed endangered or threatened species and any critical habitats, but omitted essential fish habitat.

On January 23, 2003, your department provided the requested information. **We are now requesting your assistance in making a determination of potential impacts to essential fish habitat.** To avoid duplication of work a copy of your response is enclosed.

The City has the following regulated facilities:

Department of Public Works, 680 Peverly Hill Rd
Pease Tradeport Wastewater Treatment Facility, Pease Tradeport
Pierce Island Wastewater Treatment Facility, Pierce Island

Further, the City has identified specific bodies of water that have outfalls for storm water. **We request your assistance in making a determination of potential impacts to listed endangered or threatened species, any critical habitats and essential fish habitat for the following water bodies.**

- / Lower Piscataqua River
- / Sagamore Creek
- North Mill Pond
- South Mill Pond
- / Pickering Brook
- / Little Harbor
- / Hodgsons Brook
- / Lower Newfield Brook/Upper Hodgson Brook
- / Lower Grafton

Memo



To: Tom Richter, City of Portsmouth
 Public Works Department
 680 Peverly Hill Road
 Portsmouth NH 03801

From: Sara Cairns, NH Natural Heritage Inventory

Date: 1/23/2003

Re: Review by NH Natural Heritage Inventory of request dated 1/22/2003
 NHI File ID: 2043
 Project type: Storm water pollution prevention plan

cc:

Town: Portsmouth
 Location: Portsmouth Public Works Facility, 680 Peverly Hill Road

I have searched our database for records of rare species and exemplary natural communities near the area identified in your request, with the following results. A species not listed by the state or the federal government as Threatened (T) or Endangered (E) has either been identified as a species of special concern in NH (W), or is rare enough in the state to be tracked by NH Heritage even though it has not yet been added to the official state list. An asterisk (*) indicates that the most recent report for that occurrence was more than 20 years ago.

Natural Community
 Gulf of Maine Salt Marsh

State Federal
 - -

Notes
 Threats to these communities are primarily alterations to the hydrology of the wetland (such as ditching or tidal restrictions that might affect the sheet flow of tidal waters across the intertidal flat) and increased input of nutrients and pollutants in

Plant species
 Salt-Marsh Gerardia (*Agalinis maritima*)

State Federal
 T -

Notes
 A wildflower that grows in very shallow, briefly flooded forb pannes in the high salt marsh. Threats are primarily alterations to the hydrology of the wetland (such as ditching or tidal restrictions that might affect the sheet flow of tidal waters across the intertidal flat), activities that eliminate plants, and increased input of nutrients and pollutants in storm runoff.

A negative result (no record in our database) does not mean that a sensitive species is not present. Our data can only tell you of known occurrences, based on information gathered by qualified biologists and reported to our office. However, many areas have never been surveyed, or have only been surveyed for certain species. For some purposes, including legal requirements for state wetland permits, the fact that no species of concern are known to be present is sufficient. However, an on-site survey would provide better information on what species and communities are indeed present.

County: Rockingham
Town(s): Portsmouth
Size:

USGS quad(s): Portsmouth (4307017)
Lat, Long: 430300N, 0704558W
Elevation: 4-5'

Precision: Within (but not necessarily restricted to) the area indicated on the map.

Directions: Park at Urban Forestry Center on Elwyn Road.

Dates documented

First observation: 1997-06-18

Last observation: 1997-06-18

Nichols, Bill. 1997. Field survey to Sagamore Creek on June 18.

Nichols, William F. 2000. Ecological Assessment of Selected Towns in New Hampshire's Coastal Zone. Prepared by NH Natural Heritage Inventory. Concord, NH.

New Hampshire Natural Heritage Inventory - Plant Record

Salt-Marsh Gerardia*Agalinis maritima***Legal Status**

Federal: Not listed
 State: Listed Threatened

Conservation Status

Global: Demonstrably widespread, abundant, and secure
 State: Imperiled due to rarity or vulnerability

Description at this Location

Conservation Rank: Good quality, condition and lanscape context ('B' on a scale of A-D).

Comments on Rank:

Detailed Description: 1997: Over 1,000 plants estimated in the area. 1982: Dunlop and Bertrand specimen at NHA. 50+ plants scattered in wet pannes with *Spartina patens* (salt-meadow cord-grass). All flowering plants. 1961: Harris specimen in NEBC.

General Area: 1997: Triglochin (forb) pannes were very shallow, briefly flooded, moderately vegetated depressions typically dominated by *Triglochin maritimum* (arrow grass). Other common species included spike-grass, salt marsh rush, salt-meadow cord-grass, and smooth cord-grass (short form). Less frequent species were *Plantago maritima* (salt marsh plantain), *Limonium carolinianum* (sea lavender), *Atriplex hastata* (halberd-leaved orach), *Glaux maritima* (sea milkwort), *Puccinellia maritima* (seaside alkali-grass), and silver-weed. Forb pannes also provided habitat for *Salicornia bigelovii* (Bigelow's glasswort) and the state-endangered *Pluchea odorata* (marsh-fleabane). 1982: 0-10 feet, flat, full sun, damp woods, disturbed soil and saltmarsh.

Comments: 1997: Sections of marsh to west need to be surveyed. 1982: This occurrence may have been impacted by 1995/96 Department of Transportation bridge replacement project. Plants easy to find on right date.

Location

Survey Site Name: SAGAMORE CREEK

Conservation Land:

County: Rockingham

USGS quad(s): Portsmouth (4307017)

Town(s): Portsmouth

Lat, Long: 430310N, 0704556W

Size:

Elevation: 10'

Precision: Within (but not necessarily restricted to) the area indicated on the map.

Directions: Intersection of Sagamore Creek and Rte 1A. North edge of creek, east of Rte 1.

Dates documented

First observation: 1961

Last observation: 1997-06-18


Nichols, Bill. 1997. Field survey to Sagamore Creek on June 18.

Nichols, William F. 2000. Ecological Assessment of Selected Towns in New Hampshire's Coastal Zone. Prepared by NH Natural Heritage Inventory. Concord, NH.

NHI: 2043

Known locations of rare species and exemplary natural communities

Note: Mapped locations are not always exact. Occurrences that are not in the vicinity of the project are not shown.

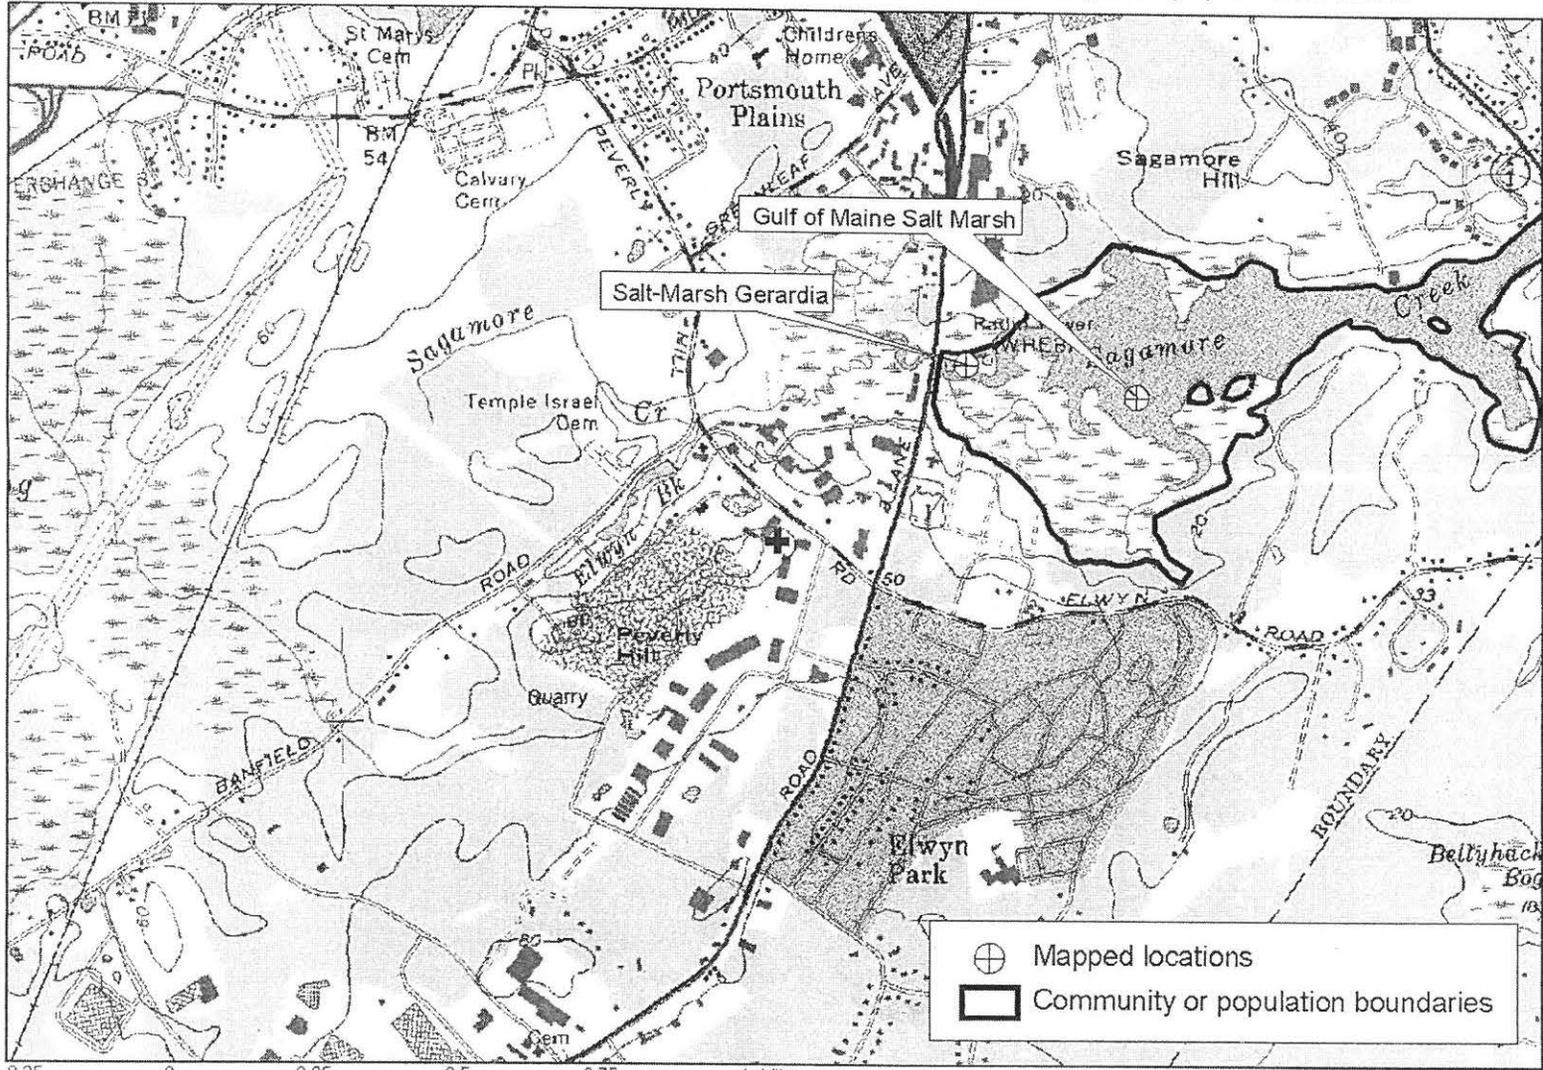

0.25 0 0.25 0.5 0.75 1 Miles

*Historical record

1:18000

23 Jan 2003



Gulf of Maine Salt Marshes

Salt marshes are naturally occurring grasslands found within estuarine intertidal zones along the coast. Together with the estuaries they occur in, they are among the most biologically productive systems on earth and support a vast array of plants and animals, including many species of migratory birds.


Although a wide variety of habitats occur within salt marshes, two major types are the low salt marsh and the high salt marsh. The low salt marsh is flooded and exposed by the tide twice a day. The high salt marsh is at or beyond the reach of most tides but within the reach of spring and storm tides.

High salt marshes are richer in plant species than low salt marshes. Relatively few plant species can tolerate the more stressful environment created by the daily ebb and flow of the tide in the low salt marsh. High salt marsh accounts for more than 90% of the total salt marsh habitat.

The boundary between the high and low salt marsh is often marked by an obvious shift from salt meadow cord-grass that dominates the high marsh, to a much taller species, smooth cord-grass that dominates the low marsh ("low" refers to the height of the land, not of the vegetation). A variety of microhabitats within salt marshes, such as tidal creeks and low, isolated areas called pannes, harbor numerous plants particular to the conditions, and provide food and shelter to a great abundance and variety of animal life. Bird species that are rare or unusual that feed or nest in New Hampshire salt marshes include the American bittern, seaside sparrow, and osprey.

Where Are They Found?

Salt marshes are found along the coast where there is shelter from high-energy ocean wave action, such as in the Great Bay Estuary, the Blackwater-Hampton River Estuary, and the Squamscott River Estuary. They are New England's most abundant natural grasslands.

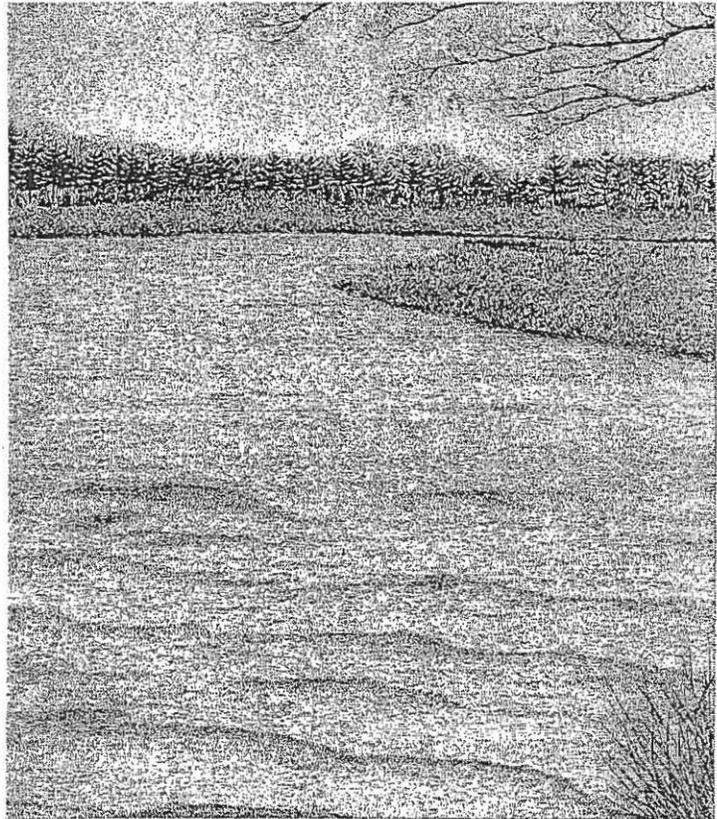

Characteristic and rare* plant species:

High Salt Marsh

large salt marsh aster (*Symphyotrichum tenuifolium*)*
marsh elder (*Iva frutescens* ssp. *oraria*)*
New York aster (*Symphyotrichum novi-belgii*)
prolific knotweed (*Polygonum prolificum*)*
salt marsh rush (*Juncus gerardii*)
salt meadow cord-grass (*Spartina patens*)
seaside gerardia (*Agalinis maritima*)*
seaside goldenrod (*Solidago sempervirens*)
smooth cord-grass, short form (*Spartina alterniflora*)
spike-grass (*Distichlis spicata*)
sweet grass (*Hierochloa odorata*)

Low Salt Marsh

common glasswort (*Salicornia europaea*)
halberd-leaved orache (*Atriplex hastata*)
small spike-rush (*Eleocharis parvula*)*
smooth orache (*Atriplex glabriuscula*)
smooth cord-grass (*Spartina alterniflora*)



New Hampshire Natural Heritage Inventory - Community Record

Gulf of Maine Salt Marsh (High Salt Marsh)**Legal Status**

Federal: Not listed
 State: Not listed

Conservation Status

Global: Demonstrably widespread, abundant, and secure
 State: Rare or uncommon

Description at this Location

Conservation Rank: Good quality, condition and landscape context ('B' on a scale of A-D).

Comments on Rank:

Detailed Description: 1997: Dominated by the perennial grass *Spartina patens* (salt-meadow cord-grass). Covered more area than the low salt marsh. Although the water table is always at or near the surface in the high marsh, tidal flooding decreases landward with increased elevation and microtopography, creating areas with higher soil oxygen that support a variety of species. *S. patens*, sensitive to tidal flooding, competitively excludes smooth cord-grass from the high marsh. Along the upland edge of the marsh, *S. patens* is itself competitively excluded by *Juncus gerardii* (salt marsh rush), the marsh perennial most susceptible to tidal flooding (Bertness 1990). Only the spring tides and storm surges reach this area along the upper edge of the high salt marsh. This zone had the highest species richness within the high marsh and included *Solidago sempervirens* (seaside goldenrod), *Festuca rubra* (red fescue), *Hierochloa odorata* (sweet grass), *Elytrigia repens* (quack-grass), *Ligusticum scoticum* (Scotch lovage), *Panicum virgatum* (switch-grass), *Aster novi-belgii* (New York aster), *Teucrium canadensis* (germander), *Sanguisorba canadensis* (Canadian burnet), *Spartina pectinata* (fresh-water cord-grass), *Carex hormathodes* (necklace sedge), and *Juncus arcticus* var. *littoralis* (shore rush). *Distichlis spicata* mixed with *S. patens*, growing at similar elevations on the high marsh or dominated in of the wetter, more poorly drained areas with *Triglochin maritimum* (arrow-grass). Some of these *Triglochin* (forb) pannes supported large numbers of the rare plants *Agalinis maritima* (salt-marsh gerardia) and *Salicornia bigelovii* (dwarf glasswort). Shallow anaerobic depressions with poor drainage, low nutrient availability, and high concentrations of sulfides and other plant growth inhibitors promoted the growth of the short form (15-30 cm [6-12 inches] tall) of *S. patens* on the high marsh (Howes et al. 1986). *Spartina alterniflora* (short form) pannes occurred on less firm peat soils and appeared to be somewhat deeper, often larger, and saturated or flooded for longer periods than forb pannes.

General Area: 1997: Sagamore Creek is a relatively diverse, sizable, and significant estuary supporting good quality estuarine habitat. Three small, fair quality brackish marshes occurred landward of the high salt marsh. Low salt marsh, tidal creek bottoms, a saline/brackish intertidal flat, and an undifferentiated saline/brackish subtidal channel/bay bottom occur toward the channel. A population of *Puccinellia pauperula* var. *alaskana* (Alaskan goose-grass) was found on the cobbly shore of one of two "salt marsh islands" in the estuary. These islands were covered by hemlock-beech-oak-pine forest. Moderate residential and commercial development occurs particularly around the western lobe where Route 1 crosses the estuary. Estuarine tidal flow was evaluated as adequate for the salt marsh west of Route 1 and unaffected for the remainder of the marsh (USDA Soil Conservation Service 1994).

Location

Survey Site Name: SAGAMORE CREEK
 Conservation Land:



PUBLIC WORKS DEPARTMENT

CITY OF PORTSMOUTH

680 Peverly Hill Road
Portsmouth N.H. 03801
(603) 427-1530 FAX (603) 427-1539

January 22, 2003

NHNHI-DRED
1726 Pembroke Road
P.O. Box 1856
Concord, NH 03302-1856
Attn: Sara Cairns

Dear Ms. Cairns:

The City of Portsmouth is currently preparing its Storm Water Pollution Prevention Plan as required under EPA-National Pollutant Elimination Discharge System Phase II regulations. Under current rules the city must determine if stormwater discharges from our regulated facilities impact listed endangered or threatened species or any critical habitats. The three facilities in question are as follows:

Portsmouth Public Works Facility
680 Peverly Hill Road

Pease Tradeport Wastewater Treatment Facility
Pease Tradeport

Peirce Island Wastewater Treatment Facility
Peirce Island

The City requests your help in making this determination so that we may modify our stormwater management plan to provide maximum protection of our environment. A locus plan is attached to assist you. If you have any questions regarding this request please call me at 603-766-1412.

Sincerely,

Tom Richter
Engineering Technician



PUBLIC WORKS DEPARTMENT

CITY OF PORTSMOUTH
680 Peverly Hill Road
Portsmouth N.H. 03801
(603) 427-1530 FAX (603) 427-1539

~~August 10, 2005~~

Returned to
Sender b/c of
P.O. Box
resent 8/22/05

James McConaha, State Historic Preservation Officer
The New Hampshire Division of Historical Resources
19 Pillsbury Street
P.O. Box 2043
Concord, New Hampshire 03302-03301-350

Re: National Pollutant Discharge Elimination System Phase II

Dear Mr. McConaha,

The City of Portsmouth is updating its Notice of Intent (NOI) per the EPA-National Pollutant Elimination Discharge System Phase II regulations. Under the current rules, the City must determine if storm water discharges may impact any site listed on the National Register of Historic Places. On February 20, 2003, your department provided the requested information.

However, the City omitted requesting the information pertaining to specific water bodies that have outfalls for storm water. Therefore we now request your assistance in making a determination of potential impacts to any sites listed on the National Registry of Historic Places for the following water bodies.

Lower Piscataqua River
Sagamore Creek
North Mill Pond
South Mill Pond
Pickering Brook
Little Harbor
Hodgsons Brook
Lower Newfield Brook/Upper Hodgson Brook
Lower Grafton

To avoid duplication of work a copy of your February 23, 2003 response is enclosed.

Your assistance in making this determination will allow us to modify our plan(s) to maximize protection of the environment. Thank you in advance for your assistance in this matter. Should you have any questions, please do not hesitate to contact the below signed at 766-1454.

Sincerely,

Silke Psula,
Solid Waste Coordinator



PUBLIC WORKS DEPARTMENT

CITY OF PORTSMOUTH
680 Peverly Hill Road
Portsmouth N.H. 03801
(603) 427-1530 FAX (603) 427-1539
August 10 2005

Patricia Kurkul, Regional Administrator
NOAA Fisheries Service
Northeast Regional Office
One Blackburn Drive
Gloucester, Massachusetts 01930-2298

Re: National Pollutant Elimination Discharge System Phase II

Dear Ms. Kurkul,

The City of Portsmouth is updating its Notice of Intent (NOI) per the EPA-National Pollutant Elimination Discharge System Phase II regulations. Under the current rules, the City must determine if storm water discharges may adversely impact listed endangered or threatened species, any critical habitats and essential fish habitat. We request your assistance in making a determination of potential impacts to listed endangered or threatened species, any critical habitats and essential fish habitat.

The City has the following regulated facilities:

Department of Public Works, 680 Peverly Hill Rd
Pease Tradeport Wastewater Treatment Facility, Pease Tradeport
Pierce Island Wastewater Treatment Facility, Pierce Island

Further, the City has identified specific bodies of water that have outfalls for storm water.

Lower Piscataqua River
Sagamore Creek
North Mill Pond
South Mill Pond
Pickering Brook
Little Harbor
Hodgsons Brook
Lower Newfield Brook/Upper Hodgson Brook
Lower Grafton

Your assistance in making this determination will allow us to modify our plan(s) to maximize protection of the environment. Thank you in advance for your assistance in this matter. Should you have any questions, please do not hesitate to contact the below signed at 766-1454.

Sincerely,

Silke Psula,
Solid Waste Coordinator

APPENDIX C

Letters to and from Regulatory Authorities regarding
Historical Resources



PUBLIC WORKS DEPARTMENT

CITY OF PORTSMOUTH
680 Peverly Hill Road
Portsmouth N.H. 03801
(603) 427-1530 FAX (603) 427-1539

January 22, 2003

The New Hampshire Division of Historical Resources
19 Pillsbury Street
P.O. Box 2043
Concord, NH 03302

Dear Sir or Madam:

The City of Portsmouth is currently preparing its Storm Water Pollution Prevention Plan as required under EPA-National Pollutant Elimination Discharge System Phase II regulations. Under current rules the city must determine if stormwater discharges from our regulated facilities impact any site listed on the National Register of Historic Places. The three facilities in question are as follows:

Portsmouth Public Works Facility
680 Peverly Hill Road

Pease Tradeport Wastewater Treatment Facility
Pease Tradeport

Peirce Island Wastewater Treatment Facility
Peirce Island

The City requests your help in making this determination so that we may modify our stormwater management plan to provide maximum protection of our environment. A locus plan is attached to assist you. If you have any questions regarding this request please call me at 603-766-1412.

Sincerely,

Tom Richter
Engineering Technician



NEW HAMPSHIRE DIVISION OF HISTORICAL RESOURCES

State of New Hampshire, Department of Cultural Resources
19 Pillsbury Street, P. O. Box 2043, Concord NH 03302-2043
Voice / TTY RELAY ACCESS 1-800-735-2964
<http://www.state.nh.us/nhdhr>

603-271-3483
603-271-3558
FAX 603-271-3433
preservation@nhdhr.state.nh.us

February 20, 2003

Tom Richter
Public Works Department, City of Portsmouth
680 Peverly Hill Road
Portsmouth, NH 03801

Re: NPDES Storm Water Pollution Prevention Plan-Multiple Facilities in Portsmouth
Portsmouth Public Works Facility, 680 Peverly Hill Road
Pease Tradeport Wastewater Treatment Facility, Pease Tradeport

Dear Mr. Richter:

In accordance with the National Historic Preservation Act of 1966 (P.L. 89-655), as amended, and as implemented by regulations of the Federal Advisory Council on Historic Preservation ("36 CFR Part 800: Protection of Historic Properties"), the New Hampshire Division of Historical Resources/State Historic Preservation Office have reviewed the undertaking referenced above to identify potential effects on properties listed, or potentially eligible for listing, in the National Register of Historic Places.

Based upon the information currently available, it has been determined that there are no known properties of architectural, historical, archaeological, engineering, or cultural significance within the area of the undertaking's potential impact and no identification or evaluative studies are recommended.

If any other resources are discovered or affected as a result of project planning or implementation, the Division of Historical Resources is to be consulted on the need for appropriate evaluative studies, determinations of National Register eligibility, and mitigative measures (redesign, resource protection, or data recovery) as required by federal law and regulations.

For the purpose of compliance with the Advisory Council on Historic Preservation procedures (36 CFR 800), I request that this determination be construed as a finding of "No Historic Properties Affected".

Sincerely,

James McConaha
State Historic Preservation Officer

JM:emf



ROUTINE FACILITY INSPECTION

Cross reference Section 11 of the Recycling Center SWPPP.

BMPs, structural and non-structural, as identified in section 9 of the [Recycling Center's] SWPPP, are in place to address the identified potential and existing sources of stormwater contamination and achieve non-numeric effluent limits. The Routine Facility Inspection shall include a review of these BMPs prior to the physical walk around/site inspection of the facility and take their effectiveness into consideration as the inspection is conducted.

The following areas are to be inspected:

Scrap Recycling and Waste Recycling Facility (Sector N): areas where waste is generated, received, stored, treated, or disposed of and that are exposed to precipitation or stormwater run-off. For purposes of this (DPW Facilities Plan) this includes, but is not limited to the Recycling Center and all operations within.

Land Transportation and Warehousing (Sector P): Collocated industrial activity/operations that are exposed to precipitation or stormwater run-off. This includes the Fuel Distribution Depot; the Salt Storage Shed and loading area; the Materials Storage area; the Vehicle Maintenance Facility and storage areas for vehicles/equipment awaiting maintenance.

If the form provided on the reverse side does not provide sufficient room for comments, additional comments may be made in the space below.

Inspection Date & Time	General Weather Forecast:	Temperature : ___° Hi / ___° Lo
Barometer: _____	Humidity: _____	Wind: _____
Have both Vortechinics have been checked and cleaned?		YES NO
If yes, when? _____		
If no, which one(s) and provide explanation: _____		
Condition of Control Measures (i.e. need for maintenance and/or repair):		

Circle appropriate answer. Corrective action must be taken for any answers in the affirmative.		
Litter present on ground that could contaminate stormwater or be washed away in stormwater?	YES	NO
Sand/Salt pile has track out?	YES	NO
Fueling area has leaks, drips, spills and/or stains?	YES	NO
Spill kit at fueling area is missing or short adequate supplies?	YES	NO
Outdoor vehicle storage area has leaks, drips and/or stains?	YES	NO
Drums, chemicals and wastes are stored outside and exposed to stormwater runoff?	YES	NO
Catch basin grates are obstructed and stormwater cannot enter freely?	YES	NO
Sheen and/or other waste is accumulated around the Waste Oil AST?	YES	NO
There is evidence of stormwater pollution in the retention pond?	YES	NO
When was the Facility (DPW and Recycling Center) and access road last swept with the street sweeper?	When was the oil/water separator in the floor drain system last checked and cleaned?	
Is the oil/water separator functioning properly? YES NO		
Any previously unidentified discharges of pollutants from the site:		

Any incident of non-compliance? i.e. failed control measures need replacement (circle one) YES / NO If yes, provide description comment below:		

Any control measures needed to comply with permit requirements? (circle one) YES / NO		
If yes, provide description comment below:		

Both Inspectors must print and sign this inspection form:		

QUARTERLY VISUAL ASSESSMENTS

Quarterly visual assessments are samples collected, each quarter of the permit term, with the intent of assessing water quality characteristics, such as color, odor, floating solids, oil sheen, foam, etc. The visual inspection shall be conducted on each of the outfalls at the Facility and is intended to be representative of stormwater discharge.

Samples are not required to be collected consistent with 40 CFR Part 136 procedures but should be collected in such a manner that the samples are representative of the stormwater discharge.

The visual assessment must be made:

- Of a sample in a clean, clear glass, or plastic container and examined in a well-lit area;
- On samples collected within the first 30 minutes of an actual discharge from a storm event. If it is not possible to collect the sample within the first 30 minutes of discharge, the sample must be collected as soon as practicable after the first 30 minutes. It must be documented why it was not possible to take samples with the first 30 minutes. In the case of snowmelt, samples must be taken during a period with a measurable discharge from the site: and
- For storm events, on discharges that occur at least 72 hours (3 days) from the previous discharge. The 72-hour (3-day) storm interval does not apply if its been documented that less than a 72-hour (3-day) interval is representative for local storm events during the sampling period.

The form provided in this Appendix (reverse side) shall be used to document the Visual Assessment. Completed forms shall be maintained, for a minimum of three (3) years, on-site with this SWPPP.

The form must be completed for each sample collected. If the form provided on the reverse side does not provide sufficient room for comments, additional comments may be made in the space below.

Sample Collection Date & Time	Sample Location
----------------------------------	-----------------

Nature of the discharge: (i.e. runoff or snow melt):

Results of observations (circle all that apply and provide additional comment as necessary reverse side of this form)

- | | | | | | | |
|--|-----------------------|--------------|----------------------|--------------------|-------------|----------|
| Color: | Brown | Redish Brown | Gray | Green | Multi-color | No color |
| Odor: | Rotten egg | Soapy | Chlorine/Bleach odor | Sharp/Pungent odor | No odor | |
| Clarity: | Impenetrable by Light | | Cloudy | Clear/Transparent | | |
| Floating Solids present? (circle one) | | | Yes | No | | |
| Settled Solids present? (circle one) | | | Yes | No | | |
| Suspended solids present? (circle one) | | | Yes | No | | |
| Foam present? (circle one) | | | Yes | No | | |
| Oil sheen present? (circle one) | | | Yes | No | | |

Other observations:

Probable sources of any observed stormwater contamination:

If applicable, why was it not possible to take samples within the first 30 minutes. (Write "N/A" if samples were collected within first 30 minutes.)

Recommended action to prevent in future:

Inspector(s) (Print & Sign)

APPENDIX F
ANNUAL REPORTING FORM

--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--



Annual Reporting Form

A. GENERAL INFORMATION

1. Facility Name:

2. NPDES Permit Tracking No.:

3. Facility Physical Address:

a. Street:

b. City:

c. State:

d. Zip Code: -

4. Lead Inspectors Name:

Title:

Additional Inspectors Name(s):

5. Contact Person:

Title:

Phone: - - Ext. E-mail:

6. Inspection Date: / /

B. GENERAL INSPECTION FINDINGS

1. As part of this comprehensive site inspection, did you inspect all potential pollutant sources, including areas where industrial activity may be exposed to stormwater?

YES NO

If NO, describe why not:

NOTE: Complete Section C of this form for each industrial activity area inspected and included in your SWPPP or as newly identified in B.2 or B.3 below where pollutants may be exposed to stormwater.

2. Did this inspection identify any stormwater or non-stormwater outfalls not previously identified in your SWPPP? YES NO

If YES, for each location, describe the sources of those stormwater and non-stormwater discharges and any associated control measures in place:

--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--

3. Did this inspection identify any sources of stormwater or non-stormwater discharges not previously identified in your SWPPP? YES NO

If YES, describe these sources of stormwater or non-stormwater pollutants expected to be present in these discharges, and any control measures in place:

4. Did you review stormwater monitoring data as part of this inspection to identify potential pollutant hot spots? YES NO NA, no monitoring performed

If YES, summarize the findings of that review and describe any additional inspection activities resulting from this review:

5. Describe any evidence of pollutants entering the drainage system or discharging to surface waters, and the condition of and around outfalls, including flow dissipation measures to prevent scouring:

6. Have you taken or do you plan to take any corrective actions, as specified in Part 3 of the permit, since your last annual report submission (or since you received authorization to discharge under this permit if this is your first annual report), including any corrective actions identified as a result of this annual comprehensive site inspection?

YES NO

If YES, how many conditions requiring review for correction action as specified in Parts 3.1 and 3.2 were addressed by these corrective actions?

--	--	--

NOTE: Complete the attached Corrective Action Form (Section D) for each condition identified, including any conditions identified as a result of this comprehensive stormwater inspection.

--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--

C. INDUSTRIAL ACTIVITY AREA SPECIFIC FINDINGS

Complete one block for each industrial activity area where pollutants may be exposed to stormwater. Copy this page for additional industrial activity areas.

In reviewing each area, you should consider:

- Industrial materials, residue, or trash that may have or could come into contact with stormwater;
- Leaks or spills from industrial equipment, drums, tanks, and other containers;
- Offsite tracking of industrial or waste materials from areas of no exposure to exposed areas; and
- Tracking or blowing of raw, final, or waste materials from areas of no exposure to exposed areas.

INDUSTRIAL ACTIVITY AREA _____:

1. Brief Description:

2. Are any control measures in need of maintenance or repair? YES NO
3. Have any control measures failed and require replacement? YES NO
4. Are any additional/revised control measures necessary in this area? YES NO

If YES to any of these three questions, provide a description of the problem: (Any necessary corrective actions should be described on the attached Corrective Action Form)

INDUSTRIAL ACTIVITY AREA _____:

1. Brief Description:

2. Are any control measures in need of maintenance or repair? YES NO
3. Have any control measures failed and require replacement? YES NO
4. Are any additional/revised c necessary in this area? YES NO

If YES to any of these three questions, provide a description of the problem: (Any necessary corrective actions should be described on the attached Corrective Action Form)

INDUSTRIAL ACTIVITY AREA _____:

Brief Description:

2. Are any control measures in need of maintenance or repair? YES NO
3. Have any control measures failed and require replacement? YES NO
4. Are any additional/revised BMPs necessary in this area? YES NO

If YES to any of these three questions, provide a description of the problem: (Any necessary corrective actions should be described on the attached Corrective Action Form)

**United States Environmental Protection Agency (EPA)
National Pollutant Discharge Elimination System (NPDES)**

**MULTI-SECTOR GENERAL PERMIT FOR STORMWATER DISCHARGES
ASSOCIATED WITH INDUSTRIAL ACTIVITY (MSGP)**

**AUTHORIZATION TO DISCHARGE UNDER THE
NATIONAL POLLUTANT DISCHARGE ELIMINATION SYSTEM**

In compliance with the provisions of the Clean Water Act (CWA), as amended (33 U.S.C. 1251 *et seq.*), operators of stormwater discharges associated with industrial activity located in an area identified in Appendix C where EPA is the permitting authority are authorized to discharge to waters of the United States in accordance with the eligibility and Notice of Intent (NOI) requirements, effluent limitations, inspection requirements, and other conditions set forth in this permit. This permit is structured as follows:

- general requirements that apply to all facilities are found in Parts 1 through 7;
- industry sector-specific requirements are found in Part 8; and
- specific requirements that apply in individual States and Indian Country Lands are found in Part 9.

The Appendices (A through K) contain additional permit conditions that apply to all operators covered under this permit.

This permit becomes effective on September 29, 2008.

This permit and the authorization to discharge expire at midnight, September 29, 2013.

Robert W. Varney, Regional Administrator
EPA Region 1

Timothy C. Henry, Acting Director, Water Division
EPA Region 5

Carl-Axel P. Soderberg, Division Director, Caribbean
Environmental Protection Division
EPA Region 2

Miguel I. Flores, Director, Water Quality Protection
Division
EPA Region 6

Jon M. Capacasa, Director, Water Protection
Division
EPA Region 3

Alexis Strauss, Director, Water Division
EPA Region 9

Michael Gearheard, Director, Office of Water and
Watersheds
EPA Region 10

**NPDES MULTI-SECTOR GENERAL PERMITS FOR STORMWATER
DISCHARGES ASSOCIATED WITH INDUSTRIAL ACTIVITY
TABLE OF CONTENTS**

1.	Coverage under this Permit.	1
1.1	Eligibility.	1
1.1.1	Facilities Covered.	1
1.1.2	Allowable Stormwater Discharges.	1
1.1.3	Allowable Non-Stormwater Discharges.	2
1.1.4	Limitations on Coverage.	3
1.1.4.1	<i>Discharges Mixed with Non-Stormwater.</i>	3
1.1.4.2	<i>Stormwater Discharges Associated with Construction Activity.</i>	3
1.1.4.3	<i>Discharges Currently or Previously Covered by Another Permit.</i>	3
1.1.4.4	<i>Stormwater Discharges Subject to Effluent Limitations Guidelines.</i>	3
1.1.4.5	<i>Endangered and Threatened Species and Critical Habitat Protection.</i>	3
1.1.4.6	<i>Historic Properties Preservation.</i>	5
1.1.4.7	<i>New Discharges to Water Quality Impaired Waters.</i>	6
1.1.4.8	<i>New Discharges to Waters Designated as Tier 3 for Antidegradation Purposes.</i>	7
1.2	Permit Compliance.	7
1.3	Authorization under this Permit.	7
1.3.1	How to Obtain Authorization.	7
1.3.2	Continuation of this Permit.	9
1.4	Terminating Coverage.	10
1.4.1	Submitting a Notice of Termination.	10
1.4.2	When to Submit a Notice of Termination.	10
1.5	Conditional Exclusion for No Exposure.	11
1.6	Alternative Permits.	11
1.6.1	EPA Requiring Coverage under an Alternative Permit.	11
1.6.2	Permittee Requesting Coverage under an Alternative Permit.	11
1.7	Severability.	12
2.	Control Measures and Effluent Limits.	12
2.1	Control Measures.	12
2.1.1	Control Measure Selection and Design Considerations	12
2.1.2	Non-Numeric Technology-Based Effluent Limits (BPT/BAT/BCT).	13
2.1.2.1	<i>Minimize Exposure.</i>	13
2.1.2.2	<i>Good Housekeeping.</i>	13
2.1.2.3	<i>Maintenance.</i>	14
2.1.2.4	<i>Spill Prevention and Response Procedures.</i>	14
2.1.2.5	<i>Erosion and Sediment Controls.</i>	14
2.1.2.6	<i>Management of Runoff.</i>	15
2.1.2.7	<i>Salt Storage Piles or Piles Containing Salt.</i>	15
2.1.2.8	<i>Sector Specific Non-Numeric Effluent Limits.</i>	15
2.1.2.9	<i>Employee Training.</i>	15
2.1.2.10	<i>Non-Stormwater Discharges.</i>	15
2.1.2.11	<i>Waste, Garbage and Floatable Debris.</i>	15
2.1.2.12	<i>Dust Generation and Vehicle Tracking of Industrial Materials.</i>	16
2.1.3	Numeric Effluent Limitations Based on Effluent Limitations Guidelines	16
2.2	Water Quality-Based Effluent Limitations.	16
2.2.1	Water Quality Standards	16
2.2.2	Discharges to Water Quality Impaired Waters.	17
2.2.2.1	<i>Existing Discharge to an Impaired Water with an EPA Approved or Established TMDL.</i>	17
2.2.2.2	<i>Existing Discharge to an Impaired Water without an EPA Approved or Established TMDL.</i>	17
2.2.2.3	<i>New Discharge to an Impaired Water.</i>	17
2.2.3	Tier 2 Antidegradation Requirements for New or Increased Dischargers.	17
2.3	Requirements Relating to Endangered Species and Historic Properties.	17
2.4	Requirements Relating to the National Environmental Policy Act (NEPA) Review.	18

3.	Corrective Actions	18
3.1	Conditions Requiring Review and Revision to Eliminate Problem	18
3.2	Conditions Requiring Review to Determine if Modifications Are Necessary	18
3.3	Corrective Action Deadlines.....	18
3.4	Corrective Action Report	19
3.5	Effect of Corrective Action	19
3.6	Substantially Identical Outfalls.....	20
4.	Inspections	20
4.1	Routine Facility Inspections.....	20
4.1.1	Routine Facility Inspection Procedures.....	20
4.1.2	Routine Facility Inspection Documentation.....	20
4.1.3	Exceptions to Routine Facility Inspections.....	21
4.2	Quarterly Visual Assessment of Stormwater Discharges.....	21
4.2.1	Quarterly Visual Assessment Procedures.....	21
4.2.2	Quarterly Visual Assessment Documentation.....	22
4.2.3	Exceptions to Quarterly Visual Assessments.....	22
4.3	Comprehensive Site Inspections.....	24
4.3.1	Comprehensive Site Inspection Procedures.....	24
4.3.2	Comprehensive Site Inspection Documentation.....	25
5.	Stormwater Pollution Prevention Plan (SWPPP).....	25
5.1	Contents of Your SWPPP.....	26
5.1.1	Stormwater Pollution Prevention Team.....	26
5.1.2	Site Description.....	26
5.1.3	Summary of Potential Pollutant Sources.....	27
5.1.3.1	<i>Activities in the area.....</i>	27
5.1.3.2	<i>Pollutants.....</i>	28
5.1.3.3	<i>Spills and Leaks.....</i>	28
5.1.3.4	<i>Non-Stormwater Discharges.....</i>	28
5.1.3.5	<i>Salt Storage.....</i>	28
5.1.3.6	<i>Sampling Data.....</i>	28
5.1.4	Description of Control Measures.....	28
5.1.4.1	<i>Control Measures to Meet Technology-Based and Water Quality-Based Effluent Limits.....</i>	28
5.1.5	Schedules and Procedures.....	29
5.1.5.1	<i>Pertaining to Control Measures Used to Comply with the Effluent Limits in Part 2.....</i>	29
5.1.5.2	<i>Pertaining to Monitoring and Inspection.....</i>	29
5.1.6	Documentation to Support Eligibility Considerations Under Other Federal Laws.....	31
5.1.6.1	<i>Documentation Regarding Endangered Species.....</i>	31
5.1.6.2	<i>Documentation Regarding Historic Properties.....</i>	31
5.1.6.3	<i>Documentation Regarding NEPA Review.....</i>	31
5.1.7	Signature Requirements.....	31
5.2	Required SWPPP Modifications.....	31
5.3	SWPPP Availability.....	31
5.4	Additional Documentation Requirements.....	32
6.	Monitoring.....	33
6.1	Monitoring Procedures.....	33
6.1.1	Monitored Outfalls.....	33
6.1.2	Commingled Discharges.....	33
6.1.3	Measurable Storm Events.....	33
6.1.4	Sample Type.....	34
6.1.5	Adverse Weather Conditions.....	34
6.1.6	Climates with Irregular Stormwater Runoff.....	34
6.1.7	Monitoring Periods.....	34
6.1.8	Monitoring for Allowable Non-Stormwater Discharges.....	35
6.2	Required Monitoring.....	35
6.2.1	Benchmark Monitoring.....	35

6.2.1.1	<i>Applicability of Benchmark Monitoring.</i>	35
6.2.1.2	<i>Benchmark Monitoring Schedule.</i>	36
6.2.1.3	<i>Exception for Inactive and Unstaffed Sites.</i>	37
6.2.2	Effluent Limitations Monitoring.	38
6.2.2.1	<i>Monitoring Based on Effluent Limitations Guidelines.</i>	38
6.2.2.2	<i>Substantially Identical Outfalls.</i>	38
6.2.3	State or Tribal Provisions Monitoring.	38
6.2.3.1	<i>Sectors Required to Conduct State or Tribal Monitoring.</i>	38
6.2.3.2	<i>State or Tribal Monitoring Schedule.</i>	38
6.2.4	Discharges to Impaired Waters Monitoring.	39
6.2.4.1	<i>Permittees Required to Monitor Discharges to Impaired Waters.</i>	39
6.2.4.2	<i>Impaired Waters Monitoring Schedule.</i>	39
6.2.5	Additional Monitoring Required by EPA.	40
6.3	Follow-up Actions if Discharge Exceeds Numeric Effluent Limit.	40
6.3.1	Submit an Exceedance Report.	40
6.3.2	Continue to Monitor.	40
7.	Reporting and Recordkeeping	41
7.1	Reporting Monitoring Data to EPA.	41
7.2	Annual Report	41
7.3	Exceedance Report for Numeric Effluent Limits	41
7.4	Additional Reporting.	42
7.5	Recordkeeping.	43
7.6	Addresses for Reports	43
7.6.1	EPA Addresses.	43
7.6.2	Regional Addresses.	44
7.6.3	State and Tribal Addresses.	46
8.	Sector Specific Requirements	47
8A.	Sector A: Timber Products	47
8B.	Sector B: Paper and Allied Products	50
8C.	Sector C: Chemicals and Allied Products Manufacturing	51
8D.	Sector D: Asphalt Paving and Roofing Materials and Lubricant Manufacturing	54
8E.	Sector E: Glass, Clay, Cement, Concrete, and Gypsum Products	56
8F.	Sector F: Primary Metals	58
8G.	Sector G: Metal Mining (Ore Mining and Dressing)	60
8H.	Sector H: Coal Mines and Coal Mining-Related Facilities	71
8I.	Sector I: Oil and Gas Extraction and Refining	77
8J.	Sector J: Mineral Mining and Dressing	79
8K.	Sector K: Hazardous Waste Treatment, Storage, or Disposal Facilities	87
8L.	Sector L: Landfills, Land Application Sites, and Open Dumps	91
8M.	Sector M: Automobile Salvage Yards	95
8N.	Sector N: Scrap Recycling Facilities	97
8O.	Sector O: Steam Electric Generating Facilities	103
8P.	Sector P: Land Transportation and Warehousing	107
8Q.	Sector Q: Water Transportation	110
8R.	Sector R: Ship and Boat Building and Repairing Yards	113
8S.	Sector S: Air Transportation Facilities	116
8T.	Sector T: Treatment Works	121
8U.	Sector U: Food and Kindred Products	123
8V.	Sector V: Textile Mills, Apparel, and Other Fabric Product Manufacturing; Leather and Leather Products	125
8W.	Sector W: Furniture and Fixtures	127
8X.	Sector X: Printing and Publishing	128
8Y.	Sector Y: Rubber, Miscellaneous Plastic Products, and Miscellaneous Manufacturing Industries	130
8Z.	Sector Z: Leather Tanning and Finishing	132

8AA. Sector AA: Fabricated Metal Products..... 134
 8AB. Sector AB: Transportation Equipment, Industrial or Commercial Machinery 137
 8AC. Sector AC: Electronic, Electrical, Photographic, and Optical Goods..... 138
 8AD. Sector AD: Non-Classified Facilities 139

9. State/Tribal Specific Requirements.....140

Appendices

Appendix A Definitions and AcronymsA-1
 Appendix B Standard Permit ConditionsB-1
 Appendix C Areas Covered.....C-1
 Appendix D Activities Covered.....D-1
 Appendix E Procedures relating to Endangered Species.....E-1
 Appendix F National Historic Preservation Act Procedures.....F-1
 Appendix G Notice of IntentG-1
 Appendix H Notice of TerminationH-1
 Appendix I Comprehensive Site Inspection and Reporting Form.....I-1
 Appendix J Calculating Hardness in Receiving Waters for Hardness Dependent Metals.....J-1
 Appendix K No Exposure Certification.....K-1

1. Coverage under this Permit.

1.1 Eligibility.

1.1.1 Facilities Covered.

To be eligible to discharge under this permit, you must (1) have a stormwater discharge associated with industrial activity from your primary industrial activity, as defined in Appendix A, provided your primary industrial activity is included in Appendix D, or (2) be notified by EPA that you are eligible for coverage under Sector AD of this permit.

1.1.2 Allowable Stormwater Discharges.

Unless otherwise made ineligible under Part 1.1.4, the following discharges are eligible for coverage under this permit:

1.1.2.1 Stormwater discharges associated with industrial activity for any primary industrial activities and co-located industrial activities, as defined in Appendix A;

1.1.2.2 Discharges designated by EPA as needing a stormwater permit as provided in Sector AD;

1.1.2.3 Discharges that are not otherwise required to obtain NPDES permit authorization but are commingled with discharges that are authorized under this permit;

1.1.2.4 Discharges subject to any of the national stormwater-specific effluent limitations guidelines listed in Table 1-1; and

Table 1-1. Stormwater-specific Effluent Limitations Guidelines

Regulated Discharge	40 CFR Section	MSGP Sector	New Source Performance Standard (NSPS)	New Source Date
Discharges resulting from spray down or intentional wetting of logs at wet deck storage areas	Part 429, Subpart I	A	Yes	1/26/81
Runoff from phosphate fertilizer manufacturing facilities that comes into contact with any raw materials, finished product, by-products or waste products (SIC 2874)	Part 418, Subpart A	C	Yes	4/8/74
Runoff from asphalt emulsion facilities	Part 443, Subpart A	D	Yes	7/28/75
Runoff from material storage piles at cement manufacturing facilities	Part 411, Subpart C	E	Yes	2/20/74

Mine dewatering discharges at crushed stone, construction sand and gravel, or industrial sand mining facilities	Part 436, Subparts B, C, and D	J	No	N/A
Runoff from hazardous waste and non-hazardous waste landfills	Part 445, Subparts A and B	K, L	Yes	2/2/00
Runoff from coal storage piles at steam electric generating facilities	Part 423	O	Yes	11/19/82 (10/8/74) ¹

1.1.2.5 Discharges subject to any New Source Performance Standards (NSPS) identified in Table 1-1 (i.e., where facilities were constructed after the promulgation of that industry's NSPS), provided that you obtain and retain the following EPA documentation with your SWPPP, prior to submitting your NOI, and that you comply with any limits pursuant to Part 2.4:

- Determination of "No Significant Impact" under the National Environmental Policy Act (NEPA); or
- A completed Environmental Impact Statement in accordance with an environmental review conducted by EPA pursuant to 40 CFR 6.102(a)(6)².

1.1.3 Allowable Non-Stormwater Discharges.

The following are the non-stormwater discharges authorized under this permit, provided the non-stormwater component of your discharge is in compliance with Part 2.1.2.10:

- Discharges from fire-fighting activities;
- Fire hydrant flushings;
- Potable water, including water line flushings;
- Uncontaminated condensate from air conditioners, coolers, and other compressors and from the outside storage of refrigerated gases or liquids;
- Irrigation drainage;
- Landscape watering provided all pesticides, herbicides, and fertilizer have been applied in accordance with the approved labeling;
- Pavement wash waters where no detergents are used and no spills or leaks of toxic or hazardous materials have occurred (unless all spilled material has been removed);
- Routine external building washdown that does not use detergents;
- Uncontaminated ground water or spring water;

¹ NSPS promulgated in 1974 were not removed via the 1982 regulation; therefore wastewaters generated by Part 423-applicable sources that were New Sources under the 1974 regulations are subject to the 1974 NSPS.

² Note that if you have previously completed an Environmental Impact Statement or obtained a "No Significant Impact" statement for discharges subject to NSPS, you have met your obligation under this provision and you only need to retain this documentation for your files.

- Foundation or footing drains where flows are not contaminated with process materials; and
- Incidental windblown mist from cooling towers that collects on rooftops or adjacent portions of your facility, but not intentional discharges from the cooling tower (e.g., “piped” cooling tower blowdown or drains).

1.1.4 Limitations on Coverage.

1.1.4.1 Discharges Mixed with Non-Stormwater. Stormwater discharges that are mixed with non-stormwater, other than those non-stormwater discharges listed in Part 1.1.3, are not eligible for coverage under this permit.

1.1.4.2 Stormwater Discharges Associated with Construction Activity. Stormwater discharges associated with construction activity disturbing one acre or more are not eligible for coverage under this permit, unless in conjunction with mining activities or certain oil and gas extraction activities as specified in Sectors G, H, I, and J of this permit.

1.1.4.3 Discharges Currently or Previously Covered by Another Permit. Unless you received written notification from EPA specifically allowing these discharges to be covered under this permit, you are not eligible for coverage under this permit for any of the following:

- Stormwater discharges associated with industrial activity that are currently covered under an individual NPDES permit or an alternative NPDES general permit;
- Discharges covered within five years prior to the effective date of this permit by an individual permit or alternative general permit where that permit established site-specific numeric water quality-based limitations developed for the stormwater component of the discharge; or
- Discharges from facilities where any NPDES permit has been or is in the process of being denied, terminated, or revoked by EPA (this does not apply to the routine reissuance of permits every five years).

1.1.4.4 Stormwater Discharges Subject to Effluent Limitations Guidelines. For discharges subject to stormwater effluent limitation guidelines under 40 CFR, Subchapter N, only those stormwater discharges identified in Table 1-1 are eligible for coverage under this permit.

1.1.4.5 Endangered and Threatened Species and Critical Habitat Protection. Coverage under this permit is available only if your stormwater discharges, allowable non-stormwater discharges, and stormwater discharge-related activities will not adversely affect any species that are federally-listed as endangered or threatened (“listed”) under the Endangered Species Act (ESA) and will not result in the adverse modification or destruction of habitat that is federally-designated as “critical habitat” under the ESA. You must meet one of the criteria below, following the procedures in Appendix E:

Criterion A. No federally-listed threatened or endangered species or their designated critical habitat are likely to occur in the “action area” as defined in Appendix A; or

Criterion B. Consultation between a Federal agency and the U.S. Fish and Wildlife Service and/or the National Marine Fisheries Service (together, the “Services”) under section 7 of the ESA has been concluded. Consultations can be either formal or informal, and would have occurred only as a result of a separate federal action (e.g., during application for an individual wastewater discharge permit or the issuance of a wetlands dredge and fill permit).

The consultation must have addressed the effects of your facility’s stormwater discharges, allowable non-stormwater discharges, and stormwater discharge-related activities on federally-listed threatened or endangered species and federally-designated critical habitat, and must have resulted in either:

- i. a biological opinion finding no jeopardy to federally-listed species or destruction/adverse modification of federally-designated critical habitat; or
- ii. written concurrence from the Service(s) with a finding that the facility’s stormwater discharges associated with industrial activity, discharge-related activities and allowable non-stormwater discharges are not likely to adversely affect federally-listed species or federally-designated critical habitat; or

Criterion C. Your industrial activities are authorized through the issuance of a permit under section 10 of the ESA, and authorization addresses the effects of the stormwater discharges associated with industrial activity, discharge-related activities, and allowable non-stormwater discharges on federally-listed species and federally-designated critical habitat; or

Criterion D. Coordination between you and the U.S. Fish and Wildlife Service and/or the National Marine Fisheries Service has been concluded. The coordination must have addressed the effects of the facility’s stormwater discharges associated with industrial activity, discharge-related activities, and allowable non-stormwater discharges on federally-listed threatened or endangered species and federally-designated critical habitat. The result of the coordination must be a written statement from the Service concluding that authorizing your stormwater discharges, discharge-related activities, and allowable non-stormwater discharges is consistent with the determination that the issuance of the MSGP is not likely to adversely affect federally-listed threatened or endangered species and federally-designated critical habitat. Any conditions or prerequisites deemed necessary to achieve consistency with the “not likely to adversely effect” determination become eligibility conditions for MSGP coverage, and permit requirements under Part 2.3; or

Criterion E. Authorizing your stormwater discharges associated with industrial activity, discharge-related activities, and allowable non-stormwater discharges is

consistent with the determination that the issuance of the MSGP is not likely to adversely affect any federally-listed endangered and threatened (“listed”) species or designated critical habitat (“critical habitat”). To support your determination that you meet Criterion E, you must provide supporting documentation for your determination.

- i. If you are an existing discharger, you must provide the following information with your completed Notice of Intent (NOI) form: (1) a list of the federally-listed threatened or endangered species or their designated critical habitat that are likely to occur in the “action area”; (2) a list of the pollutant parameters for which you have ever exceeded an applicable benchmark or effluent limitations guideline, or for which your discharge has ever been found to cause or contribute to an exceedance of an applicable water quality standard, or to violate State or Tribal water quality requirements (Part 9); and (3) your rationale supporting your determination that you meet Criterion E, including appropriate measures to be undertaken to avoid or eliminate the likelihood of adverse effects.
- ii. If you are a new discharger, you must provide the following information with your completed NOI form: (1) a list of the federally-listed threatened or endangered species or their designated critical habitat that are likely to occur in the “action area”; (2) a list of the potential pollutants in your discharge; and (3) your rationale supporting your determination that you meet Criterion E, including appropriate measures to be undertaken to avoid or eliminate the likelihood of adverse effects; or

Criterion F. The facility’s stormwater discharges associated with industrial activity, discharge-related activities, and allowable non-stormwater discharges were already addressed in another operator’s valid certification of eligibility that included these discharges and activities and there is no reason to believe that federally-listed species or federally-designated critical habitat not considered in the prior certification may be present or located in the “action area”. To certify eligibility under this criterion there must be no lapse of coverage in the other operator’s certification. By certifying eligibility under this criterion, you agree to comply with any measures or controls upon which the other operator's certification was based. You must comply with any applicable terms, conditions, or other requirements developed in the process of meeting the eligibility requirements of the criteria in this section to remain eligible for coverage under this permit. If your certification is based on another operator’s certification under Criterion E, that certification is valid only if you have documentation showing that the other operator had certified under Criterion E, and you provide EPA with the supporting information required of existing dischargers in Criterion E (above, under subparagraph (i)) in your NOI form.

1.1.4.6 Historic Properties Preservation. Coverage under this permit is available only if your stormwater discharges, allowable non-stormwater discharges, and stormwater discharge-

related activities meet one of the eligibility criteria below, following the procedures in Appendix F:

- Criterion A. Your stormwater discharges and allowable non-stormwater discharges do not have the potential to have an effect on historic properties and you are not constructing or installing new stormwater control measures on your site that cause subsurface disturbance; or
- Criterion B. Your discharge-related activities (i.e., construction and/or installation of stormwater control measures that involve subsurface disturbance) will not affect historic properties; or
- Criterion C. Your stormwater discharges, allowable non-stormwater discharges, and discharge-related activities have the potential to have an effect on historic properties, and you have consulted with the State Historic Preservation Officer (SHPO), Tribal Historic Preservation Officer (THPO), or other tribal representative regarding measures to mitigate or prevent any adverse effects on historic properties, and you have either (1) obtained and are in compliance with a written agreement that outlines all such measures, or (2) been unable to reach agreement on such measures; or
- Criterion D. You have contacted the State Historic Preservation Officer, Tribal Historic Preservation Officer, or other tribal representative and EPA in writing informing them that you have the potential to have an effect on historic properties and you did not receive a response from the SHPO, THPO, or tribal representative within 30 days of receiving your letter.

If you have been unable to reach agreement with a SHPO, THPO, or other tribal representative regarding appropriate measures to mitigate or prevent adverse effects, EPA may notify you of additional measures you must implement to be eligible for coverage under this permit.

1.1.4.7 New Discharges to Water Quality Impaired Waters. If you are a new discharger you are not eligible for coverage under this permit to discharge to an “impaired water”, as defined in Appendix A unless you:

- a. prevent all exposure to stormwater of the pollutant(s) for which the waterbody is impaired, and retain documentation of procedures taken to prevent exposure onsite with your SWPPP; or
- b. document that the pollutant(s) for which the waterbody is impaired is not present at your site, and retain documentation of this finding with your SWPPP; or
- c. in advance of submitting your NOI, provide to the appropriate EPA Regional Office data to support a showing that the discharge is not expected to cause or contribute to an exceedance of a water quality standard, and retain such data

onsite with your SWPPP. To do this, you must provide data and other technical information to the Regional Office sufficient to demonstrate:

- i. For discharges to waters without an EPA approved or established TMDL, that the discharge of the pollutant for which the water is impaired will meet in-stream water quality criteria at the point of discharge to the waterbody; or
- ii. For discharges to waters with an EPA approved or established TMDL, that there are sufficient remaining wasteload allocations in an EPA approved or established TMDL to allow your discharge and that existing dischargers to the waterbody are subject to compliance schedules designed to bring the waterbody into attainment with water quality standards.

You are eligible under Part 1.1.4.7.c if you receive an affirmative determination from the Regional Office that your discharge will not contribute to the existing impairment, in which case you must maintain such determination onsite with your SWPPP, or if the Regional Office fails to respond within 30 days of submission of data to the Regional Office.

1.1.4.8 New Discharges to Waters Designated as Tier 3 for Antidegradation Purposes. If you are a new discharger, you are not eligible for coverage under this permit for discharges to waters designated by a State or Tribe as Tier 3 (outstanding natural resource waters) for antidegradation purposes under 40 CFR 131.13(a)(3) (see list of Tier 3 waters on EPA's website at <http://www.epa.gov/npdes/stormwater/msgp>).

1.2 Permit Compliance.

Any noncompliance with any of the requirements of this permit constitutes a violation of the Clean Water Act. As detailed in Part 3 (Corrective Actions) of this permit, failure to take any required corrective actions constitute an independent, additional violation of this permit and the Clean Water Act. As such, any actions and time periods specified for remedying noncompliance do not absolve parties of the initial underlying noncompliance. However, where corrective action is triggered by an event that does not itself constitute permit noncompliance, such as an exceedance of an applicable benchmark, there is no permit violation provided you take the required corrective action within the relevant deadlines established in Part 3.3.

1.3 Authorization under this Permit.

1.3.1 How to Obtain Authorization.

To obtain authorization under this permit, you must:

- Be located in a State, territory, or Indian Country, or be a Federal Facility identified in Appendix C where EPA is the permitting authority;
- Meet the Part 1.1 eligibility requirements;

- Select, design, install, and implement control measures in accordance with Part 2.1 to meet numeric and non-numeric effluent limits;
- Submit a complete and accurate Notice of Intent (NOI) either using EPA's electronic Notice of Intent (eNOI) system (accessible at www.epa.gov/npdes/eNOI) or using a paper form (included in Appendix G of this permit) and then submitting that paper form to the address listed in Part 7.6.1; and
- Develop a SWPPP according to the requirements in Part 5 of this permit.

EPA will post on the Internet, at www.epa.gov/npdes/noisearch, all NOIs received. Late NOIs will be accepted but authorization to discharge will not be retroactive.

Timeframes for discharge authorization are contained in Table 1-2. Some authorization dates in Table 1-2 are dependent on you posting a copy of your SWPPP on the Internet. Posting requires that (1) your NOI identifies the Uniform Resource Locator (URL) that provides direct access to your SWPPP, (2) you post a complete copy of your SWPPP at that URL, and (3) the SWPPP is available from that URL at least for the period starting the day you submit your NOI until you are authorized to discharge. You are not required to post any confidential business information (CBI) at this URL, but you must clearly identify those portions of the SWPPP that are being withheld from public access as a result of your determination of CBI.

Table 1-2. NOI Submittal Deadlines/Discharge Authorization Dates

Category	NOI Submission Deadline	Discharge Authorization Date ¹
<u>Existing Dischargers</u> – in operation as of October 30, 2005 and authorized for coverage under MSGP 2000.	No later than January 5, 2009.	30 days after EPA posts your NOI. Your authorization under the MSGP 2000 is automatically continued until you have been granted coverage under this permit or an alternative permit, or coverage is otherwise terminated.
<u>New Dischargers or New Sources</u> - have commenced discharging between October 30, 2005 and January 5, 2009.	As soon as possible but no later than January 5, 2009.	30 days after EPA posts your NOI.
<u>New Dischargers or New Sources</u> - commence discharging after January 5, 2009.	A minimum of 60 days prior to commencing discharge, or a minimum of 30 days if your SWPPP is posted on the Internet during this period and the Internet address (i.e., URL) to your SWPPP is provided on the NOI form.	If you post your SWPPP on the Internet, 30 days after EPA posts your NOI. Otherwise, 60 days after EPA posts your NOI.
<u>New Owner/Operator of Existing Discharger</u> - transfer of ownership and/or operation of a facility whose discharge is authorized under this permit	A minimum of 30 days prior to date that the transfer will take place to the new owner/operator.	30 days after EPA posts your NOI.
<u>Other Eligible Dischargers</u> - in operation prior to October 30, 2005, but not covered under the MSGP 2000 or another NPDES permit.	Immediately, to minimize the time discharges from the facility will continue to be unauthorized.	If you post your SWPPP on the Internet, 30 days after EPA posts your NOI. Otherwise, 60 days after EPA posts your NOI.

¹Based on a review of your NOI or other information, EPA may delay your authorization for further review, notify you that additional effluent limitations are necessary, or may deny coverage under this permit and require submission of an application for an individual NPDES permit, as detailed in Part 1.6. In these instances, EPA will notify you in writing of the delay, of the need for additional effluent limits, or of the request for submission of an individual NPDES permit application.

1.3.2 Continuation of this Permit.

If this permit is not reissued or replaced prior to the expiration date, it will be administratively continued in accordance with 40 CFR 122.6 and remain in force and effect. If

you were authorized to discharge under this permit prior to the expiration date, any discharges authorized under this permit will automatically remain covered by this permit until the earliest of:

- Your authorization for coverage under a reissued permit or a replacement of this permit following your timely and appropriate submittal of a complete NOI requesting authorization to discharge under the new permit and compliance with the requirements of the new permit; or
- Your submittal of a Notice of Termination; or
- Issuance or denial of an individual permit for the facility's discharges; or
- A formal permit decision by EPA not to reissue this general permit, at which time EPA will identify a reasonable time period for covered dischargers to seek coverage under an alternative general permit or an individual permit. Coverage under this permit will cease at the end of this time period.

1.4 Terminating Coverage.

1.4.1 Submitting a Notice of Termination.

To terminate permit coverage, you must submit a complete and accurate Notice of Termination either electronically (strongly encouraged) at www.epa.gov/npdes/eNOI or using the paper Notice of Termination form included in Appendix H of this permit, to the address listed in Part 7.6.1. Your authorization to discharge under this permit terminates at midnight of the day that a complete Notice of Termination is processed and posted on EPA's website (www.epa.gov/npdes/noisearch). If you submit a Notice of Termination without meeting one or more of the conditions identified in Part 1.4.2, then your Notice of Termination is not valid. You are responsible for meeting the terms of this permit until your authorization is terminated.

1.4.2 When to Submit a Notice of Termination.

You must submit a Notice of Termination within 30 days after one or more of the following conditions have been met:

- A new owner or operator has taken over responsibility for the facility; or
- You have ceased operations at the facility, there are not or no longer will be discharges of stormwater associated with industrial activity from the facility, and you have already implemented necessary sediment and erosion controls as required by Part 2.1.2.5;
- You are a Sector G, H, or J facility and you have met the applicable termination requirements; or
- You have obtained coverage under an individual or alternative general permit for all discharges required to be covered by an NPDES permit, unless EPA has required that you obtain such coverage under authority of Part 1.6.1, in which case coverage under this permit will terminate automatically.

1.5 Conditional Exclusion for No Exposure.

If you are covered by this permit, and become eligible for a no exposure exclusion from permitting under 40 CFR 122.26(g), you may file a No Exposure Certification. You are no longer required to have a permit upon submission of a complete and accurate no exposure certification to EPA. If you are no longer required to have permit coverage because of a no exposure exclusion and have submitted a No Exposure Certification form to EPA, you are not required to submit a Notice of Termination. You must submit a No Exposure Certification to EPA once every five years. File your No Exposure Certification using the eNOI system at www.epa.gov/npdes/eNOI.

1.6 Alternative Permits.

1.6.1 EPA Requiring Coverage under an Alternative Permit.

EPA may require you to apply for and/or obtain authorization to discharge under either an individual NPDES permit or an alternative NPDES general permit in accordance with 40 CFR 122.64 and 124.5. Any interested person may petition EPA to take action under this paragraph. If EPA requires you to apply for an individual NPDES permit, EPA will notify you in writing that a permit application is required. This notification will include a brief statement of the reasons for this decision and will provide application information. In addition, if you are an existing discharger authorized to discharge under this permit, the notice will set a deadline to file the permit application, and will include a statement that on the effective date of the individual NPDES permit, or the alternative general permit as it applies to you, coverage under this general permit will terminate. EPA may grant additional time to submit the application if you request it. If you are covered under this permit and fail to submit an individual NPDES permit application as required by EPA, then the applicability of this permit to you is terminated at the end of the day specified by EPA as the deadline for application submittal. EPA may take appropriate enforcement action for any unpermitted discharge.

1.6.2 Permittee Requesting Coverage under an Alternative Permit.

You may request to be excluded from coverage under this general permit by applying for an individual permit. In such a case, you must submit an individual permit application in accordance with the requirements of 40 CFR 122.26(c)(1)(ii), with reasons supporting the request, to EPA at the applicable EPA Regional Office listed in Part 7.6.2 of this permit. The request may be granted by issuance of an individual permit or authorization of coverage under an alternative general permit if your reasons are adequate to support the request.

When an individual NPDES permit is issued to you or you are authorized to discharge under an alternative NPDES general permit, your authorization to discharge under this permit is terminated on the effective date of the individual permit or the date of authorization of coverage under the alternative general permit.

1.7 Severability.

Invalidation of a portion of this permit does not necessarily render the whole permit invalid. EPA's intent is that the permit is to remain in effect to the extent possible; in the event that any part of this permit is invalidated, EPA will advise the regulated community as to the effect of such invalidation.

2. Control Measures and Effluent Limits.

In the technology-based limits included in Part 2.1 and in Part 8, the term "minimize" means reduce and/or eliminate to the extent achievable using control measures (including best management practices) that are technologically available and economically practicable and achievable in light of best industry practice.

2.1 Control Measures.

You must select, design, install, and implement control measures (including best management practices) to address the selection and design considerations in Part 2.1.1, meet the non-numeric effluent limits in Part 2.1.2, and meet limits contained in applicable effluent limitations guidelines in Part 2.1.3. The selection, design, installation, and implementation of these control measures must be in accordance with good engineering practices and manufacturer's specifications. Note that you may deviate from such manufacturer's specifications where you provide justification for such deviation and include documentation of your rationale in the part of your SWPPP that describes your control measures, consistent with Part 5.1.4. If you find that your control measures are not achieving their intended effect of minimizing pollutant discharges, you must modify these control measures as expeditiously as practicable. Regulated stormwater discharges from your facility include stormwater run-on that commingles with stormwater discharges associated with industrial activity at your facility.

2.1.1 Control Measure Selection and Design Considerations

You must consider the following when selecting and designing control measures:

- preventing stormwater from coming into contact with polluting materials is generally more effective, and less costly, than trying to remove pollutants from stormwater;
- using control measures in combination is more effective than using control measures in isolation for minimizing pollutants in your stormwater discharge;
- assessing the type and quantity of pollutants, including their potential to impact receiving water quality, is critical to designing effective control measures that will achieve the limits in this permit;
- minimizing impervious areas at your facility and infiltrating runoff onsite (including bioretention cells, green roofs, and pervious pavement, among other approaches) can reduce runoff and improve groundwater recharge and stream base flows in local streams, although care must be taken to avoid ground water contamination;

- attenuating flow using open vegetated swales and natural depressions can reduce in-stream impacts of erosive flows;
- conserving and/or restoring of riparian buffers will help protect streams from stormwater runoff and improve water quality; and
- using treatment interceptors (e.g., swirl separators and sand filters) may be appropriate in some instances to minimize the discharge of pollutants.

2.1.2 Non-Numeric Technology-Based Effluent Limits (BPT/BAT/BCT).

2.1.2.1 Minimize Exposure. You must minimize the exposure of manufacturing, processing, and material storage areas (including loading and unloading, storage, disposal, cleaning, maintenance, and fueling operations) to rain, snow, snowmelt, and runoff by either locating these industrial materials and activities inside or protecting them with storm resistant coverings (although significant enlargement of impervious surface area is not recommended). In minimizing exposure, you should pay particular attention to the following:

- use grading, berming, or curbing to prevent runoff of contaminated flows and divert run-on away from these areas;
- locate materials, equipment, and activities so that leaks are contained in existing containment and diversion systems (confine the storage of leaky or leak-prone vehicles and equipment awaiting maintenance to protected areas);
- clean up spills and leaks promptly using dry methods (e.g., absorbents) to prevent the discharge of pollutants;
- use drip pans and absorbents under or around leaky vehicles and equipment or store indoors where feasible;
- use spill/overflow protection equipment;
- drain fluids from equipment and vehicles prior to on-site storage or disposal;
- perform all cleaning operations indoors, under cover, or in bermed areas that prevent runoff and run-on and also that capture any overspray; and
- ensure that all washwater drains to a proper collection system (i.e., not the stormwater drainage system).

The discharge of vehicle and equipment washwater, including tank cleaning operations, is not authorized by this permit. These wastewaters must be covered under a separate NPDES permit, discharged to a sanitary sewer in accordance with applicable industrial pretreatment requirements, or disposed of otherwise in accordance with applicable law.

Note: Industrial materials do not need to be enclosed or covered if stormwater runoff from affected areas will not be discharged to receiving waters or if discharges are authorized under another NPDES permit.

2.1.2.2 Good Housekeeping. You must keep clean all exposed areas that are potential sources of pollutants, using such measures as sweeping at regular intervals, keeping materials orderly and labeled, and storing materials in appropriate containers.

2.1.2.3 Maintenance. You must regularly inspect, test, maintain, and repair all industrial equipment and systems to avoid situations that may result in leaks, spills, and other releases of pollutants in stormwater discharged to receiving waters. You must maintain all control measures that are used to achieve the effluent limits required by this permit in effective operating condition. Nonstructural control measures must also be diligently maintained (e.g., spill response supplies available, personnel appropriately trained). If you find that your control measures need to be replaced or repaired, you must make the necessary repairs or modifications as expeditiously as practicable.

2.1.2.4 Spill Prevention and Response Procedures. You must minimize the potential for leaks, spills and other releases that may be exposed to stormwater and develop plans for effective response to such spills if or when they occur. At a minimum, you must implement:

- Procedures for plainly labeling containers (e.g., “Used Oil,” “Spent Solvents,” “Fertilizers and Pesticides,” etc.) that could be susceptible to spillage or leakage to encourage proper handling and facilitate rapid response if spills or leaks occur;
- Preventative measures such as barriers between material storage and traffic areas, secondary containment provisions, and procedures for material storage and handling;
- Procedures for expeditiously stopping, containing, and cleaning up leaks, spills, and other releases. Employees who may cause, detect, or respond to a spill or leak must be trained in these procedures and have necessary spill response equipment available. If possible, one of these individuals should be a member of your stormwater pollution prevention team (see Part 5.1.1); and
- Procedures for notification of appropriate facility personnel, emergency response agencies, and regulatory agencies. Where a leak, spill, or other release containing a hazardous substance or oil in an amount equal to or in excess of a reportable quantity established under either 40 CFR Part 110, 40 CFR Part 117, or 40 CFR Part 302, occurs during a 24-hour period, you must notify the National Response Center (NRC) at (800) 424-8802 or, in the Washington, DC, metropolitan area, call (202) 267-2675 in accordance with the requirements of 40 CFR Part 110, 40 CFR Part 117, and 40 CFR Part 302 as soon as you have knowledge of the discharge. State or local requirements may necessitate reporting spills or discharges to local emergency response, public health, or drinking water supply agencies. Contact information must be in locations that are readily accessible and available.

2.1.2.5 Erosion and Sediment Controls. You must stabilize exposed areas and contain runoff using structural and/or non-structural control measures to minimize onsite erosion and sedimentation, and the resulting discharge of pollutants. Among other actions you must take to meet this limit, you must place flow velocity dissipation devices at discharge locations and within outfall channels where necessary to reduce erosion and/or settle out pollutants. In selecting, designing, installing, and implementing appropriate control measures, you are encouraged to consult with EPA’s internet-based resources relating to BMPs for erosion and sedimentation, including the sector-specific *Industrial Stormwater*

Fact Sheet Series, (www.epa.gov/npdes/stormwater/msgp), *National Menu of Stormwater BMPs* (www.epa.gov/npdes/stormwater/menuofbmps), and *National Management Measures to Control Nonpoint Source Pollution from Urban Areas* (www.epa.gov/owow/nps/urbanmm/index.html), and any similar State or Tribal publications.

2.1.2.6 Management of Runoff. You must divert, infiltrate, reuse, contain, or otherwise reduce stormwater runoff, to minimize pollutants in your discharges. In selecting, designing, installing, and implementing appropriate control measures, you are encouraged to consult with EPA's internet-based resources relating to runoff management, including the sector-specific *Industrial Stormwater Fact Sheet Series*, (www.epa.gov/npdes/stormwater/msgp), *National Menu of Stormwater BMPs* (www.epa.gov/npdes/stormwater/menuofbmps), and *National Management Measures to Control Nonpoint Source Pollution from Urban Areas* (www.epa.gov/owow/nps/urbanmm/index.html), and any similar State or Tribal publications.

2.1.2.7 Salt Storage Piles or Piles Containing Salt. You must enclose or cover storage piles of salt, or piles containing salt, used for deicing or other commercial or industrial purposes, including maintenance of paved surfaces. You must implement appropriate measures (e.g., good housekeeping, diversions, containment) to minimize exposure resulting from adding to or removing materials from the pile. Piles do not need to be enclosed or covered if stormwater runoff from the piles is not discharged or if discharges from the piles are authorized under another NPDES permit.

2.1.2.8 Sector Specific Non-Numeric Effluent Limits. You must achieve any additional non-numeric limits stipulated in the relevant sector-specific section(s) of Part 8.

2.1.2.9 Employee Training. You must train all employees who work in areas where industrial materials or activities are exposed to stormwater, or who are responsible for implementing activities necessary to meet the conditions of this permit (e.g., inspectors, maintenance personnel), including all members of your Pollution Prevention Team. Training must cover both the specific control measures used to achieve the effluent limits in this Part, and monitoring, inspection, planning, reporting, and documentation requirements in other parts of this permit. EPA recommends training be conducted at least annually (or more often if employee turnover is high).

2.1.2.10 Non-Stormwater Discharges. You must eliminate non-stormwater discharges not authorized by an NPDES permit. See Part 1.2.3 for a list of non-stormwater discharges authorized by this permit.

2.1.2.11 Waste, Garbage and Floatable Debris. You must ensure that waste, garbage, and floatable debris are not discharged to receiving waters by keeping exposed areas free of such materials or by intercepting them before they are discharged.

2.1.2.12 Dust Generation and Vehicle Tracking of Industrial Materials. You must minimize generation of dust and off-site tracking of raw, final, or waste materials.

2.1.3 Numeric Effluent Limitations Based on Effluent Limitations Guidelines

If you are in an industrial category subject to one of the effluent limitations guidelines identified in Table 6-1 (see Part 6.2.2.1), you must meet the effluent limits referenced in Table 2-1 below:

Regulated Activity	40 CFR Part/Subpart	Effluent Limit
Discharges resulting from spray down or intentional wetting of logs at wet deck storage areas	Part 429, Subpart I	See Part 8.A.7
Runoff from phosphate fertilizer manufacturing facilities that comes into contact with any raw materials, finished product, by-products or waste products (SIC 2874)	Part 418, Subpart A	See Part 8.C.4
Runoff from asphalt emulsion facilities	Part 443, Subpart A	See Part 8.D.4
Runoff from material storage piles at cement manufacturing facilities	Part 411, Subpart C	See Part 8.E.5
Mine dewatering discharges at crushed stone, construction sand and gravel, or industrial sand mining facilities	Part 436, Subparts B, C, or D	See Part 8.J.9
Runoff from hazardous waste landfills	Part 445, Subpart A	See Part 8.K.6
Runoff from non-hazardous waste landfills	Part 445, Subpart B	See Part 8.L.10
Runoff from coal storage piles at steam electric generating facilities	Part 423	See Part 8.O.8

2.2 Water Quality-Based Effluent Limitations.

2.2.1 Water Quality Standards

Your discharge must be controlled as necessary to meet applicable water quality standards.

EPA expects that compliance with the other conditions in this permit will control discharges as necessary to meet applicable water quality standards. If at any time you become aware, or EPA determines, that your discharge causes or contributes to an exceedance of applicable water quality standards, you must take corrective action as required in Part 3.1, document the corrective actions as required in Parts 3.4 and 5.4, and report the corrective actions to EPA as required in Part 7.2.

Additionally, EPA may impose additional water quality-based limitations on a site-specific basis, or require you to obtain coverage under an individual permit, if information in your NOI, required reports, or from other sources indicates that your discharges are not controlled as necessary to meet applicable water quality standards.

2.2.2 Discharges to Water Quality Impaired Waters.

2.2.2.1 Existing Discharge to an Impaired Water with an EPA Approved or Established TMDL. If you discharge to an impaired water with an EPA approved or established TMDL, EPA will inform you if any additional limits or controls are necessary for your discharge to be consistent with the assumptions of any available wasteload allocation in the TMDL, or if coverage under an individual permit is necessary in accordance with Part 1.6.1.

2.2.2.2 Existing Discharge to an Impaired Water without an EPA Approved or Established TMDL. If you discharge to an impaired water without an EPA approved or established TMDL, you are required to comply with Part 2.2.1 and the monitoring requirement of Part 6.2.4. Note that this provision also applies to situations where EPA determines that your discharge is not controlled as necessary to meet water quality standards in a downstream water segment, even if your discharge is to a receiving water that is not specifically identified on a Section 303(d) list.

2.2.2.3 New Discharge to an Impaired Water. If your authorization to discharge under this permit relied on Part 1.1.4.7 for a new discharge to an impaired water, you must implement and maintain any control measures or conditions on your site that enabled you to become eligible under Part 1.1.4.7, and modify such measures or conditions as necessary pursuant to any Part 3 corrective actions. You are also required to comply with Part 2.2.1 and the monitoring requirements of Parts 6.2.4.

2.2.3 Tier 2 Antidegradation Requirements for New or Increased Dischargers

If you are a new discharger, or an existing discharger required to notify EPA of an increased discharge consistent with Part 7.4 (i.e., a “planned changes” report), and you discharge directly to waters designated by a State or Tribe as Tier 2 or Tier 2.5 for antidegradation purposes under 40 CFR 131.12(a) (see list of Tier 2 and 2.5 waters on EPA’s website at <http://www.epa.gov/npdes/stormwater/msgp>), EPA may notify you that additional analyses, control measures, or other permit conditions are necessary to comply with the applicable antidegradation requirements, or notify you that an individual permit application is necessary in accordance with Part 1.6.1.

2.3 Requirements Relating to Endangered Species and Historic Properties

If your eligibility under either Part 1.1.4.5 or Part 1.1.4.6 was made possible through your, or another operator’s, agreement to include certain measures or prerequisite actions, or implement certain terms and conditions, you must comply with all such agreed-upon requirements to maintain eligibility under the MSGP.

2.4 Requirements Relating to the National Environmental Policy Act (NEPA) Review

If your eligibility under Part 1.1.2.5 was made possible through your agreement to implement any mitigation measures as a result of the NEPA review process, you must comply with all such agreed-upon measures to maintain eligibility under the MSGP.

3. Corrective Actions

3.1 Conditions Requiring Review and Revision to Eliminate Problem

If any of the following conditions occur, you must review and revise the selection, design, installation, and implementation of your control measures to ensure that the condition is eliminated and will not be repeated in the future:

- an unauthorized release or discharge (e.g., spill, leak, or discharge of non-stormwater not authorized by this or another NPDES permit) occurs at your facility;
- a discharge violates a numeric effluent limit;
- you become aware, or EPA determines, that your control measures are not stringent enough for the discharge to meet applicable water quality standards;
- an inspection or evaluation of your facility by an EPA official, or local, State, or Tribal entity, determines that modifications to the control measures are necessary to meet the non-numeric effluent limits in this permit; or
- you find in your routine facility inspection, quarterly visual assessment, or comprehensive site inspection that your control measures are not being properly operated and maintained.

3.2 Conditions Requiring Review to Determine if Modifications Are Necessary

If any of the following conditions occur, you must review the selection, design, installation, and implementation of your control measures to determine if modifications are necessary to meet the effluent limits in this permit:

- construction or a change in design, operation, or maintenance at your facility significantly changes the nature of pollutants discharged in stormwater from your facility, or significantly increases the quantity of pollutants discharged; or
- the average of 4 quarterly sampling results exceeds an applicable benchmark. If less than 4 benchmark samples have been taken, but the results are such that an exceedence of the 4 quarter average is mathematically certain (i.e., if the sum of quarterly sample results to date is more than 4 times the benchmark level) this is considered a benchmark exceedence, triggering this review.

3.3 Corrective Action Deadlines

You must document your discovery of any of the conditions listed in Parts 3.1 and 3.2 within 24 hours of making such discovery. Subsequently, within 14 days of such discovery, you

must document any corrective action(s) to be taken to eliminate or further investigate the deficiency, or if no corrective action is needed, the basis for that determination. Specific documentation required within 24 hours and 14 days is detailed in Part 3.4. If you determine that changes are necessary following your review, any modifications to your control measures must be made before the next storm event if possible, or as soon as practicable following that storm event. These time intervals are not grace periods, but are schedules considered reasonable for documenting your findings and for making repairs and improvements. They are included in this permit to ensure that the conditions prompting the need for these repairs and improvements are not allowed to persist indefinitely.

3.4 Corrective Action Report

Within 24 hours of discovery of any condition listed in Parts 3.1 and 3.2, you must document the following information (i.e., questions 3-5 of the Corrective Actions section in the Annual Reporting Form, provided in Appendix I):

- Identification of the condition triggering the need for corrective action review;
- Description of the problem identified; and
- Date the problem was identified.

Within 14 days of discovery of any condition listed in Parts 3.1 and 3.2, you must document the following information (i.e., questions 7-11 of the Corrective Actions section in the Annual Reporting Form, provided in Appendix I):

- Summary of corrective action taken or to be taken (or, for triggering events identified in Part 3.2 where you determine that corrective action is not necessary, the basis for this determination);
- Notice of whether SWPPP modifications are required as a result of this discovery or corrective action;
- Date corrective action initiated; and
- Date corrective action completed or expected to be completed.

You must submit this documentation in an annual report as required in Part 7.2 and retain a copy onsite with your SWPPP as required in Part 5.4.

3.5 Effect of Corrective Action

If the event triggering the review is a permit violation (e.g., non-compliance with an effluent limit), correcting it does not remove the original violation. Additionally, failing to take corrective action in accordance with this section is an additional permit violation. EPA will consider the appropriateness and promptness of corrective action in determining enforcement responses to permit violations.

3.6 Substantially Identical Outfalls

If the event triggering corrective action is linked to an outfall that represents other substantially identical outfalls, your review must assess the need for corrective action for each outfall represented by the outfall that triggered the review. Any necessary changes to control measures that affect these other outfalls must also be made before the next storm event if possible, or as soon as practicable following that storm event.

4. Inspections

You must conduct the inspections in Parts 4.1, 4.2, and 4.3 at your facility.

4.1 Routine Facility Inspections.

4.1.1 Routine Facility Inspection Procedures.

Conduct routine facility inspections of all areas of the facility where industrial materials or activities are exposed to stormwater, and of all stormwater control measures used to comply with the effluent limits contained in this permit. Routine facility inspections must be conducted at least quarterly (i.e., once each calendar quarter) although in many instances, more frequent inspection (e.g., monthly) may be appropriate for some types of equipment, processes, and control measures or areas of the facility with significant activities and materials exposed to stormwater. Perform these inspections during periods when the facility is in operation. You must specify the relevant inspection schedules in your SWPPP document as required in Part 5.1.5. These routine inspections must be performed by qualified personnel (for definition see Appendix A) with at least one member of your stormwater pollution prevention team participating. At least once each calendar year, the routine facility inspection must be conducted during a period when a stormwater discharge is occurring.

4.1.2 Routine Facility Inspection Documentation.

You must document the findings of each routine facility inspection performed and maintain this documentation onsite with your SWPPP as required in Part 5.4. You are not required to submit your routine facility inspection findings to EPA, unless specifically requested to do so. At a minimum, your documentation of each routine facility inspection must include:

- The inspection date and time;
- The name(s) and signature(s) of the inspector(s);
- Weather information and a description of any discharges occurring at the time of the inspection;
- Any previously unidentified discharges of pollutants from the site;
- Any control measures needing maintenance or repairs;
- Any failed control measures that need replacement;
- Any incidents of noncompliance observed; and
- Any additional control measures needed to comply with the permit requirements.

Any corrective action required as a result of a routine facility inspection must be performed consistent with Part 3 of this permit.

4.1.3 Exceptions to Routine Facility Inspections.

Inactive and Unstaffed Sites: The requirement to conduct routine facility inspections on a quarterly basis does not apply at a facility that is inactive and unstaffed, as long as there are no industrial materials or activities exposed to stormwater. Such a facility is only required to conduct an annual comprehensive site inspection in accordance with the requirements of Part 4.3. To invoke this exception, you must maintain a statement in your SWPPP pursuant to Part 5.1.5.2 indicating that the site is inactive and unstaffed, and that there are no industrial materials or activities exposed to precipitation, in accordance with the substantive requirements in 40 CFR 122.26(g)(4)(iii). The statement must be signed and certified in accordance with Appendix B, Subsection 11. If circumstances change and industrial materials or activities become exposed to stormwater or your facility becomes active and/or staffed, this exception no longer applies and you must immediately resume quarterly facility inspections. If you are not qualified for this exception at the time you are authorized under this permit, but during the permit term you become qualified because your facility is inactive and unstaffed, and there are no industrial materials or activities that are exposed to stormwater, then you must include the same signed and certified statement as above and retain it with your records pursuant to Part 5.4.

Inactive and unstaffed facilities covered under Sectors G (Metal Mining), H (Coal Mines and Coal Mining-Related Facilities), and J (Non-Metallic Mineral Mining and Dressing), are not required to meet the “no industrial materials or activities exposed to stormwater” standard to be eligible for this exception from routine inspections, consistent with the requirements established in Parts 8.G.8.4, 8.H.8.1, and 8.J.8.1.

4.2 Quarterly Visual Assessment of Stormwater Discharges.

4.2.1 Quarterly Visual Assessment Procedures.

Once each quarter for the entire permit term, you must collect a stormwater sample from each outfall (except as noted in Part 4.2.3) and conduct a visual assessment of each of these samples. These samples are not required to be collected consistent with 40 CFR Part 136 procedures but should be collected in such a manner that the samples are representative of the stormwater discharge.

The visual assessment must be made:

- Of a sample in a clean, clear glass, or plastic container, and examined in a well-lit area;
- On samples collected within the first 30 minutes of an actual discharge from a storm event. If it is not possible to collect the sample within the first 30 minutes of discharge, the sample must be collected as soon as practicable after the first 30

minutes and you must document why it was not possible to take samples within the first 30 minutes. In the case of snowmelt, samples must be taken during a period with a measurable discharge from your site; and

- For storm events, on discharges that occur at least 72 hours (3 days) from the previous discharge. The 72-hour (3-day) storm interval does not apply if you document that less than a 72-hour (3-day) interval is representative for local storm events during the sampling period.

You must visually inspect the sample for the following water quality characteristics:

- Color;
- Odor;
- Clarity;
- Floating solids;
- Settled solids;
- Suspended solids;
- Foam;
- Oil sheen; and
- Other obvious indicators of stormwater pollution.

4.2.2 Quarterly Visual Assessment Documentation.

You must document the results of your visual assessments and maintain this documentation onsite with your SWPPP as required in Part 5.4. You are not required to submit your visual assessment findings to EPA, unless specifically requested to do so. At a minimum, your documentation of the visual assessment must include:

- Sample location(s)
- Sample collection date and time, and visual assessment date and time for each sample;
- Personnel collecting the sample and performing visual assessment, and their signatures;
- Nature of the discharge (i.e., runoff or snowmelt);
- Results of observations of the stormwater discharge;
- Probable sources of any observed stormwater contamination,
- If applicable, why it was not possible to take samples within the first 30 minutes.

Any corrective action required as a result of a quarterly visual assessment must be performed consistent with Part 3 of this permit.

4.2.3 Exceptions to Quarterly Visual Assessments.

Adverse Weather Conditions: When adverse weather conditions prevent the collection of samples during the quarter, you must take a substitute sample during the next qualifying storm event. Documentation of the rationale for no visual assessment for the quarter must be included with your SWPPP records as described in Part 5.4. Adverse conditions are

those that are dangerous or create inaccessibility for personnel, such as local flooding, high winds, or electrical storms, or situations that otherwise make sampling impractical, such as drought or extended frozen conditions.

Climates with Irregular Stormwater Runoff: If your facility is located in an area where limited rainfall occurs during many parts of the year (e.g., arid or semi-arid climate) or in an area where freezing conditions exist that prevent runoff from occurring for extended periods, then your samples for the quarterly visual assessments may be distributed during seasons when precipitation runoff occurs.

Areas Subject to Snow: In areas subject to snow, at least one quarterly visual assessment must capture snowmelt discharge, as described in Part 6.1.3, taking into account the exception described above for climates with irregular stormwater runoff.

Inactive and unstaffed sites: The requirement for a quarterly visual assessment does not apply at a facility that is inactive and unstaffed, as long as there are no industrial materials or activities exposed to stormwater. To invoke this exception, you must maintain a statement in your SWPPP as required in Part 5.1.5.2 indicating that the site is inactive and unstaffed, and that there are no industrial materials or activities exposed to precipitation, in accordance with the substantive requirements in 40 CFR 122.26(g)(4)(iii). The statement must be signed and certified in accordance with Appendix B, Subsection 11. If circumstances change and industrial materials or activities become exposed to stormwater or your facility becomes active and/or staffed, this exception no longer applies and you must immediately resume quarterly visual assessments. If you are not qualified for this exception at the time you are authorized under this permit, but during the permit term you become qualified because your facility is inactive and unstaffed, and there are no industrial materials or activities that are exposed to stormwater, then you must include the same signed and certified statement as above and retain it with your records pursuant to Part 5.4.

Inactive and unstaffed facilities covered under Sectors G (Metal Mining), H (Coal Mines and Coal Mining-Related Facilities), and J (Non-Metallic Mineral Mining and Dressing), are not required to meet the “no industrial materials or activities exposed to stormwater” standard to be eligible for this exception from quarterly visual assessment, consistent with the requirements established in Parts 8.G.8.4, 8.H.8.1, and 8.J.8.1.

Substantially identical outfalls: If your facility has two or more outfalls that you believe discharge substantially identical effluents, as documented in Part 5.1.5.2, you may conduct quarterly visual assessments of the discharge at just one of the outfalls and report that the results also apply to the substantially identical outfall(s) provided that you perform visual assessments on a rotating basis of each substantially identical outfall throughout the period of your coverage under this permit.

If stormwater contamination is identified through visual assessment performed at a substantially identical outfall, you must assess and modify your control measures as appropriate for each outfall represented by the monitored outfall.

4.3 Comprehensive Site Inspections.

4.3.1 Comprehensive Site Inspection Procedures.

You must conduct annual comprehensive site inspections while you are covered under this permit. Annual, as defined in this Part, means once during each of the following inspection periods beginning with the period you are authorized to discharge under this permit:

Year 1:	September 29, 2008 – September 29, 2009
Year 2:	September 29, 2009 – September 29, 2010
Year 3:	September 29, 2010 – September 29, 2011
Year 4:	September 29, 2011 – September 29, 2012
Year 5:	September 29, 2012 – September 29, 2013

You are waived from having to perform a comprehensive site inspection for an inspection period, as defined above, if you obtain authorization to discharge less than three months before the end of that inspection period.

Should your coverage be administratively continued after the expiration date of this permit, you must continue to perform these inspections annually until you are no longer covered.

Comprehensive site inspections must be conducted by qualified personnel with at least one member of your stormwater pollution prevention team participating in the comprehensive site inspections.

Your comprehensive site inspections must cover all areas of the facility affected by the requirements in this permit, including the areas identified in the SWPPP as potential pollutant sources (see Part 5.1.3) where industrial materials or activities are exposed to stormwater, any areas where control measures are used to comply with the effluent limits in Part 2, and areas where spills and leaks have occurred in the past 3 years. The inspections must also include a review of monitoring data collected in accordance with Part 6.2. Inspectors must consider the results of the past year's visual and analytical monitoring when planning and conducting inspections. Inspectors must examine the following:

- Industrial materials, residue, or trash that may have or could come into contact with stormwater;
- Leaks or spills from industrial equipment, drums, tanks, and other containers;
- Offsite tracking of industrial or waste materials, or sediment where vehicles enter or exit the site;
- Tracking or blowing of raw, final, or waste materials from areas of no exposure to exposed areas; and
- Control measures needing replacement, maintenance, or repair.

Stormwater control measures required by this permit must be observed to ensure that they are functioning correctly. If discharge locations are inaccessible, nearby downstream locations must be inspected.

Your annual comprehensive site inspection may also be used as one of the routine inspections, as long as all components of both types of inspections are included.

4.3.2 Comprehensive Site Inspection Documentation.

You must document the findings of each comprehensive site inspection and maintain this documentation onsite with your SWPPP as required in Part 5.4. In addition, you must submit this documentation in an annual report as required in Part 7.2. At a minimum, your documentation of the comprehensive site inspection must include (see the Annual Reporting Form included as Appendix I):

- The date of the inspection;
- The name(s) and title(s) of the personnel making the inspection;
- Findings from the examination of areas of your facility identified in Part 4.3.1;
- All observations relating to the implementation of your control measures including:
 - previously unidentified discharges from the site,
 - previously unidentified pollutants in existing discharges,
 - evidence of, or the potential for, pollutants entering the drainage system;
 - evidence of pollutants discharging to receiving waters at all facility outfall(s), and the condition of and around the outfall, including flow dissipation measures to prevent scouring, and
 - additional control measures needed to address any conditions requiring corrective action identified during the inspection.
- Any required revisions to the SWPPP resulting from the inspection;
- Any incidents of noncompliance observed or a certification stating the facility is in compliance with this permit (if there is no noncompliance); and
- A statement, signed and certified in accordance with Appendix B, Subsection 11 of the permit.

Any corrective action required as a result of the comprehensive site inspection must be performed consistent with Part 3 of this permit.

5. Stormwater Pollution Prevention Plan (SWPPP).

You must prepare a SWPPP for your facility before submitting your Notice of Intent (NOI) for permit coverage. If you prepared a SWPPP for coverage under a previous NPDES permit, you must review and update the SWPPP to implement all provisions of this permit prior to submitting your NOI. The SWPPP does not contain effluent limitations; the limitations are contained in Part 2 of the permit, and for some sectors, Parts 8 and 9 of the permit. The SWPPP is intended to document the selection, design, and installation of control measures. As distinct from the SWPPP, the additional documentation requirements (see Part 5.4) are intended to

document the implementation (including inspection, maintenance, monitoring, and corrective action) of the permit requirements.

5.1 Contents of Your SWPPP.

For coverage under this permit, your SWPPP must contain all of the following elements:

- Stormwater pollution prevention team (see Part 5.1.1);
- Site description (see Part 5.1.2);
- Summary of potential pollutant sources (see Part 5.1.3);
- Description of control measures (see Part 5.1.4);
- Schedules and procedures (see Part 5.1.5);
- Documentation to support eligibility considerations under other federal laws (see Part 5.1.6); and
- Signature requirements (see Part 5.1.7).

Where your SWPPP refers to procedures in other facility documents, such as a Spill Prevention, Control and Countermeasure (SPCC) Plan or an Environmental Management System (EMS) developed for a National Environmental Performance Track facility, copies of the relevant portions of those documents must be kept with your SWPPP.

5.1.1 Stormwater Pollution Prevention Team.

You must identify the staff members (by name or title) that comprise the facility's stormwater pollution prevention team as well as their individual responsibilities. Your stormwater pollution prevention team is responsible for assisting the facility manager in developing and revising the facility's SWPPP as well as maintaining control measures and taking corrective actions where required. Each member of the stormwater pollution prevention team must have ready access to either an electronic or paper copy of applicable portions of this permit and your SWPPP.

5.1.2 Site Description.

Your SWPPP must include the following:

- *Activities at the Facility.* Provide a description of the nature of the industrial activities at your facility.
- *General location map.* Provide a general location map (e.g., U.S. Geological Survey (USGS) quadrangle map) with enough detail to identify the location of your facility and all receiving waters for your stormwater discharges.
- *Site map.* Provide a map showing:
 - the size of the property in acres;
 - the location and extent of significant structures and impervious surfaces;
 - directions of stormwater flow (use arrows);
 - locations of all existing structural control measures;

- locations of all receiving waters in the immediate vicinity of your facility, indicating if any of the waters are impaired and, if so, whether the waters have TMDLs established for them;
- locations of all stormwater conveyances including ditches, pipes, and swales;
- locations of potential pollutant sources identified under Part 5.1.3.2;
- locations where significant spills or leaks identified under Part 5.1.3.3 have occurred;
- locations of all stormwater monitoring points;
- locations of stormwater inlets and outfalls, with a unique identification code for each outfall (e.g., Outfall No. 1, No. 2, etc), indicating if you are treating one or more outfalls as “substantially identical” under Parts 4.2.3, 5.1.5.2, and 6.1.1, and an approximate outline of the areas draining to each outfall;
- municipal separate storm sewer systems, where your stormwater discharges to them;
- locations and descriptions of all non-stormwater discharges identified under Part 2.1.2.10;
- locations of the following activities where such activities are exposed to precipitation:
 - fueling stations;
 - vehicle and equipment maintenance and/or cleaning areas;
 - loading/unloading areas;
 - locations used for the treatment, storage, or disposal of wastes;
 - liquid storage tanks;
 - processing and storage areas;
 - immediate access roads and rail lines used or traveled by carriers of raw materials, manufactured products, waste material, or by-products used or created by the facility;
 - transfer areas for substances in bulk; and
 - machinery; and
- locations and sources of run-on to your site from adjacent property that contains significant quantities of pollutants.

5.1.3 Summary of Potential Pollutant Sources.

You must document areas at your facility where industrial materials or activities are exposed to stormwater and from which allowable non-stormwater discharges are released. *Industrial materials or activities* include, but are not limited to: material handling equipment or activities; industrial machinery; raw materials; industrial production and processes; and intermediate products, by-products, final products, and waste products. *Material handling activities* include, but are not limited to: the storage, loading and unloading, transportation, disposal, or conveyance of any raw material, intermediate product, final product or waste product. For each area identified, the description must include:

5.1.3.1 Activities in the area. A list of the industrial activities exposed to stormwater (e.g., material storage; equipment fueling, maintenance, and cleaning; cutting steel beams).

5.1.3.2 Pollutants. A list of the pollutant(s) or pollutant constituents (e.g., crankcase oil, zinc, sulfuric acid, and cleaning solvents) associated with each identified activity. The pollutant list must include all significant materials that have been handled, treated, stored, or disposed, and that have been exposed to stormwater in the 3 years prior to the date you prepare or amend your SWPPP.

5.1.3.3 Spills and Leaks. You must document where potential spills and leaks could occur that could contribute pollutants to stormwater discharges, and the corresponding outfall(s) that would be affected by such spills and leaks. You must document all significant spills and leaks of oil or toxic or hazardous pollutants that actually occurred at exposed areas, or that drained to a stormwater conveyance, in the 3 years prior to the date you prepare or amend your SWPPP.

Note: Significant spills and leaks include, but are not limited to, releases of oil or hazardous substances in excess of quantities that are reportable under CWA Section 311 (see 40 CFR 110.6 and 40 CFR 117.21) or Section 102 of the Comprehensive Environmental Response, Compensation and Liability Act (CERCLA), 42 USC §9602. This permit does not relieve you of the reporting requirements of 40 CFR 110, 40 CFR 117, and 40 CFR 302 relating to spills or other releases of oils or hazardous substances.

5.1.3.4 Non-Stormwater Discharges. You must document that you have evaluated for the presence of non-stormwater discharges and that all unauthorized discharges have been eliminated. Documentation of your evaluation must include:

- The date of any evaluation;
- A description of the evaluation criteria used;
- A list of the outfalls or onsite drainage points that were directly observed during the evaluation;
- The different types of non-stormwater discharge(s) and source locations; and
- The action(s) taken, such as a list of control measures used to eliminate unauthorized discharge(s), if any were identified. For example, a floor drain was sealed, a sink drain was re-routed to sanitary, or an NPDES permit application was submitted for an unauthorized cooling water discharge.

5.1.3.5 Salt Storage. You must document the location of any storage piles containing salt used for deicing or other commercial or industrial purposes.

5.1.3.6 Sampling Data. You must summarize all stormwater discharge sampling data collected at your facility during the previous permit term.

5.1.4 Description of Control Measures.

5.1.4.1 Control Measures to Meet Technology-Based and Water Quality-Based Effluent Limits. You must document the location and type of control measures you have installed and implemented at your site to achieve the non-numeric effluent limits in Part 2.1.2, and where applicable in Part 8, the effluent limitations guidelines-based limits in Part 2.1.3,

the water quality-based effluent limits in Part 2.2, and any agreed-upon endangered species or NEPA-related requirements in Parts 2.3 and 2.4, and describe how you addressed the control measure selection and design considerations in Part 2.1.1. This documentation must describe how the control measures at your site address both the pollutant sources identified in Part 5.1.3, and any stormwater run-on that commingles with any discharges covered under this permit.

5.1.5 Schedules and Procedures

5.1.5.1 *Pertaining to Control Measures Used to Comply with the Effluent Limits in Part 2.*

The following must be documented in your SWPPP:

- Good Housekeeping (See Part 2.1.2.2) – A schedule for regular pickup and disposal of waste materials, along with routine inspections for leaks and conditions of drums, tanks and containers;
- Maintenance (See Part 2.1.2.3) – Preventative maintenance procedures, including regular inspections, testing, maintenance, and repair of all industrial equipment and systems, and control measures, to avoid situations that may result in leaks, spills, and other releases, and any back-up practices in place should a runoff event occur while a control measure is off-line;
- Spill Prevention and Response Procedures (See Part 2.1.2.4) – Procedures for preventing and responding to spills and leaks. You may reference the existence of other plans for Spill Prevention Control and Countermeasure (SPCC) developed for the facility under Section 311 of the CWA or BMP programs otherwise required by an NPDES permit for the facility, provided that you keep a copy of that other plan onsite and make it available for review consistent with Part 5.3; and
- Employee Training (Part 2.1.2.9) – A schedule for all types of necessary training.

5.1.5.2 *Pertaining to Monitoring and Inspection.* You must document in your SWPPP your procedures for conducting the five types of analytical monitoring specified by this permit, where applicable to your facility, including:

- Benchmark monitoring (see Part 6.2.1);
- Effluent limitations guidelines monitoring (see Part 6.2.2);
- State- or Tribal-specific monitoring (see Part 6.2.3);
- Impaired waters monitoring (see Part 6.2.4); and
- Other monitoring as required by EPA (see Part 6.2.5).

For each type of monitoring, your SWPPP must document:

- Locations where samples are collected, including any determination that two or more outfalls are substantially identical;
- Parameters for sampling and the frequency of sampling for each parameter;
- Schedules for monitoring at your facility, including schedule for alternate monitoring periods for climates with irregular stormwater runoff (see Part 6.1.6);

- Any numeric control values (benchmarks, effluent limitations guidelines, TMDL-related requirements, or other requirements) applicable to discharges from each outfall; and
- Procedures (e.g., responsible staff, logistics, laboratory to be used, etc.) for gathering storm event data, as specified in Part 6.1.

If you are invoking the exception for inactive and unstaffed sites for benchmark monitoring, you must include in your SWPPP the information to support this claim as required by Part 6.2.1.3.

You must document the following in your SWPPP if you plan to use the substantially identical outfall exception for your quarterly visual assessment requirements in Part 4.2 or your benchmark monitoring requirements in Part 6.2.1:

- Location of each of the substantially identical outfalls;
- Description of the general industrial activities conducted in the drainage area of each outfall;
- Description of the control measures implemented in the drainage area of each outfall;
- Description of the exposed materials located in the drainage area of each outfall that are likely to be significant contributors of pollutants to stormwater discharges;
- An estimate of the runoff coefficient of the drainage areas (low = under 40%; medium = 40 to 65%; high = above 65%); and
- Why the outfalls are expected to discharge substantially identical effluents.

You must document in your SWPPP your procedures for performing, as appropriate, the three types of inspections specified by this permit, including:

- Routine facility inspections (see Part 4.1);
- Quarterly visual assessment of stormwater discharges (see Part 4.2); and
- Comprehensive site inspections (see Part 4.3).

For each type of inspection performed, your SWPPP must identify:

- Person(s) or positions of person(s) responsible for inspection;
- Schedules for conducting inspections, including tentative schedule for facilities in climates with irregular stormwater runoff discharges (see Part 4.2.3); and
- Specific items to be covered by the inspection, including schedules for specific outfalls.

If you are invoking the exception for inactive and unstaffed sites relating to routine facility inspections and quarterly visual assessments, you must include in your SWPPP the information to support this claim as required by Parts 4.1.3 and 4.2.3.

5.1.6 Documentation to Support Eligibility Considerations Under Other Federal Laws.

5.1.6.1 Documentation Regarding Endangered Species. You must keep with your SWPPP the documentation supporting your determination with regard to Part 1.1.4.5 (Endangered and Threatened Species and Critical Habitat Protection).

5.1.6.2 Documentation Regarding Historic Properties. You must keep with your SWPPP the documentation supporting your determination with regard to Part 1.1.4.6 (Historic Properties Preservation).

5.1.6.3 Documentation Regarding NEPA Review. You must keep with your SWPPP the documentation supporting your certification of eligibility under Part 1.1.2.5 (Discharges Subject to Any New Source Performance Standards).

5.1.7 Signature Requirements.

You must sign and date your SWPPP in accordance with Appendix B, Subsection 11, including the date of signature.

5.2 Required SWPPP Modifications.

You must modify your SWPPP whenever necessary to address any of the triggering conditions for corrective action in Part 3.1 and to ensure that they do not reoccur, or to reflect changes implemented when a review following the triggering conditions in Part 3.2 indicates that changes to your control measures are necessary to meet the effluent limits in this permit. Changes to your SWPPP document must be made in accordance with the corrective action deadlines in Parts 3.3 and 3.4, and must be signed and dated in accordance with Appendix B, Subsection 11.

5.3 SWPPP Availability.

You must retain a copy of the current SWPPP required by this permit at the facility, and it must be immediately available to EPA; a State, Tribal, or local agency approving stormwater management plans; the operator of an MS4 receiving discharges from the site; and representatives of the U.S. Fish and Wildlife Service (USFWS) or the National Marine Fisheries Service (NMFS) at the time of an onsite inspection or upon request. EPA may provide access to portions of your SWPPP to a member of the public upon request. Confidential Business Information (CBI) may be withheld from the public, but may not be withheld from those staff cleared for CBI review within EPA, USFWS, or NMFS.

EPA encourages you to post your SWPPP online and provide the website address on your NOI.

5.4 Additional Documentation Requirements.

You are required to keep the following inspection, monitoring, and certification records with your SWPPP that together keep your records complete and up-to-date, and demonstrate your full compliance with the conditions of this permit:

- A copy of the NOI submitted to EPA along with any correspondence exchanged between you and EPA specific to coverage under this permit;
- A copy of the acknowledgment letter you receive from the NOI Processing Center or eNOI system assigning your permit tracking number;
- A copy of this permit (an electronic copy easily available to SWPPP personnel is also acceptable);
- Descriptions and dates of any incidences of significant spills, leaks, or other releases that resulted in discharges of pollutants to waters of the U.S., through stormwater or otherwise; the circumstances leading to the release and actions taken in response to the release; and measures taken to prevent the recurrence of such releases (see Part 2.1.2.4);
- Records of employee training, including date training received (see Part 2.1.2.9);
- Documentation of maintenance and repairs of control measures, including the date(s) of regular maintenance, date(s) of discovery of areas in need of repair/replacement, and for repairs, date(s) that the control measure(s) returned to full function, and the justification for any extended maintenance/repair schedules (see Part 2.1.2.3);
- All inspection reports, including the Routine Facility Inspection Reports (see Part 4.1), the Quarterly Visual Assessment Reports (see Part 4.2), and the Comprehensive Site Inspection Reports (see Part 4.3);
- Description of any deviations from the schedule for visual assessments and/or monitoring, and the reason for the deviations (e.g., adverse weather or it was impracticable to collect samples within the first 30 minutes of a measurable storm event) (see Parts 4.2.1, 6.1.4, and 6.2.1.2);
- Description of any corrective action taken at your site, including triggering event and dates when problems were discovered and modifications occurred;
- Documentation of any benchmark exceedances and how they were responded to, including either (1) corrective action taken, (2) a finding that the exceedance was due to natural background pollutant levels, or (3) a finding that no further pollutant reductions were technologically available and economically practicable and achievable in light of best industry practice consistent with Part 6.2.1.2;
- Documentation to support any determination that pollutants of concern are not expected to be present above natural background levels if you discharge directly to impaired waters, and that such pollutants were not detected in your discharge or were solely attributable to natural background sources (see Part 6.2.4.2); and
- Documentation to support your claim that your facility has changed its status from active to inactive and unstaffed with respect to the requirements to conduct routine facility inspections (see Part 4.1.3), quarterly visual assessments (see Part 4.2.3), and/or benchmark monitoring (see Part 6.2.1.3).

6. Monitoring.

You must collect and analyze stormwater samples and document monitoring activities consistent with the procedures described in Part 6 and Appendix B, Subsections 10 – 12, and any additional sector-specific or State/Tribal-specific requirements in Parts 8 and 9, respectively. Refer to Part 7 for reporting and recordkeeping requirements.

6.1 Monitoring Procedures

6.1.1 Monitored Outfalls.

Applicable monitoring requirements apply to each outfall authorized by this permit, except as otherwise exempt from monitoring as a “substantially identical outfall.” If your facility has two or more outfalls that you believe discharge substantially identical effluents, based on the similarities of the general industrial activities and control measures, exposed materials that may significantly contribute pollutants to stormwater, and runoff coefficients of their drainage areas, you may monitor the effluent of just one of the outfalls and report that the results also apply to the substantially identical outfall(s). As required in Part 5.1.5.2, your SWPPP must identify each outfall authorized by this permit and describe the rationale for any substantially identical outfall determinations. The allowance for monitoring only one of the substantially identical outfalls is not applicable to any outfalls with numeric effluent limitations. You are required to monitor each outfall covered by a numeric effluent limit as identified in Part 6.2.2.

6.1.2 Commingled Discharges.

If discharges authorized by this permit commingle with discharges not authorized under this permit, any required sampling of the authorized discharges must be performed at a point before they mix with other waste streams, to the extent practicable.

6.1.3 Measurable Storm Events.

All required monitoring must be performed on a storm event that results in an actual discharge from your site (“measurable storm event”) that follows the preceding measurable storm event by at least 72 hours (3 days). The 72-hour (3-day) storm interval does not apply if you are able to document that less than a 72-hour (3-day) interval is representative for local storm events during the sampling period. In the case of snowmelt, the monitoring must be performed at a time when a measurable discharge occurs at your site.

For each monitoring event, except snowmelt monitoring, you must identify the date and duration (in hours) of the rainfall event, rainfall total (in inches) for that rainfall event, and time (in days) since the previous measurable storm event. For snowmelt monitoring, you must identify the date of the sampling event.

6.1.4 Sample Type.

You must take a minimum of one grab sample from a discharge resulting from a measurable storm event as described in Part 6.1.3. Samples must be collected within the first 30 minutes of a measurable storm event. If it is not possible to collect the sample within the first 30 minutes of a measurable storm event, the sample must be collected as soon as practicable after the first 30 minutes and documentation must be kept with the SWPPP explaining why it was not possible to take samples within the first 30 minutes. In the case of snowmelt, samples must be taken during a period with a measurable discharge.

6.1.5 Adverse Weather Conditions.

When adverse weather conditions as described in Part 4.2.3 prevent the collection of samples according to the relevant monitoring schedule, you must take a substitute sample during the next qualifying storm event. Adverse weather does not exempt you from having to file a benchmark monitoring report in accordance with your sampling schedule. You must report any failure to monitor as specified in Part 7.1 indicating the basis for not sampling during the usual reporting period.

6.1.6 Climates with Irregular Stormwater Runoff.

If your facility is located in areas where limited rainfall occurs during parts of the year (e.g., arid or semi-arid climates) or in areas where freezing conditions exist that prevent runoff from occurring for extended periods, required monitoring events may be distributed during seasons when precipitation occurs, or when snowmelt results in a measurable discharge from your site. You must still collect the required number of samples.

6.1.7 Monitoring Periods.

Monitoring requirements in this permit begin in the first full quarter following either April 1, 2009 or your date of discharge authorization, whichever date comes later. If your monitoring is required on a quarterly basis (e.g., benchmark monitoring), you must monitor at least once in each of the following 3-month intervals:

- January 1 – March 31;
- April 1 – June 30;
- July 1 – September 30; and
- October 1 – December 31.

For example, if you obtain permit coverage on June 2, 2009, then your first monitoring quarter is July 1 - September 30, 2009. This monitoring schedule may be modified in accordance with Part 6.1.6 if the revised schedule is documented with your SWPPP and provided to EPA with your first monitoring report.

6.1.8 Monitoring for Allowable Non-Stormwater Discharges

You are only required to monitor allowable non-stormwater discharges (as delineated in Part 1.1.3) when they are commingled with stormwater discharges associated with industrial activity.

6.2 Required Monitoring.

This permit includes five types of required analytical monitoring, one or more of which may apply to your discharge:

- Quarterly benchmark monitoring (see Part 6.2.1)
- Annual effluent limitations guidelines monitoring (see Part 6.2.2);
- State- or Tribal-specific monitoring (see Part 6.2.3);
- Impaired waters monitoring (see Part 6.2.4); and
- Other monitoring as required by EPA (see Part 6.2.5).

When more than one type of monitoring for the same parameter at the same outfall applies (e.g., total suspended solids once per year for an effluent limit and once per quarter for benchmark monitoring at a given outfall), you may use a single sample to satisfy both monitoring requirements (i.e., one sample satisfying both the annual effluent limit sample and one of the 4 quarterly benchmark monitoring samples).

All required monitoring must be conducted in accordance with the procedures described in Appendix B, Subsection 10.D.

6.2.1 Benchmark Monitoring.

This permit stipulates pollutant benchmark concentrations that may be applicable to your discharge. The benchmark concentrations are not effluent limitations; a benchmark exceedance, therefore, is not a permit violation. Benchmark monitoring data are primarily for your use to determine the overall effectiveness of your control measures and to assist you in knowing when additional corrective action(s) may be necessary to comply with the effluent limitations in Part 2.

6.2.1.1 Applicability of Benchmark Monitoring. You must monitor for any benchmark parameters specified for the industrial sector(s), both primary industrial activity and any co-located industrial activities, applicable to your discharge. Your industry-specific benchmark concentrations are listed in the sector-specific sections of Part 8. If your facility is in one of the industrial sectors subject to benchmark concentrations that are hardness-dependent, you are required to submit to EPA with your first benchmark report a hardness value, established consistent with the procedures in Appendix J, which is representative of your receiving water.

Samples must be analyzed consistent with 40 CFR Part 136 analytical methods and using test procedures with quantitation limits at or below benchmark values for all benchmark parameters for which you are required to sample.

6.2.1.2 Benchmark Monitoring Schedule. Benchmark monitoring must be conducted quarterly, as identified in Part 6.1.7, for your first 4 full quarters of permit coverage commencing no earlier than April 1, 2009. Facilities in climates with irregular stormwater runoff, as described in Part 6.1.6, may modify this quarterly schedule provided that this revised schedule is reported to EPA when the first benchmark sample is collected and reported, and that this revised schedule is kept with the facility's SWPPP as specified in Part 5.4.

Data not exceeding benchmarks: After collection of 4 quarterly samples, if the average of the 4 monitoring values for any parameter does not exceed the benchmark, you have fulfilled your monitoring requirements for that parameter for the permit term. For averaging purposes, use a value of zero for any individual sample parameter, analyzed using procedures consistent with Part 6.2.1.1, which is determined to be less than the method detection limit. For sample values that fall between the method detection level and the quantitation limit (i.e., a confirmed detection but below the level that can be reliably quantified), use a value halfway between zero and the quantitation limit.

Data exceeding benchmarks: After collection of 4 quarterly samples, if the average of the 4 monitoring values for any parameter exceeds the benchmark, you must, in accordance with Part 3.2, review the selection, design, installation, and implementation of your control measures to determine if modifications are necessary to meet the effluent limits in this permit, and either:

- Make the necessary modifications and continue quarterly monitoring until you have completed 4 additional quarters of monitoring for which the average does not exceed the benchmark; or
- Make a determination that no further pollutant reductions are technologically available and economically practicable and achievable in light of best industry practice to meet the technology-based effluent limits or are necessary to meet the water-quality-based effluent limitations in Parts 2 of this permit, in which case you must continue monitoring once per year. You must also document your rationale for concluding that no further pollutant reductions are achievable, and retain all records related to this documentation with your SWPPP. You must also notify EPA of this determination in your next benchmark monitoring report.

In accordance with Part 3.2, you must review your control measures and perform any required corrective action immediately (or document why no corrective action is required), without waiting for the full 4 quarters of monitoring data, if an exceedance of the 4 quarter average is mathematically certain. If after modifying your control measures and conducting 4 additional quarters of monitoring, your average still exceeds the benchmark (or if an exceedance of the benchmark by the 4 quarter average is mathematically certain prior to conducting the full 4 additional quarters of monitoring), you must again review your control measures and take one of the two actions above.

Natural background pollutant levels: Following the first 4 quarters of benchmark monitoring (or sooner if the exceedance is triggered by less than 4 quarters of data, see above), if the average concentration of a pollutant exceeds a benchmark value, and you determine that exceedance of the benchmark is attributable solely to the presence of that pollutant in the natural background, you are not required to perform corrective action or additional benchmark monitoring provided that:

- The average concentration of your benchmark monitoring results is less than or equal to the concentration of that pollutant in the natural background;
- You document and maintain with your SWPPP, as required in Part 5.4, your supporting rationale for concluding that benchmark exceedances are in fact attributable solely to natural background pollutant levels. You must include in your supporting rationale any data previously collected by you or others (including literature studies) that describe the levels of natural background pollutants in your stormwater discharge; and
- You notify EPA on your final quarterly benchmark monitoring report that the benchmark exceedances are attributable solely to natural background pollutant levels.

Natural background pollutants include those substances that are naturally occurring in soils or groundwater. Natural background pollutants do not include legacy pollutants from earlier activity on your site, or pollutants in run-on from neighboring sources which are not naturally occurring.

6.2.1.3 Exception for Inactive and Unstaffed Sites. The requirement for benchmark monitoring does not apply at a facility that is inactive and unstaffed, as long as there are no industrial materials or activities exposed to stormwater. To invoke this exception, you must do the following:

- Maintain a statement onsite with your SWPPP stating that the site is inactive and unstaffed, and that there are no industrial materials or activities exposed to stormwater in accordance with the substantive requirements in 40 CFR 122.26(g) and sign and certify the statement in accordance with Appendix B, Subsection 11; and
- If circumstances change and industrial materials or activities become exposed to stormwater or your facility becomes active and/or staffed, this exception no longer applies and you must immediately begin complying with the applicable benchmark monitoring requirements under Part 6.2 as if you were in your first year of permit coverage. You must indicate in your first benchmark monitoring report that your facility has materials or activities exposed to stormwater or has become active and/or staffed.
- If you are not qualified for this exception at the time you are authorized under this permit, but during the permit term you become qualified because your facility is inactive and unstaffed, and there are no industrial materials or activities that are exposed to stormwater, then you must notify EPA of this change in your next benchmark monitoring report. You may discontinue benchmark monitoring once

you have notified EPA, and prepared and signed the certification statement described above concerning your facility's qualification for this special exception.

Note: This exception has different requirements for Sectors G, H, and J (see Part 8).

6.2.2 Effluent Limitations Monitoring.

6.2.2.1 Monitoring Based on Effluent Limitations Guidelines. Table 6-1 identifies the stormwater discharges subject to effluent limitation guidelines that are authorized for coverage under this permit. Beginning in the first full quarter following April 1, 2009 or your date of discharge authorization, whichever date comes later, you must monitor once per year at each outfall containing the discharges identified in Table 6-1 for the parameters specified in the sector-specific section of Part 8.

Table 6-1. Required Monitoring for Effluent Limits Based on Effluent Limitations Guidelines

Regulated Activity	Effluent Limit	Monitoring Frequency	Sample Type
Discharges resulting from spray down or intentional wetting of logs at wet deck storage areas	See Part 8.A.7	1/year	Grab
Runoff from phosphate fertilizer manufacturing facilities that comes into contact with any raw materials, finished product, by-products or waste products (SIC 2874)	See Part 8.C.4	1/year	Grab
Runoff from asphalt emulsion facilities	See Part 8.D.4	1/year	Grab
Runoff from material storage piles at cement manufacturing facilities	See Part 8.E.5	1/year	Grab
Mine dewatering discharges at crushed stone, construction sand and gravel, or industrial sand mining facilities	See Part 8.J.9	1/year	Grab
Runoff from hazardous waste landfills	See Part 8.K.6	1/year	Grab
Runoff from non-hazardous waste landfills	See Part 8.L.10	1/year	Grab
Runoff from coal storage piles at steam electric generating facilities	See Part 8.O.8	1/year	Grab

6.2.2.2 Substantially Identical Outfalls. You must monitor each outfall discharging runoff from any regulated activity identified in Table 6-1. The substantially identical outfall monitoring provisions are not available for numeric effluent limits monitoring.

6.2.3 State or Tribal Provisions Monitoring

6.2.3.1 Sectors Required to Conduct State or Tribal Monitoring. You must comply with any State or Tribal monitoring requirements (see Part 9) applicable to your facility's location.

6.2.3.2 State or Tribal Monitoring Schedule. If a monitoring frequency is not specified for an applicable requirement in Part 9, you must monitor once per year for the entire permit term.

6.2.4 Discharges to Impaired Waters Monitoring.

6.2.4.1 Permittees Required to Monitor Discharges to Impaired Waters. If you discharge to an impaired water, you must monitor for all pollutants for which the waterbody is impaired and for which a standard analytical method exists (see 40 CFR Part 136).

If the pollutant for which the waterbody is impaired is suspended solids, turbidity or sediment/sedimentation, you must monitor for Total Suspended Solids (TSS). If the pollutant for which the waterbody is impaired is expressed in the form of an indicator or surrogate pollutant, you must monitor for that indicator or surrogate pollutant. No monitoring is required when a waterbody's biological communities are impaired but no pollutant, including indicator or surrogate pollutants, is specified as causing the impairment, or when a waterbody's impairment is related to hydrologic modifications, impaired hydrology, or temperature.

6.2.4.2 Impaired Waters Monitoring Schedule.

Discharges to impaired waters without an EPA approved or established TMDL:

Beginning in the first full quarter following April 1, 2009 or your date of discharge authorization, whichever date comes later, you must monitor once per year at each outfall (except substantially identical outfalls) discharging stormwater to impaired waters without an EPA approved or established TMDL. This monitoring requirement does not apply after one year if the pollutant for which the waterbody is impaired is not detected above natural background levels in your stormwater discharge, and you document, as required in Part 5.4 (Additional Documentation Requirements), that this pollutant is not expected to be present above natural background levels in your discharge.

If the pollutant for which the water is impaired is not present and not expected to be present in your discharge, or it is present but you have determined that its presence is caused solely by natural background sources, you should include a notification to this effect in your first monitoring report, after which you may discontinue annual monitoring. To support a determination that the pollutant's presence is caused solely by natural background sources, you must keep the following documentation with your SWPPP records:

- An explanation of why you believe that the presence of the pollutant causing the impairment in your discharge is not related to the activities at your facility; and
- Data and/or studies that tie the presence of the pollutant causing the impairment in your discharge to natural background sources in the watershed.

Natural background pollutants include those substances that are naturally occurring in soils or groundwater. Natural background pollutants do not include legacy pollutants from earlier activity on your site, or pollutants in run-on from neighboring sources which are not naturally occurring.

Discharges to impaired waters with an EPA approved or established TMDL: For stormwater discharges to waters for which there is an EPA approved or established TMDL, you are not required to monitor for the pollutant for which the TMDL was written unless EPA informs you, upon examination of the applicable TMDL and/or WLA, that you are subject to such a requirement consistent with the assumptions of the applicable TMDL and/or WLA. EPA's notice will include specifications on which pollutant to monitor and the required monitoring frequency during the first year of permit coverage. Following the first year of monitoring:

- If the TMDL pollutant is not detected in any of your first year samples, you may discontinue further sampling, unless the TMDL has specific instructions to the contrary, in which case you must follow those instructions. You must keep records of this finding onsite with your SWPPP.
- If you detect the presence of the pollutant causing the impairment in your stormwater discharge for any of the samples collected in your first year, you must continue monitoring annually throughout the term of this permit, unless the TMDL specifies more frequent monitoring, in which case you must follow the TMDL requirements.

6.2.5 Additional Monitoring Required by EPA.

EPA may notify you of additional discharge monitoring requirements. Any such notice will briefly state the reasons for the monitoring, locations, and parameters to be monitored, frequency and period of monitoring, sample types, and reporting requirements.

6.3 Follow-up Actions if Discharge Exceeds Numeric Effluent Limit.

You must conduct follow-up monitoring within 30 calendar days (or during the next qualifying runoff event, should none occur within 30 days) of implementing corrective action(s) taken pursuant to Part 3 in response to an exceedance of a numeric effluent limit contained in this permit. See Part 9 for specific monitoring requirements applicable to individual States or Tribes. Monitoring must be performed for any pollutant(s) that exceeds the effluent limit. If this follow-up monitoring exceeds the applicable effluent limitation, you must comply with both Parts 6.3.1 and 6.3.2.

6.3.1 Submit an Exceedance Report.

You must submit an Exceedance Report consistent with Part 7.3.

6.3.2 Continue to Monitor.

You must continue to monitor, at least quarterly, until your discharge is in compliance with the effluent limit or until EPA waives the requirement for additional monitoring.

7. Reporting and Recordkeeping

7.1 Reporting Monitoring Data to EPA.

All monitoring data collected pursuant to Parts 6.2 and 6.3 must be submitted to EPA using EPA's online eNOI system (www.epa.gov/npdes/eNOI) no later than 30 days (email date or postmark date) after you have received your complete laboratory results for all monitored outfalls for the reporting period. If you cannot access eNOI, paper reporting forms must be submitted by the same deadline to the appropriate address identified in Part 7.6.1. If you are using paper reporting forms, EPA strongly recommends that you use the MSGP discharge monitoring report (MDMR) available at www.epa.gov/npdes/stormwater/msgp. See Part 9 for specific reporting requirements applicable to individual States or Tribes.

For benchmark monitoring, note that you are required to submit sampling results to EPA no later than 30 days after receiving laboratory results for each quarter that you are required to collect benchmark samples, in accordance with Part 6.2.1.2. If you collect multiple samples in a single quarter (e.g., due to adverse weather conditions, climates with irregular stormwater runoff, or areas subject to snow), you are required to submit all sampling results to EPA within 30 days of receiving the laboratory results.

7.2 Annual Report

You must submit an annual report to EPA that includes the findings from your Part 4.3 comprehensive site inspection and any corrective action documentation as required in Part 3.4. If corrective action is not yet completed at the time of submission of this annual report, you must describe the status of any outstanding corrective action(s). In addition to the information required in Parts 3.4 (Corrective Action Report) and 4.3.2 (Comprehensive Site Inspection Documentation), you must include the following information with your annual report:

- Facility name
- NPDES permit tracking number
- Facility physical address
- Contact person name, title, and phone number

EPA strongly recommends that you submit this report using the Annual Reporting Form provided as Appendix I. You must submit the annual report to EPA within 45 days (postmark date) after conducting the comprehensive site inspection to the address identified in Part 7.6.1.

7.3 Exceedance Report for Numeric Effluent Limits

If follow-up monitoring pursuant to Part 6.3 exceeds a numeric effluent limit, you must submit an Exceedance Report to EPA no later than 30 days after you have received your lab results. Your report must include the following:

- NPDES permit tracking number;

- Facility name, physical address and location;
- Name of receiving water;
- Monitoring data from this and the preceding monitoring event(s);
- An explanation of the situation; what you have done and intend to do (should your corrective actions not yet be complete) to correct the violation; and
- An appropriate contact name and phone number.

7.4 Additional Reporting.

In addition to the reporting requirements stipulated in Part 7, you are also subject to the standard permit reporting provisions of Appendix B, Subsection 12.

Where applicable, you must submit the following reports to the appropriate EPA Regional Office listed in Part 7.6.2, as applicable. If you discharge through an MS4, you must also submit these reports to the MS4 operator (identified pursuant to Part 5.1.2).

- 24-hour reporting (see Appendix B, Subsection 12.F) - You must report any noncompliance which may endanger health or the environment. Any information must be provided orally within 24 hours from the time you become aware of the circumstances;
- 5-day follow-up reporting to the 24 hour reporting (see Appendix B, Subsection 12.F) - A written submission must also be provided within five days of the time you become aware of the circumstances;
- Reportable quantity spills (see Part 2.1.2.4) - You must provide notification, as required under Part 2.1.2.4, as soon as you have knowledge of a leak, spill, or other release containing a hazardous substance or oil in an amount equal to or in excess of a reportable quantity.

Where applicable, you must submit the following reports to EPA Headquarters at the appropriate address in Part 7.6.1:

- Planned changes (see Appendix B, Subsection 12.A) – You must give notice to EPA as soon as possible of any planned physical alterations or additions to the permitted facility that qualify the facility as a new source or that could significantly change the nature or significantly increase the quantity of pollutants discharged;
- Anticipated noncompliance (see Appendix B, Subsection 12.B) – You must give advance notice to EPA of any planned changes in the permitted facility or activity which you anticipate will result in noncompliance with permit requirements;
- Transfer of ownership and/or operation – You must submit a complete and accurate NOI in accordance with the requirements of Appendix G of this permit and by the deadlines specified in Table 1-2;
- Compliance schedules (see Appendix B, Subsection 12.F) - Reports of compliance or noncompliance with, or any progress reports on, interim and final requirements contained in any compliance schedule of this permit must be submitted no later than 14 days following each schedule date;

- Other noncompliance (see Appendix B, Subsection 12.G) - You must report all instances of noncompliance not reported in your monitoring report (pursuant to Part 7.1), compliance schedule report, or 24-hour report at the time monitoring reports are submitted; and
- Other information (see Appendix B, Subsection 12.H) – You must promptly submit facts or information if you become aware that you failed to submit relevant facts in your NOI, or that you submitted incorrect information in your NOI or in any report.

7.5 Recordkeeping.

You must retain copies of your SWPPP (including any modifications made during the term of this permit), additional documentation requirements pursuant to Part 5.4 (including documentation related to corrective actions taken pursuant to Part 3), all reports and certifications required by this permit, monitoring data, and records of all data used to complete the NOI to be covered by this permit, for a period of at least 3 years from the date that your coverage under this permit expires or is terminated.

7.6 Addresses for Reports

7.6.1 EPA Addresses

Paper copies of any reports required in Part 6 and 7, not otherwise submitted electronically via EPA's eNOI system (www.epa.gov/npdes/eNOI) must be sent to one of the following addresses:

Via U.S. mail:

U.S. Environmental Protection Agency
Office of Water, Water Permits Division
Mail Code 4203M, ATTN: MSGP Reports
1200 Pennsylvania Avenue, NW
Washington, D.C. 20460

Or Via Overnight/Express Delivery:

U.S. Environmental Protection Agency
Office of Water, Water Permits Division
Room 7420, ATTN: MSGP Reports
1201 Constitution Avenue, NW
Washington, D.C. 20004
Phone number: 202-564-9545

Notices of Intent and Notices of Termination should be submitted using EPA's eNOI system (www.epa.gov/npdes/eNOI) or sent to EPA's NOI Center (see Appendix G for the address).

All other written correspondence concerning discharges in any State, Indian Country land, Territory, or from any Federal facility covered under this permit and directed to the EPA, including individual permit applications, must be sent to the address of the appropriate EPA Regional Office listed below:

7.6.2 Regional Addresses

7.6.2.1 Region 1: Connecticut, Massachusetts, and New Hampshire, Rhode Island, Vermont.

U.S. EPA Region 1
Office of Ecosystem Protection
One Congress Street - CIP
Boston, MA 02114

7.6.2.2 Region 2: New Jersey, New York, Puerto Rico, and Virgin Islands.

For Puerto Rico and the Virgin Islands

U.S. EPA Region 2
Caribbean Environmental Protection Division
Environmental Management Branch
Centro Europa Building
1492 Ponce de Leon Avenue, Suite 417
San Juan, PR 00907-4127

For New Jersey and New York:

(Coverage not available under this permit.)

U.S. EPA Region 2
Division of Environmental Planning and Protection
290 Broadway
New York, NY 10007-1866

7.6.2.3 Region 3: Delaware, District of Columbia, Maryland, Pennsylvania, Virginia, West Virginia.

U.S. EPA Region 3
Water Protection Division (3WP40)
Stormwater Coordinator
1650 Arch Street
Philadelphia, PA 19103

7.6.2.4 Region 4: Alabama, Florida, Georgia, Kentucky, Mississippi, North Carolina, South Carolina, Tennessee.

(Coverage not available under this permit.)

U.S. EPA Region 4
Clean Water Act Enforcement Section
Water Programs Enforcement Branch
Water Management Division
Atlanta Federal Center
61 Forsyth Street SW
Atlanta, GA 30303

7.6.2.5 Region 5: Illinois, Indiana, Michigan, Minnesota, Ohio, Wisconsin.

U.S. EPA Region 5
Water Division
NPDES Programs Branch
77 W. Jackson Blvd.
Mail Code WN16J
Chicago, IL 60604

7.6.2.6 Region 6: Arkansas, Louisiana, Oklahoma, Texas, and New Mexico (except see Region 9 for Navajo lands, and see Region 8 for Ute Mountain Reservation lands).

U.S. EPA Region 6
Stormwater Coordinator
Compliance Assurance and Enforcement Division (6EN-WC)
EPA SW MSGP
P.O. Box 50625
Dallas, TX 75205

7.6.2.7 Region 7: Iowa, Kansas, Missouri, Nebraska.

(Coverage not available under this permit.)

U.S. EPA - Region 7
901 N. 5th Street
Kansas City, KS 66101

7.6.2.8 Region 8: Colorado, Montana, North Dakota, South Dakota, Wyoming, Utah (except see Region 9 for Goshute Reservation and Navajo Reservation lands), the Ute Mountain Reservation in New Mexico, and the Pine Ridge Reservation in Nebraska.

(Coverage not available under this permit.)

U.S. EPA Region 8
Stormwater Coordinator (8P-W-P)
999 18th Street, Suite 300
Denver, CO 80202-2466

7.6.2.9 Region 9: Arizona, California, Hawaii, Nevada, Guam, American Samoa, the Commonwealth of the Northern Mariana Islands, the Goshute Reservation in Utah and Nevada, the Navajo Reservation in Utah, New Mexico, and Arizona, the Duck Valley Reservation in Idaho, Fort McDermitt Reservation in Oregon.

U.S. EPA Region 9
Water Management Division, WTR-5
Stormwater Coordinator
75 Hawthorne Street
San Francisco, CA 94105

7.6.2.10 Region 10: Alaska, Idaho, Oregon (except see Region 9 for Fort McDermitt Reservation), Washington.

U.S. EPA Region 10
Office of Water and Watersheds OWW-130
Stormwater Coordinator
1200 6th Avenue
Seattle, WA 98101

7.6.3 State and Tribal Addresses.

See Part 9 (States and Tribes) for the addresses of applicable States or Tribes that require submission of information to their agencies.

Part 8 – Sector-Specific Requirements for Industrial Activity

Subpart A – Sector A – Timber Products.

You must comply with Part 8 sector-specific requirements associated with your primary industrial activity and any co-located industrial activities, as defined in Appendix A. The sector-specific requirements apply to those areas of your facility where those sector-specific activities occur. These sector-specific requirements are in addition to any requirements specified elsewhere in this permit.

8.A.1 Covered Stormwater Discharges.

The requirements in Subpart A apply to stormwater discharges associated with industrial activity from Timber Products facilities as identified by the SIC Codes specified under Sector A in Table D-1 of Appendix D of the permit.

8.A.2 Limitation on Coverage

8.A.2.1 *Prohibition of Discharges.* (See also Part 1.1.4) Not covered by this permit: stormwater discharges from areas where there may be contact with the chemical formulations sprayed to provide surface protection. These discharges must be covered by a separate NPDES permit.

8.A.2.2 *Authorized Non-Stormwater Discharges.* (See also Part 1.1.3) Also authorized by this permit, provided the non-stormwater component of the discharge is in compliance with the requirements in Part 2.1.2 (Non-Numeric Effluent Limits): discharges from the spray down of lumber and wood product storage yards where no chemical additives are used in the spray-down waters and no chemicals are applied to the wood during storage.

8.A.3 Additional Technology-Based Effluent Limits.

8.A.3.1 *Good Housekeeping.* (See also Part 2.1.2.2) In areas where storage, loading and unloading, and material handling occur, perform good housekeeping to limit the discharge of wood debris, minimize the leachate generated from decaying wood materials, and minimize the generation of dust.

8.A.4 Additional SWPPP Requirements.

8.A.4.1 *Drainage Area Site Map.* (See also Part 5.1.2) Document in your SWPPP where any of the following may be exposed to precipitation or surface runoff: processing areas, treatment chemical storage areas, treated wood and residue storage areas, wet decking areas, dry decking areas, untreated wood and residue storage areas, and treatment equipment storage areas.

8.A.4.2 *Inventory of Exposed Materials.* (See also Part 5.1.3.2) Where such information exists, if your facility has used chlorophenolic, creosote, or chromium-copper-arsenic formulations for wood surface protection or preserving, document in your SWPPP the following: areas where contaminated soils, treatment equipment, and stored materials still remain and the management practices employed to minimize the contact of these materials with stormwater runoff.

8.A.4.3 *Description of Stormwater Management Controls.* (See also Part 5.1.4) Document measures implemented to address the following activities and sources: log, lumber, and wood product storage areas; residue storage areas; loading and unloading areas; material handling areas; chemical storage areas; and equipment and vehicle maintenance, storage, and repair areas. If your facility performs wood surface protection and preservation activities, address the specific control measures, including any BMPs, for these activities.

8.A.5 Additional Inspection Requirements.

See also Part 4.1. If your facility performs wood surface protection and preservation activities, inspect processing areas, transport areas, and treated wood storage areas monthly to assess the usefulness of practices to minimize the deposit of treatment chemicals on unprotected soils and in areas that will come in contact with stormwater discharges.

8.A.6 Sector-Specific Benchmarks

Table 8.A-1 identifies benchmarks that apply to the specific subsectors of Sector A. These benchmarks apply to both your primary industrial activity and any co-located industrial activities, which describe your site activities.

Table 8.A-1		
Subsector (You may be subject to requirements for more than one sector/subsector)	Parameter	Benchmark Monitoring Concentration
Subsector A1. General Sawmills and Planing Mills (SIC 2421)	Chemical Oxygen Demand (COD)	120.0 mg/L
	Total Suspended Solids (TSS)	100 mg/L
	Total Zinc ¹	Hardness Dependent
Subsector A2. Wood Preserving (SIC 2491)	Total Arsenic	0.15 mg/L
	Total Copper ¹	Hardness Dependent
Subsector A3. Log Storage and Handling (SIC 2411)	Total Suspended Solids (TSS)	100 mg/L
Subsector A4. Hardwood Dimension and Flooring Mills; Special Products Sawmills, not elsewhere classified; Millwork, Veneer, Plywood, and Structural Wood; Wood Pallets and Skids; Wood Containers, not elsewhere classified; Wood Buildings and Mobile Homes; Reconstituted Wood Products; and Wood Products Facilities not elsewhere classified (SIC 2426, 2429, 2431-2439 (except 2434), 2441, 2448, 2449, 2451, 2452, 2493, and 2499)	Chemical Oxygen Demand (COD)	120.0 mg/L
	Total Suspended Solids (TSS)	100.0 mg/L

¹ The benchmark values of some metals are dependent on water hardness. For these parameters, permittees must determine the hardness of the receiving water (see Appendix J, "Calculating Hardness in Receiving Waters for Hardness Dependent Metals," for methodology), in accordance with Part 6.2.1.1, to identify the applicable 'hardness range' for determining their benchmark value applicable to their facility. The ranges occur in 25 mg/L increments. Hardness Dependent Benchmarks follow in the table below:

Water Hardness Range	Copper (mg/L)	Zinc (mg/L)
0-25 mg/L	0.0038	0.04
25-50 mg/L	0.0056	0.05
50-75 mg/L	0.0090	0.08
75-100 mg/L	0.0123	0.11
100-125 mg/L	0.0156	0.13
125-150 mg/L	0.0189	0.16
150-175 mg/L	0.0221	0.18
175-200 mg/L	0.0253	0.20
200-225 mg/L	0.0285	0.23
225-250 mg/L	0.0316	0.25
250+ mg/L	0.0332	0.26

8.A.7 Effluent Limitations Based on Effluent Limitations Guidelines (See also Part 6.2.2.1 of the permit.)

Table 8.A-2 identifies effluent limits that apply to the industrial activities described below. Compliance with these effluent limits is to be determined based on discharges from these industrial activities independent of commingling with any other wastestreams that may be covered under this permit.

Industrial Activity		
Discharges resulting from spray down or intentional wetting of logs at wet deck storage areas	pH	6.0 - 9.0 s.u
	Debris (woody material such as bark, twigs, branches, heartwood, or sapwood)	No discharge of debris that will not pass through a 2.54-cm (1-in.) diameter round opening

¹ Monitor annually.

Part 8 – Sector-Specific Requirements for Industrial Activity

Subpart B – Sector B – Paper and Allied Products.

You must comply with Part 8 sector-specific requirements associated with your primary industrial activity and any co-located industrial activities, as defined in Appendix A. The sector-specific requirements apply to those areas of your facility where those sector-specific activities occur. These sector-specific requirements are in addition to any requirements specified elsewhere in this permit.

8.B.1 Covered Stormwater Discharges.

The requirements in Subpart B apply to stormwater discharges associated with industrial activity from Paper and Allied Products Manufacturing facilities, as identified by the SIC Codes specified under Sector B in Table D-1 of Appendix D of the permit.

8.B.2 Sector-Specific Benchmarks. (See also Part 6 of the permit.)

Table 8.B-1.		
Subsector (You may be subject to requirements for more than one sector/subsector)	Parameter	Benchmark Monitoring Concentration
Subsector B1. Paperboard Mills (SIC Code 2631)	Chemical Oxygen Demand (COD)	120 mg/L

Part 8 – Sector-Specific Requirements for Industrial Activity

Subpart C – Sector C – Chemical and Allied Products Manufacturing, and Refining.

You must comply with Part 8 sector-specific requirements associated with your primary industrial activity and any co-located industrial activities, as defined in Appendix A. The sector-specific requirements apply to those areas of your facility where those sector-specific activities occur. These sector-specific requirements are in addition to any requirements specified elsewhere in this permit.

8.C.1 Covered Stormwater Discharges.

The requirements in Subpart C apply to stormwater discharges associated with industrial activity from Chemical and Allied Products Manufacturing, and Refining facilities, as identified by the SIC Codes specified under Sector C in Table D-1 of Appendix D of the permit.

8.C.2 Limitations on Coverage.

8.C.2.1 *Prohibition of Non-Stormwater Discharges.* (See also Part 1.1.4) The following are not covered by this permit: non-stormwater discharges containing inks, paints, or substances (hazardous, nonhazardous, etc.) resulting from an onsite spill, including materials collected in drip pans; washwater from material handling and processing areas; and washwater from drum, tank, or container rinsing and cleaning.

8.C.3 Sector-Specific Benchmarks

Table 8.C-1 identifies benchmarks that apply to the specific subsectors of Sector C. These benchmarks apply to both your primary industrial activity and any co-located industrial activities.

Subsector (You may be subject to requirements for more than one sector/subsector)	Parameter	Benchmark Monitoring Concentration
Subsector C1. Agricultural Chemicals (SIC 2873-2879)	Nitrate plus Nitrite Nitrogen	0.68 mg/L
	Total Lead ¹	Hardness Dependent
	Total Iron	1.0 mg/L
	Total Zinc ¹	Hardness Dependent
	Phosphorus	2.0 mg/L
Subsector C2. Industrial Inorganic Chemicals (SIC 2812-2819)	Total Aluminum	0.75 mg/L
	Total Iron	1.0 mg/L
	Nitrate plus Nitrite Nitrogen	0.68 mg/L
Subsector C3. Soaps, Detergents, Cosmetics, and Perfumes (SIC 2841-2844)	Nitrate plus Nitrite Nitrogen	0.68 mg/L
	Total Zinc ¹	Hardness Dependent
Subsector C4. Plastics, Synthetics, and Resins (SIC 2821-2824)	Total Zinc ¹	Hardness Dependent

¹ The benchmark values of some metals are dependent on water hardness. For these parameters, permittees must determine the hardness of the receiving water (see Appendix J, "Calculating Hardness in Receiving Waters for Hardness Dependent Metals," for methodology), in accordance with Part 6.2.1.1, to identify the applicable 'hardness range' for determining their benchmark value applicable to their facility. The ranges occur in 25 mg/L increments. Hardness Dependent Benchmarks follow in the table below:

Water Hardness Range	Lead (mg/L)	Zinc (mg/L)
0-25 mg/L	0.014	0.04
25-50 mg/L	0.023	0.05
50-75 mg/L	0.045	0.08
75-100 mg/L	0.069	0.11
100-125 mg/L	0.095	0.13
125-150 mg/L	0.122	0.16
150-175 mg/L	0.151	0.18
175-200 mg/L	0.182	0.20
200-225 mg/L	0.213	0.23
225-250 mg/L	0.246	0.25
250+ mg/L	0.262	0.26

8.C.4 Effluent Limitations Based on Effluent Limitations Guidelines (See also Part 6.2.2.1 of the permit.)

Table 8.C-2 identifies effluent limits that apply to the industrial activities described below. Compliance with these effluent limits is to be determined based on discharges from these industrial activities independent of commingling with any other wastestreams that may be covered under this permit.

Industrial Activity	Parameter	Effluent Limit
Runoff from phosphate fertilizer manufacturing facilities that comes into contact with any raw materials, finished product, by-products or waste products (SIC 2874)	Total Phosphorus (as P)	105.0 mg/L, daily maximum
		35 mg/L, 30-day avg.
	Fluoride	75.0 mg/L, daily maximum
		25.0 mg/L, 30-day avg.

¹ Monitor annually.

Part 8 – Sector-Specific Requirements for Industrial Activity

Subpart D – Sector D – Asphalt Paving and Roofing Materials and Lubricant Manufacturing.

You must comply with Part 8 sector-specific requirements associated with your primary industrial activity and any co-located industrial activities, as defined in Appendix A. The sector-specific requirements apply to those areas of your facility where those sector-specific activities occur. These sector-specific requirements are in addition to any requirements specified elsewhere in this permit.

8.D.1 Covered Stormwater Discharges.

The requirements in Subpart D apply to stormwater discharges associated with industrial activity from Asphalt Paving and Roofing Materials and Lubricant Manufacturing facilities, as identified by the SIC Codes specified under Sector D in Table D-1 of Appendix D of the permit.

8.D.2 Limitations on Coverage.

The following stormwater discharges associated with industrial activity are not authorized by this permit (See also Part 1.1.4)

- 8.D.2.1 Discharges from petroleum refining facilities, including those that manufacture asphalt or asphalt products, that are subject to nationally established effluent limitation guidelines found in 40 CFR Part 419 (Petroleum Refining); or
- 8.D.2.2 Discharges from oil recycling facilities; or
- 8.D.2.3 Discharges associated with fats and oils rendering.

8.D.3 Sector-Specific Benchmarks

Table 8.D-1 identifies benchmarks that apply to the specific subsectors of Sector D. These benchmarks apply to both your primary industrial activity and any co-located industrial activities, which describe your site activities.

Subsector	Parameter	Benchmark Monitoring Concentration
Subsector D1. Asphalt Paving and Roofing Materials (SIC 2951, 2952)	Total Suspended Solids (TSS)	100 mg/L

8.D.4 Effluent Limitations Based on Effluent Limitations Guidelines (See also Part 6.2.2.1 of the permit.)

Table 8.D-2 identifies effluent limits that apply to the industrial activities described below. Compliance with these effluent limits is to be determined based on discharges from these industrial activities independent of commingling with any other wastestreams that may be covered under this permit.

Industrial Activity	Parameter	Effluent Limit
Discharges from asphalt emulsion facilities.	Total Suspended Solids (TSS)	23.0 mg/L, daily maximum 15.0 mg/L, 30-day avg.
	pH	6.0 - 9.0 s.u.
	Oil and Grease	15.0 mg/L, daily maximum
		10 mg/L, 30-day avg.

¹Monitor annually.

Part 8 – Sector-Specific Requirements for Industrial Activity

Subpart E – Sector E – Glass, Clay, Cement, Concrete, and Gypsum Products.

You must comply with Part 8 sector-specific requirements associated with your primary industrial activity and any co-located industrial activities, as defined in Appendix A. The sector-specific requirements apply to those areas of your facility where those sector-specific activities occur. These sector-specific requirements are in addition to any requirements specified elsewhere in this permit.

8.E.1 Covered Stormwater Discharges.

The requirements in Subpart E apply to stormwater discharges associated with industrial activity from Glass, Clay, Cement, Concrete, and Gypsum Products facilities, as identified by the SIC Codes specified under Sector E in Table D-1 of Appendix D of the permit.

8.E.2 Additional Technology-Based Effluent Limits.

8.E.2.1 *Good Housekeeping Measures.* (See also Part 2.1.2.2) With good housekeeping, prevent or minimize the discharge of spilled cement, aggregate (including sand or gravel), kiln dust, fly ash, settled dust, or other significant material in stormwater from paved portions of the site that are exposed to stormwater. Consider sweeping regularly or using other equivalent measures to minimize the presence of these materials. Indicate in your SWPPP the frequency of sweeping or equivalent measures. Determine the frequency based on the amount of industrial activity occurring in the area and the frequency of precipitation, but it must be performed at least once a week if cement, aggregate, kiln dust, fly ash, or settled dust are being handled or processed. You must also prevent the exposure of fine granular solids (cement, fly ash, kiln dust, etc.) to stormwater, where practicable, by storing these materials in enclosed silos, hoppers, or buildings, or under other covering.

8.E.3 Additional SWPPP Requirements.

8.E.3.1 *Drainage Area Site Map.* (See also Part 5.1.2) Document in the SWPPP the locations of the following, as applicable: bag house or other dust control device; recycle/sedimentation pond, clarifier, or other device used for the treatment of process wastewater; and the areas that drain to the treatment device.

8.E.3.2 *Certification.* (See also Part 5.1.3.4) For facilities producing ready-mix concrete, concrete block, brick, or similar products, include in the non-stormwater discharge certification a description of measures that ensure that process waste waters resulting from washing trucks, mixers, transport buckets, forms, or other equipment are discharged in accordance with NPDES requirements or are recycled.

8.E.4 Sector-Specific Benchmarks.

Table 8.E-1 identifies benchmarks that apply to the specific subsectors of Sector E. These benchmarks apply to both your primary industrial activity and any co-located industrial activities, which describe your site activities.

Subsector (You may be subject to requirements for more than one sector/subsector)	Parameter	Benchmark Monitoring Cutoff Concentration
Subsector E1. Clay Product Manufacturers (SIC 3251-3259, 3261-3269)	Total Aluminum	0.75 mg/L
Subsector E2. Concrete and Gypsum Product Manufacturers (SIC 3271-3275)	Total Suspended Solids (TSS)	100 mg/L
	Total Iron	1.0 mg/L

8.E.5 Effluent Limitations Based on Effluent Limitations Guidelines (See also Part 6.2.2.1 of the permit.)

Table 8.E-2 identifies effluent limits that apply to the industrial activities described below. Compliance with these limits is to be determined based on discharges from these industrial activities independent of commingling with any other wastestreams that may be covered under this permit.

Industrial Activity	Parameter	Effluent Limit
Discharges from material storage piles at cement manufacturing facilities	Total Suspended Solids (TSS)	50 mg/L, daily maximum
	pH	6.0 - 9.0 s.u.

¹Monitor annually.

Part 8 – Sector-Specific Requirements for Industrial Activity

Subpart F – Sector F – Primary Metals.

You must comply with Part 8 sector-specific requirements associated with your primary industrial activity and any co-located industrial activities, as defined in Appendix A. The sector-specific requirements apply to those areas of your facility where those sector-specific activities occur. These sector-specific requirements are in addition to any requirements specified elsewhere in this permit.

8.F.1 Covered Stormwater Discharges.

The requirements in Subpart F apply to stormwater discharges associated with industrial activity from Primary Metals facilities, as identified by the SIC Codes specified under Sector F in Table D-1 of Appendix D of the permit.

8.F.2 Additional Technology-Based Effluent Limits

8.F.2.1 *Good Housekeeping Measures.* (See also Part 2.1.2.2) As part of your good housekeeping program, include a cleaning and maintenance program for all impervious areas of the facility where particulate matter, dust, or debris may accumulate, especially areas where material loading and unloading, storage, handling, and processing occur; and, where practicable, the paving of areas where vehicle traffic or material storage occur but where vegetative or other stabilization methods are not practicable (institute a sweeping program in these areas too). For unstabilized areas where sweeping is not practicable, consider using stormwater management devices such as sediment traps, vegetative buffer strips, filter fabric fence, sediment filtering boom, gravel outlet protection, or other equivalent measures that effectively trap or remove sediment.

8.F.3 Additional SWPPP Requirements.

8.F.3.1 *Drainage Area Site Map.* (See also Part 5.1.2) Identify in the SWPPP where any of the following activities may be exposed to precipitation or surface runoff: storage or disposal of wastes such as spent solvents and baths, sand, slag and dross; liquid storage tanks and drums; processing areas including pollution control equipment (e.g., baghouses); and storage areas of raw material such as coal, coke, scrap, sand, fluxes, refractories, or metal in any form. In addition, indicate where an accumulation of significant amounts of particulate matter could occur from such sources as furnace or oven emissions, losses from coal and coke handling operations, etc., and could result in a discharge of pollutants to waters of the United States.

8.F.3.2 *Inventory of Exposed Material.* (See also Part 5.1.3.2) Include in the inventory of materials handled at the site that potentially may be exposed to precipitation or runoff, areas where deposition of particulate matter from process air emissions or losses during material-handling activities are possible

8.F.4 **Additional Inspection Requirements.** (See also Part 4.1) As part of conducting your quarterly routine facility inspections (Part 4.1), address all potential sources of pollutants, including (if applicable) air pollution control equipment (e.g., baghouses, electrostatic precipitators, scrubbers, and cyclones), for any signs of degradation (e.g., leaks,

corrosion, or improper operation) that could limit their efficiency and lead to excessive emissions. Consider monitoring air flow at inlets and outlets (or use equivalent measures) to check for leaks (e.g., particulate deposition) or blockage in ducts. Also inspect all process and material handling equipment (e.g., conveyors, cranes, and vehicles) for leaks, drips, or the potential loss of material; and material storage areas (e.g., piles, bins, or hoppers for storing coke, coal, scrap, or slag, as well as chemicals stored in tanks and drums) for signs of material losses due to wind or stormwater runoff.

8.F.5 Sector-Specific Benchmarks. (See also Part 6 of the permit.)

Subsector (You may be subject to requirements for more than one sector/subsector)	Parameter	Benchmark Monitoring Cutoff Concentration
Subsector F1. Steel Works, Blast Furnaces, and Rolling and Finishing Mills (SIC 3312-3317)	Total Aluminum	0.75 mg/L
	Total Zinc ¹	Hardness Dependent
Subsector F2. Iron and Steel Foundries (SIC 3321-3325)	Total Aluminum	0.75 mg/L
	Total Suspended Solids (TSS)	100 mg/L
	Total Copper ¹	Hardness Dependent
	Total Iron	1.0 mg/L
Subsector F3. Rolling, Drawing, and Extruding of Nonferrous Metals (SIC 3351-3357)	Total Zinc ¹	Hardness Dependent
	Total Copper ¹	Hardness Dependent
Subsector F4. Nonferrous Foundries (SIC 3363-3369)	Total Zinc ¹	Hardness Dependent
	Total Copper ¹	Hardness Dependent

¹ The benchmark values of some metals are dependent on water hardness. For these parameters, permittees must determine the hardness of the receiving water (see Appendix J, "Calculating Hardness in Receiving Waters for Hardness Dependent Metals," for methodology), in accordance with Part 6.2.1.1, to identify the applicable 'hardness range' for determining their benchmark value applicable to their facility. The ranges occur in 25 mg/L increments. Hardness Dependent Benchmarks follow in the table below:

Water Hardness Range	Copper (mg/L)	Zinc (mg/L)
0-25 mg/L	0.0038	0.04
25-50 mg/L	0.0056	0.05
50-75 mg/L	0.0090	0.08
75-100 mg/L	0.0123	0.11
100-125 mg/L	0.0156	0.13
125-150 mg/L	0.0189	0.16
150-175 mg/L	0.0221	0.18
175-200 mg/L	0.0253	0.20
200-225 mg/L	0.0285	0.23
225-250 mg/L	0.0316	0.25
250+ mg/L	0.0332	0.26

Part 8 – Sector-Specific Requirements for Industrial Activity

Subpart G – Sector G – Metal Mining.

You must comply with Part 8 sector-specific requirements associated with your primary industrial activity and any co-located industrial activities, as defined in Appendix A. The sector-specific requirements apply to those areas of your facility where those sector-specific activities occur. These sector-specific requirements are in addition to any requirements specified elsewhere in this permit.

8.G.1 Covered Stormwater Discharges.

The requirements in Subpart G apply to stormwater discharges associated with industrial activity from Metal Mining facilities, including mines abandoned on Federal lands, as identified by the SIC Codes specified under Sector G in Table D-1 of Appendix D. Coverage is required for metal mining facilities that discharge stormwater contaminated by contact with, or that has come into contact with, any overburden, raw material, intermediate product, finished product, byproduct, or waste product located on the site of the operation.

8.G.1.1 Covered Discharges from Inactive Facilities. All stormwater discharges.

8.G.1.2 Covered Discharges from Active and Temporarily Inactive Facilities. Only the stormwater discharges from the following areas are covered: waste rock and overburden piles if composed entirely of stormwater and not combining with mine drainage; topsoil piles; offsite haul and access roads; onsite haul and access roads constructed of waste rock, overburden, or spent ore if composed entirely of stormwater and not combining with mine drainage; onsite haul and access roads not constructed of waste rock, overburden, or spent ore except if mine drainage is used for dust control; runoff from tailings dams or dikes when not constructed of waste rock or tailings and no process fluids are present; runoff from tailings dams or dikes when constructed of waste rock or tailings and no process fluids are present, if composed entirely of stormwater and not combining with mine drainage; concentration building if no contact with material piles; mill site if no contact with material piles; office or administrative building and housing if mixed with stormwater from industrial area; chemical storage area; docking facility if no excessive contact with waste product that would otherwise constitute mine drainage; explosive storage; fuel storage; vehicle and equipment maintenance area and building; parking areas (if necessary); power plant; truck wash areas if no excessive contact with waste product that would otherwise constitute mine drainage; unreclaimed, disturbed areas outside of active mining area; reclaimed areas released from reclamation requirements prior to December 17, 1990; and partially or inadequately reclaimed areas or areas not released from reclamation requirements.

8.G.1.3 Covered Discharges from Exploration and Construction of Metal Mining and/or Ore Dressing Facilities. All stormwater discharges.

8.G.1.4 Covered Discharges from Facilities Undergoing Reclamation. All stormwater discharges.

8.G.2 Limitations on Coverage.

8.G.2.1 *Prohibition of Stormwater Discharges.* Stormwater discharges not authorized by this permit: discharges from active metal mining facilities that are subject to effluent limitation guidelines for the Ore Mining and Dressing Point Source Category (40 CFR Part 440).

NOTE: Stormwater runoff from these sources are subject to 40 CFR Part 440 if they are mixed with other discharges subject to Part 440. In this case, they are not eligible for coverage under this permit. Discharges from overburden/waste rock and overburden/waste rock-related areas are not subject to 40 CFR Part 440 unless they: (1) drain naturally (or are intentionally diverted) to a point source; and (2) combine with "mine drainage" that is otherwise regulated under the Part 440 regulations. For such sources, coverage under this permit would be available if the discharge composed entirely of stormwater does not combine with other sources of mine drainage that are not subject to 40 CFR Part 440, and meets the other eligibility criteria contained in Part 1.2 of the permit. Permit applicants bear the initial responsibility for determining if they are eligible for coverage under this permit, or must seek coverage under another NPDES permit. EPA recommends that permit applicants contact the relevant NPDES permit issuance authority for assistance to determine the nature and scope of the "active mining area" on a mine-by-mine basis, as well as to determine the appropriate permitting mechanism for authorizing such discharges.

8.G.2.2 *Prohibition of Non-Stormwater Discharges.* Not authorized by this permit: adit drainage, and contaminated springs or seeps discharging from waste rock dumps that do not directly result from precipitation events (see also the standard Limitations on Coverage in Part 1.1.4).

8.G.3 Definitions.

The following definitions are not intended to supersede the definitions of active and inactive mining facilities established by 40 CFR 122.26(b)(14)(iii).

8.G.3.1 *Mining operation* - Consists of the active and temporarily inactive phases, and the reclamation phase, but excludes the exploration and construction phases.

8.G.3.2 *Exploration phase* - Entails exploration and land disturbance activities to determine the viability of a site. The exploration phase is not considered part of "mining operations."

8.G.3.3 *Construction phase* - Includes the building of site access roads and removal of overburden and waste rock to expose mineable minerals. The construction phase is not considered part of "mining operations."

8.G.3.4 *Active phase* - Activities including the extraction, removal or recovery of metal ore. For surface mines, this definition does not include any land where grading has returned the earth to a desired contour and reclamation has begun. This definition is derived from the definition of "active mining area" found at 40 CFR 440.132(a). The active phase is considered part of "mining operations."

- 8.G.3.5 *Reclamation phase* - Activities undertaken, in compliance with applicable mined land reclamation requirements, following the cessation of the “active phase”, intended to return the land to an appropriate post-mining land use in order to meet applicable Federal and State reclamation requirements. The reclamation phase is considered part of “mining operations.”
- 8.G.3.6 *Active metal mining facility* - A place where work or other activity related to the extraction, removal, or recovery of metal ore is being conducted. For surface mines, this definition does not include any land where grading has returned the earth to a desired contour and reclamation has begun. This definition is derived from the definition of “active mining area” found at 40 CFR 440.132(a).
- 8.G.3.7 *Inactive metal mining facility* - A site or portion of a site where metal mining and/or milling occurred in the past but is not an active facility as defined above, and where the inactive portion is not covered by an active mining permit issued by the applicable State or Federal agency. An inactive metal mining facility has an identifiable owner / operator. Sites where mining claims are being maintained prior to disturbances associated with the extraction, beneficiation, or processing of mined materials and sites where minimal activities are undertaken for the sole purpose of maintaining a mining claim are not considered either active or inactive mining facilities and do not require an NPDES industrial stormwater permit.
- 8.G.3.8 *Temporarily inactive metal mining facility* - A site or portion of a site where metal mining and/or milling occurred in the past but currently are not being actively undertaken, and the facility is covered by an active mining permit issued by the applicable State or Federal agency.
- 8.G.3.9 *Final Stabilization* - A site or portion of a site is “finally stabilized” when it has implemented all applicable Federal and State reclamation requirements.

8.G.4 Technology-Based Effluent Limits for Clearing, Grading, and Excavation Activities.

Clearing, grading, and excavation activities being conducted as part of the exploration and construction phase of mining activities are covered under this permit.

8.G.4.1 Management Practices for Clearing, Grading, and Excavation Activities.

- 8.G.4.1.1 *Selecting and installing control measures.* For all areas affected by clearing, grading, and excavation activities, you must select, design, install, and implement control measures that meet applicable Part 2 effluent limits.
- 8.G.4.1.2 *Good Housekeeping.* Litter, debris, and chemicals must be prevented from becoming a pollutant source in stormwater discharges.
- 8.G.4.1.3 *Retention and Detention of Stormwater Runoff.* For drainage locations serving more than one acre, sediment basins and/or temporary sediment traps should be used. At a minimum, silt fences, vegetative buffer strips, or equivalent sediment controls are required for all down slope boundaries (and for side slope boundaries as necessary based on individual site conditions) of the development area unless a sediment basin providing storage for a calculated

volume of runoff from a 2-year, 24-hour storm or 3,600 cubic feet of storage per acre drained is provided. You are required to remove sediment from sediment traps or sedimentation ponds when design capacity has been reduced by 50 percent. Due to high sediment discharges from some Sector G facilities, permittees may need to implement a combination of structural BMP approaches to sufficiently decrease discharge of sediment from their facilities.

8.G.4.2 Inspection of Clearing, Grading, and Excavation Activities.

8.G.4.2.1 *Inspection Frequency.* Inspections must be conducted either at least once every 7 calendar days, or at least once every 14 calendar days and within 24 hours of the end of a storm event of 0.5 inches or greater. Inspection frequency may be reduced to at least once every month if the entire site is temporarily stabilized (pursuant to Part 8.G.4.3.2), if runoff is unlikely due to winter (e.g., site is covered with snow or ice) or frozen conditions, or construction is occurring during seasonal dry periods in arid areas and semi-arid areas.

8.G.4.2.2 *Location of Inspections.* Inspections must include all areas of the site disturbed by clearing, grading, and/or excavation activities and areas used for storage of materials that are exposed to precipitation. Sedimentation and erosion control measures must be observed to ensure proper operation. Discharge locations must be inspected to ascertain whether erosion control measures are effective in preventing significant impacts to waters of the United States, where accessible. Where discharge locations are inaccessible, nearby downstream locations must be inspected to the extent that such inspections are practicable. Locations where vehicles enter or exit the site must be inspected for evidence of significant off-site sediment tracking.

8.G.4.2.3 *Inspection Reports.* For each inspection required above, you must complete an inspection report. At a minimum, the inspection report must include the information required in Part 4.1.

8.G.4.3 Requirements for Cessation of Clearing, Grading, and Excavation Activities.

8.G.4.3.1 *Inspections and Maintenance.* Inspections and maintenance of control measures, including BMPs, associated with clearing, grading, and excavation activities being conducted as part of the exploration and construction phase of a mining operation must continue until final stabilization has been achieved on all portions of the disturbed area, or until the commencement of the active mining phase for those areas that have been temporarily stabilized as a precursor to mining.

8.G.4.3.2 *Temporary Stabilization of Disturbed Areas.* Stabilization measures should be initiated immediately in portions of the site where clearing, grading and/or excavation activities have temporarily ceased, but in no case more than 14 days after the clearing, grading and/or excavation activities in that portion of the site have temporarily ceased. In arid, semiarid, and drought-stricken areas, or in areas subject to snow or freezing conditions, where initiating perennial

vegetative stabilization measures is not possible within 14 days after mining, exploration, and/or construction activity has temporarily ceased, temporary vegetative stabilization measures must be initiated as soon as practicable. Until temporary vegetative stabilization is achieved, interim measures such as erosion control blankets with an appropriate seed base and tackifiers must be employed. In areas of the site, where exploration and/or construction has permanently ceased prior to active mining, temporary stabilization measures must be implemented to minimize mobilization of sediment or other pollutants until such time as the active mining phase commences.

- 8.G.4.3.3 *Final Stabilization of Disturbed Areas.* Stabilization measures should be initiated immediately in portions of the site where exploration and/or construction activities have permanently ceased, but in no case more than 14 days after the exploration and/or construction activity in that portion of the site has permanently ceased. In arid, semiarid, and drought-stricken areas, or in areas subject to snow or freezing conditions, where initiating perennial vegetative stabilization measures is not possible within 14 days after mining, exploration, and/or construction activity has permanently ceased, final vegetative stabilization measures must be initiated as soon as possible. Until final stabilization is achieved temporary stabilization measures, such as erosion control blankets with an appropriate seed base and tackifiers, must be used.

8.G.5 Additional Technology-Based Effluent Limits.

- 8.G.5.1 *Employee Training.* (See also Part 2.1.2.9) Conduct employee training at least annually at active and temporarily inactive sites.
- 8.G.5.2 *Stormwater Controls.* Apart from the control measures you implement to meet your Part 2 effluent limits, consider implementing the following control measures at your site. The potential pollutants identified in Part 8.G.6.3 shall determine the priority and appropriateness of the control measures selected.
- 8.G.5.2.1 *Stormwater Diversions:* Consider diverting stormwater away from potential pollutant sources. Following are some options: interceptor or diversion controls (e.g., dikes, swales, curbs, or berms); pipe slope drains; subsurface drains; conveyance systems (e.g., channels or gutters, open-top box culverts, and waterbars; rolling dips and road sloping; roadway surface water deflector and culverts); or their equivalents.
- 8.G.5.2.2 *Capping:* When capping is necessary to minimize pollutant discharges in stormwater, identify the source being capped and the material used to construct the cap.
- 8.G.5.2.3 *Treatment:* If treatment of stormwater (e.g., chemical or physical systems, oil and water separators, artificial wetlands) is necessary to protect water quality, describe the type and location of treatment used. Passive and/or active treatment of stormwater runoff is encouraged where practicable. Treated runoff may be discharged as a stormwater source regulated under this permit

provided the discharge is not combined with discharges subject to effluent limitation guidelines for the Ore Mining and Dressing Point Source Category (40 CFR Part 440).

- 8.G.5.3 *Certification of Discharge Testing.* (See also Part 5.1.3.4) Test or evaluate all outfalls covered under this permit for the presence of specific mining-related non-stormwater discharges such as seeps or adit discharges, or discharges subject to effluent limitations guidelines (e.g., 40 CFR Part 440), such as mine drainage or process water. Alternatively (if applicable), you may keep a certification with your SWPPP consistent with Part 8.G.6.6.

8.G.6 Additional SWPPP Requirements.

- 8.G.6.1 *Nature of Industrial Activities.* (See also Part 5.1.2) Briefly document in your SWPPP the mining and associated activities that can potentially affect the stormwater discharges covered by this permit, including a general description of the location of the site relative to major transportation routes and communities.
- 8.G.6.2 *Site Map.* (See also Part 5.1.2) Document in your SWPPP the locations of the following (as appropriate): mining or milling site boundaries; access and haul roads; outline of the drainage areas of each stormwater outfall within the facility with indications of the types of discharges from the drainage areas; location(s) of all permitted discharges covered under an individual NPDES permit, outdoor equipment storage, fueling, and maintenance areas; materials handling areas; outdoor manufacturing, outdoor storage, and material disposal areas; outdoor chemicals and explosives storage areas; overburden, materials, soils, or waste storage areas; location of mine drainage (where water leaves mine) or other process water; tailings piles and ponds (including proposed ones); heap leach pads; off-site points of discharge for mine drainage and process water; surface waters; boundary of tributary areas that are subject to effluent limitations guidelines; and location(s) of reclaimed areas.
- 8.G.6.3 *Potential Pollutant Sources.* (See also Part 5.1.3) For each area of the mine or mill site where stormwater discharges associated with industrial activities occur, identify the types of pollutants (e.g., heavy metals, sediment) likely to be present in significant amounts. Consider these factors: the mineralogy of the ore and waste rock (e.g., acid forming); toxicity and quantity of chemicals used, produced, or discharged; the likelihood of contact with stormwater; vegetation of site (if any); and history of significant leaks or spills of toxic or hazardous pollutants. Also include a summary of any existing ore or waste rock or overburden characterization data and test results for potential generation of acid rock. If any new data is acquired due to changes in ore type being mined, update your SWPPP with this information.
- 8.G.6.4 *Documentation of Control Measures.* Document all control measures that you implement consistent with Part 8.G.5.2. If control measures are implemented or planned but are not listed in Part 8.G.5.2 (e.g., substituting a less toxic chemical for a more toxic one), include descriptions of them in your SWPPP.
- 8.G.6.5 *Employee Training.* All employee training(s) must be documented in the SWPPP.

8.G.6.6 *Certification of Permit Coverage for Commingled Non-Stormwater Discharges:* If you are able, consistent with Part 8.G.5.3 above, to certify that a particular discharge composed of commingled stormwater and non-stormwater is covered under a separate NPDES permit, and that permit subjects the non-stormwater portion to effluent limitations prior to any commingling, retain such certification with your SWPPP. This certification must identify the non-stormwater discharges, the applicable NPDES permit(s), the effluent limitations placed on the non-stormwater discharge by the permit(s), and the points at which the limitations are applied.

8.G.7 Additional Inspection Requirements.

(See also Part 4.1 and 8.G.4.2.) Except for areas of the site subject to clearing, grading, and/or excavation activities conducted as part of the exploration and construction phase, which are subject to Part 8.G.4.2.1, inspect sites at least quarterly unless adverse weather conditions make the site inaccessible. Sites which discharge to waters designated as outstanding waters or waters which are impaired for sediment or nitrogen must be inspected monthly. See Part 8.G.8.4 for inspection requirements for inactive and unstaffed sites.

8.G.8 Monitoring and Reporting Requirements. (See also Part 6 of the permit.)

Note: There are no Part 8.G.8 monitoring and reporting requirements for inactive and unstaffed sites.

8.G.8.1 *Benchmark Monitoring for Active Copper Ore Mining and Dressing Facilities.* Active copper ore mining and dressing facilities, must sample and analyze stormwater discharges for the pollutants listed in Table 8.G-1.

Table 8.G-1		
Subsector (You may be subject to requirements for more than one sector/subsector)	Parameter	Benchmark Monitoring Concentration
Subsector G1. Active Copper Ore Mining and Dressing Facilities (SIC 1021)	Total Suspended Solids (TSS)	100 mg/L
	Nitrate plus Nitrite Nitrogen	0.68 mg/L
	Chemical Oxygen Demand (COD)	120 mg/L

8.G.8.2 *Benchmark Monitoring Requirements for Discharges From Waste Rock and Overburden Piles at Active Metal Mining Facilities.* For discharges from waste rock and overburden piles, perform benchmark monitoring once in the first year for the parameters listed in Table 8.G-2, and twice annually in all subsequent years of coverage under this permit for any parameters for which the benchmark has been exceeded. You are also required to conduct analytic monitoring for the parameters listed in Table 8.G-3 in accordance with the requirements in Part 8.G.6.3. The Director may also notify you that you must perform additional monitoring to accurately characterize the quality and quantity of pollutants discharged from your waste rock and overburden piles.

Table 8.G-2.

Subsector (Discharges may be subject to requirements for more than one sector/subsector)	Parameter	Benchmark Monitoring Cutoff Concentration
Subsector G2. Iron Ores; Copper Ores; Lead and Zinc Ores; Gold and Silver Ores; Ferroalloy Ores, Except Vanadium; and Miscellaneous Metal Ores (SIC Codes 1011, 1021, 1031, 1041, 1044, 1061, 1081, 1094, 1099) (Note: when analyzing hardness for a suite of metals, it is more cost effective to add analysis of calcium and magnesium, and have hardness calculated than to require hardness analysis separately)	Total Suspended Solids (TSS)	100 mg/L
	Turbidity	50 NTU
	pH	6.0-9.0 s.u.
	Hardness (as CaCO ₃ ; calc. from Ca, Mg) ¹	no benchmark value
	Total Antimony	0.64 mg/L
	Total Arsenic	0.15 mg/ L
	Total Beryllium	0.13 mg/L
	Total Cadmium ¹	Hardness Dependent
	Total Copper ¹	Hardness Dependent
	Total Iron	1.0 mg/L
	Total Lead ¹	Hardness Dependent
	Total Mercury	0.0014 mg/L
	Total Nickel ¹	Hardness Dependent
	Total Selenium	0.005 mg/L
Total Silver ¹	Hardness Dependent	
Total Zinc ¹	Hardness Dependent	

¹ The benchmark values of some metals are dependent on water hardness. For these parameters, permittees must determine the hardness of the receiving water (see Appendix J, “Calculating Hardness in Receiving Waters for Hardness Dependent Metals,” for methodology), in accordance with Part 6.2.1.1, to identify the applicable ‘hardness range’ for determining their benchmark value applicable to their facility. The ranges occur in 25 mg/L increments. Hardness Dependent Benchmarks follow in the table below:

Water Hardness Range	Cadmium (mg/L)	Copper (mg/L)	Lead (mg/L)	Nickel (mg/L)	Silver (mg/L)	Zinc (mg/L)
0-25 mg/L	0.0005	0.0038	0.014	0.15	0.0007	0.04
25-50 mg/L	0.0008	0.0056	0.023	0.20	0.0007	0.05
50-75 mg/L	0.0013	0.0090	0.045	0.32	0.0017	0.08
75-100 mg/L	0.0018	0.0123	0.069	0.42	0.0030	0.11
100-125 mg/L	0.0023	0.0156	0.095	0.52	0.0046	0.13
125-150 mg/L	0.0029	0.0189	0.122	0.61	0.0065	0.16
150-175 mg/L	0.0034	0.0221	0.151	0.71	0.0087	0.18
175-200 mg/L	0.0039	0.0253	0.182	0.80	0.0112	0.20
200-225 mg/L	0.0045	0.0285	0.213	0.89	0.0138	0.23
225-250 mg/L	0.0050	0.0316	0.246	0.98	0.0168	0.25
250+ mg/L	0.0053	0.0332	0.262	1.02	0.0183	0.26

8.G.8.3 Additional Analytic Monitoring Requirements for Discharges From Waste Rock and Overburden Piles at Active Metal Mining Facilities. In addition to the monitoring required in Part 8.G.6.2 for discharges from waste rock and overburden piles, you must also conduct monitoring for additional parameters based on the type of ore you mine at your site. Where a parameter in Table 8.G-3 is the same as a pollutant you are required

to monitor for in Table 8.G-2 (i.e., for all of the metals, you must use the corresponding benchmark in Table 8.G-2 and you may use any monitoring results conducted for Part 8.G.6.2 to satisfy the monitoring requirement for that parameter for Part 8.G.6.3. For radium and uranium, which do not have corresponding benchmarks in Table 8.G-2, there are no applicable benchmarks.) The frequency and schedule for monitoring for these additional parameters is the same as that specified in Part 6.2.1.2.

Table 8.G-3. Additional Monitoring Requirements for Discharges from Waste Rock and Overburden Piles			
Supplemental Requirements			
Type of Ore Mined	Pollutants of Concern		
	Total Suspended Solids (TSS)	pH	Metals, Total
Tungsten Ore	X	X	Arsenic, Cadmium (H), Copper (H), Lead (H), Zinc (H)
Nickel Ore	X	X	Arsenic, Cadmium (H), Copper (H), Lead (H), Zinc (H)
Aluminum Ore	X	X	Iron
Mercury Ore	X	X	Nickel (H)
Iron Ore	X	X	Iron (Dissolved)
Platinum Ore			Cadmium (H), Copper (H), Mercury, Lead (H), Zinc (H)
Titanium Ore	X	X	Iron, Nickel (H), Zinc (H)
Vanadium Ore	X	X	Arsenic, Cadmium (H), Copper (H), Lead (H), Zinc (H)
Molybdenum	X	X	Arsenic, Cadmium (H), Copper (H), Lead (H), Mercury, Zinc (H)
Uranium, Radium, and Vanadium Ore	X	X	Chemical Oxygen Demand, Arsenic, Radium (Dissolved and Total), Uranium, Zinc (H)

Note: An "X" indicated for TSS and/or pH means that you are required to monitor for those parameters. (H) indicates that hardness must also be measured when this pollutant is measured.

8.G.8.4 Inactive and Unstaffed Sites – Conditional Exemption from No Exposure Requirements for Quarterly Visual Assessments and Routine Facility Inspections. As a Sector G facility, if you are seeking to exercise a waiver from the quarterly visual assessment and routine facility inspection requirements for inactive and unstaffed sites (including temporarily inactive sites), you are conditionally exempt from the requirement to certify that “there are no industrial materials or activities exposed to stormwater” in Part 4.2.3. This exemption is conditioned on the following:

- If circumstances change and your facility becomes active and/or staffed, this exception no longer applies and you must immediately begin complying with the quarterly visual assessment requirements; and
- EPA retains the authority to revoke this exemption and/or the monitoring waiver where it is determined that the discharge causes, has a reasonable potential to cause,

or contributes to an instream excursion above an applicable water quality standard, including designated uses.

Subject to the two conditions above, if your facility is inactive and unstaffed, you are waived from the requirement to conduct quarterly visual assessments and routine facility inspections. You are not waived from conducting the Part 4.3 comprehensive site inspection. You are encouraged to inspect your site more frequently where you have reason to believe that severe weather or natural disasters may have damaged control measures or increased discharges.

Discharge/Source of Discharge	Note/Comment
Piles	
Waste rock/overburden	If composed entirely of stormwater and not combining with mine drainage. See note below.
Topsoil	--
Roads constructed of waste rock or spent ore	
Onsite haul roads	If composed entirely of stormwater and not combining with mine drainage. See note below.
Offsite haul and access roads	--
Roads not constructed of waste rock or spent ore	
Onsite haul roads	Except if mine drainage is used for dust control
Offsite haul and access roads	--
Milling/concentrating	
Runoff from tailings dams and dikes when constructed of waste rock/tailings	Except if process fluids are present and only if composed entirely of stormwater and not combining with mine drainage. See Note below.
Runoff from tailings dams/dikes when not constructed of waste rock and tailings	Except if process fluids are present
Concentration building	If stormwater only and no contact with piles
Mill site	If stormwater only and no contact with piles
Ancillary areas	
Office and administrative building and housing	If mixed with stormwater from the industrial area
Chemical storage area	--
Docking facility	Except if excessive contact with waste product that would otherwise constitute mine drainage
Explosive storage	--
Fuel storage (oil tanks/coal piles)	--
Vehicle and equipment maintenance area/building	--
Parking areas	But coverage unnecessary if only employee and visitor-type parking
Power plant	
Truck wash area	Except when excessive contact with waste product that would otherwise constitute mine drainage

Table 8.G-4. Applicability of the Multi-Sector General Permit to Stormwater Runoff From Active Mining and Dressing Sites, Temporarily Inactive Sites, and Sites Undergoing Reclamation

Reclamation-related areas	
Any disturbed area (unreclaimed)	Only if not in active mining area
Reclaimed areas released from reclamation requirements prior to Dec. 17, 1990	--
Partially/inadequately reclaimed areas or areas not released from reclamation requirements	--

Note: Stormwater runoff from these sources are subject to the NPDES program for stormwater unless mixed with discharges subject to 40 CFR Part 440 that are regulated by another permit prior to mixing. Non-stormwater discharges from these sources are subject to NPDES permitting and may be subject to the effluent limitation guidelines under 40 CFR Part 440. Discharges from overburden/waste rock and overburden/waste rock-related areas are not subject to 40 CFR Part 440 unless: (1) it drains naturally (or is intentionally diverted) to a point source; and (2) combines with "mine drainage" that is otherwise regulated under the Part 440 regulations. For such sources, coverage under this permit would be available if the discharge composed entirely of stormwater does not combine with other sources of mine drainage that are not subject to 40 CFR Part 440, as well as meeting other eligibility criteria contained in Part 1.1 of the permit. Permit applicants bear the initial responsibility for determining the applicable technology-based standard for such discharges. EPA recommends that permit applicants contact the relevant NPDES permit issuance authority for assistance to determine the nature and scope of the "active mining area" on a mine-by-mine basis, as well as to determine the appropriate permitting mechanism for authorizing such discharges.

8.G.9. Termination of Permit Coverage

- 8.G.9.1 *Termination of Permit Coverage for Sites Reclaimed After December 17, 1990.* A site or a portion of a site that has been released from applicable state or federal reclamation requirements after December 17, 1990, is no longer required to maintain coverage under this permit. If the site or portion of a site reclaimed after December 17, 1990, was not subject to reclamation requirements, the site or portion of the site is no longer required to maintain coverage under this permit if the site or portion of the site has been reclaimed as defined in Part 8.G.7.2.
- 8.G.9.2 *Termination of Permit Coverage for Sites Reclaimed Before December 17, 1990.* A site or portion of a site that was released from applicable state or federal reclamation requirements before December 17, 1990, or that was otherwise reclaimed before December 17, 1990, is no longer required to maintain coverage under this permit if the site or portion of the site has been reclaimed. A site or portion of a site is considered to have been reclaimed if: (1) stormwater runoff that comes into contact with raw materials, intermediate byproducts, finished products, and waste products does not have the potential to cause or contribute to violations of state water quality standards, (2) soil disturbing activities related to mining at the sites or portion of the site have been completed, (3) the site or portion of the site has been stabilized to minimize soil erosion, and (4) as appropriate depending on location, size, and the potential to contribute pollutants to stormwater discharges, the site or portion of the site has been revegetated, will be amenable to natural revegetation, or will be left in a condition consistent with the post-mining land use.

Part 8 – Sector-Specific Requirements for Industrial Activity

Subpart H – Sector H – Coal Mines and Coal Mining-Related Facilities.

You must comply with Part 8 sector-specific requirements associated with your primary industrial activity and any co-located industrial activities, as defined in Appendix A. The sector-specific requirements apply to those areas of your facility where those sector-specific activities occur. These sector-specific requirements are in addition to any requirements specified elsewhere in this permit.

8.H.1 Covered Stormwater Discharges.

The requirements in Subpart H apply to stormwater discharges associated with industrial activity from Coal Mines and Coal Mining-Related facilities as identified by the SIC Codes specified under Sector H in Table D-1 of Appendix D.

8.H.2 Limitations on Coverage.

8.H.2.1 *Prohibition of Non-Stormwater Discharges.* (See also Part 1.1.4) Not covered by this permit: discharges from pollutant seeps or underground drainage from inactive coal mines and refuse disposal areas that do not result from precipitation events, and discharges from floor drains in maintenance buildings and other similar drains in mining and preparation plant areas.

8.H.2.2 *Discharges Subject to Stormwater Effluent Guidelines.* (See also Part 1.1.4.4) Not authorized by this permit: stormwater discharges subject to an existing effluent limitation guideline at 40 CFR Part 434.

8.H.3 Definitions

The following definitions are not intended to supersede the definitions of active and inactive mining facilities established by 40 CFR 122.26(b)(14)(iii).

8.H.3.1 *Mining operation* - Consists of the active and temporarily inactive phases, and the reclamation phase, but excludes the exploration and construction phases.

8.H.3.2 *Exploration phase* - Entails exploration and land disturbance activities to determine the financial viability of a site. The exploration phase is not considered part of “mining operations.”

8.H.3.3 *Construction phase* - Includes the building of site access roads and removal of overburden and waste rock to expose mineable coal. The construction phase is not considered part of “mining operations.”

8.H.3.4 *Active phase* - Activities including the extraction, removal or recovery of coal. For surface mines, this definition does not include any land where grading has returned the earth to a desired contour and reclamation has begun. This definition is derived from the definition of “active mining area” found at 40 CFR 434.11(b). The active phase is considered part of “mining operations.”

- 8.H.3.5 *Reclamation phase* - Activities undertaken, in compliance with applicable mined land reclamation requirements, following the cessation of the “active phase”, intended to return the land to an appropriate post-mining land use. The reclamation phase is considered part of “mining operations.”
- 8.H.3.6 *Active coal mining facility* - A place where work or other activity related to the extraction, removal, or recovery of coal is being conducted. For surface mines, this definition does not include any land where grading has returned the earth to a desired contour and reclamation has begun. This definition is derived from the definition of “active mining area” found at 40 CFR 434.11(b).
- 8.H.3.7 *Inactive coal mining facility* - A site or portion of a site where coal mining and/or milling occurred in the past but is not an active facility as defined above, and where the inactive portion is not covered by an active mining permit issued by the applicable State or Federal agency. An inactive coal mining facility has an identifiable owner / operator. Sites where mining claims are being maintained prior to disturbances associated with the extraction, beneficiation, or processing of mined materials and sites where minimal activities are undertaken for the sole purpose of maintaining a mining claim are not considered either active or inactive mining facilities and do not require an NPDES industrial stormwater permit.
- 8.H.3.8 *Temporarily inactive coal mining facility* - A site or portion of a site where coal mining and/or milling occurred in the past but currently are not being actively undertaken, and the facility is covered by an active mining permit issued by the applicable State or Federal agency.
- 8.H.3.9 *Final Stabilization* - A site or portion of a site is “finally stabilized” when it has implemented all applicable Federal and State reclamation requirements.

8.H.4 Technology-Based Effluent Limits for Clearing, Grading, and Excavation Activities.

Clearing, grading, and excavation activities being conducted as part of the exploration and construction phase of mining activities are covered under this permit.

- 8.H.4.1 Management Practices for Clearing, Grading, and Excavation Activities.
- 8.H.4.1.1 *Selecting and installing control measures.* For all areas affected by clearing, grading, and excavation activities, you must select, design, install, and implement control measures that meet applicable Part 2 effluent limits.
- 8.H.4.1.2 *Good Housekeeping.* Litter, debris, and chemicals must be prevented from becoming a pollutant source in stormwater discharges.
- 8.H.4.1.3 *Retention and Detention of Stormwater Runoff.* For drainage locations serving more than one acre, sediment basins and/or temporary sediment traps should be used. At a minimum, silt fences, vegetative buffer strips, or equivalent sediment controls are required for all down slope boundaries (and side slope boundaries as necessary based on individual site conditions) of the development area unless a sediment basin providing storage for a calculated volume of runoff from a 2-year, 24-hour storm or 3,600 cubic feet of storage

per acre drained is provided. You are required to remove sediment from sediment traps or sedimentation ponds when design capacity has been reduced by 50 percent. Due to high sediment discharges from some Sector H facilities, permittees may need to implement a combination of structural BMP approaches to sufficiently decrease discharge of sediment from their facilities.

8.H.4.2 *Inspection of Clearing, Grading, and Excavation Activities.*

8.H.4.2.1 *Inspection Frequency.* Inspections must be conducted either at least once every 7 calendar days, or at least once every 14 calendar days and within 24 hours of the end of a storm event of 0.5 inches or greater. Inspection frequency may be reduced to at least once every month if the entire site is temporarily stabilized (pursuant to Part 8.H.4.3.2), if runoff is unlikely due to winter (e.g., site is covered with snow or ice) or frozen conditions, or construction is occurring during seasonal dry periods in arid areas and semi-arid areas.

8.H.4.2.2 *Location of Inspections.* Inspections must include all areas of the site disturbed by clearing, grading, and/or excavation activities and areas used for storage of materials that are exposed to precipitation. Sedimentation and erosion control measures must be observed to ensure proper operation. Discharge locations must be inspected to ascertain whether erosion control measures are effective in preventing significant impacts to waters of the United States, where accessible. Where discharge locations are inaccessible, nearby downstream locations must be inspected to the extent that such inspections are practicable. Locations where vehicles enter or exit the site must be inspected for evidence of significant off-site sediment tracking.

8.H.4.2.3 *Inspection Reports.* For each inspection required above, you must complete an inspection report. At a minimum, the inspection report must include the information required in Part 4.1.

8.H.4.3 *Requirements for Cessation of Clearing, Grading, and Excavation Activities.*

8.H.4.3.1 *Inspections and Maintenance.* Inspections and maintenance of control measures, including BMPs, associated with clearing, grading, and/or excavation activities being conducted as part of the exploration and construction phase of a mining operation must continue until final stabilization has been achieved on all portions of the disturbed area.

8.H.4.3.2 *Temporary Stabilization of Disturbed Areas.* Stabilization measures should be initiated immediately in portions of the site where clearing, grading and/or excavation activities have temporarily ceased, but in no case more than 14 days after the clearing, grading and/or excavation activities in that portion of the site have temporarily ceased. In arid, semiarid, and drought-stricken areas, or in areas subject to snow or freezing conditions, where initiating perennial vegetative stabilization measures is not possible within 14 days after mining, exploration, and/or construction activity has temporarily ceased, temporary vegetative stabilization measures must be initiated as soon as practicable.

Until temporary vegetative stabilization is achieved, interim measures such as erosion control blankets with an appropriate seed base and tackifiers must be employed. In areas of the site, where exploration and/or construction has permanently ceased prior to active mining, temporary stabilization measures must be implemented to minimize mobilization of sediment or other pollutants until such time as the active mining phase commences.

- 8.H.4.3.2 *Final Stabilization of Disturbed Areas.* Stabilization measures should be initiated immediately in portions of the site where exploration and/or construction activities have permanently ceased, but in no case more than 14 days after the exploration and/or construction activity in that portion of the site has permanently ceased. In arid, semiarid, and drought-stricken areas, or in areas subject to snow or freezing conditions, or in areas subject to snow or freezing conditions, where initiating perennial vegetative stabilization measures is not possible within 14 days after mining, exploration, and/or construction activity has permanently ceased, temporary vegetative stabilization measures must be initiated as soon as possible. Until final stabilization is achieved temporary stabilization measures, such as erosion control blankets with an appropriate seed base and tackifiers, must be used.

8.H.5 Additional Technology-Based Effluent Limits.

- 8.H.5.1 *Good Housekeeping Measures.* (See also Part 2.1.2.2) As part of your good housekeeping program, consider using sweepers and covered storage, watering haul roads to minimize dust generation, and conserving vegetation (where possible) to minimize erosion.
- 8.H.5.2 *Preventive Maintenance.* (See also Part 2.1.2.3) Perform inspections or other equivalent measures of storage tanks and pressure lines of fuels, lubricants, hydraulic fluid, and slurry to prevent leaks due to deterioration or faulty connections.

8.H.6 Additional SWPPP Requirements.

- 8.H.6.1 *Other Applicable Regulations.* Most active coal mining-related areas (SIC Codes 1221-1241) are subject to sediment and erosion control regulations of the U.S. Office of Surface Mining (OSM) that enforces the Surface Mining Control and Reclamation Act (SMCRA). OSM has granted authority to most coal-producing states to implement SMCRA through State SMCRA regulations. All SMCRA requirements regarding control of stormwater-related pollutant discharges must be addressed and then documented with the SWPPP (directly or by reference).
- 8.H.6.2 *Site Map.* (See also Part 5.1.2) Document in your SWPPP where any of the following may be exposed to precipitation or surface runoff: haul and access roads; railroad spurs, sliding, and internal hauling lines; conveyor belts, chutes, and aerial tramways; equipment storage and maintenance yards; coal handling buildings and structures; and inactive mines and related areas; acidic spoil, refuse, or unreclaimed disturbed areas; and liquid storage tanks containing pollutants such as caustics, hydraulic fluids, and lubricants.

8.H.6.3 *Potential Pollutant Sources.* (See also Part 5.1.3) Document in your SWPPP the following sources and activities that have potential pollutants associated with them: truck traffic on haul roads and resulting generation of sediment subject to runoff and dust generation; fuel or other liquid storage; pressure lines containing slurry, hydraulic fluid, or other potential harmful liquids; and loading or temporary storage of acidic refuse or spoil.

8.H.7 Additional Inspection Requirements.

8.H.7.1 *Inspections of Active Mining-Related Areas.* (See also Part 4) Except for areas of the site subject to clearing, grading, and/or excavation activities conducted as part of the exploration and construction phase, which are subject to Part 8.H.4.2.1, perform quarterly inspections of active mining areas covered by this permit, corresponding with the inspections as performed by SMCRA inspectors, of all mining-related areas required by SMCRA. Also maintain the records of the SMCRA authority representative. See Part 8.H.8.1 for inspection requirements for inactive and unstaffed sties.

8.H.7.2 *Sediment and Erosion Control.* (See also Part 2.1.2.5) As indicated in Part 8.H.6.1, SMCRA requirements regarding sediment and erosion control measures must be complied with for those areas subject to SMCRA authority, including inspection requirements.

8.H.7.3 *Comprehensive Site Inspections.* (See also Part 4.3) Your inspection program must include inspections for pollutants entering the drainage system from activities located on or near coal mining-related areas. Among the areas to be inspected are haul and access roads; railroad spurs, sliding, and internal hauling lines; conveyor belts, chutes, and aerial tramways; equipment storage and maintenance yards; coal handling buildings and structures; and inactive mines and related areas.

8.H.8 Sector-Specific Benchmarks. (See also Part 6 of the permit.)

Subsector (You may be subject to requirements for more than one sector/subsector)	Parameter	Benchmark Monitoring Concentration
Subsector H1. Coal Mines and Related Areas (SIC 1221-1241)	Total Aluminum	0.75 mg/L
	Total Iron	1.0 mg/L
	Total Suspended Solids (TSS)	100 mg/L

8.H.8.1 *Inactive and Unstaffed Sites – Conditional Exemption from No Exposure Requirement for Routine Inspections, Quarterly Visual Assessments, and Benchmark Monitoring.* As a Sector H facility, if you are seeking to exercise a waiver from either the quarterly visual assessment or the benchmark monitoring requirements for inactive and unstaffed sites (including temporarily inactive sites), you are conditionally exempt from the requirement to certify that “there are no industrial materials or activities exposed to

stormwater” in Parts 4.2.3 and 6.2.1.3, respectively. Additionally, if you are seeking to reduce your required quarterly routine inspection frequency to a once annual comprehensive inspection, as is allowed under Part 4.1.3, you are also conditionally exempt from the requirement to certify that “there are no industrial materials or activities exposed to stormwater.” These conditional exemptions are based on the following requirements:

- If circumstances change and your facility becomes active and/or staffed, this exception no longer applies and you must immediately begin complying with the applicable benchmark monitoring requirements as if you were in your first year of permit coverage, and the quarterly visual assessment requirements; and
- EPA retains the authority to revoke this exemption and/or the monitoring waiver where it is determined that the discharge causes, has a reasonable potential to cause or contribute to an instream excursion above an applicable water quality standard, including designated uses.

Subject to the two conditions above, if your facility is inactive and unstaffed, you are waived from the requirement to conduct quarterly visual assessments and routine facility inspections. You are not waived from conducting the Part 4.3 comprehensive site inspection. You are encouraged to inspect your site more frequently where you have reason to believe that severe weather or natural disasters may have damaged control measures or increased discharges.

8.H.9 Termination of Permit Coverage

- 8.H.9.1 *Termination of Permit Coverage for Sites Reclaimed After December 17, 1990.* A site or a portion of a site that has been released from applicable state or federal reclamation requirements after December 17, 1990, is no longer required to maintain coverage under this permit. If the site or portion of a site reclaimed after December 17, 1990, was not subject to reclamation requirements, the site or portion of the site is no longer required to maintain coverage under this permit if the site or portion of the site has been reclaimed as defined in Part 8.H.7.2.
- 8.H.9.2 *Termination of Permit Coverage for Sites Reclaimed Before December 17, 1990.* A site or portion of a site that was released from applicable state or federal reclamation requirements before December 17, 1990, or that was otherwise reclaimed before December 17, 1990, is no longer required to maintain coverage under this permit if the site or portion of the site has been reclaimed. A site or portion of a site is considered to have been reclaimed if: (1) stormwater runoff that comes into contact with raw materials, intermediate byproducts, finished products, and waste products does not have the potential to cause or contribute to violations of state water quality standards, (2) soil disturbing activities related to mining at the sites or portion of the site have been completed, (3) the site or portion of the site has been stabilized to minimize soil erosion, and (4) as appropriate depending on location, size, and the potential to contribute pollutants to stormwater discharges, the site or portion of the site has been revegetated, will be amenable to natural revegetation, or will be left in a condition consistent with the post-mining land use.

Part 8 – Sector-Specific Requirements for Industrial Activity

Subpart I – Sector I – Oil and Gas Extraction.

You must comply with Part 8 sector-specific requirements associated with your primary industrial activity and any co-located industrial activities, as defined in Appendix A. The sector-specific requirements apply to those areas of your facility where those sector-specific activities occur. These sector-specific requirements are in addition to any requirements specified elsewhere in this permit.

8.I.1 Covered Stormwater Discharges.

The requirements in Subpart I apply to stormwater discharges associated with industrial activity from Oil and Gas Extraction facilities as identified by the SIC Codes specified under Sector I in Table D-1 of Appendix D of the permit.

Discharges of stormwater runoff from field activities or operations associated with oil and gas exploration, production, processing, or treatment operations or transmission facilities are exempt from NPDES permit coverage unless, in accordance with 40 CFR 122.26(c)(1)(iii), the facility:

- Has had a discharge of stormwater resulting in the discharge of a reportable quantity for which notification is or was required pursuant to 40 CFR 117.21 or 40 CFR 302.6 at anytime since November 16, 1987; or
- Has had a discharge of stormwater resulting in the discharge of a reportable quantity for which notification is or was required pursuant to 40 CFR 110.6 at any time since November 16, 1987; or
- Contributes to a violation of a water quality standard.

Any stormwater discharges that require permit coverage as a result of meeting one of the conditions of 122.26(c)(1)(iii) may be covered under this permit unless otherwise required to obtain coverage under an alternative NPDES general permit or an individual NPDES permit as specified in Part 1.6.1.

8.I.2 Limitations on Coverage.

8.I.2.1 *Stormwater Discharges Subject to Effluent Limitation Guidelines.* (See also Part 1.1.4.4) This permit does not authorize stormwater discharges from petroleum drilling operations that are subject to nationally established effluent limitation guidelines found at 40 CFR Part 435, respectively.

8.I.2.2 *Non-Stormwater Discharges.* Discharges of vehicle and equipment washwater, including tank cleaning operations, are not authorized by this permit. Alternatively, washwater discharges must be authorized under a separate NPDES permit, or be discharged to a sanitary sewer in accordance with applicable industrial pretreatment requirements.

8.1.3 Additional Technology-Based Effluent Limits.

8.1.3.1 *Vegetative Controls.* Implement vegetative practices designed to preserve existing vegetation, where attainable, and revegetate open areas as soon as practicable after grade drilling. Consider the following (or equivalent measures): temporary or permanent seeding, mulching, sod stabilization, vegetative buffer strips, and tree protection practices. Begin implementing appropriate vegetative practices on all disturbed areas within 14 days following the last activity in that area.

8.1.4 Additional SWPPP Requirements.

8.1.4.1 *Drainage Area Site Map.* (See also Part 5.1.2) Document in your SWPPP where any of the following may be exposed to precipitation or surface runoff: Reportable Quantity (RQ) releases; locations used for the treatment, storage, or disposal of wastes; processing areas and storage areas; chemical mixing areas; construction and drilling areas; all areas subject to the effluent guidelines requirements for “No Discharge” in accordance with 40 CFR 435.32; and the structural controls to achieve compliance with the “No Discharge” requirements.

8.1.4.2 *Potential Pollutant Sources.* (See also Part 5.1.3) Also document in your SWPPP the following sources and activities that have potential pollutants associated with them: chemical, cement, mud, or gel mixing activities; drilling or mining activities; and equipment cleaning and rehabilitation activities. In addition, include information about the reportable quantity (RQ) release that triggered the permit application requirements: the nature of the release (e.g., spill of oil from a drum storage area), amount of oil or hazardous substance released, amount of substance recovered, date of the release, cause of the release (e.g., poor handling techniques and lack of containment in the area), areas affected by the release (i.e., land and water), procedure to clean up release, actions or procedures implemented to prevent or improve response to a release, and remaining potential contamination of stormwater from release (taking into account human health risks, the control of drinking water intakes, and the designated uses of the receiving water).

8.1.4.3 *Erosion and Sedimentation Control.* (See also Part 2.1.2.5) Unless covered by the current Construction General Permit (CGP), the additional documentation requirements for sediment and erosion controls for well drillings and sand/shale mining areas include the following:

8.1.4.3.1 *Site Description.* Also include a description in your SWPPP of the nature of the exploration activity, estimates of the total area of site and area disturbed due to exploration activity, an estimate of runoff coefficient of the site, a site drainage map, including approximate slopes, and the names of all receiving waters.

8.1.4.3.2 *Vegetative Controls.* Document vegetative practices used consistent with Part 8.1.3.1 in the SWPPP.

8.1.5 Additional Inspection Requirements.

All erosion and sedimentation control measures must be inspected every 7 days.

Part 8 – Sector-Specific Requirements for Industrial Activity

Subpart J – Sector J – Non-Metallic Mineral Mining and Dressing.

You must comply with Part 8 sector-specific requirements associated with your primary industrial activity and any co-located industrial activities, as defined in Appendix A. The sector-specific requirements apply to those areas of your facility where those sector-specific activities occur. These sector-specific requirements are in addition to any requirements specified elsewhere in this permit.

8.J.1 Covered Stormwater Discharges.

The requirements in Subpart J apply to stormwater discharges associated with industrial activity from Active and Inactive Non-Metallic Mineral Mining and Dressing facilities as identified by the SIC Codes specified under Sector J in Table D-1 of Appendix D of the permit.

8.J.1.1 *Covered Discharges from Inactive Facilities.* All stormwater discharges.

8.J.1.2 *Covered Discharges from Active and Temporarily Inactive Facilities.* All stormwater discharges, except for most stormwater discharges subject to the existing effluent limitation guideline at 40 CFR Part 436. Mine dewatering discharges composed entirely of stormwater or uncontaminated ground water seepage from: construction sand and gravel, industrial sand, and crushed stone mining facilities in Regions 1, 2, 3, 6, 9, and 10 are covered by this permit.

8.J.1.3 *Covered Discharges from Exploration and Construction of Non-Metallic Mineral Mining Facilities.* All stormwater discharges.

8.J.1.4 Covered Discharges from Sites Undergoing Reclamation. All stormwater discharges.

8.J.2 Limitations on Coverage.

Most stormwater discharges subject to an existing effluent limitation guideline at 40 CFR Part 436 are not authorized by this permit. The exceptions to this limitation, which are covered by this permit, are mine dewatering discharges composed entirely of stormwater or uncontaminated ground water seepage from construction sand and gravel, industrial sand, and crushed stone mining facilities in Regions 1, 2, 3, 6, 9, and 10.

8.J.3 Definitions.

The following definitions are not intended to supersede the definitions of active and inactive mining facilities established by 40 CFR 122.26(b)(14)(iii).

8.J.3.1 *Mining operations* - Consists of the active and temporarily inactive phases, and the reclamation phase, but excludes the exploration and construction phases.

8.J.3.2 *Exploration phase* - Entails exploration and land disturbance activities to determine the financial viability of a site. The exploration phase is not considered part of “mining operations.”

- 8.J.3.3 *Construction phase* - Includes the building of site access roads and removal of overburden and waste rock to expose mineable minerals. The construction phase is not considered part of “mining operations”.
- 8.J.3.4 *Active phase* - Activities including the extraction, removal or recovery of minerals. For surface mines, this definition does not include any land where grading has returned the earth to a desired contour and reclamation has begun. This definition is derived from the definition of “active mining area” found at 40 CFR 440.132(a). The active phase is considered part of “mining operations.”
- 8.J.3.5 *Reclamation phase* - Activities undertaken, in compliance with applicable mined land reclamation requirements, following the cessation of the “active phase”, intended to return the land to an appropriate post-mining land use. The reclamation phase is considered part of “mining operations”.

NOTE: The following definitions are not intended to supersede the definitions of active and inactive mining facilities established by 40 CFR 122.26(b)(14)(iii).

- 8.J.3.6 *Active Mineral Mining Facility* - A place where work or other activity related to the extraction, removal, or recovery of minerals is being conducted. For surface mines, this definition does not include any land where grading has returned the earth to a desired contour and reclamation has begun. This definition is derived from the definition of “active mining area” found at 40 CFR 440.132(a).
- 8.J.3.7 *Inactive Mineral Mining Facility* - A site or portion of a site where mineral mining and/or milling occurred in the past but is not an active facility as defined above, and where the inactive portion is not covered by an active mining permit issued by the applicable State or Federal agency. An inactive mineral mining facility has an identifiable owner / operator. Sites where mining claims are being maintained prior to disturbances associated with the extraction, beneficiation, or processing of mined materials, and sites where minimal activities are undertaken for the sole purpose of maintaining a mining claim are not considered either active or inactive mining facilities and do not require an NPDES industrial stormwater permit.
- 8.J.3.8 *Temporarily Inactive Mineral Mining Facility* - A site or portion of a site where metal mining and/or milling occurred in the past but currently are not being actively undertaken, and the facility is covered by an active mining permit issued by the applicable State or Federal agency.
- 8.J.3.9 *Final Stabilization* - a site or portion of a site is “finally stabilized” when it has implemented all applicable Federal and State reclamation requirements.
- 8.J.3.10 *Uncontaminated* - Free from the presence of pollutants attributable to industrial activity.

8.J.4 Technology-Based Effluent Limits for Clearing, Grading, and Excavation Activities.

Clearing, grading, and excavation activities being conducted as part of the exploration and construction phase of mining activities are covered under this permit.

- 8.J.4.1 *Management Practices for Clearing, Grading, and Excavation Activities.*

- 8.J.4.1.1 *Selecting and installing control measures.* For all areas affected by clearing, grading, and excavation activities, you must select, design, install, and implement control measures that meet applicable Part 2 effluent limits.
- 8.J.4.1.2 *Good Housekeeping.* (See also Part 2.1.2.2) Litter, debris, and chemicals must be prevented from becoming a pollutant source in stormwater discharges.
- 8.J.4.1.3 *Retention and Detention of Stormwater Runoff.* For drainage locations serving more than one acre, sediment basins and/or temporary sediment traps should be used. At a minimum, silt fences, vegetative buffer strips, or equivalent sediment controls are required for all down slope boundaries (and for those side slope boundaries deemed appropriate as dictated by individual site conditions) of the development area unless a sediment basin providing storage for a calculated volume of runoff from a 2-year, 24-hour storm or 3,600 cubic feet of storage per acre drained is provided.
- 8.J.4.2 *Inspection of Clearing, Grading, and Excavation Activities.* (See also Part 4)
- 8.J.4.2.1 *Inspection Frequency.* Inspections must be conducted either at least once every 7 calendar days or at least once every 14 calendar days and within 24 hours of the end of a storm event of 0.5 inches or greater. Inspection frequency may be reduced to at least once every month if the entire site is temporarily stabilized (pursuant to Part 8.J.4.3.2), if runoff is unlikely due to winter conditions (e.g., site is covered with snow, ice, or the ground is frozen), or construction is occurring during seasonal arid periods in arid areas and semi-arid areas.
- 8.J.4.2.2 *Location of Inspections.* Inspections must include all areas of the site disturbed by clearing, grading, and/or excavation activities and areas used for storage of materials that are exposed to precipitation. Sedimentation and erosion control measures implemented must be observed to ensure proper operation. Discharge locations must be inspected to ascertain whether erosion control measures are effective in preventing significant impacts to waters of the United States, where accessible. Where discharge locations are inaccessible, nearby downstream locations must be inspected to the extent that such inspections are practicable. Locations where vehicles enter or exit the site must be inspected for evidence of significant off-site sediment tracking.
- 8.J.4.2.3 *Inspection Reports.* (See also Part 4.1) For each inspection required above, you must complete an inspection report. At a minimum, the inspection report must include the information required in Part 4.1.
- 8.J.4.3 *Requirements for Cessation of Clearing, Grading, and Excavation Activities.*
- 8.J.4.3.1 *Inspections and Maintenance.* Inspections and maintenance of control measures, including any BMPs, associated with clearing, grading, and/or excavation activities being conducted as part of the exploration and construction phase of a mining operation must continue until final stabilization has been achieved on all portions of the disturbed area or until the

commencement of the active mining phase for those areas that have been temporarily stabilized as a precursor to mining

- 8.J.4.3.2 *Temporary Stabilization of Disturbed Areas.* Stabilization measures should be initiated immediately in portions of the site where clearing, grading and/or excavation activities have temporarily ceased, but in no case more than 14 days after the clearing, grading and/or excavation activities in that portion of the site have temporarily ceased. In arid, semiarid, and drought-stricken areas, or in areas subject to snow or freezing conditions, where initiating perennial vegetative stabilization measures is not possible within 14 days after mining, exploration, and/or construction activity has temporarily ceased, temporary vegetative stabilization measures must be initiated as soon as practicable. Until temporary vegetative stabilization is achieved, interim measures such as erosion control blankets with an appropriate seed base and tackifiers must be employed. In areas of the site, where exploration and/or construction has permanently ceased prior to active mining, temporary stabilization measures must be implemented to minimize mobilization of sediment or other pollutants until such time as the active mining phase commences.
- 8.J.4.3.3 *Final Stabilization of Disturbed Areas.* Stabilization measures should be initiated immediately in portions of the site where mining, exploration, and/or construction activities have permanently ceased, but in no case more than 14 days after the exploration and/or construction activity in that portion of the site has permanently ceased. In arid, semiarid, and drought-stricken areas, or in areas subject to snow or freezing conditions, where initiating perennial vegetative stabilization measures is not possible within 14 days after mining, exploration, and/or construction activity has permanently ceased, final vegetative stabilization measures must be initiated as soon as possible. Until final stabilization is achieved temporary stabilization measures, such as erosion control blankets with an appropriate seed base and tackifiers must be used.

8.J.5 Additional Technology-Based Effluent Limits.

- 8.J.5.1 *Employee Training.* Conduct employee training at least annually at active and temporarily inactive sites. (See also Part 2.1.2.9)
- 8.J.5.2 *Stormwater Controls.* Apart from the control measures you implement to meet your Part 2 effluent limits, where necessary to minimize pollutant discharges, implement the following control measures at your site. The potential pollutants identified in Part 8.J.5.3 shall determine the priority and appropriateness of the control measures selected.
- 8.J.5.2.1 *Stormwater Diversions:* Consider diverting stormwater away from potential pollutant sources. Following are some control measure options: interceptor or diversion controls (e.g., dikes, swales, curbs, or berms); pipe slope drains; subsurface drains; conveyance systems (e.g., channels or gutters, open-top box culverts, and waterbars; rolling dips and road sloping; roadway surface water deflector and culverts); or their equivalents.

- 8.J.5.2.2 *Capping*: When capping is necessary to minimize pollutant discharges in stormwater, identify the source being capped and the material used to construct the cap.
- 8.J.5.2.3 *Treatment*: If treatment of stormwater (e.g., chemical or physical systems, oil and water separators, artificial wetlands) is necessary to protect water quality, describe the type and location of treatment used. Passive and/or active treatment of stormwater runoff is encouraged. Treated runoff may be discharged as a stormwater source regulated under this permit provided the discharge is not combined with discharges subject to effluent limitation guidelines for the Mineral Mining and Processing Point Source Category (40 CFR Part 436).
- 8.J.5.3 *Certification of Discharge Testing*: (See also Part 5.1.4.4) Test or evaluate all outfalls covered under this permit for the presence of specific mining-related non-stormwater discharges such as discharges subject to effluent limitations guidelines (e.g., 40 CFR Part 436). Alternatively (if applicable), you may keep a certification with your SWPPP.

8.J.6 Additional SWPPP Requirements.

The requirements in Part 8.J.6 are applicable for sites undergoing exploration and construction, active mineral mining facilities, temporarily inactive mineral mining facilities, and sites undergoing reclamation. The requirements in Part 8.J.6 are not applicable to inactive mineral mining facilities.

- 8.J.6.1 *Nature of Industrial Activities*. (See also Part 5.1.2) Document in your SWPPP the mining and associated activities that can potentially affect the stormwater discharges covered by this permit, including a general description of the location of the site relative to major transportation routes and communities.
- 8.J.6.2 *Site Map*. (See also Part 5.1.2) Document in your SWPPP the locations of the following (as appropriate): mining or milling site boundaries; access and haul roads; outline of the drainage areas of each stormwater outfall within the facility with indications of the types of discharges from the drainage areas; location(s) of all permitted discharges covered under an individual NPDES permit, outdoor equipment storage, fueling, and maintenance areas; materials handling areas; outdoor manufacturing, outdoor storage, and material disposal areas; outdoor chemicals and explosives storage areas; overburden, materials, soils, or waste storage areas; location of mine drainage dewatering or other process water; heap leach pads; off-site points of discharge for mine dewatering and process water; surface waters; boundary of tributary areas that are subject to effluent limitations guidelines; and location(s) of reclaimed areas.
- 8.J.6.3 *Potential Pollutant Sources*. (See also Part 5.1.3) For each area of the mine or mill site where stormwater discharges associated with industrial activities occur, document in your SWPPP the types of pollutants (e.g., heavy metals, sediment) likely to be present in significant amounts. For example, phosphate mining facilities will likely need to document pollutants such as selenium, which can be present in significant amounts in their discharges. Consider these factors: the mineralogy of the waste rock (e.g., acid forming); toxicity and quantity of chemicals used, produced, or discharged; the

likelihood of contact with stormwater; vegetation of site (if any); and history of significant leaks or spills of toxic or hazardous pollutants. Also include a summary of any existing waste rock or overburden characterization data and test results for potential generation of acid rock drainage.

- 8.J.6.4 *Stormwater Controls.* To the extent that you use any of the control measures in Part 8.J.5.2, document them in your SWPPP pursuant to Part 5.1.4. If control measures are implemented or planned but are not listed here (e.g., substituting a less toxic chemical for a more toxic one), include descriptions of them in your SWPPP.
- 8.J.6.4 *Employee Training.* All employee training(s) conducted in accordance with Part 8.J.5.1 must be documented with the SWPPP.
- 8.J.6.5 *Certification of Permit Coverage for Commingled Non-Stormwater Discharges.* If you determine that you are able to certify, consistent with Part 8.J.5.3, that a particular discharge composed of commingled stormwater and non-stormwater is covered under a separate NPDES permit, and that permit subjects the non-stormwater portion to effluent limitations prior to any commingling, you must retain such certification with your SWPPP. This certification must identify the non-stormwater discharges, the applicable NPDES permit(s), the effluent limitations placed on the non-stormwater discharge by the permit(s), and the points at which the limitations are applied.

8.J.7 Additional Inspection Requirements.

Except for areas of the site subject to clearing, grading, and/or excavation activities conducted as part of the exploration and construction phase, which are subject to Part 8.J.4.2.1, you must inspect sites at least quarterly unless adverse weather conditions make the site inaccessible. Sites which discharge to waters which are designated as outstanding waters or waters which are impaired for sediment or nitrogen must be inspected monthly. See Part 8.J.8.1 for inspection requirements for inactive and unstaffed sites. (See also Part 4.1 and 8.J.4.2.)

8.J.8 Sector-Specific Benchmarks

Table 8.J-1 identifies benchmarks that apply to the specific subsectors of Sector J. These benchmarks apply to both your primary industrial activity and any co-located industrial activities, which describe your site activities.

Table 8.J-1.		
Subsector (You may be subject to requirements for more than one sector/subsector)	Parameter	Benchmark Monitoring Concentration
Subsector J1. Sand and Gravel Mining (SIC 1442, 1446)	Nitrate plus Nitrite Nitrogen	0.68 mg/L
	Total Suspended Solids (TSS)	100 mg/L
Subsector J2. Dimension and Crushed Stone and Nonmetallic Minerals (except fuels) (SIC 1411, 1422-1429, 1481, 1499)	Total Suspended Solids (TSS)	100 mg/L

8.J.8.1 *Inactive and Unstaffed Sites – Conditional Exemption from No Exposure Requirement for Routine Inspections, Quarterly Visual Assessments, and Benchmark Monitoring.* As a Sector J facility, if you are seeking to exercise a waiver from either the routine inspection, quarterly visual assessment or the benchmark monitoring requirements for inactive and unstaffed sites (including temporarily inactive sites), you are conditionally exempt from the requirement to certify that “there are no industrial materials or activities exposed to stormwater” in Parts 4.2.3 and 6.2.1.3, respectively. This exemption is conditioned on the following:

- If circumstances change and your facility becomes active and/or staffed, this exception no longer applies and you must immediately begin complying with the applicable benchmark monitoring requirements as if you were in your first year of permit coverage, and the quarterly visual assessment requirements; and
- EPA retains the authority to revoke this exemption and/or the monitoring waiver where it is determined that the discharge causes, has a reasonable potential to cause, or contributes to an instream excursion above an applicable water quality standard, including designated uses.

Subject to the two conditions above, if your facility is inactive and unstaffed, you are waived from the requirement to conduct quarterly visual assessments and routine facility inspections. You are not waived from conducting the Part 4.3 comprehensive site inspection. You are encouraged to inspect your site more frequently where you have reason to believe that severe weather or natural disasters may have damaged control measures or increased discharges.

8.J.9 Effluent Limitations Based on Effluent Limitations Guidelines (See also Part 6.2.2.1 of the permit)

Table 8.J-2 identifies effluent limits that apply to the industrial activities described below. Compliance with these effluent limits is to be determined based on discharges from these industrial activities independent of commingling with any other wastestreams that may be covered under this permit.

Industrial Activity	Parameter	Effluent Limit ¹
Mine dewatering discharges at crushed stone mining facilities (SIC 1422 - 1429)	pH	6.0 - 9.0
Mine dewatering discharges at construction sand and gravel mining facilities (SIC 1442)	pH	6.0 - 9.0
Mine dewatering discharges at industrial sand mining facilities (SIC 1446)	Total Suspended Solids (TSS)	25 mg/L, monthly avg. 45 mg/L, daily maximum
	pH	6.0 - 9.0

¹Monitor annually.

8.J.10 Termination of Permit Coverage

- 8.J.10.1 *Termination of Permit Coverage for Sites Reclaimed After December 17, 1990.* A site or a portion of a site that has been released from applicable state or federal reclamation requirements after December 17, 1990, is no longer required to maintain coverage under this permit. If the site or portion of a site reclaimed after December 17, 1990, was not subject to reclamation requirements, the site or portion of the site is no longer required to maintain coverage under this permit if the site or portion of the site has been reclaimed as defined in Part 8.J.7.2.
- 8.J.10.2 *Termination of Permit Coverage for Sites Reclaimed Before December 17, 1990.* A site or portion of a site that was released from applicable state or federal reclamation requirements before December 17, 1990, or that was otherwise reclaimed before December 17, 1990, is no longer required to maintain coverage under this permit if the site or portion of the site has been reclaimed. A site or portion of a site is considered to have been reclaimed if: (1) stormwater runoff that comes into contact with raw materials, intermediate byproducts, finished products, and waste products does not have the potential to cause or contribute to violations of state water quality standards, (2) soil disturbing activities related to mining at the sites or portion of the site have been completed, (3) the site or portion of the site has been stabilized to minimize soil erosion, and (4) as appropriate depending on location, size, and the potential to contribute pollutants to stormwater discharges, the site or portion of the site has been revegetated, will be amenable to natural revegetation, or will be left in a condition consistent with the post-mining land use.

Part 8 – Sector-Specific Requirements for Industrial Activity

Subpart K – Sector K – Hazardous Waste Treatment, Storage, or Disposal Facilities.

You must comply with Part 8 sector-specific requirements associated with your primary industrial activity and any co-located industrial activities, as defined in Appendix A. The sector-specific requirements apply to those areas of your facility where those sector-specific activities occur. These sector-specific requirements are in addition to any requirements specified elsewhere in this permit.

8.K.1 Covered Stormwater Discharges.

The requirements in Subpart K apply to stormwater discharges associated with industrial activity from Hazardous Waste Treatment, Storage, or Disposal facilities (TSDFs) as identified by the Activity Code specified under Sector K in Table D-1 of Appendix D of the permit.

8.K.2 Industrial Activities Covered by Sector K.

This permit authorizes stormwater discharges associated with industrial activity from facilities that treat, store, or dispose of hazardous wastes, including those that are operating under interim status or a permit under subtitle C of RCRA.

Disposal facilities that have been properly closed and capped, and have no significant materials exposed to stormwater, are considered inactive and do not require permits.

8.K.3 Limitations on Coverage.

8.K.3.1 *Prohibition of Non-Stormwater Discharges.* (See also Part 1.1.4) The following are not authorized by this permit: leachate, gas collection condensate, drained free liquids, contaminated ground water, laboratory-derived wastewater, and contact washwater from washing truck and railcar exteriors and surface areas that have come in direct contact with solid waste at the landfill facility.

8.K.3.2 *Limitations on Coverage for Facilities Providing Commercial TSDF Services.* For facilities located in Region 6 (see Appendix C) coverage is limited to hazardous waste TSDFs that are self-generating (including occasionally accepting wastes from community household hazardous waste collection events as public service), handle only residential wastes, and/or only store hazardous wastes and do not treat or dispose of them. Coverage under this permit is not available to commercial waste disposal and treatment facilities located in Region 6 that dispose and treat on a commercial basis any produced hazardous wastes (i.e., not their own) as a service to commercial or industrial generators.

8.K.4 Definitions.

8.K.4.1 *Contaminated stormwater* - stormwater that comes into direct contact with landfill wastes, the waste handling and treatment areas, or landfill wastewater as defined in Part 8.K.4.5. Some specific areas of a landfill that may produce contaminated stormwater include (but are not limited to) the open face of an active landfill with exposed waste (no cover added); the areas around wastewater treatment operations; trucks, equipment, or machinery that has been in direct contact with the waste; and waste dumping areas.

- 8.K.4.2 *Drained free liquids* - aqueous wastes drained from waste containers (e.g., drums) prior to landfilling.
- 8.K.4.3 *Landfill* - an area of land or an excavation in which wastes are placed for permanent disposal, but that is not a land application or land treatment unit, surface impoundment, underground injection well, waste pile, salt dome formation, salt bed formation, underground mine, or cave as these terms are defined in 40 CFR 257.2, 258.2, and 260.10.
- 8.K.4.4 *Landfill wastewater* - as defined in 40 CFR Part 445 (Landfills Point Source Category), all wastewater associated with, or produced by, landfilling activities except for sanitary wastewater, non-contaminated stormwater, contaminated groundwater, and wastewater from recovery pumping wells. Landfill wastewater includes, but is not limited to, leachate, gas collection condensate, drained free liquids, laboratory derived wastewater, contaminated stormwater, and contact washwater from washing truck, equipment, and railcar exteriors and surface areas that have come in direct contact with solid waste at the landfill facility.
- 8.K.4.5 *Leachate* - liquid that has passed through or emerged from solid waste and contains soluble, suspended, or miscible materials removed from such waste.
- 8.K.4.6 *Non-contaminated stormwater* - stormwater that does not come into direct contact with landfill wastes, the waste handling and treatment areas, or landfill wastewater as defined in Part 8.K.4.4. Non-contaminated stormwater includes stormwater that flows off the cap, cover, intermediate cover, daily cover, and/or final cover of the landfill.

8.K.5 Sector-Specific Benchmarks

Table 8.K-1 identifies benchmarks that apply to the specific subsectors of Sector K. These benchmarks apply to both your primary industrial activity and any co-located industrial activities, which describe your site activities.

Subsector (You may be subject to requirements for more than one sector/subsector)	Parameter	Benchmark Monitoring Concentration
Subsector K1. ALL - Industrial Activity Code "HZ" (Note: permit coverage limited in some States). Benchmarks only applicable to discharges not subject to effluent limitations in 40 CFR Part 445 Subpart A (see below).	Ammonia	2.14 mg/L
	Total Magnesium	0.064 mg/L
	Chemical Oxygen Demand (COD)	120 mg/L
	Total Arsenic	0.15 mg/L
	Total Cadmium ¹	Hardness Dependent
	Total Cyanide	0.022 mg/ L
	Total Lead ¹	Hardness Dependent
	Total Mercury	0.0014 mg/ L
	Total Selenium	0.005 mg/L
	Total Silver ¹	Hardness Dependent

¹ The benchmark values of some metals are dependent on water hardness. For these parameters, permittees must determine the hardness of the receiving water (see Appendix J, "Calculating Hardness in Receiving Waters for Hardness Dependent Metals," for methodology), in accordance with Part 6.2.1.1, to identify the applicable 'hardness range' for determining their benchmark value applicable to their facility. The ranges occur in 25 mg/L increments. Hardness Dependent Benchmarks follow in the table below:

Water Hardness Range	Cadmium (mg/L)	Lead (mg/L)	Silver (mg/L)
0-25 mg/L	0.0005	0.014	0.0007
25-50 mg/L	0.0008	0.023	0.0007
50-75 mg/L	0.0013	0.045	0.0017
75-100 mg/L	0.0018	0.069	0.0030
100-125 mg/L	0.0023	0.095	0.0046
125-150 mg/L	0.0029	0.122	0.0065
150-175 mg/L	0.0034	0.151	0.0087
175-200 mg/L	0.0039	0.182	0.0112
200-225 mg/L	0.0045	0.213	0.0138
225-250 mg/L	0.0050	0.246	0.0168
250+ mg/L	0.0053	0.262	0.0183

8.K.6 Effluent Limitations Based on Effluent Limitations Guidelines (See also Part 6.2.2.1 of the permit.)

Table 8.K-2 identifies effluent limits that apply to the industrial activities described below. Compliance with these effluent limits is to be determined based on discharges from these industrial activities independent of commingling with any other wastestreams that may be covered under this permit.

Table 8.K-2¹

Industrial Activity	Parameter	Effluent Limit
Discharges from hazardous waste landfills subject to effluent limitations in 40 CFR Part 445 Subpart A (see footnote).	Biochemical Oxygen Demand (BOD ₅)	220 mg/L, daily maximum
		56 mg/L, monthly avg. maximum
	Total Suspended Solids (TSS)	88 mg/L, daily maximum
		27 mg/L, monthly avg. maximum
	Ammonia	10 mg/L, daily maximum
		4.9 mg/L, monthly avg. maximum
	Alpha Terpineol	0.042 mg/L, daily maximum
		0.019 mg/L, monthly avg. maximum
	Aniline	0.024 mg/L, daily maximum
		0.015 mg/L, monthly avg. maximum
	Benzoic Acid	0.119 mg/L, daily maximum
		0.073 mg/L, monthly avg. maximum
	Naphthalene	0.059 mg/L, daily maximum
		0.022 mg/L, monthly avg. maximum
	p-Cresol	0.024 mg/L, daily maximum
		0.015 mg/L, monthly avg. maximum
	Phenol	0.048 mg/L, daily maximum
		0.029 mg/L, monthly avg. maximum
	Pyridine	0.072 mg/L, daily maximum
		0.025 mg/L, monthly avg. maximum
	Total Arsenic	1.1 mg/L, daily maximum
		0.54 mg/L, monthly avg. maximum
Total Chromium	1.1 mg/L, daily maximum	
	0.46 mg/L, monthly avg. maximum	
Total Zinc	0.535 mg/L, daily maximum	
	0.296 mg/L, monthly avg. maximum	
pH	Within the range of 6-9 standard pH units (s.u.)	

¹ Monitor annually. As set forth at 40 CFR Part 445 Subpart A, these numeric limitations apply to contaminated stormwater discharges from hazardous waste landfills subject to the provisions of RCRA Subtitle C at 40 CFR Parts 264 (Subpart N) and 265 (Subpart N) except for any of the following facilities:

- landfills operated in conjunction with other industrial or commercial operations when the landfill receives only wastes generated by the industrial or commercial operation directly associated with the landfill;
- landfills operated in conjunction with other industrial or commercial operations when the landfill receives wastes generated by the industrial or commercial operation directly associated with the landfill and also receives other wastes, provided that the other wastes received for disposal are generated by a facility that is subject to the same provisions in 40 CFR Subchapter N as the industrial or commercial operation or that the other wastes received are of similar nature to the wastes generated by the industrial or commercial operation;
- landfills operated in conjunction with Centralized Waste Treatment (CWT) facilities subject to 40 CFR Part 437, so long as the CWT facility commingles the landfill wastewater with other non-landfill wastewater for discharge. A landfill directly associated with a CWT facility is subject to this part if the CWT facility discharges landfill wastewater separately from other CWT wastewater or commingles the wastewater from its landfill only with wastewater from other landfills; or
- landfills operated in conjunction with other industrial or commercial operations when the landfill receives wastes from public service activities, so long as the company owning the landfill does not receive a fee or other remuneration for the disposal service.

Part 8 – Sector-Specific Requirements for Industrial Activity

Subpart L – Sector L – Landfills, Land Application Sites, and Open Dumps.

You must comply with Part 8 sector-specific requirements associated with your primary industrial activity and any co-located industrial activities, as defined in Appendix A. The sector-specific requirements apply to those areas of your facility where those sector-specific activities occur. These sector-specific requirements are in addition to any requirements specified elsewhere in this permit.

8.L.1 Covered Stormwater Discharges.

The requirements in Subpart L apply to stormwater discharges associated with industrial activity from Landfills and Land Application Sites and Open Dumps as identified by the Activity Code specified under Sector L in Table D-1 of Appendix D of the permit.

8.L.2 Industrial Activities Covered by Sector L.

This permit may authorize stormwater discharges for Sector L facilities associated with waste disposal at landfills, land application sites, and open dumps that receive or have received industrial waste, including sites subject to regulation under Subtitle D of RCRA. This permit does not cover discharges from landfills that receive only municipal wastes.

8.L.3 Limitations on Coverage.

8.L.3.1 *Prohibition of Non-Stormwater Discharges.* (See also Part 1.1.4) The following discharges are not authorized by this permit: leachate, gas collection condensate, drained free liquids, contaminated ground water, laboratory wastewater, and contact washwater from washing truck and railcar exteriors and surface areas that have come in direct contact with solid waste at the landfill facility.

8.L.4 Definitions.

8.L.4.1 *Contaminated stormwater* - stormwater that comes into direct contact with landfill wastes, the waste handling and treatment areas, or landfill wastewater. Some areas of a landfill that may produce contaminated stormwater include (but are not limited to) the open face of an active landfill with exposed waste (no cover added); the areas around wastewater treatment operations; trucks, equipment, or machinery that has been in direct contact with the waste; and waste dumping areas.

8.L.4.2 *Drained free liquids* - aqueous wastes drained from waste containers (e.g., drums) prior to landfilling.

8.L.4.3 *Landfill wastewater* - as defined in 40 CFR Part 445 (Landfills Point Source Category) all wastewater associated with, or produced by, landfilling activities except for sanitary wastewater, non-contaminated stormwater, contaminated groundwater, and wastewater from recovery pumping wells. Landfill process wastewater includes, but is not limited to, leachate; gas collection condensate; drained free liquids; laboratory-derived wastewater; contaminated stormwater; and contact washwater from washing truck,

equipment, and railcar exteriors and surface areas that have come in direct contact with solid waste at the landfill facility.

- 8.L.4.4 *Leachate* - liquid that has passed through or emerged from solid waste and contains soluble, suspended, or miscible materials removed from such waste.
- 8.L.4.5 *Non-contaminated stormwater* - stormwater that does not come into direct contact with landfill wastes, the waste handling and treatment areas, or landfill wastewater. Non-contaminated stormwater includes stormwater that flows off the cap, cover, intermediate cover, daily cover, and/or final cover of the landfill.

8.L.5 Additional Technology-Based Effluent Limits.

- 8.L.5.1 *Preventive Maintenance Program.* (See also Part 2.1.2.3) As part of your preventive maintenance program, maintain the following: all elements of leachate collection and treatment systems, to prevent commingling of leachate with stormwater; the integrity and effectiveness of any intermediate or final cover (including repairing the cover as necessary), to minimize the effects of settlement, sinking, and erosion.
- 8.L.5.2 *Erosion and Sedimentation Control.* (See also Part 2.1.2.5) Provide temporary stabilization (e.g., temporary seeding, mulching, and placing geotextiles on the inactive portions of stockpiles) for the following: materials stockpiled for daily, intermediate, and final cover; inactive areas of the landfill or open dump; landfills or open dump areas that have gotten final covers but where vegetation has yet to establish itself; and land application sites where waste application has been completed but final vegetation has not yet been established.
- 8.L.5.3 *Unauthorized Discharge Test Certification.* (See also Part 5.1.3.4) The discharge test and certification must also be conducted for the presence of leachate and vehicle washwater.

8.L.6 Additional SWPPP Requirements.

- 8.L.5.1 *Drainage Area Site Map.* (See also Part 5.1.2) Document in your SWPPP where any of the following may be exposed to precipitation or surface runoff: active and closed landfill cells or trenches, active and closed land application areas, locations where open dumping is occurring or has occurred, locations of any known leachate springs or other areas where uncontrolled leachate may commingle with runoff, and leachate collection and handling systems.
- 8.L.5.2 *Summary of Potential Pollutant Sources.* (See also Part 5.1.3) Document in your SWPPP the following sources and activities that have potential pollutants associated with them: fertilizer, herbicide, and pesticide application; earth and soil moving; waste hauling and loading or unloading; outdoor storage of significant materials, including daily, interim, and final cover material stockpiles as well as temporary waste storage areas; exposure of active and inactive landfill and land application areas; uncontrolled leachate flows; and failure or leaks from leachate collection and treatment systems.

8.L.7 Additional Inspection Requirements. (See also Part 4)

8.L.7.1 *Inspections of Active Sites.* Except in arid and semi-arid climates, inspect operating landfills, open dumps, and land application sites at least once every 7 days. Focus on areas of landfills that have not yet been finally stabilized; active land application areas, areas used for storage of material and wastes that are exposed to precipitation, stabilization, and structural control measures; leachate collection and treatment systems; and locations where equipment and waste trucks enter and exit the site. Ensure that sediment and erosion control measures are operating properly. For stabilized sites and areas where land application has been completed, or where the climate is arid or semi-arid, conduct inspections at least once every month.

8.L.7.2 *Inspections of Inactive Sites.* Inspect inactive landfills, open dumps, and land application sites at least quarterly. Qualified personnel must inspect landfill (or open dump) stabilization and structural erosion control measures, leachate collection and treatment systems, and all closed land application areas.

8.L.8 Additional Post-Authorization Documentation Requirements.

8.L.8.1 *Recordkeeping and Internal Reporting.* Keep records with your SWPPP of the types of wastes disposed of in each cell or trench of a landfill or open dump. For land application sites, track the types and quantities of wastes applied in specific areas.

8.L.9 Sector-Specific Benchmarks

Table 8.L-1 identifies benchmarks that apply to the specific subsectors of Sector L. These benchmarks apply to both your primary industrial activity and any co-located industrial activities, which describe your site activities.

Table 8.L-1.		
Subsector (You may be subject to requirements for more than one sector/subsector)	Parameter	Benchmark Monitoring Concentration ¹
Subsector L1. All Landfill, Land Application Sites and Open Dumps (Industrial Activity Code "LF")	Total Suspended Solids (TSS)	100 mg/L
Subsector L2. All Landfill, Land Application Sites and Open Dumps, except Municipal Solid Waste Landfill (MSWLF) Areas Closed in Accordance with 40 CFR 258.60 (Industrial Activity Code "LF")	Total Iron	1.0 mg/L

¹Benchmark monitoring required only for discharges not subject to effluent limitations in 40 CFR Part 445 Subpart B (see Table L-2 above).

8.L.10. Effluent Limitations Based on Effluent Limitations Guidelines (See also Part 6.2.2.1 of the permit.)

Table 8.L-2 identifies effluent limits that apply to the industrial activities described below. Compliance with these effluent limits is to be determined based on discharges from these industrial activities independent of commingling with any other wastestreams that may be covered under this permit.

Industrial Activity	Parameter	Effluent Limit
Discharges from non-hazardous waste landfills subject to effluent limitations in 40 CFR Part 445 Subpart B.	Biochemical Oxygen Demand (BOD ₅)	140 mg/L, daily maximum
		37 mg/L, monthly avg. maximum
	Total Suspended Solids (TSS)	88 mg/L, daily maximum
		27 mg/L, monthly avg. maximum
	Ammonia	10 mg/L, daily maximum
		4.9 mg/L, monthly avg. maximum
	Alpha Terpineol	0.033 mg/L, daily maximum
		0.016 mg/L monthly avg. maximum
	Benzoic Acid	0.12 mg/L, daily maximum
		0.071 mg/L, monthly avg. maximum
	p-Cresol	0.025 mg/L, daily maximum
		0.014 mg/L, monthly avg. maximum
	Phenol	0.026 mg/L, daily maximum
		0.015 mg/L, monthly avg. maximum
Total Zinc	0.20 mg/L, daily maximum	
	0.11 mg/L, monthly avg. maximum	
pH	Within the range of 6-9 standard pH units (s.u.)	

¹ Monitor annually. As set forth at 40 CFR Part 445 Subpart B, these numeric limitations apply to contaminated stormwater discharges from MSWLFs that have not been closed in accordance with 40 CFR 258.60, and to contaminated stormwater discharges from those landfills that are subject to the provisions of 40 CFR Part 257 except for discharges from any of the following facilities:

- landfills operated in conjunction with other industrial or commercial operations, when the landfill receives only wastes generated by the industrial or commercial operation directly associated with the landfill;
- landfills operated in conjunction with other industrial or commercial operations, when the landfill receives wastes generated by the industrial or commercial operation directly associated with the landfill and also receives other wastes, provided that the other wastes received for disposal are generated by a facility that is subject to the same provisions in 40 CFR Subchapter N as the industrial or commercial operation, or that the other wastes received are of similar nature to the wastes generated by the industrial or commercial operation;
- landfills operated in conjunction with CWT facilities subject to 40 CFR Part 437, so long as the CWT facility commingles the landfill wastewater with other non-landfill wastewater for discharge. A landfill directly associated with a CWT facility is subject to this part if the CWT facility discharges landfill wastewater separately from other CWT wastewater or commingles the wastewater from its landfill only with wastewater from other landfills; or
- landfills operated in conjunction with other industrial or commercial operations when the landfill receives wastes from public service activities, so long as the company owning the landfill does not receive a fee or other remuneration for the disposal service.

Part 8 – Sector-Specific Requirements for Industrial Activity

Subpart M – Sector M – Automobile Salvage Yards.

You must comply with Part 8 sector-specific requirements associated with your primary industrial activity and any co-located industrial activities, as defined in Appendix A. The sector-specific requirements apply to those areas of your facility where those sector-specific activities occur. These sector-specific requirements are in addition to any requirements specified elsewhere in this permit.

8.M.1 Covered Stormwater Discharges.

The requirements in Subpart M apply to stormwater discharges associated with industrial activity from Automobile Salvage Yards as identified by the SIC Code specified under Sector M in Table D-1 of Appendix D of this permit.

8.M.2 Additional Technology-Based Effluent Limits.

8.M.2.1 *Spill and Leak Prevention Procedures.* (See also Part 2.1.2.4) Drain vehicles intended to be dismantled of all fluids upon arrival at the site (or as soon thereafter as feasible), or employ some other equivalent means to prevent spills and leaks.

8.M.2.2 *Employee Training.* (See also Part 2.1.2.9) If applicable to your facility, address the following areas (at a minimum) in your employee training program: proper handling (collection, storage, and disposal) of oil, used mineral spirits, anti-freeze, mercury switches, and solvents.

8.M.2.3 *Management of Runoff.* (See also Part 2.1.2.6) Consider the following management practices: berms or drainage ditches on the property line (to help prevent run-on from neighboring properties); berms for uncovered outdoor storage of oily parts, engine blocks, and above-ground liquid storage; installation of detention ponds; and installation of filtering devices and oil and water separators.

8.M.3 Additional SWPPP Requirements.

8.M.3.1 *Drainage Area Site Map.* (See also Part 5.1.2) Identify locations used for dismantling, storage, and maintenance of used motor vehicle parts. Also identify where any of the following may be exposed to precipitation or surface runoff: dismantling areas, parts (e.g., engine blocks, tires, hub caps, batteries, hoods, mufflers) storage areas, and liquid storage tanks and drums for fuel and other fluids.

8.M.3.2 *Potential Pollutant Sources.* (See also Part 5.1.3) Assess the potential for the following to contribute pollutants to stormwater discharges: vehicle storage areas, dismantling areas, parts storage areas (e.g., engine blocks, tires, hub caps, batteries, hoods, mufflers), and fueling stations.

8.M.4 **Additional Inspection Requirements.** (See also Part 4.1) Immediately (or as soon thereafter as feasible) inspect vehicles arriving at the site for leaks. Inspect quarterly for signs of leakage all equipment containing oily parts, hydraulic fluids, any other types of fluids, or mercury switches. Also, inspect quarterly for signs of leakage all vessels and

areas where hazardous materials and general automotive fluids are stored, including, but not limited to, mercury switches, brake fluid, transmission fluid, radiator water, and antifreeze.

8.M.5 Sector-Specific Benchmarks. (See also Part 6 of the permit.)

Subsector (You may be subject to requirements for more than one sector/subsector)	Parameter	Benchmark Monitoring Concentration
Subsector M1. Automobile Salvage Yards (SIC 5015)	Total Suspended Solids (TSS)	100 mg/L
	Total Aluminum	0.75 mg/L
	Total Iron	1.0 mg/L
	Total Lead ¹	Hardness Dependent

¹ The benchmark values of some metals are dependent on water hardness. For these parameters, permittees must determine the hardness of the receiving water (see Appendix J, "Calculating Hardness in Receiving Waters for Hardness Dependent Metals," for methodology), in accordance with Part 6.2.1.1, to identify the applicable 'hardness range' for determining their benchmark value applicable to their facility. The ranges occur in 25 mg/L increments. Hardness Dependent Benchmarks follow in the table below:

Water Hardness Range	Lead (mg/L)
0-25 mg/L	0.014
25-50 mg/L	0.023
50-75 mg/L	0.045
75-100 mg/L	0.069
100-125 mg/L	0.095
125-150 mg/L	0.122
150-175 mg/L	0.151
175-200 mg/L	0.182
200-225 mg/L	0.213
225-250 mg/L	0.246
250+ mg/L	0.262

Part 8 – Sector-Specific Requirements for Industrial Activity

Subpart N – Sector N – Scrap Recycling and Waste Recycling Facilities.

You must comply with Part 8 sector-specific requirements associated with your primary industrial activity and any co-located industrial activities, as defined in Appendix A. The sector-specific requirements apply to those areas of your facility where those sector-specific activities occur. These sector-specific requirements are in addition to any requirements specified elsewhere in this permit.

8.N.1 Covered Stormwater Discharges.

The requirements in Subpart N apply to stormwater discharges associated with industrial activity from Scrap Recycling and Waste Recycling facilities as identified by the SIC Code specified under Sector N in Table D-1 of Appendix D of the permit.

8.N.2 Limitation on Coverage.

Separate permit requirements have been established for recycling facilities that only receive source-separated recyclable materials primarily from non-industrial and residential sources (i.e., common consumer products including paper, newspaper, glass, cardboard, plastic containers, and aluminum and tin cans). This includes recycling facilities commonly referred to as material recovery facilities (MRF).

8.N.2.1 *Prohibition of Non-Stormwater Discharges.* (See also Part 1.1.4) Non-stormwater discharges from turnings containment areas are not covered by this permit (see also Part 8.N.3.2.3). Discharges from containment areas in the absence of a storm event are prohibited unless covered by a separate NPDES permit.

8.N.3 Additional Technology-Based Effluent Limits.

8.N.3.1 *Scrap and Waste Recycling Facilities (Non-Source Separated, Nonliquid Recyclable Materials).* Requirements for facilities that receive, process, and do wholesale distribution of nonliquid recyclable wastes (e.g., ferrous and nonferrous metals, plastics, glass, cardboard, and paper). These facilities may receive both nonrecyclable and recyclable materials. This section is not intended for those facilities that accept recyclables only from primarily non-industrial and residential sources.

8.N.3.1.1 *Inbound Recyclable and Waste Material Control Program.* Minimize the chance of accepting materials that could be significant sources of pollutants by conducting inspections of inbound recyclables and waste materials. Following are some control measure options: (a) provide information and education to suppliers of scrap and recyclable waste materials on draining and properly disposing of residual fluids (e.g., from vehicles and equipment engines, radiators and transmissions, oil filled transformers, and individual containers or drums) and removal of mercury switches from vehicles before delivery to your facility; (b) establish procedures to minimize the potential of any residual fluids from coming into contact with precipitation or runoff; (c) establish procedures for accepting scrap lead-acid batteries (additional requirements for

the handling, storage, and disposal or recycling of batteries are contained in the scrap lead-acid battery program provisions in Part 8.N.3.2.6); (d) provide training targeted for those personnel engaged in the inspection and acceptance of inbound recyclable materials; and (e) establish procedures to ensure that liquid wastes, including used oil, are stored in materially compatible and non-leaking containers and are disposed of or recycled in accordance with the Resource Conservation and Recovery Act (RCRA).

- 8.N.3.1.2 *Scrap and Waste Material Stockpiles and Storage (Outdoor)*. Minimize contact of stormwater runoff with stockpiled materials, processed materials, and nonrecyclable wastes. Following are some control measure options: (a) permanent or semi-permanent covers; (b) sediment traps, vegetated swales and strips, catch basin filters, and sand filters to facilitate settling or filtering of pollutants; (c) dikes, berms, containment trenches, culverts, and surface grading to divert runoff from storage areas; (d) silt fencing; and (e) oil and water separators, sumps, and dry absorbents for areas where potential sources of residual fluids are stockpiled (e.g., automobile engine storage areas).
- 8.N.3.1.3 *Stockpiling of Turnings Exposed to Cutting Fluids (Outdoor Storage)*. Minimize contact of surface runoff with residual cutting fluids by: (a) storing all turnings exposed to cutting fluids under some form of permanent or semi-permanent cover, or (b) establishing dedicated containment areas for all turnings that have been exposed to cutting fluids. Any containment areas must be constructed of concrete, asphalt, or other equivalent types of impermeable material and include a barrier (e.g., berms, curbing, elevated pads) to prevent contact with stormwater run-on. Stormwater runoff from these areas can be discharged, provided that any runoff is first collected and treated by an oil and water separator or its equivalent. You must regularly maintain the oil and water separator (or its equivalent) and properly dispose of or recycle collected residual fluids.
- 8.N.3.1.4 *Scrap and Waste Material Stockpiles and Storage (Covered or Indoor Storage)*. Minimize contact of residual liquids and particulate matter from materials stored indoors or under cover with surface runoff. Following are some control measure options: (a) good housekeeping measures, including the use of dry absorbents or wet vacuuming to contain, dispose of, or recycle residual liquids originating from recyclable containers, or mercury spill kits for spills from storage of mercury switches; (b) not allowing washwater from tipping floors or other processing areas to discharge to the storm sewer system; and (c) disconnecting or sealing off all floor drains connected to the storm sewer system.
- 8.N.3.1.5 *Scrap and Recyclable Waste Processing Areas*. Minimize surface runoff from coming in contact with scrap processing equipment. Pay attention to operations that generate visible amounts of particulate residue (e.g., shredding) to minimize the contact of accumulated particulate matter and residual fluids with runoff (i.e., through good housekeeping, preventive maintenance, etc.). Following are some control measure options: (a) regularly

inspect equipment for spills or leaks and malfunctioning, worn, or corroded parts or equipment; (b) establish a preventive maintenance program for processing equipment; (c) use dry-absorbents or other cleanup practices to collect and dispose of or recycle spilled or leaking fluids or use mercury spill kits for spills from storage of mercury switches; (d) on unattended hydraulic reservoirs over 150 gallons in capacity, install protection devices such as low-level alarms or equivalent devices, or secondary containment that can hold the entire volume of the reservoir; (e) containment or diversion structures such as dikes, berms, culverts, trenches, elevated concrete pads, and grading to minimize contact of stormwater runoff with outdoor processing equipment or stored materials; (f) oil and water separators or sumps; (g) permanent or semi-permanent covers in processing areas where there are residual fluids and grease; (h) retention or detention ponds or basins; sediment traps, and vegetated swales or strips (for pollutant settling and filtration); (i) catch basin filters or sand filters.

8.N.3.1.6 *Scrap Lead-Acid Battery Program*. Properly handle, store, and dispose of scrap lead-acid batteries. Following are some control measure options (a) segregate scrap lead-acid batteries from other scrap materials; (b) properly handle, store, and dispose of cracked or broken batteries; (c) collect and dispose of leaking lead-acid battery fluid; (d) minimize or eliminate (if possible) exposure of scrap lead-acid batteries to precipitation or runoff; and (e) provide employee training for the management of scrap batteries.

8.N.3.1.7 *Spill Prevention and Response Procedures*. (See also Part 2.1.2.4) Install alarms and/or pump shutoff systems on outdoor equipment with hydraulic reservoirs exceeding 150 gallons in the event of a line break. Alternatively, a secondary containment system capable of holding the entire contents of the reservoir plus room for precipitation can be used. Use a mercury spill kit for any release of mercury from switches, anti-lock brake systems, and switch storage areas.

8.N.3.1.8 *Supplier Notification Program*. As appropriate, notify major suppliers which scrap materials will not be accepted at the facility or will be accepted only under certain conditions.

8.N.3.2 Waste Recycling Facilities (Liquid Recyclable Materials).

8.N.3.2.1 *Waste Material Storage (Indoor)*. Minimize or eliminate contact between residual liquids from waste materials stored indoors and from surface runoff. The plan may refer to applicable portions of other existing plans, such as Spill Prevention, Control, and Countermeasure (SPCC) plans required under 40 CFR Part 112. Following are some control measure options (a) procedures for material handling (including labeling and marking); (b) clean up spills and leaks with dry absorbent materials, a wet vacuum system; (c) appropriate containment structures (trenching, curbing, gutters, etc.); and (d) a drainage system, including appurtenances (e.g., pumps or ejectors, manually operated valves), to handle discharges from diked or bermed areas. Drainage should be

discharged to an appropriate treatment facility or sanitary sewer system, or otherwise disposed of properly. These discharges may require coverage under a separate NPDES wastewater permit or industrial user permit under the pretreatment program.

- 8.N.3.2.2 *Waste Material Storage (Outdoor)*. Minimize contact between stored residual liquids and precipitation or runoff. The plan may refer to applicable portions of other existing plans, such as SPCC plans required under 40 CFR Part 112. Discharges of precipitation from containment areas containing used oil must also be in accordance with applicable sections of 40 CFR Part 112. Following are some control measure options (a) appropriate containment structures (e.g., dikes, berms, curbing, pits) to store the volume of the largest tank, with sufficient extra capacity for precipitation; (b) drainage control and other diversionary structures; (c) corrosion protection and/or leak detection systems for storage tanks; and (d) dry-absorbent materials or a wet vacuum system to collect spills.
- 8.N.3.2.3 *Trucks and Rail Car Waste Transfer Areas*. Minimize pollutants in discharges from truck and rail car loading and unloading areas. Include measures to clean up minor spills and leaks resulting from the transfer of liquid wastes. Following are two control measure options: (a) containment and diversionary structures to minimize contact with precipitation or runoff, and (b) dry clean-up methods, wet vacuuming, roof coverings, or runoff controls.
- 8.N.3.3 *Recycling Facilities (Source-Separated Materials)*. The following identifies considerations for facilities that receive only source-separated recyclables, primarily from non-industrial and residential sources.
- 8.N.3.3.1 *Inbound Recyclable Material Control*. Minimize the chance of accepting nonrecyclables (e.g., hazardous materials) that could be a significant source of pollutants by conducting inspections of inbound materials. Following are some control measure options: (a) providing information and education measures to inform suppliers of recyclables about acceptable and non-acceptable materials, (b) training drivers responsible for pickup of recycled material, (c) clearly marking public drop-off containers regarding which materials can be accepted, (d) rejecting nonrecyclable wastes or household hazardous wastes at the source, and (e) establishing procedures for handling and disposal of nonrecyclable material.
- 8.N.3.3.2 *Outdoor Storage*. Minimize exposure of recyclables to precipitation and runoff. Use good housekeeping measures to prevent accumulation of particulate matter and fluids, particularly in high traffic areas. Following are some control measure options (a) provide totally enclosed drop-off containers for the public; (b) install a sump and pump with each container pit and treat or discharge collected fluids to a sanitary sewer system; (c) provide dikes and curbs for secondary containment (e.g., around bales of recyclable waste paper); (d) divert surface water runoff away from outside material storage areas; (e) provide covers over containment bins, dumpsters, and roll-off boxes;

and (f) store the equivalent of one day's volume of recyclable material indoors.

8.N.3.3.3 *Indoor Storage and Material Processing.* Minimize the release of pollutants from indoor storage and processing areas. Following are some control measure options (a) schedule routine good housekeeping measures for all storage and processing areas, (b) prohibit tipping floor washwater from draining to the storm sewer system, and (c) provide employee training on pollution prevention practices.

8.N.3.3.4 *Vehicle and Equipment Maintenance.* Following are some control measure options for areas where vehicle and equipment maintenance occur outdoors (a) prohibit vehicle and equipment washwater from discharging to the storm sewer system, (b) minimize or eliminate outdoor maintenance areas whenever possible, (c) establish spill prevention and clean-up procedures in fueling areas, (d) avoid topping off fuel tanks, (e) divert runoff from fueling areas, (f) store lubricants and hydraulic fluids indoors, and (g) provide employee training on proper handling and storage of hydraulic fluids and lubricants.

8.N.4 Additional SWPPP Requirements.

8.N.4.1 *Drainage Area Site Map.* (See also Part 5.1.2) Document in your SWPPP the locations of any of the following activities or sources that may be exposed to precipitation or surface runoff: scrap and waste material storage, outdoor scrap and waste processing equipment; and containment areas for turnings exposed to cutting fluids.

8.N.4.2 *Maintenance Schedules/Procedures for Collection, Handling, and Disposal or Recycling of Residual Fluids at Scrap and Waste Recycling Facilities.* If you are subject to Part 8.N.3.1.3, your SWPPP must identify any applicable maintenance schedule and the procedures to collect, handle, and dispose of or recycle residual fluids.

8.N.5 Additional Inspection Requirements.

8.N.5.1 *Inspections for Waste Recycling Facilities.* The inspections must be performed quarterly, pursuant to Part 4.1, and include, at a minimum, all areas where waste is generated, received, stored, treated, or disposed of and that are exposed to either precipitation or stormwater runoff.

8.N.6 Sector-Specific Benchmarks. (See also Part 6 of the permit.)

Subsector (You may be subject to requirements for more than one sector/subsector)	Parameter	Benchmark Monitoring Concentration
Subsector N1. Scrap Recycling and Waste Recycling Facilities except Source-Separated Recycling (SIC 5093)	Chemical Oxygen Demand (COD)	120 mg/L
	Total Suspended Solids (TSS)	100 mg/L
	Total Recoverable Aluminum	0.75 mg/L
	Total Recoverable Copper ¹	Hardness Dependent
	Total Recoverable Iron	1.0 mg/L
	Total Recoverable Lead ¹	Hardness Dependent
	Total Recoverable Zinc ¹	Hardness Dependent

¹ The benchmark values of some metals are dependent on water hardness. For these parameters, permittees must determine the hardness of the receiving water (see Appendix J, "Calculating Hardness in Receiving Waters for Hardness Dependent Metals," for methodology), in accordance with Part 6.2.1.1, to identify the applicable 'hardness range' for determining their benchmark value applicable to their facility. The ranges occur in 25 mg/L increments. Hardness Dependent Benchmarks follow in the table below:

Water Hardness Range	Copper (mg/L)	Lead (mg/L)	Zinc (mg/L)
0-25 mg/L	0.0038	0.014	0.04
25-50 mg/L	0.0056	0.023	0.05
50-75 mg/L	0.0090	0.045	0.08
75-100 mg/L	0.0123	0.069	0.11
100-125 mg/L	0.0156	0.095	0.13
125-150 mg/L	0.0189	0.122	0.16
150-175 mg/L	0.0221	0.151	0.18
175-200 mg/L	0.0253	0.182	0.20
200-225 mg/L	0.0285	0.213	0.23
225-250 mg/L	0.0316	0.246	0.25
250+ mg/L	0.0332	0.262	0.26

Part 8 – Sector-Specific Requirements for Industrial Activity

Subpart O – Sector O – Steam Electric Generating Facilities.

You must comply with Part 8 sector-specific requirements associated with your primary industrial activity and any co-located industrial activities, as defined in Appendix A. The sector-specific requirements apply to those areas of your facility where those sector-specific activities occur. These sector-specific requirements are in addition to any requirements specified elsewhere in this permit.

8.O.1 Covered Stormwater Discharges.

The requirements in Subpart O apply to stormwater discharges associated with industrial activity from Steam Electric Power Generating Facilities as identified by the Activity Code specified under Sector O in Table D-1 of Appendix D.

8.O.2 Industrial Activities Covered by Sector O.

This permit authorizes stormwater discharges from the following industrial activities at Sector O facilities:

- 8.O.2.1 steam electric power generation using coal, natural gas, oil, nuclear energy, etc., to produce a steam source, including coal handling areas;
- 8.O.2.2 coal pile runoff, including effluent limitations established by 40 CFR Part 423; and
- 8.O.2.3 dual fuel facilities that could employ a steam boiler.

8.O.3 Limitations on Coverage.

- 8.O.3.1 *Prohibition of Non-Stormwater Discharges.* Non-stormwater discharges subject to effluent limitations guidelines are not covered by this permit.
- 8.O.3.2 *Prohibition of Stormwater Discharges.* Stormwater discharges from the following are not covered by this permit:
 - 8.O.3.2.1 ancillary facilities (e.g., fleet centers and substations) that are not contiguous to a steam electric power generating facility;
 - 8.O.3.2.2 gas turbine facilities (providing the facility is not a dual-fuel facility that includes a steam boiler), and combined-cycle facilities where no supplemental fuel oil is burned (and the facility is not a dual-fuel facility that includes a steam boiler); and
 - 8.O.3.2.3 cogeneration (combined heat and power) facilities utilizing a gas turbine.

8.O.4 Additional Technology-Based Effluent Limits. The following good housekeeping measures are required in addition to Part 2.1.2.2:

- 8.O.4.1 *Fugitive Dust Emissions.* Minimize fugitive dust emissions from coal handling areas. To minimize the tracking of coal dust offsite, consider procedures such as installing

- specially designed tires or washing vehicles in a designated area before they leave the site and controlling the wash water.
- 8.O.4.2 *Delivery Vehicles.* Minimize contamination of stormwater runoff from delivery vehicles arriving at the plant site. Consider procedures to inspect delivery vehicles arriving at the plant site and ensure overall integrity of the body or container and procedures to deal with leakage or spillage from vehicles or containers.
- 8.O.4.3 *Fuel Oil Unloading Areas.* Minimize contamination of precipitation or surface runoff from fuel oil unloading areas. Consider using containment curbs in unloading areas, having personnel familiar with spill prevention and response procedures present during deliveries to ensure that any leaks or spills are immediately contained and cleaned up, and using spill and overflow protection devices (e.g., drip pans, drip diapers, or other containment devices placed beneath fuel oil connectors to contain potential spillage during deliveries or from leaks at the connectors).
- 8.O.4.4 *Chemical Loading and Unloading.* Minimize contamination of precipitation or surface runoff from chemical loading and unloading areas. Consider using containment curbs at chemical loading and unloading areas to contain spills, having personnel familiar with spill prevention and response procedures present during deliveries to ensure that any leaks or spills are immediately contained and cleaned up, and loading and unloading in covered areas and storing chemicals indoors.
- 8.O.4.5 *Miscellaneous Loading and Unloading Areas.* Minimize contamination of precipitation or surface runoff from loading and unloading areas. Consider covering the loading area; grading, berming, or curbing around the loading area to divert run-on; locating the loading and unloading equipment and vehicles so that leaks are contained in existing containment and flow diversion systems; or equivalent procedures.
- 8.O.4.6 *Liquid Storage Tanks.* Minimize contamination of surface runoff from above-ground liquid storage tanks. Consider protective guards around tanks, containment curbs, spill and overflow protection, dry cleanup methods, or equivalent measures.
- 8.O.4.7 *Large Bulk Fuel Storage Tanks.* Minimize contamination of surface runoff from large bulk fuel storage tanks. Consider containment berms (or their equivalent). You must also comply with applicable State and Federal laws, including Spill Prevention, Control and Countermeasure (SPCC) Plan requirements.
- 8.O.4.8 *Spill Reduction Measures.* Minimize the potential for an oil or chemical spill, or reference the appropriate part of your SPCC plan. Visually inspect as part of your routine facility inspection the structural integrity of all above-ground tanks, pipelines, pumps, and related equipment that may be exposed to stormwater, and make any necessary repairs immediately.
- 8.O.4.9 *Oil-Bearing Equipment in Switchyards.* Minimize contamination of surface runoff from oil-bearing equipment in switchyard areas. Consider using level grades and gravel surfaces to retard flows and limit the spread of spills, or collecting runoff in perimeter ditches.
- 8.O.4.10 *Residue-Hauling Vehicles.* Inspect all residue-hauling vehicles for proper covering over the load, adequate gate sealing, and overall integrity of the container body. Repair

vehicles without load covering or adequate gate sealing, or with leaking containers or beds.

- 8.O.4.11 *Ash Loading Areas.* Reduce or control the tracking of ash and residue from ash loading areas. Clear the ash building floor and immediately adjacent roadways of spillage, debris, and excess water before departure of each loaded vehicle.
- 8.O.4.12 *Areas Adjacent to Disposal Ponds or Landfills.* Minimize contamination of surface runoff from areas adjacent to disposal ponds or landfills. Reduce ash residue that may be tracked on to access roads traveled by residue handling vehicles, and reduce ash residue on exit roads leading into and out of residue handling areas.
- 8.O.4.13 *Landfills, Scrap yards, Surface Impoundments, Open Dumps, General Refuse Sites.* Minimize the potential for contamination of runoff from these areas.

8.O.5 Additional SWPPP Requirements.

- 8.O.5.1 *Drainage Area Site Map.* (See also Part 5.1.2) Document in your SWPPP the locations of any of the following activities or sources that may be exposed to precipitation or surface runoff: storage tanks, scrap yards, and general refuse areas; short- and long-term storage of general materials (including but not limited to supplies, construction materials, paint equipment, oils, fuels, used and unused solvents, cleaning materials, paint, water treatment chemicals, fertilizer, and pesticides); landfills and construction sites; and stock pile areas (e.g., coal or limestone piles).
- 8.O.5.2 *Documentation of Good Housekeeping Measures.* You must document in your SWPPP the good housekeeping measures implemented to meet the effluent limits in Part 8.O.4.

8.O.6 Additional Inspection Requirements.

- 8.O.6.1 *Comprehensive Site Compliance Inspection.* (See also Part 4.3) As part of your inspection, inspect the following areas monthly: coal handling areas, loading or unloading areas, switchyards, fueling areas, bulk storage areas, ash handling areas, areas adjacent to disposal ponds and landfills, maintenance areas, liquid storage tanks, and long term and short term material storage areas.

8.O.7 Sector-Specific Benchmarks

Table 8.O-1 identifies benchmarks that apply to the specific subsectors of Sector O. These benchmarks apply to both your primary industrial activity and any co-located industrial activities, which describe your site activities.

Table 8.O-1.		
Subsector (You may be subject to requirements for more than one sector/subsector)	Parameter	Benchmark Monitoring Concentration
Subsector O1. Steam Electric Generating Facilities (Industrial Activity Code "SE")	Total Iron	1.0 mg/L

8.O.8 Effluent Limitations Based on Effluent Limitations Guidelines (See also Part 6.2.2.1 of the permit.)

Table 8.O-2 identifies effluent limits that apply to the industrial activities described below. Compliance with these effluent limits is to be determined based on discharges from these industrial activities independent of commingling with any other wastestreams that may be covered under this permit.

Industrial Activity	Parameter	Effluent Limit
Discharges from coal storage piles at Steam Electric Generating Facilities	TSS	50 mg/l ²
	pH	6.0 min - 9.0 max

¹ Monitor annually.

² If your facility is designed, constructed, and operated to treat the volume of coal pile runoff that is associated with a 10-year, 24-hour rainfall event, any untreated overflow of coal pile runoff from the treatment unit is not subject to the 50 mg/L limitation for total suspended solids.

Part 8 – Sector-Specific Requirements for Industrial Activity

Subpart P – Sector P – Land Transportation and Warehousing.

You must comply with Part 8 sector-specific requirements associated with your primary industrial activity and any co-located industrial activities, as defined in Appendix A. The sector-specific requirements apply to those areas of your facility where those sector-specific activities occur. These sector-specific requirements are in addition to any requirements specified elsewhere in this permit.

8.P.1 Covered Stormwater Discharges.

The requirements in Subpart P apply to stormwater discharges associated with industrial activity from Land Transportation and Warehousing facilities as identified by the SIC Codes specified under Sector P in Table D-1 of Appendix D of the permit.

8.P.2 Limitation on Coverage

8.P.2.1 *Prohibited Discharges* (see also Parts 1.1.4 and 8.P.3.6) This permit does not authorize the discharge of vehicle/equipment/surface washwater, including tank cleaning operations. Such discharges must be authorized under a separate NPDES permit, discharged to a sanitary sewer in accordance with applicable industrial pretreatment requirements, or recycled on-site.

8.P.3 Additional Technology-Based Effluent Limits.

8.P.3.1 *Good Housekeeping Measures.* (See also Part 2.1.2.2) In addition to the Good Housekeeping requirements in Part 2.1.2.2, you must do the following. Recommended control measures are discussed as indicated:

8.P.3.1.1 *Vehicle and Equipment Storage Areas.* Minimize the potential for stormwater exposure to leaky or leak-prone vehicles/equipment awaiting maintenance. Consider the following (or other equivalent measures): use of drip pans under vehicles/equipment, indoor storage of vehicles and equipment, installation of berms or dikes, use of absorbents, roofing or covering storage areas, and cleaning pavement surfaces to remove oil and grease.

8.P.3.1.2 *Fueling Areas.* Minimize contamination of stormwater runoff from fueling areas. Consider the following (or other equivalent measures): Covering the fueling area; using spill/overflow protection and cleanup equipment; minimizing stormwater run-on/runoff to the fueling area; using dry cleanup methods; and treating and/or recycling collected stormwater runoff.

8.P.3.1.3 *Material Storage Areas.* Maintain all material storage vessels (e.g., for used oil/oil filters, spent solvents, paint wastes, hydraulic fluids) to prevent contamination of stormwater and plainly label them (e.g., “Used Oil,” “Spent Solvents,” etc.). Consider the following (or other equivalent measures): storing the materials indoors; installing berms/dikes around the areas; minimizing runoff of stormwater to the areas; using dry cleanup methods; and treating and/or recycling collected stormwater runoff.

- 8.P.3.1.4 *Vehicle and Equipment Cleaning Areas.* Minimize contamination of stormwater runoff from all areas used for vehicle/equipment cleaning. Consider the following (or other equivalent measures): performing all cleaning operations indoors; covering the cleaning operation, ensuring that all washwater drains to a proper collection system (i.e., not the stormwater drainage system); treating and/or recycling collected washwater, or other equivalent measures.
- 8.P.3.1.5 *Vehicle and Equipment Maintenance Areas.* Minimize contamination of stormwater runoff from all areas used for vehicle/equipment maintenance. Consider the following (or other equivalent measures): performing maintenance activities indoors; using drip pans; keeping an organized inventory of materials used in the shop; draining all parts of fluid prior to disposal; prohibiting wet clean up practices if these practices would result in the discharge of pollutants to stormwater drainage systems; using dry cleanup methods; treating and/or recycling collected stormwater runoff, minimizing run on/runoff of stormwater to maintenance areas.
- 8.P.3.1.6 *Locomotive Sanding (Loading Sand for Traction) Areas.* Consider the following (or other equivalent measures): covering sanding areas; minimizing stormwater run on/runoff; or appropriate sediment removal practices to minimize the offsite transport of sanding material by stormwater.
- 8.P.3.2 *Employee Training.* (See also Part 2.1.2.9) Train personnel at least once a year and address the following activities, as applicable: used oil and spent solvent management; fueling procedures; general good housekeeping practices; proper painting procedures; and used battery management.
- 8.P.4 Additional SWPPP Requirements.**
- 8.P.4.1 *Drainage Area Site Map.* (See also Part 5.1.2) Identify in the SWPPP the following areas of the facility and indicate whether activities occurring there may be exposed to precipitation/surface runoff: Fueling stations; vehicle/equipment maintenance or cleaning areas; storage areas for vehicle/equipment with actual or potential fluid leaks; loading/unloading areas; areas where treatment, storage or disposal of wastes occur; liquid storage tanks; processing areas; and storage areas.
- 8.P.4.2 *Potential Pollutant Sources.* (See also Part 5.1.3) Assess the potential for the following activities and facility areas to contribute pollutants to stormwater discharges: Onsite waste storage or disposal; dirt/gravel parking areas for vehicles awaiting maintenance; illicit plumbing connections between shop floor drains and the stormwater conveyance system(s); and fueling areas. Describe these activities in the SWPPP.
- 8.P.4.3 *Description of Good Housekeeping Measures.* You must document in your SWPPP the good housekeeping measures you implement consistent with Part 8.P.3.
- 8.P.4.4 *Vehicle and Equipment Washwater Requirements.* If applicable, attach to or reference in your SWPPP, a copy of the NPDES permit issued for vehicle/equipment washwater or, if an NPDES permit has not been issued, a copy of the pending application. If an

industrial user permit is issued under a local pretreatment program, attach a copy to your SWPPP. In any case, implement all non-stormwater discharge permit conditions or pretreatment conditions in your SWPPP. If washwater is handled in another manner (e.g., hauled offsite), describe the disposal method and attach all pertinent documentation/information (e.g., frequency, volume, destination, etc.) in the plan.

8.P.5 Additional Inspection Requirements. (See also Part 4.1) Inspect all the following areas/activities: storage areas for vehicles/equipment awaiting maintenance, fueling areas, indoor and outdoor vehicle/equipment maintenance areas, material storage areas, vehicle/equipment cleaning areas and loading/unloading areas.

Part 8 – Sector-Specific Requirements for Industrial Activity

Subpart Q – Sector Q – Water Transportation.

You must comply with Part 8 sector-specific requirements associated with your primary industrial activity and any co-located industrial activities, as defined in Appendix A. The sector-specific requirements apply to those areas of your facility where those sector-specific activities occur. These sector-specific requirements are in addition to any requirements specified elsewhere in this permit.

8.Q.1 Covered Stormwater Discharges.

The requirements in Subpart Q apply to stormwater discharges associated with industrial activity from Water Transportation facilities as identified by the SIC Codes specified under Sector Q in Table D-1 of Appendix D of the permit.

8.Q.2 Limitations on Coverage.

8.Q.2.1 *Prohibition of Non-Stormwater Discharges.* (See also Part 1.1.4) Not covered by this permit: bilge and ballast water, sanitary wastes, pressure wash water, and cooling water originating from vessels.

8.Q.3 Additional Technology-Based Effluent Limits.

8.Q.3.1 *Good Housekeeping Measures.* You must implement the following good housekeeping measures in addition to the requirements of part 2.1.2.2:

8.Q.3.1.1 *Pressure Washing Area.* If pressure washing is used to remove marine growth from vessels, the discharge water must be permitted by a separate NPDES permit. Collect or contain the discharges from the pressures washing area so that they are not co-mingled with stormwater discharges authorized by this permit.

8.Q.3.1.2 *Blasting and Painting Area.* Minimize the potential for spent abrasives, paint chips, and overspray to discharge into receiving waters or the storm sewer systems. Consider containing all blasting and painting activities or use other measures to minimize the discharge of contaminants (e.g., hanging plastic barriers or tarpaulins during blasting or painting operations to contain debris). When necessary, regularly clean stormwater conveyances of deposits of abrasive blasting debris and paint chips.

8.Q.3.1.3 *Material Storage Areas.* Store and plainly label all containerized materials (e.g., fuels, paints, solvents, waste oil, antifreeze, batteries) in a protected, secure location away from drains. Minimize the contamination of precipitation or surface runoff from the storage areas. Specify which materials are stored indoors, and consider containment or enclosure for those stored outdoors. If abrasive blasting is performed, discuss the storage and disposal of spent abrasive materials generated at the facility. Consider implementing an inventory control plan to limit the presence of potentially hazardous materials onsite.

- 8.Q.3.1.4 *Engine Maintenance and Repair Areas.* Minimize the contamination of precipitation or surface runoff from all areas used for engine maintenance and repair. Consider the following (or their equivalents): performing all maintenance activities indoors, maintaining an organized inventory of materials used in the shop, draining all parts of fluid prior to disposal, prohibiting the practice of hosing down the shop floor, using dry cleanup methods, and treating and/or recycling stormwater runoff collected from the maintenance area.
- 8.Q.3.1.5 *Material Handling Area.* Minimize the contamination of precipitation or surface runoff from material handling operations and areas (e.g., fueling, paint and solvent mixing, disposal of process wastewater streams from vessels). Consider the following (or their equivalents): covering fueling areas, using spill and overflow protection, mixing paints and solvents in a designated area (preferably indoors or under a shed), and minimizing runoff of stormwater to material handling areas.
- 8.Q.3.1.6 *Drydock Activities.* Routinely maintain and clean the drydock to minimize pollutants in stormwater runoff. Address the cleaning of accessible areas of the drydock prior to flooding, and final cleanup following removal of the vessel and raising the dock. Include procedures for cleaning up oil, grease, and fuel spills occurring on the drydock. Consider the following (or their equivalents): sweeping rather than hosing off debris and spent blasting material from accessible areas of the drydock prior to flooding and making absorbent materials and oil containment booms readily available to clean up or contain any spills.
- 8.Q.3.2 *Employee Training.* (See also Part 2.1.2.9) As part of your employee training program, address, at a minimum, the following activities (as applicable): used oil management, spent solvent management, disposal of spent abrasives, disposal of vessel wastewaters, spill prevention and control, fueling procedures, general good housekeeping practices, painting and blasting procedures, and used battery management.
- 8.Q.3.3 *Preventive Maintenance.* (See also Part 2.1.2.3) As part of your preventive maintenance program, perform timely inspection and maintenance of stormwater management devices (e.g., cleaning oil and water separators and sediment traps to ensure that spent abrasives, paint chips, and solids will be intercepted and retained prior to entering the storm drainage system), as well as inspecting and testing facility equipment and systems to uncover conditions that could cause breakdowns or failures resulting in discharges of pollutants to surface waters.
- 8.Q.4 Additional SWPPP Requirements.**
- 8.Q.4.1 *Drainage Area Site Map.* (See also Part 5.1.2) Document in your SWPPP where any of the following may be exposed to precipitation or surface runoff: fueling; engine maintenance and repair; vessel maintenance and repair; pressure washing; painting; sanding; blasting; welding; metal fabrication; loading and unloading areas; locations used for the treatment, storage, or disposal of wastes; liquid storage tanks; liquid

storage areas (e.g., paint, solvents, resins); and material storage areas (e.g., blasting media, aluminum, steel, scrap iron).

8.Q.4.2 *Summary of Potential Pollutant Sources.* (See also Part 5.1.3) Document in the SWPPP the following additional sources and activities that have potential pollutants associated with them: outdoor manufacturing or processing activities (e.g., welding, metal fabricating) and significant dust or particulate generating processes (e.g., abrasive blasting, sanding, and painting.)

8.Q.5 Additional Inspection Requirements.

(See also Part 4.1) Include the following in all quarterly routine facility inspections: pressure washing area; blasting, sanding, and painting areas; material storage areas; engine maintenance and repair areas; material handling areas; drydock area; and general yard area.

8.Q.6 Sector-Specific Benchmarks. (See also Part 6 of the permit.)

Table 8.Q-1.

Subsector (You may be subject to requirements for more than one sector/subsector)	Parameter	Benchmark Monitoring Concentration
Subsector Q1. Water Transportation Facilities (SIC 4412-4499)	Total Aluminum	0.75 mg/L
	Total Iron	1.0 mg/L
	Total Lead ¹	Hardness Dependent
	Total Zinc ¹	Hardness Dependent

¹ The benchmark values of some metals are dependent on water hardness. For these parameters, permittees must determine the hardness of the receiving water (see Appendix J, “Calculating Hardness in Receiving Waters for Hardness Dependent Metals,” for methodology), in accordance with Part 6.2.1.1, to identify the applicable ‘hardness range’ for determining their benchmark value applicable to their facility. The ranges occur in 25 mg/L increments. Hardness Dependent Benchmarks follow in the table below:

Water Hardness Range	Lead (mg/L)	Zinc (mg/L)
0-25 mg/L	0.014	0.04
25-50 mg/L	0.023	0.05
50-75 mg/L	0.045	0.08
75-100 mg/L	0.069	0.11
100-125 mg/L	0.095	0.13
125-150 mg/L	0.122	0.16
150-175 mg/L	0.151	0.18
175-200 mg/L	0.182	0.20
200-225 mg/L	0.213	0.23
225-250 mg/L	0.246	0.25
250+ mg/L	0.262	0.26

Part 8 – Sector-Specific Requirements for Industrial Activity

Subpart R – Sector R – Ship and Boat Building and Repair Yards.

You must comply with Part 8 sector-specific requirements associated with your primary industrial activity and any co-located industrial activities, as defined in Appendix A. The sector-specific requirements apply to those areas of your facility where those sector-specific activities occur. These sector-specific requirements are in addition to any requirements specified elsewhere in this permit.

8.R.1 Covered Stormwater Discharges.

The requirements in Subpart R apply to stormwater discharges associated with industrial activity from Ship and Boat Building and Repair Yards as identified by the SIC Codes specified under Sector R in Table D-1 of Appendix D of the permit.

8.R.2 Limitations on Coverage.

8.R.2.1 *Prohibition of Non-Stormwater Discharges.* (See also Part 1.1.4) Discharges containing bilge and ballast water, sanitary wastes, pressure wash water, and cooling water originating from vessels are not covered by this permit.

8.R.3 Additional Technology-Based Effluent Limits.

8.R.3.1 *Good Housekeeping Measures.* (See also Part 2.1.2.2)

8.R.3.1.1 *Pressure Washing Area.* If pressure washing is used to remove marine growth from vessels, the discharged water must be permitted as a process wastewater by a separate NPDES permit.

8.R.3.1.2 *Blasting and Painting Area.* Minimize the potential for spent abrasives, paint chips, and overspray to discharging into the receiving water or the storm sewer systems. Consider containing all blasting and painting activities, or use other measures to prevent the discharge of the contaminants (e.g., hanging plastic barriers or tarpaulins during blasting or painting operations to contain debris). When necessary, regularly clean stormwater conveyances of deposits of abrasive blasting debris and paint chips.

8.R.3.1.3 *Material Storage Areas.* Store and plainly label all containerized materials (e.g., fuels, paints, solvents, waste oil, antifreeze, batteries) in a protected, secure location away from drains. Minimize the contamination of precipitation or surface runoff from the storage areas. If abrasive blasting is performed, discuss the storage and disposal of spent abrasive materials generated at the facility. Consider implementing an inventory control plan to limit the presence of potentially hazardous materials onsite.

8.R.3.1.4 *Engine Maintenance and Repair Areas.* Minimize the contamination of precipitation or surface runoff from all areas used for engine maintenance and repair. Consider the following (or their equivalents): performing all maintenance activities indoors, maintaining an organized inventory of

materials used in the shop, draining all parts of fluid prior to disposal, prohibiting the practice of hosing down the shop floor, using dry cleanup methods, and treating and/or recycling stormwater runoff collected from the maintenance area.

- 8.R.3.1.5 *Material Handling Area.* Minimize the contamination of precipitation or surface runoff from material handling operations and areas (e.g., fueling, paint and solvent mixing, disposal of process wastewater streams from vessels). Consider the following (or their equivalents): covering fueling areas, using spill and overflow protection, mixing paints and solvents in a designated area (preferably indoors or under a shed), and minimizing stormwater run-on to material handling areas.
- 8.R.3.1.6 *Drydock Activities.* Routinely maintain and clean the drydock to minimize pollutants in stormwater runoff. Clean accessible areas of the drydock prior to flooding and final cleanup following removal of the vessel and raising the dock. Include procedures for cleaning up oil, grease, or fuel spills occurring on the drydock. Consider the following (or their equivalents): sweeping rather than hosing off debris and spent blasting material from accessible areas of the drydock prior to flooding, and having absorbent materials and oil containment booms readily available to clean up and contain any spills.
- 8.R.3.2 *Employee Training.* (See also Part 2.1.2.9) As part of your employee training program, address, at a minimum, the following activities (as applicable): used oil management, spent solvent management, disposal of spent abrasives, disposal of vessel wastewaters, spill prevention and control, fueling procedures, general good housekeeping practices, painting and blasting procedures, and used battery management.
- 8.R.3.4 *Preventive Maintenance.* (See also Part 2.1.2.3) As part of your preventive maintenance program, perform timely inspection and maintenance of stormwater management devices (e.g., cleaning oil and water separators and sediment traps to ensure that spent abrasives, paint chips, and solids will be intercepted and retained prior to entering the storm drainage system), as well as inspecting and testing facility equipment and systems to uncover conditions that could cause breakdowns or failures resulting in discharges of pollutants to surface waters.
- 8.R.4 Additional SWPPP Requirements.**
- 8.R.4.1 *Drainage Area Site Map.* (See also Part 5.1.2) Document in your SWPPP where any of the following may be exposed to precipitation or surface runoff: fueling; engine maintenance or repair; vessel maintenance or repair; pressure washing; painting; sanding; blasting; welding; metal fabrication; loading and unloading areas; treatment, storage, and waste disposal areas; liquid storage tanks; liquid storage areas (e.g., paint, solvents, resins); and material storage areas (e.g., blasting media, aluminum, steel, scrap iron).
- 8.R.4.2 *Potential Pollutant Sources.* (See also Part 5.1.3) Document in your SWPPP the following additional sources and activities that have potential pollutants associated with them (if applicable): outdoor manufacturing or processing activities (e.g., welding,

metal fabricating) and significant dust or particulate generating processes (e.g., abrasive blasting, sanding, and painting).

8.R.4.3 *Documentation of Good Housekeeping Measures.* Document in your SWPPP any good housekeeping measures implemented to meet the effluent limits in Part 8.R.3.

8.R.4.3.1 *Blasting and Painting Areas.* Document in the SWPPP any standard operating practices relating to blasting and painting (e.g., prohibiting uncontained blasting and painting over open water or prohibiting blasting and painting during windy conditions, which can render containment ineffective).

8.R.4.3.2 *Storage Areas.* Specify in your SWPPP which materials are stored indoors, and consider containment or enclosure for those stored outdoors.

8.R.5 Additional Inspection Requirements.

(See also Part 4.1) Include the following in all quarterly routine facility inspections: pressure washing area; blasting, sanding, and painting areas; material storage areas; engine maintenance and repair areas; material handling areas; drydock area; and general yard area.

Part 8 – Sector-Specific Requirements for Industrial Activity

Subpart S – Sector S – Air Transportation.

You must comply with Part 8 sector-specific requirements associated with your primary industrial activity and any co-located industrial activities, as defined in Appendix A. The sector-specific requirements apply to those areas of your facility where those sector-specific activities occur. These sector-specific requirements are in addition to any requirements specified elsewhere in this permit.

8.S.1 Covered Stormwater Discharges.

The requirements in Subpart S apply to stormwater discharges associated with industrial activity from Air Transportation facilities identified by the SIC Codes specified under Sector S in Table D-1 of Appendix D of the permit.

8.S.2 Limitation on Coverage

8.S.2.1 *Limitations on Coverage.* This permit authorizes stormwater discharges from only those portions of the air transportation facility that are involved in vehicle maintenance (including vehicle rehabilitation, mechanical repairs, painting, fueling and lubrication), equipment cleaning operations or deicing operations.

Note: “deicing” will generally be used to imply both deicing (removing frost, snow or ice) and anti-icing (preventing accumulation of frost, snow or ice) activities, unless specific mention is made regarding anti-icing and/or deicing activities.

8.S.2.2 *Prohibition of Non-Stormwater Discharges.* (See also Part 1.1.4 and Part 8.S.3) This permit does not authorize the discharge of aircraft, ground vehicle, runway and equipment washwaters; nor the dry weather discharge of deicing chemicals. Such discharges must be covered by separate NPDES permit(s). Note that a discharge resulting from snowmelt is not a dry weather discharge.

8.S.3 Additional Technology-Based Effluent Limits.

8.S.3.1 *Good Housekeeping Measures.* (See also Part 2.1.2.2)

8.S.3.1.1 Aircraft, Ground Vehicle and Equipment Maintenance Areas. Minimize the contamination of stormwater runoff from all areas used for aircraft, ground vehicle and equipment maintenance (including the maintenance conducted on the terminal apron and in dedicated hangers). Consider the following practices (or their equivalents): performing maintenance activities indoors; maintaining an organized inventory of material used in the maintenance areas; draining all parts of fluids prior to disposal; prohibiting the practice of hosing down the apron or hanger floor; using dry cleanup methods; and collecting the stormwater runoff from the maintenance area and providing treatment or recycling.

8.S.3.1.2 Aircraft, Ground Vehicle and Equipment Cleaning Areas. (See also Part 8.S.3.6) Clearly demarcate these areas on the ground using signage or other

appropriate means. Minimize the contamination of stormwater runoff from cleaning areas.

8.S.3.1.3 Aircraft, Ground Vehicle and Equipment Storage Areas. Store all aircraft, ground vehicles and equipment awaiting maintenance in designated areas only and minimize the contamination of stormwater runoff from these storage areas. Consider the following control measures, including any BMPs (or their equivalents): storing aircraft and ground vehicles indoors; using drip pans for the collection of fluid leaks; and perimeter drains, dikes or berms surrounding the storage areas.

8.S.3.1.4 Material Storage Areas. Maintain the vessels of stored materials (e.g., used oils, hydraulic fluids, spent solvents, and waste aircraft fuel) in good condition, to prevent or minimize contamination of stormwater. Also plainly label the vessels (e.g., "used oil," "Contaminated Jet A," etc.). Minimize contamination of precipitation/runoff from these areas. Consider the following control measures (or their equivalents): storing materials indoors; storing waste materials in a centralized location; and installing berms/dikes around storage areas.

8.S.3.1.5 Airport Fuel System and Fueling Areas. Minimize the discharge of fuel to the storm sewer/surface waters resulting from fuel servicing activities or other operations conducted in support of the airport fuel system. Consider the following control measures (or their equivalents): implementing spill and overflow practices (e.g., placing absorptive materials beneath aircraft during fueling operations); using only dry cleanup methods; and collecting stormwater runoff.

8.S.3.1.6 Source Reduction. Minimize, and where feasible eliminate, the use of urea and glycol-based deicing chemicals, in order to reduce the aggregate amount of deicing chemicals used and/or lessen the environmental impact. Chemical options to replace ethylene glycol, propylene glycol and urea include: potassium acetate; magnesium acetate; calcium acetate; and anhydrous sodium acetate.

8.S.3.1.6.1 Runway Deicing Operation: Minimize contamination of stormwater runoff from runways as a result of deicing operations. Evaluate whether over-application of deicing chemicals occurs by analyzing application rates, and adjust as necessary, consistent with considerations of flight safety. Also consider these control measure options (or their equivalents): metered application of chemicals; pre-wetting dry chemical constituents prior to application; installing a runway ice detection system; implementing anti-icing operations as a preventive measure against ice buildup.

8.S.3.1.6.2 Aircraft Deicing Operations. Minimize contamination of stormwater runoff from aircraft deicing operations. Determine whether excessive application of deicing chemicals occurs and

adjust as necessary, consistent with considerations of flight safety. This evaluation should be carried out by the personnel most familiar with the particular aircraft and flight operations in question (versus an outside entity such as the airport authority). Consider using alternative deicing/anti-icing agents as well as containment measures for all applied chemicals. Also consider these control measure options (or their equivalents) for reducing deicing fluid use: forced-air deicing systems, computer-controlled fixed-gantry systems, infrared technology, hot water, varying glycol content to air temperature, enclosed-basket deicing trucks, mechanical methods, solar radiation, hangar storage, aircraft covers, and thermal blankets for MD-80s and DC-9s. Also consider using ice-detection systems and airport traffic flow strategies and departure slot allocation systems.

8.S.3.1.7 Management of Runoff. (See also 2.1.2.6) Where deicing operations occur, implement a program to control or manage contaminated runoff to minimize the amount of pollutants being discharged from the site. Consider these control measure options (or their equivalents): a dedicated deicing facility with a runoff collection/ recovery system; using vacuum/collection trucks; storing contaminated stormwater/deicing fluids in tanks and releasing controlled amounts to a publicly owned treatment works; collecting contaminated runoff in a wet pond for biochemical decomposition (be aware of attracting wildlife that may prove hazardous to flight operations); and directing runoff into vegetative swales or other infiltration measures. Also consider recovering deicing materials when these materials are applied during non-precipitation events (e.g., covering storm sewer inlets, using booms, installing absorptive interceptors in the drains, etc.) to prevent these materials from later becoming a source of stormwater contamination. Used deicing fluid should be recycled whenever possible.

8.S.3.2 *Deicing Season.* You must determine the seasonal timeframe (e.g., December-February, October - March, etc.) during which deicing activities typically occur at the facility. Implementation of control measures, including any BMPs, facility inspections and monitoring must be conducted with particular emphasis throughout the defined deicing season. If you meet the deicing chemical usage thresholds of 100,000 gallons glycol and/or 100 tons of urea, the deicing season you identified is the timeframe during which you must obtain the four required benchmark monitoring event results for deicing-related parameters, i.e., BOD, COD, ammonia and pH. See also Part 8.S.6.

8.S.4 Additional SWPPP Requirements.

An airport authority and tenants of the airport are encouraged to work in partnership in the development of a SWPPP. If an airport tenant obtains authorization under this permit and develops a SWPPP for discharges from his own areas of the airport, prior to authorization, that SWPPP must be coordinated and integrated with the SWPPP for the entire airport. Tenants of the airport facility include air passenger or cargo companies, fixed based operators and other parties

who have contracts with the airport authority to conduct business operations on airport property and whose operations result in stormwater discharges associated with industrial activity.

- 8.S.4.1 *Drainage Area Site Map.* (See also Part 5.1.2) Document in the SWPPP the following areas of the facility and indicate whether activities occurring there may be exposed to precipitation/surface runoff: aircraft and runway deicing operations; fueling stations; aircraft, ground vehicle and equipment maintenance/cleaning areas; storage areas for aircraft, ground vehicles and equipment awaiting maintenance.
- 8.S.4.2 *Potential Pollutant Sources.* (See also Part 5.1.3) In your inventory of exposed materials, describe in your SWPPP the potential for the following activities and facility areas to contribute pollutants to stormwater discharges: aircraft, runway, ground vehicle and equipment maintenance and cleaning; aircraft and runway deicing operations (including apron and centralized aircraft deicing stations, runways, taxiways and ramps). If you use deicing chemicals, you must maintain a record of the types (including the Material Safety Data Sheets [MSDS]) used and the monthly quantities, either as measured or, in the absence of metering, as estimated to the best of your knowledge. This includes all deicing chemicals, not just glycols and urea (e.g., potassium acetate), because large quantities of these other chemicals can still have an adverse impact on receiving waters. Tenants or other fixed-based operations that conduct deicing operations must provide the above information to the airport authority for inclusion with any comprehensive airport SWPPPs.
- 8.S.4.3 *Vehicle and Equipment Washwater Requirements.* Attach to or reference in your SWPPP, a copy of the NPDES permit issued for vehicle/equipment washwater or, if an NPDES permit has not been issued, a copy of the pending application. If an industrial user permit is issued under a local pretreatment program, include a copy in your SWPPP. In any case, if you are subject to another permit, describe your control measures for implementing all non-stormwater discharge permit conditions or pretreatment requirements in your SWPPP. If washwater is handled in another manner (e.g., hauled offsite, retained onsite), describe the disposal method and attach all pertinent documentation/information (e.g., frequency, volume, destination, etc.) in your SWPPP.
- 8.S.4.4 *Documentation of Control Measures Used for Management of Runoff:* Document in your SWPPP the control measures used for collecting or containing contaminated melt water from collection areas used for disposal of contaminated snow.

8.S.5 Additional Inspection Requirements.

- 8.S.5.1 *Inspections.* (See also Part 4.1) At a minimum conduct routine facility inspections at least monthly during the deicing season (e.g., October through April for most mid-latitude airports). If your facility needs to deice before or after this period, expand the monthly inspections to include all months during which deicing chemicals may be used. The Director may specifically require you to increase inspection frequencies.
- 8.S.5.2 *Comprehensive Site Inspections.* (See also Part 4.3) Using only qualified personnel, conduct your annual site inspection during periods of actual deicing operations, if possible. If not practicable during active deicing because of weather, conduct the

inspection during the season when deicing operations occur and the materials and equipment for deicing are in place.

8.S.6 Sector-Specific Benchmarks. (See also Part 6 of the permit.)

Monitor per the requirements in Table 8.S-1.

Table 8.S-1.		
Subsector (You may be subject to requirements for more than one sector/subsector)	Parameter	Benchmark Monitoring Concentration
For airports where a single permittee, or a combination of permitted facilities use more than 100,000 gallons of glycol-based deicing chemicals and/or 100 tons or more of urea on an average annual basis, monitor the first four parameters in ONLY those outfalls that collect runoff from areas where deicing activities occur (SIC 4512-4581).	Biochemical Oxygen Demand (BOD ₅) ¹	30 mg/L
	Chemical Oxygen Demand (COD) ¹	120 mg/L
	Ammonia ¹	2.14 mg/L
	pH ¹	6.0 - 9.0 s.u.

¹ These are deicing-related parameters. Collect the four benchmark samples, and any required follow-up benchmark samples, during the timeframe defined in Part 8.S.3.2 when deicing activities are occurring.

Part 8 – Sector-Specific Requirements for Industrial Activity

Subpart T – Sector T – Treatment Works.

You must comply with Part 8 sector-specific requirements associated with your primary industrial activity and any co-located industrial activities, as defined in Appendix A. The sector-specific requirements apply to those areas of your facility where those sector-specific activities occur. These sector-specific requirements are in addition to any requirements specified elsewhere in this permit.

8.T.1 Covered Stormwater Discharges.

The requirements in Subpart T apply to stormwater discharges associated with industrial activity from Treatment Works as identified by the Activity Code specified under Sector T in Table D-1 of Appendix D of the permit.

8.T.2 Industrial Activities Covered by Sector T.

The requirements listed under this part apply to all existing point source stormwater discharges associated with the following activities:

- 8.T.2.1 Treatment works treating domestic sewage, or any other sewage sludge or wastewater treatment device or system used in the storage, treatment, recycling, and reclamation of municipal or domestic sewage, including land dedicated to the disposal of sewage sludge; that are located within the confines of a facility with a design flow of 1.0 million gallons per day (MGD) or more; or are required to have an approved pretreatment program under 40 CFR Part 403.
- 8.T.2.2 The following are not required to have permit coverage: farm lands, domestic gardens or lands used for sludge management where sludge is beneficially reused and which are not physically located within the facility, or areas that are in compliance with Section 405 of the CWA.

8.T.3 Limitations on Coverage.

- 8.T.3.1 *Prohibition of Non-Stormwater Discharges.* (See also Part 1.1.4) Sanitary and industrial wastewater and equipment and vehicle washwater are not authorized by this permit.

8.T.4 Additional Technology-Based Effluent Limits.

- 8.T.4.1 *Control Measures.* (See also the non-numeric effluent limits in Part 2.1.2) In addition to the other control measures, consider the following: routing stormwater to the treatment works; or covering exposed materials (i.e., from the following areas: grit, screenings, and other solids handling, storage, or disposal areas; sludge drying beds; dried sludge piles; compost piles; and septage or hauled waste receiving station).
- 8.T.4.2 *Employee Training.* (See also Part 2.1.2.9) At a minimum, training must address the following areas when applicable to a facility: petroleum product management; process chemical management; spill prevention and controls; fueling procedures; general good

housekeeping practices; and proper procedures for using fertilizer, herbicides, and pesticides.

8.T.5 Additional SWPPP Requirements.

- 8.T.5.1 *Site Map.* (See also Part 5.1.2) Document in your SWPPP where any of the following may be exposed to precipitation or surface runoff: grit, screenings, and other solids handling, storage, or disposal areas; sludge drying beds; dried sludge piles; compost piles; septage or hauled waste receiving station; and storage areas for process chemicals, petroleum products, solvents, fertilizers, herbicides, and pesticides.
- 8.T.5.2 *Potential Pollutant Sources.* (See also Part 5.1.3) Document in your SWPPP the following additional sources and activities that have potential pollutants associated with them, as applicable: grit, screenings, and other solids handling, storage, or disposal areas; sludge drying beds; dried sludge piles; compost piles; septage or hauled waste receiving station; and access roads and rail lines.
- 8.T.5.3 *Wastewater and Washwater Requirements.* Keep a copy of all your current NPDES permits issued for wastewater and industrial, vehicle and equipment washwater discharges or, if an NPDES permit has not yet been issued, a copy of the pending application(s) with your SWPPP. If the washwater is handled in another manner, the disposal method must be described and all pertinent documentation must be retained onsite.

8.T.6 Additional Inspection Requirements.

(See also Part 4.1) Include the following areas in all inspections: access roads and rail lines; grit, screenings, and other solids handling, storage, or disposal areas; sludge drying beds; dried sludge piles; compost piles; and septage or hauled waste receiving station.

Part 8 – Sector-Specific Requirements for Industrial Activity

Subpart U – Sector U – Food and Kindred Products.

You must comply with Part 8 sector-specific requirements associated with your primary industrial activity and any co-located industrial activities, as defined in Appendix A. The sector-specific requirements apply to those areas of your facility where those sector-specific activities occur. These sector-specific requirements are in addition to any requirements specified elsewhere in this permit.

8.U.1 Covered Stormwater Discharges.

The requirements in Subpart U apply to stormwater discharges associated with industrial activity from Food and Kindred Products facilities as identified by the SIC Codes specified in Table D-1 of Appendix D of the permit.

8.U.2 Limitations on Coverage.

8.U.2.1 *Prohibition of Non-Stormwater Discharges.* (See also Part 1.1.4) The following discharges are not authorized by this permit: discharges containing boiler blowdown, cooling tower overflow and blowdown, ammonia refrigeration purging, and vehicle washing and clean-out operations.

8.U.3 Additional Technology-Based Limitations.

8.U.3.1 *Employee Training.* (See also Part 2.1.2.9) Address pest control in your employee training program.

8.U.4 Additional SWPPP Requirements.

8.U.4.1 *Drainage Area Site Map.* (See also Part 5.1.2) Document in your SWPPP the locations of the following activities if they are exposed to precipitation or runoff: vents and stacks from cooking, drying, and similar operations; dry product vacuum transfer lines; animal holding pens; spoiled product; and broken product container storage areas.

8.U.4.2 *Potential Pollutant Sources.* (See also Part 5.1.3) Document in your SWPPP, in addition to food and kindred products processing-related industrial activities, application and storage of pest control chemicals (e.g., rodenticides, insecticides, fungicides) used on plant grounds.

8.U.5 Additional Inspection Requirements.

(See also Part 4.1) Inspect on a quarterly basis, at a minimum, the following areas where the potential for exposure to stormwater exists: loading and unloading areas for all significant materials; storage areas, including associated containment areas; waste management units; vents and stacks emanating from industrial activities; spoiled product and broken product container holding areas; animal holding pens; staging areas; and air pollution control equipment.

8.U.6 Sector-Specific Benchmarks. (See also Part 6 of the permit.)

Table 8.U-1.		
Subsector (You may be subject to requirements for more than one Sector / Subsector)	Parameter	Benchmark Monitoring Concentration
Subsector U1. Grain Mill Products (SIC 2041-2048)	Total Suspended Solids (TSS)	100 mg/L
Subsector U2. Fats and Oils Products (SIC 2074-2079)	Biochemical Oxygen Demand (BOD ₅)	30 mg/L
	Chemical Oxygen Demand (COD)	120 mg/L
	Nitrate plus Nitrite Nitrogen	0.68 mg/L
	Total Suspended Solids (TSS)	100 mg/L

Part 8 – Sector-Specific Requirements for Industrial Activity

Subpart V – Sector V – Textile Mills, Apparel, and Other Fabric Products.

You must comply with Part 8 sector-specific requirements associated with your primary industrial activity and any co-located industrial activities, as defined in Appendix A. The sector-specific requirements apply to those areas of your facility where those sector-specific activities occur. These sector-specific requirements are in addition to any requirements specified elsewhere in this permit.

8.V.1 Covered Stormwater Discharges.

The requirements in Subpart V apply to stormwater discharges associated with industrial activity from Textile Mills, Apparel, and Other Fabric Product manufacturing as identified by the SIC Codes specified under Sector V in Table D-1 of Appendix D of the permit.

8.V.2 Limitations on Coverage.

8.V.2.1 *Prohibition of Non-Stormwater Discharges.* (See also Part 1.1.4) The following are not authorized by this permit: discharges of wastewater (e.g., wastewater resulting from wet processing or from any processes relating to the production process), reused or recycled water, and waters used in cooling towers. If you have these types of discharges from your facility, you must cover them under a separate NPDES permit.

8.V.3 Additional Technology-Based Limitations.

8.V.3.1 *Good Housekeeping Measures.* (See also Part 2.1.2.2)

8.V.3.1.1 *Material Storage Areas.* Plainly label and store all containerized materials (e.g., fuels, petroleum products, solvents, and dyes) in a protected area, away from drains. Minimize contamination of the stormwater runoff from such storage areas. Also consider an inventory control plan to prevent excessive purchasing of potentially hazardous substances. For storing empty chemical drums or containers, ensure that the drums and containers are clean (consider triple-rinsing) and that there is no contact of residuals with precipitation or runoff. Collect and dispose of washwater from these cleanings properly.

8.V.3.1.2 *Material Handling Areas.* Minimize contamination of stormwater runoff from material handling operations and areas. Consider the following (or their equivalents): use of spill and overflow protection; covering fueling areas; and covering or enclosing areas where the transfer of material may occur. When applicable, address the replacement or repair of leaking connections, valves, transfer lines, and pipes that may carry chemicals, dyes, or wastewater.

8.V.3.1.3 *Fueling Areas.* Minimize contamination of stormwater runoff from fueling areas. Consider the following (or their equivalents): covering the fueling area, using spill and overflow protection, minimizing run-on of stormwater to the fueling areas, using dry cleanup methods, and treating and/or recycling stormwater runoff collected from the fueling area.

8.V.3.1.4 *Above-Ground Storage Tank Area.* Minimize contamination of the stormwater runoff from above-ground storage tank areas, including the associated piping and valves. Consider the following (or their equivalents): regular cleanup of these areas; including measures for tanks, piping and valves explicitly in your SPCC program; minimizing runoff of stormwater from adjacent areas; restricting access to the area; inserting filters in adjacent catch basins; providing absorbent booms in unbermed fueling areas; using dry cleanup methods; and permanently sealing drains within critical areas that may discharge to a storm drain.

8.V.3.2 *Employee Training.* (See also Part 2.1.2.9) As part of your employee training program, address, at a minimum, the following activities (as applicable): use of reused and recycled waters, solvents management, proper disposal of dyes, proper disposal of petroleum products and spent lubricants, spill prevention and control, fueling procedures, and general good housekeeping practices.

8.V.4 Additional SWPPP Requirements.

8.V.4.1 *Potential Pollutant Sources.* (See also Part 5.1.3) Document in your SWPPP the following additional sources and activities that have potential pollutants associated with them: industry-specific significant materials and industrial activities (e.g., backwinding, beaming, bleaching, backing bonding, carbonizing, carding, cut and sew operations, desizing, drawing, dyeing locking, fulling, knitting, mercerizing, opening, packing, plying, scouring, slashing, spinning, synthetic-felt processing, textile waste processing, tufting, turning, weaving, web forming, winging, yarn spinning, and yarn texturing).

8.V.4.2 *Description of Good Housekeeping Measures for Material Storage Areas.* Document in the SWPPP your containment area or enclosure for materials stored outdoors in connection with Part 8.V.3.1.1 above.

8.V.5 Additional Inspection Requirements.

(See also Part 4.1) Inspect, at least monthly, the following activities and areas (at a minimum): transfer and transmission lines, spill prevention, good housekeeping practices, management of process waste products, and all structural and nonstructural management practices.

Part 8 – Sector-Specific Requirements for Industrial Activity**Subpart W – Sector W – Furniture and Fixtures.**

You must comply with Part 8 sector-specific requirements associated with your primary industrial activity and any co-located industrial activities, as defined in Appendix A. The sector-specific requirements apply to those areas of your facility where those sector-specific activities occur. These sector-specific requirements are in addition to any requirements specified elsewhere in this permit.

8.W.1 Covered Stormwater Discharges.

The requirements in Subpart W apply to stormwater discharges associated with industrial activity from Furniture and Fixtures facilities as identified by the SIC Codes specified under Sector W in Table D-1 of Appendix D of the permit.

8.W.2 Additional SWPPP Requirements.

8.W.2.1 *Drainage Area Site Map.* (See also Part 5.1.2) Document in your SWPPP where any of the following may be exposed to precipitation or surface runoff: material storage (including tanks or other vessels used for liquid or waste storage) areas; outdoor material processing areas; areas where wastes are treated, stored, or disposed of; access roads; and rail spurs.

Part 8 – Sector-Specific Requirements for Industrial Activity

Subpart X – Sector X – Printing and Publishing.

You must comply with Part 8 sector-specific requirements associated with your primary industrial activity and any co-located industrial activities, as defined in Appendix A. The sector-specific requirements apply to those areas of your facility where those sector-specific activities occur. These sector-specific requirements are in addition to any requirements specified elsewhere in this permit.

8.X.1 Covered Stormwater Discharges.

The requirements in Subpart X apply to stormwater discharges associated with industrial activity from Printing and Publishing facilities as identified by the SIC Codes specified under Sector X in Table D-1 of Appendix D of the permit.

8.X.2 Additional Technology-Based Effluent Limits.

8.X.2.1 *Good Housekeeping Measures.* (See also Part 2.1.2.2)

- 8.X.2.1.1 *Material Storage Areas.* Plainly label and store all containerized materials (e.g., skids, pallets, solvents, bulk inks, hazardous waste, empty drums, portable and mobile containers of plant debris, wood crates, steel racks, and fuel oil) in a protected area, away from drains. Minimize contamination of the stormwater runoff from such storage areas. Also consider an inventory control plan to prevent excessive purchasing of potentially hazardous substances.
- 8.X.2.1.2 *Material Handling Area.* Minimize contamination of stormwater runoff from material handling operations and areas (e.g., blanket wash, mixing solvents, loading and unloading materials). Consider the following (or their equivalents): using spill and overflow protection, covering fueling areas, and covering or enclosing areas where the transfer of materials may occur. When applicable, address the replacement or repair of leaking connections, valves, transfer lines, and pipes that may carry chemicals or wastewater.
- 8.X.2.1.3 *Fueling Areas.* Minimize contamination of stormwater runoff from fueling areas. Consider the following (or their equivalents): covering the fueling area, using spill and overflow protection, minimizing runoff of stormwater to the fueling areas, using dry cleanup methods, and treating and/or recycling stormwater runoff collected from the fueling area.
- 8.X.2.1.4 *Above Ground Storage Tank Area.* Minimize contamination of the stormwater runoff from above-ground storage tank areas, including the associated piping and valves. Consider the following (or their equivalents): regularly cleaning these areas, explicitly addressing tanks, piping and valves in the SPCC program, minimizing stormwater runoff from adjacent areas, restricting access to the area, inserting filters in adjacent catch basins, providing absorbent booms in unbermed fueling areas, using dry cleanup methods, and permanently sealing drains within critical areas that may discharge to a storm drain.

8.X.2.2 *Employee Training.* (See also Part 2.1.2.9) As part of your employee training program, address, at a minimum, the following activities (as applicable): spent solvent management, spill prevention and control, used oil management, fueling procedures, and general good housekeeping practices.

8.X.3 Additional SWPPP Requirements.

8.X.3.1 *Description of Good Housekeeping Measures for Material Storage Areas.* In connection with Part 8.X.2.1.1, describe in the SWPPP the containment area or enclosure for materials stored outdoors.

Part 8 – Sector-Specific Requirements for Industrial Activity

Subpart Y – Sector Y – Rubber, Miscellaneous Plastic Products, and Miscellaneous Manufacturing Industries.

You must comply with Part 8 sector-specific requirements associated with your primary industrial activity and any co-located industrial activities, as defined in Appendix A. The sector-specific requirements apply to those areas of your facility where those sector-specific activities occur. These sector-specific requirements are in addition to any requirements specified elsewhere in this permit.

8.Y.1 Covered Stormwater Discharges.

The requirements in Subpart Y apply to stormwater discharges associated with industrial activity from Rubber, Miscellaneous Plastic Products, and Miscellaneous Manufacturing Industries facilities as identified by the SIC Codes specified under Sector Y in Table D-1 of Appendix D of the permit.

8.Y.2 Additional Technology-Based Effluent Limits.

8.Y.2.1 *Controls for Rubber Manufacturers.* (See also Part 2.1.2) Minimize the discharge of zinc in your stormwater discharges. Parts 8.Y.2.1.1 to 8.Y.2.1.5 give possible sources of zinc to be reviewed and list some specific control measures to be considered for implementation (or their equivalents). Following are some general control measure options to consider: using chemicals purchased in pre-weighed, sealed polyethylene bags; storing in-use materials in sealable containers, ensuring an airspace between the container and the cover to minimize “puffing” losses when the container is opened, and using automatic dispensing and weighing equipment.

8.Y.2.1.1 *Zinc Bags.* Ensure proper handling and storage of zinc bags at your facility. Following are some control measure options: employee training on the handling and storage of zinc bags, indoor storage of zinc bags, cleanup of zinc spills without washing the zinc into the storm drain, and the use of 2,500-pound sacks of zinc rather than 50- to 100-pound sacks.

8.Y.2.1.2 *Dumpsters.* Minimize discharges of zinc from dumpsters. Following are some control measure options: covering the dumpster, moving the dumpster indoors, or providing a lining for the dumpster.

8.Y.2.1.3 *Dust Collectors and Baghouses.* Minimize contributions of zinc to stormwater from dust collectors and baghouses. Replace or repair, as appropriate, improperly operating dust collectors and baghouses.

8.Y.2.1.4 *Grinding Operations.* Minimize contamination of stormwater as a result of dust generation from rubber grinding operations. One control measure option is to install a dust collection system.

8.Y.2.1.5 *Zinc Stearate Coating Operations.* Minimize the potential for stormwater contamination from drips and spills of zinc stearate slurry that may be released

to the storm drain. One control measure option is to use alternative compounds to zinc stearate.

8.Y.2.2 *Controls for Plastic Products Manufacturers.* Minimize the discharge of plastic resin pellets in your stormwater discharges. Control measures to be considered for implementation (or their equivalents) include minimizing spills, cleaning up of spills promptly and thoroughly, sweeping thoroughly, pellet capturing, employee education, and disposal precautions.

8.Y.3 Additional SWPPP Requirements.

8.Y.3.1 *Potential Pollutant Sources for Rubber Manufacturers.* (See also Part 5.1.3) Document in your SWPPP the use of zinc at your facility and the possible pathways through which zinc may be discharged in stormwater runoff.

8.Y.4 Sector-Specific Benchmarks. (See also Part 6 of the permit.)

Subsector (You may be subject to requirements for more than one sector/subsector)	Parameter	Benchmark Monitoring Concentration
Subsector Y1. Rubber Products Manufacturing (SIC 3011, 3021, 3052, 3053, 3061, 3069)	Total Zinc ¹	Hardness Dependent

¹ The benchmark values of some metals are dependent on water hardness. For these parameters, permittees must determine the hardness of the receiving water (see Appendix J, "Calculating Hardness in Receiving Waters for Hardness Dependent Metals," for methodology), in accordance with Part 6.2.1.1, to identify the applicable 'hardness range' for determining their benchmark value applicable to their facility. The ranges occur in 25 mg/L increments. Hardness Dependent Benchmarks follow in the table below:

Water Hardness Range	Zinc (mg/L)
0-25 mg/L	0.04
25-50 mg/L	0.05
50-75 mg/L	0.08
75-100 mg/L	0.11
100-125 mg/L	0.13
125-150 mg/L	0.16
150-175 mg/L	0.18
175-200 mg/L	0.20
200-225 mg/L	0.23
225-250 mg/L	0.25
250+ mg/L	0.26

Part 8 – Sector-Specific Requirements for Industrial Activity

Subpart Z – Sector Z – Leather Tanning and Finishing.

You must comply with Part 8 sector-specific requirements associated with your primary industrial activity and any co-located industrial activities, as defined in Appendix A. The sector-specific requirements apply to those areas of your facility where those sector-specific activities occur. These sector-specific requirements are in addition to any requirements specified elsewhere in this permit.

8.Z.1 Covered Stormwater Discharges.

The requirements in Subpart Z apply to stormwater discharges associated with industrial activity from Leather Tanning and Finishing facilities as identified by the SIC Code specified under Sector Z in Table D-1 of Appendix D of the permit.

8.Z.2 Additional Technology-Based Effluent Limits.

8.Z.2.3 *Good Housekeeping Measures.* (See also Part 2.1.2.2)

8.Z.2.3.1 *Storage Areas for Raw, Semiprocessed, or Finished Tannery By-products.*

Minimize contamination of stormwater runoff from pallets and bales of raw, semiprocessed, or finished tannery by-products (e.g., splits, trimmings, shavings). Consider indoor storage or protection with polyethylene wrapping, tarpaulins, roofed storage, etc. Consider placing materials on an impermeable surface and enclosing or putting berms (or equivalent measures) around the area to prevent stormwater run-on and runoff.

8.Z.2.3.2 *Material Storage Areas.* Label storage containers of all materials (e.g., specific chemicals, hazardous materials, spent solvents, waste materials) minimize contact of such materials with stormwater.

8.Z.2.3.3 *Buffing and Shaving Areas.* Minimize contamination of stormwater runoff with leather dust from buffing and shaving areas. Consider dust collection enclosures, preventive inspection and maintenance programs, or other appropriate preventive measures.

8.Z.2.3.4 *Receiving, Unloading, and Storage Areas.* Minimize contamination of stormwater runoff from receiving, unloading, and storage areas. If these areas are exposed, consider the following (or their equivalents): covering all hides and chemical supplies, diverting drainage to the process sewer, or grade berming or curbing the area to prevent stormwater runoff.

8.Z.2.3.5 *Outdoor Storage of Contaminated Equipment.* Minimize contact of stormwater with contaminated equipment. Consider the following (or their equivalents): covering equipment, diverting drainage to the process sewer, and cleaning thoroughly prior to storage.

8.Z.2.3.6 *Waste Management.* Minimize contamination of stormwater runoff from waste storage areas. Consider the following (or their equivalents): covering

dumpsters, moving waste management activities indoors, covering waste piles with temporary covering material such as tarpaulins or polyethylene, and minimizing stormwater runoff by enclosing the area or building berms around the area.

8.Z.3 Additional SWPPP Requirements.

8.Z.3.1 *Drainage Area Site Map.* (See also Part 5.1.2) Identify in your SWPPP where any of the following may be exposed to precipitation or surface runoff: processing and storage areas of the beamhouse, tanyard, and re-tan wet finishing and dry finishing operations.

8.Z.3.2 *Potential Pollutant Sources.* (See also Part 5.1.3) Document in your SWPPP the following sources and activities that have potential pollutants associated with them (as appropriate): temporary or permanent storage of fresh and brine-cured hides; extraneous hide substances and hair; leather dust, scraps, trimmings, and shavings.

Part 8 – Sector-Specific Requirements for Industrial Activity

Subpart AA – Sector AA – Fabricated Metal Products

You must comply with Part 8 sector-specific requirements associated with your primary industrial activity and any co-located industrial activities, as defined in Appendix A. The sector-specific requirements apply to those areas of your facility where those sector-specific activities occur. These sector-specific requirements are in addition to any requirements specified elsewhere in this permit.

8.AA.1 Covered Stormwater Discharges.

The requirements in Subpart AA apply to stormwater discharges associated with industrial activity from Fabricated Metal Products facilities as identified by the SIC Codes specified under Sector AA in Table D-1 of Appendix D of the permit.

8.AA.2 Additional Technology-Based Effluent Limits.

8.AA.2.1 *Good Housekeeping Measures.* (See also Part 2.1.2.2)

8.AA.2.1.1 *Raw Steel Handling Storage.* Minimize the generation of and/or recover and properly manage scrap metals, fines, and iron dust. Include measures for containing materials within storage handling areas.

8.AA.2.1.2 *Paints and Painting Equipment.* Minimize exposure of paint and painting equipment to stormwater.

8.AA.2.2 *Spill Prevention and Response Procedures.* (See also Part 2.1.2.4) Ensure that the necessary equipment to implement a cleanup is available to personnel. The following areas should be addressed

8.AA.2.2.1 *Metal Fabricating Areas.* Maintain clean, dry, orderly conditions in these areas. Consider using dry clean-up techniques.

8.AA.2.2.2 *Storage Areas for Raw Metal.* Keep these areas free of conditions that could cause, or impede appropriate and timely response to, spills or leakage of materials. Consider the following (or their equivalents): maintaining storage areas so that there is easy access in the event of a spill, and labeling stored materials to aid in identifying spill contents.

8.AA.2.2.3 *Metal Working Fluid Storage Areas.* Minimize the potential for stormwater contamination from storage areas for metal working fluids.

8.AA.2.2.4 *Cleaners and Rinse Water.* Control and clean up spills of solvents and other liquid cleaners, control sand buildup and disbursement from sand-blasting operations, and prevent exposure of recyclable wastes. Substitute environmentally benign cleaners when possible.

8.AA.2.2.5 *Lubricating Oil and Hydraulic Fluid Operations.* Minimize the potential for stormwater contamination from lubricating oil and hydraulic fluid operations. Consider using monitoring equipment or other devices to detect and control

leaks and overflows. Consider installing perimeter controls such as dikes, curbs, grass filter strips, or equivalent measures.

8.AA.2.2.6 *Chemical Storage Areas*. Minimize stormwater contamination and accidental spillage in chemical storage areas. Include a program to inspect containers and identify proper disposal methods.

8.AA.2.3 *Spills and Leaks*. (See also Part 5.1.3.3) In your spill prevention and response procedures, required by Part 2.1.2.4, pay attention to the following materials (at a minimum): chromium, toluene, pickle liquor, sulfuric acid, zinc and other water priority chemicals, and hazardous chemicals and wastes.

8.AA.3 Additional SWPPP Requirements.

8.AA.3.1 *Drainage Area Site Map*. (See also Part 5.1.2) Document in your SWPPP where any of the following may be exposed to precipitation or surface runoff: raw metal storage areas; finished metal storage areas; scrap disposal collection sites; equipment storage areas; retention and detention basins; temporary and permanent diversion dikes or berms; right-of-way or perimeter diversion devices; sediment traps and barriers; processing areas, including outside painting areas; wood preparation; recycling; and raw material storage.

8.AA.3.2 *Potential Pollutant Sources*. (See also Part 5.1.3) Document in your SWPPP the following additional sources and activities that have potential pollutants associated with them: loading and unloading operations for paints, chemicals, and raw materials; outdoor storage activities for raw materials, paints, empty containers, corn cobs, chemicals, and scrap metals; outdoor manufacturing or processing activities such as grinding, cutting, degreasing, buffing, and brazing; onsite waste disposal practices for spent solvents, sludge, pickling baths, shavings, ingot pieces, and refuse and waste piles.

8.AA.4 Additional Inspection Requirements

8.AA.4.1 *Inspections*. (See also Part 4) At a minimum, include the following areas in all inspections: raw metal storage areas, finished product storage areas, material and chemical storage areas, recycling areas, loading and unloading areas, equipment storage areas, paint areas, and vehicle fueling and maintenance areas.

8.AA.4.2 *Comprehensive Site Inspections*. (See also Part 4.3) As part of your inspection, also inspect areas associated with the storage of raw metals, spent solvents and chemicals storage areas, outdoor paint areas, and drainage from roof. Potential pollutants include chromium, zinc, lubricating oil, solvents, aluminum, oil and grease, methyl ethyl ketone, steel, and related materials.

8.AA.5 Sector-Specific Benchmarks. (See also Part 6 of the permit.)

Subsector (You may be subject to requirements for more than one sector/subsector)	Parameter	Benchmark Monitoring Concentration
Subsector AA1. Fabricated Metal Products, except Coating (SIC 3411-3499; 3911-3915)	Total Aluminum	0.75 mg/L
	Total Iron	1.0 mg/L
	Total Zinc ¹	Hardness Dependent
	Nitrate plus Nitrite Nitrogen	0.68 mg/L
Subsector AA2. Fabricated Metal Coating and Engraving (SIC 3479)	Total Zinc ¹	Hardness Dependent
	Nitrate plus Nitrite Nitrogen	0.68 mg/L

¹ The benchmark values of some metals are dependent on water hardness. For these parameters, permittees must determine the hardness of the receiving water (see Appendix J, "Calculating Hardness in Receiving Waters for Hardness Dependent Metals," for methodology), in accordance with Part 6.2.1.1, to identify the applicable 'hardness range' for determining their benchmark value applicable to their facility. The ranges occur in 25 mg/L increments. Hardness Dependent Benchmarks follow in the table below:

Water Hardness Range	Zinc (mg/L)
0-25 mg/L	0.04
25-50 mg/L	0.05
50-75 mg/L	0.08
75-100 mg/L	0.11
100-125 mg/L	0.13
125-150 mg/L	0.16
150-175 mg/L	0.18
175-200 mg/L	0.20
200-225 mg/L	0.23
225-250 mg/L	0.25
250+ mg/L	0.26

Part 8 – Sector-Specific Requirements for Industrial Activity**Subpart AB – Sector AB – Transportation Equipment, Industrial or Commercial Machinery Facilities.**

You must comply with Part 8 sector-specific requirements associated with your primary industrial activity and any co-located industrial activities, as defined in Appendix A. The sector-specific requirements apply to those areas of your facility where those sector-specific activities occur. These sector-specific requirements are in addition to any requirements specified elsewhere in this permit.

8.AB.1 Covered Stormwater Discharges.

The requirements in Subpart AB apply to stormwater discharges associated with industrial activity from Transportation Equipment, Industrial or Commercial Machinery facilities as identified by the SIC Codes specified under Sector AB in Table D-1 of Appendix D of the permit.

8.AB.2 Additional SWPPP Requirements.

8.AB.2.1 *Drainage Area Site Map.* (See also Part 5.1.2) Identify in your SWPPP where any of the following may be exposed to precipitation or surface runoff: vents and stacks from metal processing and similar operations.

Part 8 – Sector-Specific Requirements for Industrial Activity

Subpart AC– Sector AC –Electronic and Electrical Equipment and Components, Photographic and Optical Goods.

You must comply with Part 8 sector-specific requirements associated with your primary industrial activity and any co-located industrial activities, as defined in Appendix A. The sector-specific requirements apply to those areas of your facility where those sector-specific activities occur. These sector-specific requirements are in addition to any requirements specified elsewhere in this permit.

8.AC.1 Covered Stormwater Discharges.

The requirements in Subpart AC apply to stormwater discharges associated with industrial activity from facilities that manufacture Electronic and Electrical Equipment and Components, Photographic and Optical goods as identified by the SIC Codes specified in Table D-1 of Appendix D of the permit.

8.AC.2 Additional Requirements.

No additional sector-specific requirements apply.

Part 8 – Sector-Specific Requirements for Industrial Activity

Subpart AD – Sector AD – Stormwater Discharges Designated by the Director as Requiring Permits.

You must comply with Part 8 sector-specific requirements associated with your primary industrial activity and any co-located industrial activities, as defined in Appendix A. The sector-specific requirements apply to those areas of your facility where those sector-specific activities occur. These sector-specific requirements are in addition to any requirements specified elsewhere in this permit.

8.AD.1 Covered Stormwater Discharges.

Sector AD is used to provide permit coverage for facilities designated by the Director as needing a stormwater permit, and any discharges of stormwater associated with industrial activity that do not meet the description of an industrial activity covered by Sectors A-AC.

8.AD.1.1 *Eligibility for Permit Coverage.* Because this sector is primarily intended for use by discharges designated by the Director as needing a stormwater permit (which is an atypical circumstance), and your facility may or may not normally be discharging stormwater associated with industrial activity, you must obtain the Director's written permission to use this permit prior to submitting an NOI. If you are authorized to use this permit, you will still be required to ensure that your discharges meet the basic eligibility provisions of this permit at Part 1.2.

8.AD.2 Sector-Specific Benchmarks and Effluent Limits. (See also Part 6 of the permit.)

The Director will establish any additional monitoring and reporting requirements for your facility prior to authorizing you to be covered by this permit. Additional monitoring requirements would be based on the nature of activities at your facility and your stormwater discharges.

9. Permit Conditions Applicable to Specific States, Indian Country Lands, or Territories

9.1 Region 1

9.1.1 CTR05000I: Indian Country lands within the State of Connecticut

No additional requirements.

9.1.2 MAR050000: Commonwealth of Massachusetts, except Indian Country lands.

Permittees in Massachusetts must also meet the following conditions.

9.1.2.1 Additional Section 401(a) conditions required by the Commonwealth of Massachusetts. Discharges covered by the general permit must comply with the provisions of 314 CMR 3.00; 314 CMR 4.00; 314 CMR 9.00; and 314 CMR 10.00 and any other related policies adopted under the authority of the Massachusetts Clean Waters Act, MGL c.21, ss. 26-53 and Wetlands Protection Act, MGL s. 40.

New facilities or redevelopment of existing facilities subject to this permit must comply with applicable stormwater performance standards prescribed by state regulation or policy. A permit under 314 CMR 3.04 is not required for existing facilities which meet state stormwater performance standards. An application for a permit under 314 CMR 3.00 is required only when required under 314 CMR 3.04(2)(b) {designation of a discharge on a case-by-case basis} or is otherwise identified in 314 CMR 3.00 or any Department policy as a discharge requiring a permit application. Department regulations and policies may be obtained through the State House Bookstore or online at www.mass.gov/dep.

9.1.2.2 SWPPP Availability. The Department may request a copy of the Stormwater Pollution Prevention Plan (SWPPP) and the permittee is required to submit the SWPPP to the Department within 14 days of such a request.

9.1.2.3 Authorization to Inspect. The Department may conduct an inspection of any facility covered by this permit to ensure compliance with state law requirements, including state water quality standards. The Department may enforce its certification conditions.

9.1.2.4 Submission of Monitoring Data. The results of any monitoring required by this permit must be sent to the appropriate Regional Office of the Department [attention: Bureau of Waste Prevention] where the monitoring identifies exceedances of any effluent limits or benchmarks for any parameter for which

monitoring is required under this permit. In addition, any follow-up monitoring and a description of the corrective actions required and undertaken to meet the effluent limits or benchmarks must be sent to the appropriate Department Regional Office.

9.1.2.5 Sector-Specific Requirements. The Massachusetts Coastal Zone Management Program submitted the following conditions to be added to the permit in order to meet the Programs Consistency Review and which will be included in the requirements of this Water Quality Certification:

- In Sector Q [Water Transportation] add copper and tributyltin to the required monitoring parameters.
- In Sector R [Ship and Boat Building and Repair Yards] add aluminum, iron, lead, copper and tributyltin to the list of required monitoring parameters
- For both Sector Q and R, the benchmark for tributyltin should be 0.42 ug/l, the acute saltwater criteria; report any exceedances of that value.
- Modify the monitoring requirements [Part 6.2.1.2 of the permit] such that all four of the quarterly monitoring samples must meet the benchmarks rather than the average of the four before no further monitoring is required.

9.1.3 MAR05000I: Indian Country lands within the Commonwealth of Massachusetts.

No additional requirements.

9.1.5 NHR050000: State of New Hampshire.

Permittees in New Hampshire must also meet the following conditions:

9.1.5.1 On-site Infiltration of Stormwater. In Part 2.1.1 (Control Measure Selection and Design Considerations), you are required to consider opportunities for infiltrating runoff onsite. This is encouraged, but it should only be done if consistent with the statutes and rules of the Department of Environmental Services written to protect groundwater. Infiltration BMPs are not recommended at industrial sites except in areas where industrial activities do not occur, such as at office buildings and their associated parking facilities, or in drainage areas at the facility where a certification of no exposure will always be possible [see 40 CFR 122.26(g)]. Other justifiable reasons for not using on-site infiltration BMPs include the following:

- The facility is located in a wellhead protection area as defined in RSA 485-C:2; or
- The facility is located in an area where groundwater has been reclassified to GAA, GAI or GA2 pursuant to RSA 485-C and Env-Ws 420; or

- Any areas that would be exempt from the groundwater recharge requirements contained in Env-Ws 415.41, including all land uses or activities considered to be a "High-load site."

9.1.5.2 Maintenance of infiltration best management practices. In addition to the requirements in Part 5, the SWPPP must contain the following:

- A description of and the location of each on-site infiltration BMP installed;
- The maintenance procedures that will be followed to ensure proper operation, including the removal of sediment from pretreatment devices;
- The inspection procedures that will be followed at least annually. These should include the procedures for ensuring that the stormwater being infiltrated is not exposed to industrial pollutants and the procedures for ensuring proper drainage to prevent mosquito breeding;
- The employee name (or title of the position) who is a member of the stormwater pollution prevention team (see Part 5.1.1) who will be responsible for the maintenance required in this section, the inspections required in this section, and any necessary corrective actions required in Part 3; and
- Records for all maintenance performed, inspections conducted, and corrective actions taken.

9.1.5.3 Discontinue, Permit or Register On-site Infiltration BMP if Necessary. If at any time a certification of no exposure can no longer be made for any of the stormwater to be infiltrated, then the infiltration BMP must cease for that portion of the runoff or the discharge must be permitted or registered as appropriate. The following may be required:

- Infiltration BMP that meet the definition of a Class V well or that infiltrates stormwater via a subsurface structure (i.e. concrete chambers, dry well, leach field, etc.) will need an underground injection control (UIC) registration from NHDES; and
- Permitting as a groundwater discharge as required in Env-Ws 1500, if the stormwater will or may contain regulated contaminants.

The SWPPP must be modified immediately if new infiltration BMPs are proposed or if existing infiltration BMPs will cease.

9.1.5.4 Required NHDES notification.

- Notify the NHDES Groundwater Discharge Permit Coordinator immediately if you believe that any infiltration BMP may need to be permitted or registered (See Part 9.1.5.3) during the permit term.
- Notify the NHDES Wastewater Engineering Bureau immediately of any plans to discharge any new non-stormwater discharges during the permit term. This does not include the allowable non-stormwater discharges listed in Part 1.1.3.

9.1.5.5 Information that may be requested by NHDES. To ensure compliance with RSA 485-C, RSA 485-A, RSA 485-A:13, I(a), Env-Wq 400 and Env-Ws 401 the following information may be requested by NHDES. This information must be kept on site unless you receive a written request from NHDES that it be sent to the address shown in Part 9.1.5.6.

- A site map required in Part 5.1.2, showing the type and location of all on-site infiltration BMPs utilized at the facility or the reason(s) why none were installed.
- A list of all non-stormwater discharges that occur at the facility, including their source locations and the control measures being used (See Sections 1.1.3 and 5.1.3.4).
- A copy of the Annual Reports required in Part 7.2.

9.1.5.6 Where to Submit Information. All required or requested documents must be sent to: NH Department of Environmental Services, Wastewater Engineering Bureau, Permits & Compliance Section, P.O. Box 95, Concord, NH 03302-0095.

9.1.5.7 Modification of Clean Water Act Section 401 Water Quality Certification.

When NHDES determines that additional water quality certification requirements are necessary to protect water quality, it may require individual dischargers to meet additional conditions to obtain or continue coverage under the MSGP. Any such conditions must be supplied to the permittee in writing. Any required pollutant loading analyses and any designs for structural best management practices necessary to protect water quality must be prepared by a civil or sanitary engineer registered in New Hampshire.

9.1.6 RIR05000I: Indian Country lands within the State of Rhode Island.

No additional requirements.

9.1.7 VTR05000F: Federal Facilities in the State of Vermont.

No additional requirement.

9.2 Region 2

9.2.1 PPR050000: Commonwealth of Puerto Rico

No additional requirements.

9.3 Region 3

9.3.1 DCR050000: The District of Columbia

Permittees in the District of Columbia must also meet the following conditions:

9.3.1.1 Compliance with District of Columbia Laws and Regulations. Discharges covered by the MSGP must comply with the District of Columbia Water Pollution Control Act, (D.C. Code § 8-103.01 *et seq.*) and its implementing regulations in Title 21, Chapters 11 and 19 of the District of Columbia Municipal Regulations. Nothing in this permit will be construed to preclude the institution of any legal action or relieve the permittee from any responsibilities, liabilities, or penalties established pursuant to District of Columbia laws and regulations.

9.3.1.2 Submission of SWPPP. The Stormwater Pollution Prevention Plan (SWPPP) shall be submitted to the District Department of the Environment (Department) at the same time the NOI is submitted to EPA, to ensure compliance with District of Columbia laws and regulations.

9.3.1.3 Submission of No Exposure Certification and NOT. Copies of the No Exposure Certification and Notice of Termination (NOT) shall be submitted to the Department at the same time it is submitted to EPA.

9.3.1.4 Authorization to Inspect. The permittee shall allow the Department to inspect any facilities, equipment, practices, or operations regulated or required under this permit and to access records maintained under the conditions of this permit.

9.3.1.5 Submission of Reports. Signed copies of all reports required under this permit including the reporting requirements of Appendix B.12 shall be submitted to the Department at the same time it is submitted to EPA.

9.3.1.6 Where to Submit Information. All required or requested documents shall be sent to the: District Department of the Environment, Natural Resources Administration, 51 N Street, NE, 5th Floor, Washington, D.C. 20002, Attention: Associate Director, Water Quality Division.

9.3.2 DER05000F: Federal Facilities within the State of Delaware.

No additional requirements.

9.4 Region 4

Permit coverage not available.

9.5 Region 5

9.5.1 MIR05000I: Indian Country Lands within the State of Michigan

No additional requirements.

9.5.2 MNR05000I: Indian Country Lands within the State of Minnesota

9.5.2.1 Fond du Lac Reservation

The following conditions apply only to discharges on the Fond du Lac Reservation.

- 9.5.2.1.1 *Submission of NOI and NOT.*** Copies of the Notice of Intent (NOI) and Notice of Termination (NOT) shall be submitted to the Office of Water Protection at the same time it is submitted to EPA.
- 9.5.2.1.2 *Submission of SWPPP.*** A copy of the Stormwater Pollution Plan (SWPPP) shall be submitted to the Office of Water Protection at least thirty (30) days in advance of submitting the NOI to EPA.
- 9.5.2.1.3 *Benchmark Monitoring for TSS.*** Benchmark Monitoring Concentration (BMC) for Total Suspended Solids (TSS) shall be 10 mg/L for Sector A (Timber Products), Sector J (Mineral Mining and Dressing), and Sector M (Automobile Salvage Yards) that conduct Industrial Activities on the Fond du Lac Reservation.
- 9.5.2.1.4 *Benchmark Monitoring for Nitrate plus Nitrite Nitrogen.*** Benchmark Monitoring Concentration (BMC) for Nitrate plus Nitrite Nitrogen shall be 0.12mg/L for Sector J (Mineral Mining and Dressing) that conduct Industrial Activities on the Fond du Lac Reservation.
- 9.5.2.1.5 *Submission of Monitoring Reports.*** Copies of all Monitoring Reports required by this permit shall be submitted to the Office of Water Protection.
- 9.5.2.1.6 *Where to Submit Information.*** All required or requested documents shall be sent to the: Fond du Lac Reservation Office of Water Protection (OWP) at Fond du Lac Reservation, Office of Water Protection, 1720 Big Lake Road, Cloquet, Minnesota 55720.

9.5.2.2 Grand Portage Reservation

The following conditions apply only to discharges on the Grand Portage Reservation.

- 9.5.2.2.1 *Compliance with Grand Portage Reservation Laws and Regulations.*** All industrial stormwater discharges authorized by this permit must comply with the Grand Portage Water Quality Standards, Applicable Federal Standards, and the Grand Portage Water Resources Ordinance, as amended, (“Water Resources Ordinance”).
- 9.5.2.2.2 *Additional Monitoring Required by Grand Portage Reservation.*** The Board must be contacted, at the address in Part 9.5.2.2.10, at the onset of writing the

Stormwater Pollution Prevention Plan (SWPPP). Grand Portage may require monitoring of stormwater discharges as determined on a case-by-case basis. If the Board determines that a monitoring plan is necessary, the monitoring plan must be prepared and incorporated in the SWPPP before the Notice of Intent (NOI) is submitted to EPA.

- 9.5.2.2.3 *Submission of SWPPP and NOI.*** A copy of the SWPPP and NOI must be submitted to the Board for review and approval at least 30 days before submitting the NOI to EPA.
- 9.5.2.2.4 *Submission of NOT.*** A copy of the Notice of Termination (NOT) must be submitted to the Board at the address in Part 9.5.3.10 at the same time it is submitted to EPA.
- 9.5.2.2.5 *Additional Information.*** If requested by the Grand Portage Environmental Department, the permittee is required to provide additional information necessary for a case-by-case eligibility determination to assure compliance with the Grand Portage Water Quality Standards and any Applicable Federal Standards.
- 9.5.2.2.6 *Submission of Monitoring Data.*** All analytical data (e.g., Discharge Monitoring Reports, etc.) must be submitted to the Board at the same time it is submitted to EPA.
- 9.5.2.2.7 *Water Quality Standards.*** Discharges that the Board has determined to be or may reasonably be expected to be contributing to a violation of Grand Portage Water Quality Standards or Applicable Federal Standards are not authorized by this permit. Upon receipt of this determination EPA will notify the permittee to either improve their SWPPP to comply with Grand Portage Water Standards or apply for and obtain an individual NPDES permit for these discharges.
- 9.5.2.2.8 *Appeals.*** Appeals related to Tribal decisions actions, or enforcement taken pursuant to any of the preceding conditions will be heard by the Grand Portage Tribal Court.
- 9.5.2.2.9 *Definitions.*** The definitions set forth in the Grand Portage Water Resources Ordinance, as amended, govern these certification conditions.
- 9.5.2.2.10 *Where to Submit Information.*** All required or requested documents shall be sent to the: Grand Portage Environmental Resources Board, P.O. Box 428, Grand Portage, MN 55605.
- 9.5.3 WIR05000I: Indian Country lands within the State of Wisconsin, except those on Sokaogon Chippewa Community lands**

No additional requirements.

Note: Facilities in the Sokaogon Chippewa Community are not eligible for stormwater discharge coverage under this permit. Contact the EPA Region 5 office for an individual permit application.

9.6 Region 6

9.6.1 LAR05000I: Indian Country Lands within the State of Louisiana

No additional requirements.

9.6.2 The State of New Mexico, except Indian Country lands.

Permittees in New Mexico must also meet the following conditions:

9.6.2.1 Certification Requirements. Operators are not eligible to obtain authorization under this permit for all new and existing stormwater discharges to outstanding national resource waters (ONRWs) (also referred to as “Tier 3” waters.) As of 2/16/06, the following ONRWs have been designated by the SWQB in New Mexico (see Subsection D of 20.6.4.9 NMAC). (1) Rio Santa Barbara, including the west, middle and east forks from their headwaters downstream to the boundary of the Pecos Wilderness; and (2) the water within the US forest service Valle Vidal special management unit including: (a) Rio Costilla, including Comanche, La Cueva, Fernandez, Chuckwagon, Little Costilla, Holman, Gold, Grassy, LaBelle, and Vidal creeks, from their headwaters downstream to the boundary of the US forest service Valle Vidal special management unit. (b) Middle Ponil creek, including the waters of Greenwood Canyon, from their headwaters downstream to the boundary of the Elliott S. Barker wildlife management area; (c) Shuree lakes; (d) North Ponil creek, including McCrystal and Seally Canyon creeks, from their headwaters downstream to the boundary of the US forest service Valle Vidal special management unit; and (e) Leandro creek from its headwaters downstream to the boundary of the US forest service Valle Vidal.

9.6.3 Indian Country lands within the State of New Mexico, except Ute Mountain Reservations Lands (see Region 8) and Navajo Reservation Lands (see Region 9).

9.6.3.1 Pueblo of Acoma.

The following condition applies only to discharges on the Pueblo of Acoma:

9.6.3.1.1 Submission of NOI and NOT. The Pueblo will require the owner/operator of each facility on or bordering the Pueblo of Acoma to submit copies of its

Notice of Intent (NOI) and Notice of Termination (NOT) to the Haaku Water Office (HWO) Director at the same time it is submitted to EPA.

- 9.6.3.1.2 SWPPP Availability.** The HWO may request a copy of the Stormwater Pollution Prevention Plan (SWPPP) and the permittee is required to submit the SWPPP to the HWO upon such request.
- 9.6.3.1.3 Submission of Monitoring Data.** All analytical data shall also be provided to the HWO at the same time it is submitted to EPA.
- 9.6.3.1.4 Where to Submit Information.** All required or requested documents shall be sent to: HWO Director, Haaku Water Office, P.O. Box 309, Pueblo of Acoma, NM 87034.

9.6.3.2 Pueblo of Isleta.

The following conditions apply only to discharges on the Pueblo of Isleta:

- 9.6.3.2.1 Submission of SWPPP.** The Stormwater Pollution Prevention Plan (SWPPP) must be submitted to the Pueblo of Isleta prior to submitting the Notice of Intent (NOI) to EPA.
- 9.6.3.2.2 SWPPP Modification.** Any update or amendment of the SWPPP shall be submitted to the Pueblo of Isleta within 5 calendar days of its finalization.
- 9.6.3.2.3 Submission of Monitoring Data.** All monitoring data and reports shall be submitted to the Pueblo of Isleta at the same time they are submitted to EPA.
- 9.6.3.2.4 Submission of Inspection Reports.** All inspection reports, including the Compliance Evaluation Report, shall be submitted to the Pueblo of Isleta within 5 calendar days of their finalization.
- 9.6.3.2.6 Additional Reporting.** Any spill or leak directly to waters designated by the Pueblo of Isleta as 'Primary Contact Recreation' and/or 'Primary Contact Ceremonial' shall be considered significant if it contains toxic or hazardous pollutants, oil or petroleum products. The Pueblo of Isleta shall be notified of any spill containing toxic or hazardous pollutants and of any spill of oil or petroleum product within 8-hours of spill detection.
- 9.6.3.2.7 Benchmark Monitoring.** Following 4 quarters of benchmark monitoring, if the maximum value of the 4 monitoring values does not exceed the benchmark, you have fulfilled your monitoring requirements for that parameter for the permit term. If any of the 4 monitoring values exceeds the benchmark, quarterly monitoring shall continue until no exceedances of the benchmark are detected in four consecutive quarters. Following this determination, you may reduce monitoring for that pollutant to once per year

for the duration of the permit period unless an exceedance is again detected at which time quarterly sampling will again be required.

9.6.3.2.8 Corrective Action. You must take corrective action following any benchmark exceedance if you determine as a result of reviewing your SWPPP that your SWPPP does not meet the requirements of Part 5 of this permit.

9.6.3.2.9 Conditions applicable only to Sector G, Metal Mining. (See Part G.4.2.1. Inspection Frequency). Inspections must be conducted at least once every 7 calendar days or at least once every 14 calendar days and within 24 hours of the end of a storm event of 0.25 inches or greater. Inspection frequency may be reduced to at least once every month if the entire site is temporarily stabilized, if runoff is unlikely due to winter conditions (e.g., site is covered with snow, ice, or the ground is frozen), or construction is occurring during seasonal arid periods in arid areas and semi-arid areas.

9.6.3.2.10 Where to Submit Information. All required or requested documents shall be sent to: Director, Environment Department, Pueblo of Isleta, P.O. Box 1270, Isleta, NM 87022.

9.6.3.3 Pueblo of Nambe.

The following conditions apply only to discharges on the Pueblo of Nambe:

9.6.3.3.1 Submission of NOI and NOT. Copies of the Notice of Intent (NOI) and Notice of Termination (NOT) shall be submitted to the Pueblo of Nambe at the same time it is submitted to EPA.

9.6.3.3.2 SWPPP Availability. A copy of the Stormwater Pollution Prevention Plan (SWPPP) must also be submitted to the Pueblo of Nambe, if requested, at the same time the NOI is submitted to EPA.

9.6.3.3.3 Submission of Reports. All analytical data and a copy of all written reports shall be provided to the Pueblo of Nambe at the same time they are provided to the EPA, if requested by the Pueblo of Nambe.

9.6.3.3.4 Where to Submit Information. All required or requested documents shall be sent to: Alan G Hook, Manager, Pueblo of Nambe, Department of Environment and Natural Resources (DENR), Rt. 1 Box 117-BB, Sante Fe, NM 87506.

9.6.3.4 Pueblo of Pojoaque.

The following conditions apply only to discharges on the Pueblo of Pojoaque:

- 9.6.3.4.1 Submission of NOI and NOT.** Copies of the Notice of Intent (NOI) and Notice of Termination (NOT) shall be provided at the same time it is provided to EPA.
- 9.6.3.4.2 SWPPP Availability.** The Pueblo may request a copy of the Stormwater Pollution Prevention Plan (SWPPP) and the permittee is required to submit the SWPPP to the Pueblo upon such request.
- 9.6.3.4.3 Submission of Monitoring Data.** All analytical data (e.g., Discharge Monitoring Reports, etc) shall be submitted to the Pueblo at the same time it is submitted to EPA.
- 9.6.3.4.4 Where to Submit Information.** All required or requested documents shall be sent to: Luke Mario Duran, Director, Environment Department, 5 West Gutierrez, Suite 2B, Sante Fe, NM 87506.

9.6.3.5 Ohkay Owingeh - (formerly known as San Juan Pueblo).

The following condition applies only to discharges on Ohkay Owingeh (formerly known as San Juan Pueblo):

- 9.6.3.5.1 Submission of NOI and NOT.** Copies of the Notice of Intent (NOI) and Notice of Termination (NOT) shall be submitted to Ohkay Owingeh at the same time it is submitted to EPA.
- 9.6.3.5.2 Submission of Monitoring Data and Additional Reporting.** Copies of monitoring data or other documents required under the permit must also be submitted to Ohkay Owingeh upon request.
- 9.6.3.5.3 Where to Submit Information.** All required or requested documents shall be sent to the: Ohkay Owingeh, Office of Environmental Affairs, P.O. Box 1099, San Juan Pueblo, NM 87566.

9.6.3.6 Pueblo of Sandia.

The following conditions apply only to discharges on the Pueblo of Sandia:

- 9.6.3.6.1 Submission of NOI.** A copy of the Notice of Intent (NOI) must be submitted to the Environment Director at the same time it is submitted to EPA.
- 9.6.3.6.2 Submission of NOT.** A copy of the Notice of Termination (NOT) must be submitted to the Environment Director at the same time it is submitted to EPA. The Pueblo of Sandia must verify termination of activities prior to EPA's termination of the permit.

- 9.6.3.6.3 SWPPP Availability.** The Stormwater Pollution Prevention Plan (SWPPP) must be made available to Pueblo of Sandia Environment Department personnel upon request.
- 9.6.3.6.4 Submission of Monitoring Data.** All analytical data (e.g., Discharge Monitoring Reports, follow-up monitoring reports, Exceedance reports, etc) shall be submitted to the Environment Director at the same time it is submitted to EPA.
- 9.6.3.6.5 Submission of Quarterly Visual Assessments.** Copies of all "Quarterly Visual Assessments" (Part 4.2) must be submitted to the Environment Director within 7 days of completion.
- 9.6.3.6.6 Submission of Comprehensive Site Inspection Reports.** Copies of all "Comprehensive Site Inspection Reports" (Part 4.3) must be submitted to the Environment Director within 10 days of completion.
- 9.6.3.6.7 Additional Reporting.** Any notice of release of oils or hazardous substances shall be provided to the Environment Director within twenty-four (24) hours of becoming aware of the circumstance, followed by the reporting requirements of 40 CFR 110, 40 CFR 302, and 40 CFR 302 relating to spills or other releases of oil or hazardous substances.

The permittee must also telephone the Pueblo of Sandia Environment Department at (505) 867-4533 of any spills or unauthorized discharges that may affect drinking water supplies, ceremonial and recreational surface waters, elicit fish kills, harm wildlife or endangered species or endanger human health or the environment within ten (10) hours of becoming aware of the circumstance, followed by the written report when it is sent to the EPA.

- 9.6.3.6.8 Water Quality Standards.** If requested by the Pueblo of Sandia Environment Department, the permittee shall provide additional information necessary for a "case by case" eligibility determination to assure compliance with Pueblo of Sandia Water Quality Standards.

Note: Upon receipt of a determination by the Pueblo of Sandia that discharges from a permittee have reasonable potential to be causing or contributing to a violation of Pueblo of Sandia Water Quality Standards, EPA Region 6 would be notified. EPA Region 6 would then notify the permittee to either improve their Stormwater Pollution Prevention Plan (SWPPP) to achieve compliance with the Pueblo of Sandia Water Quality Standards or apply for and obtain an individual NPDES permit for these discharges per CFR 122.28(b)(3).

- 9.6.3.6.9 Authorization to Inspect.** If requested by the Pueblo of Sandia Environment Department the permittee must allow the Pueblo to perform its own routine or compliance inspection to ensure the permittee is in compliance and any

discharge is not contributing to a violation of the Pueblo of Sandia's Water Quality Standard.

9.6.3.6.10 *Alternative Permit.* Any industry discharging to waters of the United States that has been designated by the EPA as an impaired water shall not be covered under the Multi-Sector General Permit but will be required to obtain an individual permit.

9.6.3.6.11 *Where to Submit Information.* All required or requested documents shall be sent to: Environment Director, Pueblo of Sandia Environment Department at 481 Sandia Loop, Bernalillo, New Mexico 87004

9.6.3.7 Pueblo of Santa Clara.

The following condition applies only to discharges on the Santa Clara Indian Pueblo:

9.6.3.7.1 *Submission of NOI and NOT.* The Notice of Intent (NOI) and Notice of Termination (NOT) must be submitted to the Santa Clara Pueblo Governor's Office at the same time it is submitted to EPA

9.6.3.7.2 *SWPPP Availability.* A copy of the Stormwater Pollution Prevention Plan must be made available to the Pueblo of Santa Clara staff upon request.

9.6.3.7.3 *Where to Submit Information.* All required or requested documents shall be sent to the: Santa Clara Pueblo, Governor's Office, P.O. Box 580, Espanola, NM 87532.

9.6.3.8 Pueblo of Taos

The following conditions apply only to discharges on the Pueblo of Taos:

9.6.3.8.1 *Submission of NOI and NOT.* Copies of the Notice of Intent (NOI) and Notice of Termination (NOT) shall be provided at the same time it is provided to EPA.

9.6.3.8.2 *Submission of SWPPP.* Upon request by the Pueblo, a copy of the Stormwater Pollution Prevention Plan must be provided to the Taos Pueblo Environmental Officer.

9.6.3.8.3 *Submission of Data and Reports.* All analytical data and a copy of all written reports shall be provided to the Pueblo at the same time it is provided to the EPA.

9.6.3.8.4 Where to Submit Information. All requested materials shall be sent to Program Manager, Taos Pueblo Environmental Office Program Manager, P.O. Box 1846, Taos, NM, 97571.

9.6.3.9 Pueblo of Tesuque.

The following conditions apply only to discharges on the Pueblo of Tesuque:

9.6.3.9.1 Submission of NOI and NOT. Copies of the Notice of Intent (NOI) and Notice of Termination (NOT) shall be provided at the same time it is provided to EPA.

9.6.3.9.2 Submission of SWPPP. A copy of the Stormwater Pollution Prevention Plan must also be made available to the Pueblo of Tesuque at the time the NOI submitted.

9.6.3.9.3 Submission of Monitoring Data. All analytical data (e.g., Discharge Monitoring Reports, etc) shall be provided to the Pueblo at the same time it is provided to the EPA.

9.6.3.9.4 Where to Submit Information. All required or requested documents shall be sent to: Jennifer Montoya, Director, Pueblo of Tesuque Environment Department, Rt. 42 Box 360-T, Santa Fe, NM 87506.

9.6.4 OKR05000I: Indian Country lands within the State of Oklahoma

9.6.4.1 Certification Requirements. In order to protect downstream waters subject to the state of Oklahoma's Water Quality Standards (OAC 785:45-5-25) coverage under this permit is not available for any new or proposed discharges located within the watershed of any part of the Oklahoma Scenic Rivers system, including the Illinois River, Flint Creek, Barren Fork Creek, Upper Mountain Fork Creek, Little Lee Creek, and Big Lee Creek or to any water designated as an Outstanding Resource Water (ORW). Existing discharges of stormwater in these watersheds may be permitted under this permit only from point sources existing as of June 25, 1992, whether or not such stormwater discharges were permitted as point sources prior to June 25, 1992. For any such existing discharge, increased load of any pollutant above levels of June 25, 1992 is prohibited. Any new or proposed discharges not eligible for permit coverage under this paragraph must apply for an individual permit.

9.6.4.2 Pawnee Nation of Oklahoma

The following conditions apply only to discharges on the Pawnee Nation of Oklahoma:

- 9.6.4.2.1 Submission of NOI and NOT.** Copies of the Notice of Intent (NOI) and Notice of Termination (NOT) shall be provided at the same time it is provided to EPA.
- 9.6.4.2.2 Submission of SWPPP.** Copies of the Stormwater Pollution Prevention Plan must be provided to the Director of the Pawnee Nation Department of Environmental Conservation and Safety (DECS) no later than the same time as submitted to EPA.
- 9.6.4.2.3 Submission of Data and Reports.** All analytical data and a copy of all written reports shall be provided to DECS no later than the same time it is submitted to the EPA.
- 9.6.4.2.4 Spills or Leaks.** All spills or leaks of any size or amount occurring upon the Pawnee Nation shall be reported to DECS and the Bureau of Indian Affairs – Pawnee Agency, Bureau of Land Management-Moore Office, Oklahoma City, immediately upon detection as required under Title X, Article 6, section 611 (Pawnee Nation Oil Pollution Control Act – Emergency Response/Notification) of the Pawnee Nation Law and Order Code.
- 9.6.4.2.5 Discharges from Secondary Containment.** Discharge of stormwater from secondary containment is prohibited and shall not be authorized as cited in Title X, Article 6, Section 604(B) (Pawnee National Oil Pollution Control Act – Secondary Containment).
- 9.6.4.2.6 Where to Submit Information.** All required or requested documents shall be sent to: Director of the Pawnee Nation Department of Environmental Conservation and Safety (DECS), P.O. Box 470, Pawnee, OK 74058.
- 9.6.5 OKR05000F: Facilities in the State of Oklahoma not under the jurisdiction of the Oklahoma Department of Environmental Quality, except those on Indian Country lands.**
- 9.6.5.1 Certification Requirements.** In accordance with Oklahoma’s Water Quality Standards (OAC 785:45-5-25) coverage under this permit is not available for any new or proposed discharges located within the watershed or any part of the Oklahoma Scenic Rivers system, including Illinois River, Flint Creek, Barren Fork Creek, Upper Mountain Fork River, Little Lee Creek, and Big Lee Creek or to any water designated as an Outstanding Resource Water (ORW). Existing discharges of stormwater in these watersheds may be permitted under this permit only from point sources existing as of June 25, 1992, whether or not such stormwater discharges were permitted as point sources prior to June 25, 1992. For any such existing discharge, increased load of any pollutant above levels of June 25, 1992 is prohibited. Any new or proposed discharges not eligible for permit coverage under this paragraph must apply for an individual permit.

9.6.6 TXR05000F: Facilities in the State of Texas not under the jurisdiction of the Texas Commission on Environmental Quality, except those on Indian Country lands.

No additional requirements.

9.6.7 TXR05000I: Indian Country lands within the State of Texas.

No additional requirements.

9.7 Region 7

Permit coverage not available

9.8 Region 8

Permit coverage not available

9.9 Region 9

9.9.1 ASR050000: The islands of American Samoa

The following condition applies only to discharges on the American Samoa:

9.9.1.1 *Submission of NOI.* All Notices of Intent (NOIs) for stormwater discharges covered under the general permits in American Samoa shall be submitted to the American Samoa Environmental Protection Agency at the same time it is submitted to EPA.

9.9.1.2 *Submission of SWPPPs.* All SWPPPs for stormwater discharges in American Samoa shall be submitted to the American Samoa Environmental Protection Agency for review and approval.

9.9.2 AZR05000I: Indian Country lands within the State of Arizona, including Navajo Reservation lands in New Mexico and Utah.

9.9.2.1 Hualapai Tribe (Arizona)

The following condition applies only to discharges on the Hualapai Tribe:

9.9.2.1.1 *Submission of NOI and SWPPP.* All Notices of Intent (NOIs) and Stormwater Pollution Plans (SWPPPs) for stormwater discharges on Hualapai Tribal lands shall be submitted to the Water Resource Program through the Tribal Chairman for review and approval

9.9.2.1.2 Where to Submit Information. All required or requested documents shall be sent to: Water Resource Program through the Tribal Chairman, P.O. Box 179, Peach Springs, AZ 86434.

9.9.2.2 Navajo Nation (Arizona).

The following conditions apply only to discharges on the Navajo Nation:

9.9.2.2.1 Submission of NOI. Notices of Intent (NOI) must be submitted to Navajo EPA for review, comment and tracking.

9.9.2.2.2 Submission of SWPPP. Copies of Stormwater Water Pollution Plans (SWPPPs) and supporting Best Management Practices (BMPs) must be submitted to Navajo EPA for review and concurrence.

9.9.2.2.3 Submission of Monitoring Data. Copies of all monitoring reports must be provided to Navajo EPA.

9.9.2.3 White Mountain Apache Tribe (Arizona).

The following condition applies only to discharges on the White Mountain Apache Tribe:

9.9.2.3.1 Submission of NOI. All Notices of Intent for proposed stormwater discharges under the MSGP must be submitted to the Tribal Environmental Office.

9.9.2.3.2 Where to Submit Information. All required or requested documents shall be sent to the: Tribal Environmental Office, Attention: Doreen E. Gatewood, P.O. Box 1000, Whiteriver, AZ 85941.

9.9.3 CAR05000I: Indian Country lands within the State of California.

9.9.3.1 Big Pine Paiute Tribe of the Owens Valley (California).

The following condition applies only to discharges on the Big Pine Paiute Tribe of the Owens Valley:

9.9.3.1.1 Submission of NOI. Copies of Notices of Intent (NOIs) shall be submitted to the Tribe at the same time (or prior to) it is submitted to EPA.

9.9.3.2 Bishop Paiute Tribe (California).

The following condition applies only to discharges on the Bishop Paiute Tribe:

9.9.3.2.1 Submission of NOI. Copies of Notices of Intent (NOIs) for proposed stormwater discharges must be submitted to the Tribe's Environmental Management Office for review and comment by the Tribal Environmental Protection Agency (TEPA) Board.

9.9.3.3 Hoopa Valley Tribe (California).

The following conditions apply only to discharges on the Hoopa Valley Tribe:

9.9.3.3.1 Submission of NOI. All Notices of Intent (NOI) submitted for stormwater discharges under the general permits in Hoopa Valley Indian Reservation (HVIR) shall be submitted to the Tribal Environmental Protection Agency (TEPA).

9.9.3.3.2 Submission of SWPPP. All Stormwater Pollution Plans (SWPPPs) for stormwater discharges in HVIR shall be submitted to TEPA for review and approval.

9.9.3.4 Twenty-Nine Palms Band of Mission Indians (California)

The following conditions apply only to discharges on the Twenty-Nine Palms Band of Mission Indians:

9.9.3.4.1 Submission of NOI. Notices of Intent (NOI) must be submitted to the 29 Palms Tribal EPA for review, comment, and tracking.

9.9.3.4.2 Submission of SWPPP. Copies of Stormwater Pollution Prevention Plans (SWPPPs) and supporting best management practices (BMPs) must be submitted to the 29 Palms Tribal EPA for review and compliance.

9.9.3.4.3 Submission of Monitoring Data. Copies of all monitoring reports must be provided to the 29 Palms Tribal EPA.

9.9.4 GUR050000: The Island of Guam.

No additional requirements.

9.9.5 JAR050000: Johnston Atoll.

No additional requirements.

9.9.6 MWR050000: Midway Island and Wake Island.

No additional requirements.

9.9.7 Commonwealth of the Northern Mariana Islands

The following conditions apply only to discharges on the Commonwealth of the Northern Mariana Islands (CNMI):

- 9.9.7.1 Submission of NOI.** Pursuant to Part 10.3(h)(5) of the Standards, every Notice of Intent (NOI) submitted to EPA for activities in the CNMI that are to be covered under this permit must be postmarked no less than seven (7) calendar days prior to any stormwater discharges and a copy must be submitted to the Director of Division of Environmental Quality (DEQ) no later than seven (7) calendar days prior to any stormwater discharges.
- 9.9.7.2 Submission of SWPPP.** Pursuant to Part 10.3(h)(3) of the Standards, for any activity subject to the permit in the CNMI, a Stormwater Pollution Prevention Plan (SWPPP) for stormwater discharges associated with industrial activities must be submitted to DEQ and approved by the Director of DEQ prior to submission of the NOI to EPA.
- 9.9.7.3 Submission of SWPPP Approval Letter.** Pursuant to Part 10.3(h)(4) of the Standards, every NOI submitted to EPA for activities in the CNMI that are to be covered under this permit must be accompanied by a SWPPP approval letter from DEQ.
- 9.9.7.4 Submission of Monitoring Data.** Pursuant to Part 10.3(h)(6) of the Standards, permittees covered under this permit must submit copies of all monitoring reports to DEQ.
- 9.9.7.5 Certification.** Pursuant to Section 10.6 of the Standards, this certification shall be subject to amendment or modification if and to the extent that existing water quality standards are made more stringent, or new water quality standards are adopted, by DEQ.

This certification does not relieve the applicant from obtaining other applicable local or federal permits.

9.9.8 NVR05000I: Indian Country lands within the State of Nevada, including the Duck Valley Reservation in Idaho, the Fort McDermitt Reservation in Oregon and the Confederated Tribes of the Goshute Reservation in Utah

9.9.8.1 Pyramid Lake Paiute Tribe (Nevada)

The following conditions apply only to discharges on the Pyramid Lake Paiute Tribe:

- 9.9.8.1.1 Submission of NOI.** Notice of Intents (NOI) must be submitted to the Tribe for review, comments, and tracking.

9.9.8.1.2 Submission of SWPPP. Copies of Stormwater Pollution Prevention Plans (SWPPPs) and supporting best management practices (BMPs) must be submitted to the Pyramid Lake Paiute Tribe for review and concurrence.

9.9.8.1.3 Submission of Monitoring Data. Copies of all monitoring reports must be submitted to the Pyramid Lake Paiute Tribe.

9.10 Region 10

9.10.1 AKR050000: The State of Alaska, except Indian Country lands.

[Reserved for additional requirements to be included upon permit issuance.]

9.10.2 AKR05000I: Indian Country lands within Alaska

No additional requirements.

9.10.3 IDR050000: The State of Idaho, except Indian Country lands

[Reserved for additional requirements to be included upon permit issuance.]

9.10.4 IDR05000I: Indian Country lands within the State of Idaho, except Duck Valley Reservation lands, which are covered under Nevada permit NVR05000I listed in Part C.9

[Reserved for additional requirements to be included upon permit issuance.]

9.10.5 ORR05000I: Indian Country lands within the State of Oregon, except Fort McDermitt Reservation lands, which are covered under Nevada permit NVR05000I listed in Part C.9

[Reserved for additional requirements to be included upon permit issuance.]

9.10.6 WAR05000I: Indian Country lands within the State of Washington

[Reserved for additional requirements to be included upon permit issuance.]

9.10.7 WAR05000F: Federal Facilities in the State of Washington, except those located on Indian Country lands

[Reserved for additional requirements to be included upon permit issuance.]

Appendix A
Definitions, Abbreviations and Acronyms

Appendix A. Definitions, Abbreviations, and Acronyms (for the purposes of this permit).

Action Area – all areas to be affected directly or indirectly by the stormwater discharges, allowable non-stormwater discharges, and stormwater discharge-related activities, and not merely the immediate area involved in these discharges and activities.

Arid Climate – areas where annual rainfall averages from 0 to 10 inches.

Best Management Practices (BMPs) – schedules of activities, practices (and prohibitions of practices), structures, vegetation, maintenance procedures, and other management practices to prevent or reduce the discharge of pollutants to waters of the United States. BMPs also include treatment requirements, operating procedures, and practices to control plant site runoff, spillage or leaks, sludge or waste disposal, or drainage from raw material storage. See 40 CFR 122.2.

Co-located Industrial Activities – Any industrial activities, excluding your primary industrial activity(ies), located on-site that are defined by the stormwater regulations at 122.26(b)(14)(i)-(ix) and (xi). An activity at a facility is not considered co-located if the activity, when considered separately, does not meet the description of a category of industrial activity covered by the stormwater regulations or identified by the SIC code list in Appendix D.

Control Measure – refers to any BMP or other method (including effluent limitations) used to prevent or reduce the discharge of pollutants to waters of the United States.

Director – a Regional Administrator of the Environmental Protection Agency or an authorized representative. See 40 CFR 122.2.

Discharge – when used without qualification, means the "discharge of a pollutant." See 40 CFR 122.2.

Discharge of a pollutant – any addition of any "pollutant" or combination of pollutants to "waters of the United States" from any "point source," or any addition of any pollutant or combination of pollutants to the waters of the "contiguous zone" or the ocean from any point source other than a vessel or other floating craft which is being used as a means of transportation. This includes additions of pollutants into waters of the United States from: surface runoff which is collected or channeled by man; discharges through pipes, sewers, or other conveyances, leading into privately owned treatment works. See 40 CFR 122.2.

Discharge-related activities – activities that cause, contribute to, or result in stormwater and allowable non-stormwater point source discharges, and measures such as the siting, construction and operation of BMPs to control, reduce, or prevent pollution in the discharges.

Drought-stricken area – a period of below average water content in streams, reservoirs, ground-water aquifers, lakes and soils.

EPA Approved or Established Total Maximum Daily Loads (TMDLs) – “EPA Approved TMDLs” are those that are developed by a State and approved by EPA. “EPA Established TMDLs” are those that are developed by EPA.

Existing Discharger – an operator applying for coverage under this permit for discharges authorized previously under an NPDES general or individual permit.

Facility or Activity – any NPDES “point source” (including land or appurtenances thereto) that is subject to regulation under the NPDES program. See 40 CFR 122.2.

Federal Facility – any buildings, installations, structures, land, public works, equipment, aircraft, vessels, and other vehicles and property, owned by, or constructed or manufactured for the purpose of leasing to, the federal government.

Impaired Water (or “Water Quality Impaired Water” or “Water Quality Limited Segment”) – A water is impaired for purposes of this permit if it has been identified by a State or EPA pursuant to Section 303(d) of the Clean Water Act as not meeting applicable State water quality standards (these waters are called “water quality limited segments” under 40 CFR 30.2(j)). Impaired waters include both waters with approved or established TMDLs, and those for which a TMDL has not yet been approved or established.

Indian Country – (a) all land within the limits of any Indian reservation under the jurisdiction of the United States Government, notwithstanding the issuance of any patent, and including rights-of-way running through the reservation; (b) all dependent Indian communities within the borders of the United States, whether within the original or subsequently acquired territory thereof, and whether within or without the limits of a State, and (c) all Indian allotments, the Indian titles to which have not been extinguished, including rights-of-way running through the same. This definition includes all land held in trust for an Indian tribe. (18 U.S.C. 1151)

Industrial Activity – the 10 categories of industrial activities included in the definition of “stormwater discharges associated with industrial activity” as defined in 40 CFR 122.26(b)(14)(i)-(ix) and (xi).

Industrial Stormwater – stormwater runoff from industrial activity.

Municipal Separate Storm Sewer – a conveyance or system of conveyances (including roads with drainage systems, municipal streets, catch basins, curbs, gutters, ditches, man-made channels, or storm drains):

- (i) Owned or operated by a State, city, town, borough, county, parish, district, association, or other public body (created by or pursuant to State law) having jurisdiction over disposal of sewage, industrial wastes, stormwater, or other wastes, including special districts under State law such as a sewer district, flood control district or drainage district, or similar entity, or an Indian tribe or an authorized Indian tribal organization, or a designated and approved management agency under section 208 of the CWA that discharges to waters of the United States;

- (ii) Designed or used for collecting or conveying stormwater;
- (iii) Which is not a combined sewer; and
- (iv) Which is not part of a Publicly Owned Treatment Works (POTW) as defined at 40 CFR 122.2. See 40 CFR 122.26(b)(4) and (b)(7).

New Discharger – a facility from which there is a discharge, that did not commence the discharge at a particular site prior to August 13, 1979, which is not a new source, and which has never received a finally effective NPDES permit for discharges at that site. See 40 CFR 122.2.

New Source – any building, structure, facility, or installation from which there is or may be a “discharge of pollutants,” the construction of which commenced:

- after promulgation of standards of performance under section 306 of the CWA which are applicable to such source, or
- after proposal of standards of performance in accordance with section 306 of the CWA which are applicable to such source, but only if the standards are promulgated in accordance with section 306 within 120 days of their proposal. See 40 CFR 122.2.

New Source Performance Standards (NSPS) – technology-based standards for facilities that qualify as new sources under 40 CFR 122.2 and 40 CFR 122.29.

No exposure – all industrial materials or activities are protected by a storm-resistant shelter to prevent exposure to rain, snow, snowmelt, and/or runoff. See 40 CFR 122.26(g).

Operator – any entity with a stormwater discharge associated with industrial activity that meets either of the following two criteria:

- (i) The entity has operational control over industrial activities, including the ability to modify those activities; or
- (ii) The entity has day-to-day operational control of activities at a facility necessary to ensure compliance with the permit (e.g., the entity is authorized to direct workers at a facility to carry out activities required by the permit).

Person – an individual, association, partnership, corporation, municipality, State or Federal agency, or an agent or employee thereof. See 40 CFR 122.2.

Point source – any discernible, confined, and discrete conveyance, including but not limited to any pipe, ditch, channel, tunnel, conduit, well, discrete fissure, container, rolling stock, concentrated animal feeding operation, landfill leachate collection system, vessel, or other floating craft from which pollutants are or may be discharged. This term does not include return flows from irrigated agriculture or agricultural stormwater runoff. See 40 CFR 122.2.

Pollutant – dredged spoil, solid waste, incinerator residue, filter backwash, sewage, garbage, sewage sludge, munitions, chemical wastes, biological materials, heat, wrecked or discarded equipment, rock, sand, cellar dirt, and industrial, municipal and agricultural waste discharged into water. See 40 CFR 122.2.

Pollutant of concern – A pollutant which causes or contributes to a violation of a water quality standard, including a pollutant which is identified as causing an impairment in a state's 303(d) list.

Primary industrial activity – includes any activities performed on-site which are (1) identified by the facility's primary SIC code; or (2) included in the narrative descriptions of 122.26(b)(14)(i), (iv), (v), or (vii), and (ix). [For co-located activities covered by multiple SIC codes, it is recommended that the primary industrial determination be based on the value of receipts or revenues or, if such information is not available for a particular facility, the number of employees or production rate for each process may be compared. The operation that generates the most revenue or employs the most personnel is the operation in which the facility is primarily engaged. In situations where the vast majority of on-site activity falls within one SIC code, that activity may be the primary industrial activity.] Narrative descriptions in 40 CFR 122.26(b)(14) identified above include: (i) activities subject to stormwater effluent limitations guidelines, new source performance standards, or toxic pollutant effluent standards; (iv) hazardous waste treatment storage, or disposal facilities including those that are operating under interim status or a permit under subtitle C of the Resource Conservation and Recovery Act (RCRA); (v) landfills, land application sites and open dumps that receive or have received industrial wastes; (vii) steam electric power generating facilities; and (ix) sewage treatment works with a design flow of 1.0 mgd or more.

Qualified Personnel – Qualified personnel are those who possess the knowledge and skills to assess conditions and activities that could impact stormwater quality at your facility, and who can also evaluate the effectiveness of control measures.

Reportable Quantity Release – a release of a hazardous substance at or above the established legal threshold that requires emergency notification. Refer to 40 CFR Parts 110, 117, and 302 for complete definitions and reportable quantities for which notification is required.

Runoff coefficient – the fraction of total rainfall that will appear at the conveyance as runoff. See 40 CFR 122.26(b)(11).

Semi-Arid Climate – areas where annual rainfall averages from 10 to 20 inches.

Significant materials – includes, but is not limited to: raw materials; fuels; materials such as solvents, detergents, and plastic pellets; finished materials such as metallic products; raw materials used in food processing or production; hazardous substances designated under section 101(14) of CERCLA; any chemical the facility is required to report pursuant to section 313 of Title III of SARA; fertilizers; pesticides; and waste products such as ashes, slag and sludge that have the potential to be released with stormwater discharges. See 40 CFR 122.26(b)(12).

Special Aquatic Sites – sites identified in 40 CFR 230 Subpart E. These are geographic areas, large or small, possessing special ecological characteristics of productivity, habitat, wildlife protection, or other important and easily disrupted ecological values. These areas are generally recognized as significantly influencing or positively contributing to the general overall environmental health or vitality of the entire ecosystem of a region.

Stormwater – stormwater runoff, snow melt runoff, and surface runoff and drainage. See 40 CFR 122.26(b)(13).

Stormwater Discharges Associated with Construction Activity – a discharge of pollutants in stormwater runoff from areas where soil disturbing activities (e.g., clearing, grading, or excavating), construction materials, or equipment storage or maintenance (e.g., fill piles, borrow areas, concrete truck washout, fueling), or other industrial stormwater directly related to the construction process (e.g., concrete or asphalt batch plants) are located. See 40 CFR 122.26(b)(14)(x) and 40 CFR 122.26(b)(15).

Stormwater Discharges Associated with Industrial Activity – the discharge from any conveyance that is used for collecting and conveying stormwater and that is directly related to manufacturing, processing or raw materials storage areas at an industrial plant. The term does not include discharges from facilities or activities excluded from the NPDES program under Part 122. For the categories of industries identified in this section, the term includes, but is not limited to, stormwater discharges from industrial plant yards; immediate access roads and rail lines used or traveled by carriers of raw materials, manufactured products, waste material, or by-products used or created by the facility; material handling sites; refuse sites; sites used for the application or disposal of process waste waters (as defined at part 401 of this chapter); sites used for the storage and maintenance of material handling equipment; sites used for residual treatment, storage, or disposal; shipping and receiving areas; manufacturing buildings; storage areas (including tank farms) for raw materials, and intermediate and final products; and areas where industrial activity has taken place in the past and significant materials remain and are exposed to stormwater. For the purposes of this paragraph, material handling activities include storage, loading and unloading, transportation, or conveyance of any raw material, intermediate product, final product, by-product or waste product. The term excludes areas located on plant lands separate from the plant's industrial activities, such as office buildings and accompanying parking lots as long as the drainage from the excluded areas is not mixed with stormwater drained from the above described areas. Industrial facilities include those that are federally, State, or municipally owned or operated that meet the description of the facilities listed in 40 CFR 122.26(b)(14). The term also includes those facilities designated under the provisions of 40 CFR 122.26(a)(1)(v). See 40 CFR 122.26(b)(14).

Tier 2 Waters – For antidegradation purposes, pursuant to 40 CFR 131.12(a)(2), Tier 2 waters are characterized as having water quality that exceeds the levels necessary to support propagation of fish, shellfish, and wildlife and recreation in and on the water.

Tier 2.5 Waters – For antidegradation purposes, Tier 2.5 waters are those waters designated by States or Tribes as neither Tier 2 nor Tier 3. States have special requirements for these waters.

These waters are given a level of protection equal to and above that given to Tier 2 waters, but less than that given Tier 3 waters.

Tier 3 Waters – For antidegradation purposes, pursuant to 40 CFR 131.12(a)(3), Tier 3 waters are identified by states as having high quality waters constituting an Outstanding Natural Resource Water (ONRW), such as waters of National Parks and State Parks, wildlife refuges, and waters of exceptional recreational or ecological significance.

Total Maximum Daily Loads (TMDLs) – A TMDL is a calculation of the maximum amount of a pollutant that a waterbody can receive and still meet water quality standards, and an allocation of that amount to the pollutant's sources. A TMDL includes wasteload allocations (WLAs) for point source discharges; load allocations (LAs) for nonpoint sources and/or natural background, and must include a margin of safety (MOS) and account for seasonal variations. (See section 303(d) of the Clean Water Act and 40 CFR 130.2 and 130.7).

Water Quality Impaired – See ‘Impaired Water’.

Water Quality Standards – A water quality standard defines the water quality goals of a water body, or portion thereof, by designating the use or uses to be made of the water and by setting criteria necessary to protect the uses. States and EPA adopt water quality standards to protect public health or welfare, enhance the quality of water and serve the purposes of the Clean Water Act (See CWA sections 101(a)2 and 303(c)). Water quality standards also include an antidegradation policy. See P.U.D. o. 1 of Jefferson County et al v. Wash Dept of Ecology et al, 511 US 701, 705 (1994).

“You” and “Your” – as used in this permit are intended to refer to the permittee, the operator, or the discharger as the context indicates and that party’s facility or responsibilities. The use of “you” and “your” refers to a particular facility and not to all facilities operated by a particular entity. For example, “you must submit” means the permittee must submit something for that particular facility. Likewise, “all your discharges” would refer only to discharges at that one facility.

A.2. ABBREVIATIONS AND ACRONYMS

BAT – Best Available Technology Economically Achievable

BOD5 – Biochemical Oxygen Demand (5-day test)

BMP – Best Management Practice

BPJ – Best Professional Judgment

BPT – Best Practicable Control Technology Currently Available

CERCLA – Comprehensive Environmental Response, Compensation and Liability Act

CGP – Construction General Permit

COD – Chemical Oxygen Demand

CWA – Clean Water Act (or the Federal Water Pollution Control Act, 33 U.S.C. §1251 *et seq*)

CWT – Centralized Waste Treatment

DMR – Discharge Monitoring Report

EPA – U. S. Environmental Protection Agency

ESA – Endangered Species Act

FWS – U. S. Fish and Wildlife Service

LA – Load Allocations

MDMR – MSGP Discharge Monitoring Report

MGD – Million Gallons per Day

MOS – Margin of Safety

MS4 – Municipal Separate Storm Sewer System

MSDS – Material Safety Data Sheet

MSGP – Multi-Sector General Permit

NAICS – North American Industry Classification System

NEPA – National Environmental Policy Act

NHPA – National Historic Preservation Act

NMFS – U. S. National Marine Fisheries Service

NOI – Notice of Intent

NOT – Notice of Termination

NPDES – National Pollutant Discharge Elimination System

NRC – National Response Center

NRHP – National Register of Historic Places
NSPS – New Source Performance Standard
NTU – Nephelometric Turbidity Unit
OMB – U. S. Office of Management and Budget
ORW – Outstanding Resource Water
OSM – U. S. Office of Surface Mining
POTW – Publicly Owned Treatment Works
RCRA – Resource Conservation and Recovery Act
RQ – Reportable Quantity
SARA – Superfund Amendments and Reauthorization Act
SHPO – State Historic Preservation Officer
SIC – Standard Industrial Classification
SMCRA – Surface Mining Control and Reclamation Act
SPCC – Spill Prevention, Control, and Countermeasures
SWPPP – Stormwater Pollution Prevention Plan
THPO – Tribal Historic Preservation Officer
TMDL – Total Maximum Daily Load
TSDF – Treatment, Storage, or Disposal Facility
TSS – Total Suspended Solids
USGS – United States Geological Survey
WLA – Wasteload Allocation
WQS – Water Quality Standard

**Appendix B
Standard Permit Conditions**

Appendix B. Standard Permit Conditions.

Standard permit conditions in Appendix B are consistent with the general permit provisions required under 40 CFR 122.41.

B.1 Duty To Comply.

You must comply with all conditions of this permit. Any permit noncompliance constitutes a violation of the Clean Water Act and is grounds for enforcement action; for permit termination, revocation and reissuance, or modification; or for denial of a permit renewal application.

- A. You must comply with effluent standards or prohibitions established under section 307(a) of the Clean Water Act for toxic pollutants within the time provided in the regulations that establish these standards, even if the permit has not yet been modified to incorporate the requirement.
- B. Penalties for Violations of Permit Conditions: The Director will adjust the civil and administrative penalties listed below in accordance with the Civil Monetary Penalty Inflation Adjustment Rule (61 FR 252, December 31, 1996, pp. 69359-69366, as corrected in 62 FR 54, March 20, 1997, pp.13514-13517) as mandated by the Debt Collection Improvement Act of 1996 for inflation on a periodic basis. This rule allows EPA's penalties to keep pace with inflation. The Agency is required to review its penalties at least once every 4 years thereafter and to adjust them as necessary for inflation according to a specified formula. The civil and administrative penalties following were adjusted for inflation starting in 1996.
 1. Criminal Penalties.
 - 1.1 *Negligent Violations.* The CWA provides that any person who negligently violates permit conditions implementing Sections 301, 302, 306, 307, 308, 318, or 405 of the Act is subject to criminal penalties of not less than \$2,500 nor more than \$25,000 per day of violation, or imprisonment of not more than one year, or both. In the case of a second or subsequent conviction for a negligent violation, a person shall be subject to criminal penalties of not more than \$50,000 per day of violation or by imprisonment of not more than two years, or both.
 - 1.2 *Knowing Violations.* The CWA provides that any person who knowingly violates permit conditions implementing Sections 301, 302, 306, 307, 308, 318, or 405 of the Act is subject to a fine of not less than \$5,000 nor more than \$50,000 per day of violation, or by imprisonment for not more than 3 years, or both. In the case of a second or subsequent conviction for a knowing violation, a person shall be subject to criminal penalties of not more than \$100,000 per day of violation, or imprisonment of not more than 6 years, or both.

- 1.3. *Knowing Endangerment.* The CWA provides that any person who knowingly violates permit conditions implementing Sections 301, 302, 306, 307, 308, 318, or 405 of the Act and who knows at that time that he or she is placing another person in imminent danger of death or serious bodily injury shall upon conviction be subject to a fine of not more than \$250,000 or by imprisonment of not more than 15 years, or both. In the case of a second or subsequent conviction for a knowing endangerment violation, a person shall be subject to a fine of not more than \$500,000 or by imprisonment of not more than 30 years, or both. An organization, as defined in section 309(c)(3)(B)(iii) of the Act, shall, upon conviction of violating the imminent danger provision be subject to a fine of not more than \$1,000,000 and can be fined up to \$2,000,000 for second or subsequent convictions.
- 1.4. *False Statement.* The CWA provides that any person who falsifies, tampers with, or knowingly renders inaccurate any monitoring device or method required to be maintained under this permit shall, upon conviction, be punished by a fine of not more than \$10,000, or by imprisonment for not more than 2 years, or both. If a conviction of a person is for a violation committed after a first conviction of such person under this paragraph, punishment is a fine of not more than \$20,000 per day of violation, or by imprisonment of not more than 4 years, or both. The Act further provides that any person who knowingly makes any false statement, representation, or certification in any record or other document submitted or required to be maintained under this permit, including monitoring reports or reports of compliance or non-compliance shall, upon conviction, be punished by a fine of not more than \$10,000 per violation, or by imprisonment for not more than 6 months per violation, or by both.
2. *Civil Penalties.* The CWA provides that any person who violates a permit condition implementing Sections 301, 302, 306, 307, 308, 318, or 405 of the Act is subject to a civil penalty not to exceed the maximum amounts authorized by Section 309(d) of the Act and the Federal Civil Penalties Inflation Adjustment Act (28 U.S.C. § 2461 note) as amended by the Debt Collection Improvement Act (31 U.S.C. § 3701 note) (currently \$32,500 per day for each violation).
3. *Administrative Penalties.* The CWA provides that any person who violates a permit condition implementing Sections 301, 302, 306, 307, 308, 318, or 405 of the Act is subject to an administrative penalty, as follows
 - 3.1. *Class I Penalty.* Not to exceed the maximum amounts authorized by Section 309(g)(2)(A) of the Act and the Federal Civil Penalties Inflation Adjustment Act (28 U.S.C. § 2461 note) as amended by the Debt Collection Improvement Act (31 U.S.C. § 3701 note) (currently \$11,000 per violation, with the maximum amount of any Class I penalty assessed not to exceed \$32,500).

- 3.2. *Class II Penalty.* Not to exceed the maximum amounts authorized by Section 309(g)(2)(B) of the Act and the Federal Civil Penalties Inflation Adjustment Act (28 U.S.C. § 2461 note) as amended by the Debt Collection Improvement Act (31 U.S.C. § 3701 note) (currently \$11,000 per day for each day during which the violation continues, with the maximum amount of any Class II penalty not to exceed \$157,500).

B.2 Duty to Reapply.

If you wish to continue an activity regulated by this permit after the expiration date of this permit, you must apply for and obtain authorization as required by the new permit once EPA issues it.

B.3 Need to Halt or Reduce Activity Not a Defense.

It shall not be a defense for you in an enforcement action that it would have been necessary to halt or reduce the permitted activity in order to maintain compliance with the conditions of this permit.

B.4 Duty to Mitigate.

You must take all reasonable steps to minimize or prevent any discharge in violation of this permit which has a reasonable likelihood of adversely affecting human health or the environment.

B.5 Proper Operation and Maintenance.

You must at all times properly operate and maintain all facilities and systems of treatment and control (and related appurtenances) which are installed or used by you to achieve compliance with the conditions of this permit. Proper operation and maintenance also includes adequate laboratory controls and appropriate quality assurance procedures. This provision requires the operation of backup or auxiliary facilities or similar systems which are installed by you only when the operation is necessary to achieve compliance with the conditions of this permit.

B.6 Permit Actions.

This permit may be modified, revoked and reissued, or terminated for cause. Your filing of a request for a permit modification, revocation and reissuance, or termination, or a notification of planned changes or anticipated noncompliance does not stay any permit condition.

B.7 Property Rights.

This permit does not convey any property rights of any sort, or any exclusive privileges.

B.8 Duty to Provide Information.

You must furnish to EPA or an authorized representative (including an authorized contractor acting as a representative of EPA), within a reasonable time, any information which EPA may request to determine whether cause exists for modifying, revoking and reissuing, or terminating this permit or to determine compliance with this permit. You must also furnish to EPA or an authorized representative upon request, copies of records required to be kept by this permit.

B.9 Inspection and Entry.

You must allow EPA or an authorized representative (including an authorized contractor acting as a representative of EPA), upon presentation of credentials and other documents as may be required by law, to:

- A. Enter upon your premises where a regulated facility or activity is located or conducted, or where records must be kept under the conditions of this permit;
- B. Have access to and copy, at reasonable times, any records that must be kept under the conditions of this permit;
- C. Inspect at reasonable times any facilities; equipment (including monitoring and control equipment), practices, or operations regulated or required under this permit; and
- D. Sample or monitor at reasonable times, for the purposes of assuring permit compliance or as otherwise authorized by the Clean Water Act, any substances or parameters at any location.

B.10 Monitoring and Records.

- A. Samples and measurements taken for the purpose of monitoring must be representative of the volume and nature of the monitored activity.
- B. You must retain records of all monitoring information, including all calibration and maintenance records and all original strip chart recordings for continuous monitoring instrumentation, copies of all reports required by this permit, and records of all data used to complete the application for this permit, for a period of at least three years from the date the permit expires or the date the permittee's authorization is terminated. This period may be extended by request of EPA at any time.
- C. Records of monitoring information must include:
 - 1. The date, exact place, and time of sampling or measurements;
 - 2. The individual(s) who performed the sampling or measurements;

3. The date(s) analyses were performed
 4. The individual(s) who performed the analyses;
 5. The analytical techniques or methods used; and
 6. The results of such analyses.
- D. Monitoring must be conducted according to test procedures approved under 40 CFR Part 136, unless other test procedures have been specified in the permit.
- E. The Clean Water Act provides that any person who falsifies, tampers with, or knowingly renders inaccurate any monitoring device or method required to be maintained under this permit shall, upon conviction, be punished by a fine of not more than \$10,000, or by imprisonment for not more than 2 years, or both. If a conviction of a person is for a violation committed after a first conviction of such person under this paragraph, punishment is a fine of not more than \$20,000 per day of violation, or by imprisonment of not more than 4 years, or both.

B.11 Signatory Requirements.

- A. All applications, including NOIs, must be signed as follows:
1. For a corporation: By a responsible corporate officer. For the purpose of this subsection, a responsible corporate officer means: (i) a president, secretary, treasurer, or vice-president of the corporation in charge of a principal business function, or any other person who performs similar policy- or decision-making functions for the corporation, or (ii) the manager of one or more manufacturing, production, or operating facilities, provided, the manager is authorized to make management decisions which govern the operation of the regulated facility including having the explicit or implicit duty of making major capital investment recommendations, and initiating and directing other comprehensive measures to assure long term environmental compliance with environmental laws and regulations; the manager can ensure that the necessary systems are established or actions taken to gather complete and accurate information for permit application requirements; and where authority to sign documents has been assigned or delegated to the manager in accordance with corporate procedures.
 2. For a partnership or sole proprietorship: By a general partner or the proprietor, respectively; or
 3. For a municipality, state, federal, or other public agency: By either a principal executive officer or ranking elected official. For purposes of this subsection, a principal executive officer of a federal agency includes (i) the chief executive officer of the agency, or (ii) a senior executive officer having responsibility for

the overall operations of a principal geographic unit of the agency (e.g., Regional Administrator of EPA).

- B. Your SWPPP, including changes to your SWPPP to document any corrective actions taken as required by Part 3.1, and all reports submitted to EPA, must be signed by a person described in Appendix B, Subsection 11.A above or by a duly authorized representative of that person. A person is a duly authorized representative only if:
1. The authorization is made in writing by a person described in Appendix B, Subsection 11.A;
 2. The authorization specifies either an individual or a position having responsibility for the overall operation of the regulated facility or activity such as the position of plant manager, operator of a well or a well field, superintendent, position of equivalent responsibility, or an individual or position having overall responsibility for environmental matters for the company. (A duly authorized representative may thus be either a named individual or any individual occupying a named position); and
 3. The signed and dated written authorization is included in the SWPPP. A copy must be submitted to EPA, if requested.
- C. All other changes to your SWPPP, and other compliance documentation required under Part 5.4, must be signed and dated by the person preparing the change or documentation.
- D. Changes to Authorization. If an authorization under Appendix B, Subsection 11.B is no longer accurate because the industrial facility has been purchased by a different entity, a new NOI satisfying the requirements of Subsection 11.B must be submitted to EPA. See Table 1-2 in Part 1.3.1 of the permit. However, if the only change that is occurring is a change in contact information or a change in the facility's address, the operator need only make a modification to the existing NOI submitted for authorization.
- E. Any person signing documents in accordance with Appendix B, Subsections 11.A or 11.B above must include the following certification:

"I certify under penalty of law that this document and all attachments were prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gathered and evaluated the information contained therein. Based on my inquiry of the person or persons who manage the system, or those persons directly responsible for gathering the information, the information contained is, to the best of my knowledge and belief, true, accurate, and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations."

- F. The CWA provides that any person who knowingly makes any false statement, representation, or certification in any record or other document submitted or required to be maintained under this permit, including monitoring reports or reports of compliance or non-compliance shall, upon conviction, be punished by a fine of not more than \$10,000 per violation, or by imprisonment for not more than 6 months per violation, or by both.

B.12 Reporting Requirements.

- A. Planned changes. You must give notice to EPA as soon as possible of any planned physical alterations or additions to the permitted facility. Notice is required only when:
1. The alteration or addition to a permitted facility may meet one of the criteria for determining whether a facility is a new source in 40 CFR 122.29(b); or
 2. The alteration or addition could significantly change the nature or increase the quantity of pollutants discharged. This notification applies to pollutants which are subject neither to effluent limitations in the permit, nor to notification requirements under 40 CFR 122.42(a)(1).
- B. Anticipated noncompliance. You must give advance notice to EPA of any planned changes in the permitted facility or activity which may result in noncompliance with permit requirements.
- C. Transfers. This permit is not transferable to any person except after notice to EPA. Where a facility wants to change the name of the permittee, the original permittee (the first owner or operators) must submit a Notice of Termination pursuant to Part 1.4. The new owner or operator must submit a Notice of Intent in accordance with Part 1.3.1 and Table 1-2. See also requirements in Appendix B, Subsections 11.B and 11.D.
- D. Monitoring reports. Monitoring results must be reported at the intervals specified elsewhere in this permit.
1. Pursuant to Part 7.1, all monitoring data collected pursuant to Part 6.2 and 6.3 must be submitted to EPA using EPA's online eNOI system (www.epa.gov/npdes/eNOI). Alternatively, if you cannot access eNOI, monitoring results should be reported on the MSGP Discharge Monitoring Report (MDMR) form, available at www.epa.gov/npdes/stormwater/msgp, and submitted to EPA.
 2. If you monitor any pollutant more frequently than required by the permit using test procedures approved under 40 CFR Part 136 or as specified in the permit, the results of this monitoring must be included in the calculation and reporting of the data submitted in the MDMR.
 3. Calculations for all limitations which require averaging of measurements must use an arithmetic mean. For averaging purposes, use a value of zero for any

individual sample parameter, which is determined to be less than the method detection limit. For sample values that fall between the method detection level and the quantitation limit (i.e., a confirmed detection but below the level that can be reliably quantified), use a value halfway between zero and the quantitation limit.

- E. Compliance schedules. Reports of compliance or noncompliance with, or any progress reports on, interim and final requirements contained in any compliance schedule of this permit must be submitted no later than 14 days following each schedule date.
- F. Twenty-four hour reporting.
 - 1. You must report any noncompliance which may endanger health or the environment. Any information must be provided orally within 24 hours from the time you become aware of the circumstances. A written submission must also be provided within five days of the time you become aware of the circumstances. The written submission must contain a description of the noncompliance and its cause; the period of noncompliance, including exact dates and times, and if the noncompliance has not been corrected, the anticipated time it is expected to continue; and steps taken or planned to reduce, eliminate, and prevent reoccurrence of the noncompliance.
 - 2. The following shall be included as information which must be reported within 24 hours under this paragraph.
 - a. Any unanticipated bypass which exceeds any effluent limitation in the permit. (See 40 CFR 122.41(m)(3)(ii))
 - b. Any upset which exceeds any effluent limitation in the permit
 - c. Violation of a maximum daily discharge limit for any numeric effluent limitation. (See 40 CFR 122.44(g).)
 - 3. EPA may waive the written report on a case-by-case basis for reports under Appendix B, Subsection 12.F.2 if the oral report has been received within 24 hours.
- G. Other noncompliance. You must report all instances of noncompliance not reported under Appendix B, Subsections 12.D, 12.E, and 12.F, at the time monitoring reports are submitted. The reports must contain the information listed in Appendix B, Subsection 12.F.
- H. Other information. Where you become aware that you failed to submit any relevant facts in a permit application, or submitted incorrect information in a permit application or in any report to the Permitting Authority, you must promptly submit such facts or information.

B.13 Bypass.**A. Definitions.**

1. Bypass means the intentional diversion of waste streams from any portion of a treatment facility See 40 CFR 122.41(m)(1)(i).
2. Severe property damage means substantial physical damage to property, damage to the treatment facilities which causes them to become inoperable, or substantial and permanent loss of natural resources which can reasonably be expected to occur in the absence of a bypass. Severe property damage does not mean economic loss caused by delays in production. See 40 CFR 122.41(m)(1)(ii).

B. Bypass not exceeding limitations. You may allow any bypass to occur which does not cause effluent limitations to be exceeded, but only if it also is for essential maintenance to assure efficient operation. These bypasses are not subject to the provisions of Appendix B, Subsections 13.C and 13.D. See 40 CFR 122.41(m)(2).**C. Notice.**

1. Anticipated bypass. If you know in advance of the need for a bypass, you must submit prior notice, if possible at least ten days before the date of the bypass. See 40 CFR 122.41(m)(3)(i).
2. Unanticipated bypass. You must submit notice of an unanticipated bypass as required in Appendix B, Subsection 12.F (24-hour notice). See 40 CFR 122.41(m)(3)(ii).

D. Prohibition of bypass. See 40 CFR 122.41(m)(4).

1. Bypass is prohibited, and EPA may take enforcement action against you for bypass, unless:
 - a. Bypass was unavoidable to prevent loss of life, personal injury, or severe property damage;
 - b. There were no feasible alternatives to the bypass, such as the use of auxiliary treatment facilities, retention of untreated wastes, or maintenance during normal periods of equipment downtime. This condition is not satisfied if adequate back-up equipment should have been installed in the exercise of reasonable engineering judgment to prevent a bypass which occurred during normal periods of equipment downtime or preventive maintenance; and

- c. You submitted notices as required under Appendix B, Subsection 13.C.
2. EPA may approve an anticipated bypass, after considering its adverse effects, if EPA determines that it will meet the three conditions listed above in Appendix B, Subsection 13.D.1.

B.14 Upset.

- A. **Definition.** Upset means an exceptional incident in which there is unintentional and temporary noncompliance with technology based permit effluent limitations because of factors beyond your reasonable control. An upset does not include noncompliance to the extent caused by operational error, improperly designed treatment facilities, inadequate treatment facilities, lack of preventive maintenance, or careless or improper operation. See 40 CFR 122.41(n)(1).
- B. **Effect of an upset.** An upset constitutes an affirmative defense to an action brought for noncompliance with such technology based permit effluent limitations if the requirements of Appendix B, Subsection 14.C are met. No determination made during administrative review of claims that noncompliance was caused by upset, and before an action for noncompliance, is final administrative action subject to judicial review. See 40 CFR 122.41(n)(2).
- C. **Conditions necessary for a demonstration of upset.** See 40 CFR 122.41(n)(3). A permittee who wishes to establish the affirmative defense of upset must demonstrate, through properly signed, contemporaneous operating logs, or other relevant evidence that:
 1. An upset occurred and that you can identify the cause(s) of the upset;
 2. The permitted facility was at the time being properly operated; and
 3. You submitted notice of the upset as required in Appendix B, Subsection 12.F.2.b (24 hour notice).
 4. You complied with any remedial measures required under Appendix B, Subsection 4.
- D. **Burden of proof.** In any enforcement proceeding, you, as the one seeking to establish the occurrence of an upset, have the burden of proof. See 40 CFR 122.41(n)(4).

**Appendix C
Areas Covered**

Appendix C. Permit Area.

EPA can only provide permit coverage in these areas and for classes of discharges that are outside the scope of a State's NPDES program authorization.

C.1 EPA Region 1: Connecticut, Massachusetts, Maine, New Hampshire, Rhode Island, Vermont.

This permit offers NPDES permit coverage for stormwater discharges associated with industrial activity from the following areas in EPA Region 1:

Permit Number	Areas of Coverage/Where EPA Is Permitting Authority
CTR05000I	Indian Country within the State of Connecticut
MAR050000	Commonwealth of Massachusetts, except Indian Country
MAR05000I	Indian Country within the Commonwealth of Massachusetts
NHR050000	State of New Hampshire
RIR05000I	Indian Country within the State of Rhode Island
VTR05000F	Federal facilities in the State of Vermont

For stormwater discharges in EPA Region 1 outside the areas of coverage identified above, please contact your State NPDES permitting authority to obtain coverage under a State-issued NPDES permit.

C.2 EPA Region 2: New Jersey, New York, Puerto Rico, Virgin Islands.

This permit offers NPDES permit coverage for stormwater discharges associated with industrial activity from the following areas in EPA Region 2:

Permit Number	Areas of Coverage/Where EPA Is Permitting Authority
PRR050000	Commonwealth of Puerto Rico

For stormwater discharges in EPA Region 2 outside the areas of coverage identified above, please contact your State NPDES permitting authority to obtain coverage under a State-issued NPDES permit.

C.3 EPA Region 3: Delaware, District of Columbia, Maryland, Pennsylvania, Virginia, West Virginia.

This permit offers NPDES permit coverage for stormwater discharges associated with industrial activity from the following areas in EPA Region 3:

Permit Number	Areas of Coverage/Where EPA Is Permitting Authority
DCR050000	District of Columbia
DER05000F	Federal facilities in the State of Delaware

For stormwater discharges in EPA Region 3 outside the areas of coverage identified above, please contact your State NPDES permitting authority to obtain coverage under a State-issued NPDES permit.

C.4 EPA Region 4: Alabama, Florida, Georgia, Kentucky, Mississippi, North Carolina, South Carolina, Tennessee (Coverage not available under this permit).

For stormwater discharges in EPA Region 4, please contact your State NPDES permitting authority to obtain coverage under a State-issued NPDES permit.

C.5 EPA Region 5: Illinois, Indiana, Michigan, Minnesota, Ohio, Wisconsin.

This permit offers NPDES permit coverage for stormwater discharges associated with industrial activity from the following areas in EPA Region 5:

Permit Number	Areas of Coverage/Where EPA Is Permitting Authority
MIR05000I	Indian Country within the State of Michigan
MNR05000I	Indian Country within the State of Minnesota
WIR05000I	Indian Country within the State of Wisconsin, except those on Sokaogon Chippewa Community lands

For stormwater discharges in EPA Region 5 outside the areas of coverage identified above, please contact your State NPDES permitting authority to obtain coverage under a State-issued NPDES permit.

C.6 EPA Region 6: Arkansas, Louisiana, Oklahoma, Texas, and New Mexico (except see Region 9 for Navajo lands, and see Region 8 for Ute Mountain Reservation lands).

This permit offers NPDES permit coverage for stormwater discharges associated with industrial activity from the following areas in EPA Region 6:

Permit Number	Areas of Coverage/Where EPA Is Permitting Authority
LAR05000I	Indian Country within the State of Louisiana
NMR050000	The State of New Mexico, except Indian Country
NMR05000I	Indian Country within the State of New Mexico, except Ute Mountain Reservation lands that are covered under Colorado permit COR05000I listed in Part C.8 and Navajo Reservation lands that are covered under Arizona permit AZR05000I listed in Part C.9.
OKR05000I	Indian Country within the State of Oklahoma
OKR05000F	Facilities in the State of Oklahoma not under the jurisdiction of the Oklahoma Department of Environmental Quality, except those on Indian Country. EPA jurisdiction facilities include SIC Codes 1311, 1381, 1382, 1389, and 5171 and point source (but not nonpoint source) discharges associated with agricultural production, services, and silviculture.

Permit Number	Areas of Coverage/Where EPA Is Permitting Authority
TXR05000F	Facilities in the State of Texas not under the jurisdiction of the Texas Commission on Environmental Quality, except those on Indian Country. EPA-jurisdiction facilities include SIC Codes 1311, 1321, 1381, 1382, and 1389 (other than oil field service company "home base" facilities).
TXR05000I	Indian Country within the State of Texas

For stormwater discharges in EPA Region 6 outside the areas of coverage identified above, please contact your State NPDES permitting authority to obtain coverage under a State-issued NPDES permit.

C.7 EPA Region 7: Iowa, Kansas, Missouri, Nebraska (Coverage not available under this permit).

For stormwater discharges in EPA Region 7, please contact EPA Region 7 or your State NPDES permitting authority to obtain coverage under a State-issued NPDES permit.

C.8 EPA Region 8: Colorado, Montana, North Dakota, South Dakota, Wyoming, Utah (Coverage not available under this permit).

For stormwater discharges in EPA Region 8 please contact EPA Region 8 or your State NPDES permitting authority to obtain coverage under an NPDES permit.

C.9 EPA Region 9: California, Hawaii, Nevada, Guam, American Samoa, the Commonwealth of the Northern Mariana Islands, the Confederated Tribes of the Goshute Reservation in Utah and Nevada, Indian Country within the State of Arizona including the Navajo Reservation in Utah and New Mexico and Arizona, the Duck Valley Reservation in Idaho, and the Fort McDermitt Reservation in Oregon.

This permit offers NPDES permit coverage for stormwater discharges associated with industrial activity from the following areas in EPA Region 9:

Permit Number	Areas of Coverage/Where EPA Is Permitting Authority
ASR050000	The islands of American Samoa
AZR050001	Indian Country within the State of Arizona, including Navajo Reservation lands in New Mexico and Utah
CAR050001	Indian Country within the State of California
GUR050000	The island of Guam
JAR050000	Johnston Atoll
MWR050000	Midway Island and Wake Island
NIR050000	Commonwealth of the Northern Mariana Islands
NVR050001	Indian Country within the State of Nevada, including the Duck Valley Reservation in Idaho, the Fort McDermitt Reservation in Oregon and the Confederated Tribes of the Goshute Reservation in Utah

For stormwater discharges in EPA Region 9 outside the areas of coverage identified above, please contact your State NPDES permitting authority to obtain coverage under a State-issued NPDES permit.

C.10 Region 10: Alaska, Idaho (except see Region 9 for Duck Valley Reservation lands), Oregon (except see Region 9 for Fort McDermitt Reservation), Washington.

This permit offers NPDES permit coverage for stormwater discharges associated with industrial activity from the following areas in EPA Region 10:

Permit Number	Areas of Coverage/Where EPA Is Permitting Authority
AKR050000	The State of Alaska, except Indian Country lands [coverage not yet available]
AKR05000I	Indian Country lands within Alaska
IDR050000	The State of Idaho, except Indian Country lands [coverage not yet available]
IDR05000I	Indian Country lands within the State of Idaho, except Duck Valley Reservation lands, which are covered under Nevada permit NVR05000I listed in Part C.9 [coverage not yet available]
ORR05000I	Indian Country lands within the State of Oregon, except Fort McDermitt Reservation lands, which are covered under Nevada permit NVR05000I listed in Part C.9 [coverage not yet available]
WAR05000I	Indian Country lands within the State of Washington [coverage not yet available]
WAR05000F	Federal facilities in the State of Washington, except those located on Indian Country lands [coverage not yet available]

For stormwater discharges in EPA Region 10 outside the areas of coverage identified above, please contact your State NPDES permitting authority to obtain coverage under a State-issued NPDES permit.

**Appendix D
Activities Covered**

Appendix D. Facilities and Activities Covered

Your permit eligibility is limited to discharges from facilities in the “sectors” of industrial activity summarized in Table D-1. These sector descriptions are based on Standard Industrial Classification (SIC) Codes and Industrial Activity Codes. References to “sectors” in this permit (e.g., sector-specific monitoring requirements) refer to these groupings.

Table D-1. Sectors of Industrial Activity Covered by This Permit		
Subsector (May be subject to more than one sector/subsector)	SIC Code or Activity Code¹	Activity Represented
SECTOR A: TIMBER PRODUCTS		
A1	2421	General Sawmills and Planing Mills
A2	2491	Wood Preserving
A3	2411	Log Storage and Handling
A4	2426	Hardwood Dimension and Flooring Mills
	2429	Special Product Sawmills, Not Elsewhere Classified
	2431-2439 (except 2434)	Millwork, Veneer, Plywood, and Structural Wood (see Sector W)
	2448	Wood Pallets and Skids
	2449	Wood Containers, Not Elsewhere Classified
	2451, 2452	Wood Buildings and Mobile Homes
	2493	Reconstituted Wood Products
A5	2499	Wood Products, Not Elsewhere Classified
A5	2441	Nailed and Lock Corner Wood Boxes and Shook
SECTOR B: PAPER AND ALLIED PRODUCTS		
B1	2631	Paperboard Mills
B2	2611	Pulp Mills
	2621	Paper Mills
	2652-2657	Paperboard Containers and Boxes
	2671-2679	Converted Paper and Paperboard Products, Except Containers and Boxes
SECTOR C: CHEMICALS AND ALLIED PRODUCTS		
C1	2873-2879	Agricultural Chemicals
C2	2812-2819	Industrial Inorganic Chemicals
C3	2841-2844	Soaps, Detergents, and Cleaning Preparations; Perfumes, Cosmetics, and Other Toilet Preparations
C4	2821-2824	Plastics Materials and Synthetic Resins, Synthetic Rubber, Cellulosic and Other Manmade Fibers Except Glass
C5	2833-2836	Medicinal Chemicals and Botanical Products; Pharmaceutical Preparations; in vitro and in vivo Diagnostic Substances; and Biological Products, Except Diagnostic Substances
	2851	Paints, Varnishes, Lacquers, Enamels, and Allied Products

Table D-1. Sectors of Industrial Activity Covered by This Permit		
Subsector (May be subject to more than one sector/subsector)	SIC Code or Activity Code¹	Activity Represented
	2861-2869	Industrial Organic Chemicals
	2891-2899	Miscellaneous Chemical Products
	3952 (limited to list of inks and paints)	Inks and Paints, Including China Painting Enamels, India Ink, Drawing Ink, Platinum Paints for Burnt Wood or Leather Work, Paints for China Painting, Artist's Paints and Artist's Watercolors
	2911	Petroleum Refining
SECTOR D: ASPHALT PAVING AND ROOFING MATERIALS AND LUBRICANTS		
D1	2951, 2952	Asphalt Paving and Roofing Materials
D2	2992, 2999	Miscellaneous Products of Petroleum and Coal
SECTOR E: GLASS, CLAY, CEMENT, CONCRETE, AND GYPSUM PRODUCTS		
E1	3251-3259	Structural Clay Products
	3261-3269	Pottery and Related Products
E2	3271-3275	Concrete, Gypsum, and Plaster Products
E3	3211	Flat Glass
	3221, 3229	Glass and Glassware, Pressed or Blown
	3231	Glass Products Made of Purchased Glass
	3241	Hydraulic Cement
	3281	Cut Stone and Stone Products
	3291-3299	Abrasive, Asbestos, and Miscellaneous Nonmetallic Mineral Products
SECTOR F: PRIMARY METALS		
F1	3312-3317	Steel Works, Blast Furnaces, and Rolling and Finishing Mills
F2	3321-3325	Iron and Steel Foundries
F3	3351-3357	Rolling, Drawing, and Extruding of Nonferrous Metals
F4	3363-3369	Nonferrous Foundries (Castings)
F5	3331-3339	Primary Smelting and Refining of Nonferrous Metals
	3341	Secondary Smelting and Refining of Nonferrous Metals
	3398, 3399	Miscellaneous Primary Metal Products
SECTOR G: METAL MINING (ORE MINING AND DRESSING)		
G1	1021	Copper Ore and Mining Dressing Facilities
G2	1011	Iron Ores
	1021	Copper Ores
	1031	Lead and Zinc Ores
	1041, 1044	Gold and Silver Ores
	1061	Ferroalloy Ores, Except Vanadium
	1081	Metal Mining Services
	1094, 1099	Miscellaneous Metal Ores

Table D-1. Sectors of Industrial Activity Covered by This Permit		
Subsector (May be subject to more than one sector/subsector)	SIC Code or Activity Code¹	Activity Represented
SECTOR H: COAL MINES AND COAL MINING-RELATED FACILITIES		
H1	1221-1241	Coal Mines and Coal Mining-Related Facilities
SECTOR I: OIL AND GAS EXTRACTION AND REFINING		
I1	1311	Crude Petroleum and Natural Gas
	1321	Natural Gas Liquids
	1381-1389	Oil and Gas Field Services
SECTOR J: MINERAL MINING AND DRESSING		
J1	1442	Construction Sand and Gravel
	1446	Industrial Sand
J2	1411	Dimension Stone
	1422-1429	Crushed and Broken Stone, Including Rip Rap
	1481	Nonmetallic Minerals Services, Except Fuels
J3	1499	Miscellaneous Nonmetallic Minerals, Except Fuels
	1455, 1459	Clay, Ceramic, and Refractory Materials
J3	1474-1479	Chemical and Fertilizer Mineral Mining
	SECTOR K: HAZARDOUS WASTE TREATMENT, STORAGE, OR DISPOSAL FACILITIES	
K1	HZ	Hazardous Waste Treatment, Storage, or Disposal Facilities, including those that are operating under interim status or a permit under subtitle C of RCRA
SECTOR L: LANDFILLS, LAND APPLICATION SITES, AND OPEN DUMPS		
L1	LF	All Landfill, Land Application Sites and Open Dumps
L2	LF	All Landfill, Land Application Sites and Open Dumps, except Municipal Solid Waste Landfill (MSWLF) Areas Closed in Accordance with 40 CFR 258.60
SECTOR M: AUTOMOBILE SALVAGE YARDS		
M1	5015	Automobile Salvage Yards
SECTOR N: SCRAP RECYCLING FACILITIES		
N1	5093	Scrap Recycling and Waste Recycling Facilities except Source-Separated Recycling
N2	5093	Source-separated Recycling Facility
SECTOR O: STEAM ELECTRIC GENERATING FACILITIES		
O1	SE	Steam Electric Generating Facilities, including coal handling sites
SECTOR P: LAND TRANSPORTATION AND WAREHOUSING		
P1	4011, 4013	Railroad Transportation
	4111-4173	Local and Highway Passenger Transportation
	4212-4231	Motor Freight Transportation and Warehousing
	4311	United States Postal Service

Table D-1. Sectors of Industrial Activity Covered by This Permit		
Subsector (May be subject to more than one sector/subsector)	SIC Code or Activity Code¹	Activity Represented
	5171	Petroleum Bulk Stations and Terminals
SECTOR Q: WATER TRANSPORTATION		
Q1	4412-4499	Water Transportation Facilities
SECTOR R: SHIP AND BOAT BUILDING AND REPAIRING YARDS		
R1	3731, 3732	Ship and Boat Building or Repairing Yards
SECTOR S: AIR TRANSPORTATION FACILITIES		
S1	4512-4581	Air Transportation Facilities
SECTOR T: TREATMENT WORKS		
T1	TW	Treatment Works treating domestic sewage or any other sewage sludge or wastewater treatment device or system, used in the storage, treatment, recycling, and reclamation of municipal or domestic sewage, including land dedicated to the disposal of sewage sludge that are located within the confines of the facility, with a design flow of 1.0 mgd or more, or required to have an approved pretreatment program under 40 CFR Part 403. Not included are farm lands, domestic gardens or lands used for sludge management where sludge is beneficially reused and which are not physically located in the confines of the facility, or areas that are in compliance with section 405 of the CWA
SECTOR U: FOOD AND KINDRED PRODUCTS		
U1	2041-2048	Grain Mill Products
U2	2074-2079	Fats and Oils Products
U3	2011-2015	Meat Products
	2021-2026	Dairy Products
	2032-2038	Canned, Frozen, and Preserved Fruits, Vegetables, and Food Specialties
	2051-2053	Bakery Products
	2061-2068	Sugar and Confectionery Products
	2082-2087	Beverages
	2091-2099	Miscellaneous Food Preparations and Kindred Products
	2111-2141	Tobacco Products
SECTOR V: TEXTILE MILLS, APPAREL, AND OTHER FABRIC PRODUCT MANUFACTURING; LEATHER AND LEATHER PRODUCTS		
V1	2211-2299	Textile Mill Products
	2311-2399	Apparel and Other Finished Products Made from Fabrics and Similar Materials
	3131-3199	Leather and Leather Products (note: see Sector Z1 for Leather Tanning and Finishing)
SECTOR W: FURNITURE AND FIXTURES		
W1	2434	Wood Kitchen Cabinets
	2511-2599	Furniture and Fixtures

Table D-1. Sectors of Industrial Activity Covered by This Permit		
Subsector (May be subject to more than one sector/subsector)	SIC Code or Activity Code¹	Activity Represented
SECTOR X: PRINTING AND PUBLISHING		
X1	2711-2796	Printing, Publishing, and Allied Industries
SECTOR Y: RUBBER, MISCELLANEOUS PLASTIC PRODUCTS, AND MISCELLANEOUS MANUFACTURING INDUSTRIES		
Y1	3011	Tires and Inner Tubes
	3021	Rubber and Plastics Footwear
	3052, 3053	Gaskets, Packing and Sealing Devices, and Rubber and Plastic Hoses and Belting
	3061, 3069	Fabricated Rubber Products, Not Elsewhere Classified
Y2	3081-3089	Miscellaneous Plastics Products
	3931	Musical Instruments
	3942-3949	Dolls, Toys, Games, and Sporting and Athletic Goods
	3951-3955 (except 3952 – see Sector C)	Pens, Pencils, and Other Artists' Materials
	3961, 3965	Costume Jewelry, Costume Novelties, Buttons, and Miscellaneous Notions, Except Precious Metal
	3991-3999	Miscellaneous Manufacturing Industries
SECTOR Z: LEATHER TANNING AND FINISHING		
Z1	3111	Leather Tanning and Finishing
SECTOR AA: FABRICATED METAL PRODUCTS		
AA1	3411-3499 (except 3479)	Fabricated Metal Products, Except Machinery and Transportation Equipment, and Coating, Engraving, and Allied Services.
	3911-3915	Jewelry, Silverware, and Plated Ware
AA2	3479	Fabricated Metal Coating and Engraving
SECTOR AB: TRANSPORTATION EQUIPMENT, INDUSTRIAL OR COMMERCIAL MACHINERY		
AB1	3511-3599 (except 3571- 3579)	Industrial and Commercial Machinery, Except Computer and Office Equipment (see Sector AC)
	3711-3799 (except 3731, 3732)	Transportation Equipment Except Ship and Boat Building and Repairing (see Sector R)
SECTOR AC: ELECTRONIC, ELECTRICAL, PHOTOGRAPHIC, AND OPTICAL GOODS		
AC1	3571-3579	Computer and Office Equipment
	3812-3873	Measuring, Analyzing, and Controlling Instruments; Photographic and Optical Goods, Watches, and Clocks
	3612-3699	Electronic and Electrical Equipment and Components, Except Computer Equipment

Table D-1. Sectors of Industrial Activity Covered by This Permit		
Subsector (May be subject to more than one sector/subsector)	SIC Code or Activity Code¹	Activity Represented
SECTOR AD: NON-CLASSIFIED FACILITIES		
AD1		Other stormwater discharges designated by the Director as needing a permit (see 40 CFR 122.26(a)(9)(i)(C) & (D)) or any facility discharging stormwater associated with industrial activity not described by any of Sectors A-AC. NOTE: Facilities may not elect to be covered under Sector AD. Only the Director may assign a facility to Sector AD.

¹ A complete list of SIC Codes (and conversions from the newer North American Industry Classification System" (NAICS)) can be obtained from the Internet at www.census.gov/epcd/www/naics.html or in paper form from various locations in the document titled *Handbook of Standard Industrial Classifications*, Office of Management and Budget, 1987.

Appendix E
Procedures Relating to Endangered Species Protection

Appendix E. Procedures Relating to Endangered Species Protection

E.1 Assessing the Effects of Your Discharge and Discharge-Related Activities

You must follow the procedures in this appendix to assess the potential effects of applicable stormwater discharges, discharge-related activities, and allowable non-stormwater discharges on listed species and their critical habitat and determine which of the eligibility criterion (see Part E.2), if any, you qualify under. In accordance with Part 5.1.6.1 of this permit, you must keep documentation with your SWPPP to support your determination of eligibility under Part 1.1.4.5, including the process employed and results of the endangered species investigation.

If you are seeking renewal of coverage under the MSGP, you must complete this analysis using any data collected when your site was fully active and operational, even if you are now claiming that your site is inactive and no industrial materials or activities are exposed to stormwater. If no such data exist for your facility, you should utilize the best available information from any industrial facility(ies) expected to discharge substantially similar effluents, based on the similarities of the general industrial activity, control measures, and runoff coefficients of their drainage areas. You should contact EPA if you need assistance in obtaining data from a facility with a substantially similar effluent.

When evaluating the potential effects of your activities, you must consider effects to listed species or critical habitats within the “action area.” Action area is defined in Appendix B as all areas affected directly or indirectly by the stormwater discharges, allowable non-stormwater discharges, and stormwater discharge-related activities, and not merely the immediate area involved in these discharges and activities. This includes areas beyond the footprint of the facility that are likely to be affected by stormwater discharges, discharge-related activities, and allowable non-stormwater discharges. For example, normal construction, operations and maintenance activities can result in noise impacts and discharges of pollutants into downstream areas which can increase the “action area” beyond the footprint of the facility. “Facility” is defined in Appendix A.

Step One: *Determine if the Eligibility Requirements of Criterion B, C, or F Can Be Met.*

You should first determine whether you are eligible under Criteria B, C, or F because of a previously completed ESA section 7 consultation, a previously issued ESA Section 10 permit, or because your activities were already addressed in another discharger’s certification of eligibility as follows:

- i. The effects of your activities have been addressed in a consultation under ESA Section 7 on a separate Federal action (check box B corresponding to Criterion B).
- ii. The effects of your activities have been addressed through approval of a Habitat Conservation Plan under Section 10 of the ESA (check box C corresponding to Criterion C). Stormwater discharges from your industrial facility may be

authorized by this MSGP if some activity is authorized through the issuance of a permit under section 10 of the ESA and that authorization addressed the effects of your stormwater discharges on federally-listed species and designated critical habitat. You must follow U.S. Fish and Wildlife Service (FWS) and/or National Marine Fisheries Service, also known as NOAA Fisheries (NMFS) procedures when applying for an ESA Section 10 permit (see 50 CFR 17.22(b)(1) for FWS and 222.22 for NMFS). Application instructions for section 10 permits for FWS and NMFS can be obtained by accessing the FWS and NMFS websites (www.fws.gov and www.nmfs.noaa.gov) or by contacting the appropriate FWS and NMFS regional office.

- iii. You are covered under the eligibility certification of another operator for the project area (check box F corresponding to Criterion F). Your stormwater discharges, discharge-related activities, and allowable non-stormwater discharges were already addressed in another discharger's certification of eligibility under Criteria A, B, C, D, or E, which also included your facility and determined that federally listed endangered or threatened species or designated critical habitat would not be jeopardized. To certify eligibility under this criterion there must be no lapse of coverage in the other operator's certification. By certifying eligibility under Criterion F, you agree to comply with any measures or controls upon which the other discharge certification under Criterion B, C, or D was based. If your certification is based on another operator's certification under Criterion E, that certification is valid only if you have documentation showing that the other operator had certified under Criterion E, and you provide EPA with the relevant supporting information in your NOI form. Certification under Criterion F is discussed in more detail in the Fact Sheet that accompanies this permit.

Step Two: *Determine if Listed Threatened or Endangered Species and Critical Habitat are Present in the Action Area.*

Next, you should first determine whether federally-listed species are likely to occur in your action area. If you determine that there is a federally-listed species likely to occur in your action area, follow Step 3. If you determine that there are no federally-listed species likely to occur in your action area, you can certify that the facility meets Criteria A (check box A corresponding to Criteria A).

You can do this by obtaining a list of threatened and endangered species that are likely to occur in your general area, including the appropriate receiving water for your discharges. County-specific or sometimes township-specific lists of Federally threatened and endangered species are available from the local offices of FWS, and NMFS, or on their internet sites. The types of species that are likely to be present determine which Service office you should contact (in general, NMFS has jurisdiction over marine, estuarine, and anadromous species). Visit www.epa.gov/npdes/stormwater/cgp to find the appropriate site for your state or check with your local Service office. If there are listed species in your county or township, you must then determine, as best you are able, whether any of the species are likely to occur in your action area

(use the Services or State and Tribal Heritage Centers, as necessary). General species information can be found at www.fws.gov/endangered.wildlife.html.

You must also check to see if critical habitat has been designated and whether such areas overlap your action area. Critical habitat should be listed on the species list for your county or township available from the appropriate Service office. You can also find critical habitat designations at 50 CFR Parts 17 and 226 www.access.gpo.gov and at www.fws.gov/endangered/wildlife.html.

If there are no listed species and no critical habitat areas that overlap your action area, or if your local FWS or NMFS indicates that listed species are not likely to occur in your action area, you have satisfied your eligibility obligations under Criterion A (check box A on the Notice of Intent Form). If there are listed species and if you determine or your local FWS, NMFS, or State or Tribal Heritage Center indicates that these species could occur in the action area, you will need to evaluate whether your action area supports habitat(s) that are suitable for listed species or the constituent elements of critical habitat. Your evaluation may utilize one or more of the following approaches:

Gather information about the species and critical habitat that are likely to occur in your action area (www.fws.gov/endangered/wildlife.html). Conduct a visual inspection of the action area to assess the potential presence of listed species and their habitats. Compare the size and types of habitats available in your action area and adjacent areas with the size and types of habitats used by listed species and constituent elements of critical habitat. This method may be particularly suitable for facilities where the action area is smaller in size or located in non-natural settings such as highly urbanized areas or industrial parks where there is little or no natural habitat, or for facilities that discharge directly into municipal separate storm sewer systems.

Conduct a formal biological survey (typically performed by environmental consulting firms). In some cases, biological surveys may be an appropriate way to assess whether species are likely to be located in the action area and whether there could be adverse effects to such species. A biological survey may in some cases be useful in conjunction with Steps Two, Three or Four of these instructions. However, biological surveys can often be inconclusive and some survey methods may require a special State or Federal permit. You should coordinate with the appropriate Service office before conducting biological surveys for threatened and endangered species.

Reference an environmental assessment completed for the site under the National Environmental Policy Act (NEPA). Such assessments may indicate whether listed species and critical habitats are likely to occur in the action area. Coverage under this MSGP may trigger a requirement for such an assessment for new sources (that is, dischargers subject to New Source Performance Standards under section 306 of the Clean Water Act). Other facilities might require an assessment under NEPA for other reasons, such as federal funding or other federal involvement in the facility. If the action area likely supports listed threatened or endangered species or critical habitat, you must evaluate the potential for impacts to species and/or habitat when following Steps Three through Five. Note that many but not all measures implemented to protect listed species under these steps will also protect critical habitat. Thus, meeting the

eligibility requirements of this MSGP may require measures to protect critical habitat that are separate from those to protect listed species.

Step Three: *Determine if your Activities Are Not Likely to Adversely Affect Listed Threatened or Endangered Species or Designated Critical Habitat*

To receive MSGP coverage, you must analyze the effects of your activities, which may include not only your discharge, but also any construction, operation, and maintenance activities related to stormwater management. You must be able to conclude that your discharge and stormwater management related activities are not likely to adversely affect threatened or endangered species or designated critical habitat that are likely to occur in your action area. To arrive at this conclusion, you should be able to conclude that listed species and critical habitat are not likely to be exposed to the effects of your activities, or if they are exposed, they are not likely to respond to the effects, or if they do respond, the responses are not sufficient to reduce an individual's chances of surviving and reproducing or diminish the amount or suitability of constituent elements of critical habitat. Construction, operation, and maintenance of facilities related to your stormwater discharge can potentially result in the following adverse effects:

- **Hydrological.** Stormwater discharges may adversely affect receiving waters from pollutant parameters such as temperature, salinity or pH. These effects will vary with the amount of stormwater discharged and the volume and condition of the receiving water. Where a stormwater discharge constitutes a minute portion of the total volume of the receiving water, adverse hydrological effects are less likely. Industrial activity itself may also alter drainage patterns on a site where construction occurs, which can impact listed species, their habitat, and critical habitat.
- **Habitat.** Outdoor activities, such as storage of materials and land disturbances associated with stormwater management-related activities, such as the installation or placement of stormwater control measures, may adversely affect listed species, their habitat, and critical habitat. Stormwater may drain or inundate listed species habitat.
- **Toxicity.** Pollutants in stormwater may have toxic effects on listed species and adversely affect critical habitat. Exceedances of benchmarks, effluent limitation guidelines, or State or Tribal water quality requirements may be indicative of potential adverse effects on listed species or critical habitat.

The scope of effects to consider will vary with each site. If you are having difficulty determining whether your facility is likely to adversely affect listed species or critical habitat, or one of the Services has already raised concerns to you, you must contact the appropriate office of the FWS or NMFS for assistance. If adverse effects are not likely, you have satisfied your eligibility obligations under Criterion E and you may proceed to submitting your NOI for coverage under the MSGP (check box E corresponding to Criterion E). As part of certifying your compliance with Criterion E, you must submit information to support your findings. If you are an existing discharger, you are required to (1) identify any pollutant parameters for which you have ever exceeded the benchmark or effluent limitations guideline, or have ever been found to have caused or contributed to an exceedance of an applicable water quality standard, or

violated a State or Tribal water quality requirement; (2) provide a list of the federally-listed threatened or endangered species or their designated critical habitat that are likely to occur in the action area; and (3) provide your rationale supporting your determination that you qualify under Criterion E. If you are a new discharger, you must provide the list of species or critical habitat and the technical evaluation (described in (2) and (3) above, respectively), and you must also include a list of the potential pollutants in your discharge.

If you can not yet conclude your stormwater discharge is not likely to adversely affect listed species or critical habitat, or if you conclude that your stormwater discharge could potentially adversely affect listed species or critical habitat, you must follow Step Four.

Step Four: *Determine if Measures Can Be Implemented to Avoid Adverse Effects or If Further Analysis Supports the Conclusion that Adverse Effects Are Not Likely.*

If you could not make a preliminary determination in Step 3 that adverse effects to listed species and/or critical habitat are not likely to occur, you can still receive coverage under Criterion E if appropriate measures are undertaken to avoid or eliminate the likelihood of adverse effects prior to applying for MSGP coverage. These measures may be relatively simple, e.g., re-routing a stormwater discharge to bypass an area where species are located, relocating control measures, or changing the “footprint” of the industrial activity. Provided you are able to install and implement appropriate measures, you may proceed to submitting your NOI for coverage under the MSGP (check box E corresponding to Criterion E). As part of certifying your compliance with Criterion E, you must submit information to support your findings. If you are an existing discharger, you are first required to (1) identify any pollutant parameters for which you have ever exceeded a benchmark or an effluent limitations guideline, or have ever been found to have caused or contributed to an exceedance of an applicable water quality standard, or violated a State or Tribal water quality requirement; (2) provide a list of the federally-listed threatened or endangered species or their designated critical habitat that are likely to occur in the action area; and (3) provide your rationale supporting your determination that you qualify under Criterion E, including a description of measures you will implement to avoid or eliminate the likelihood of adverse effects. If you are a new discharger, you must provide the list of species or critical habitat and the technical evaluation (described in (2) and (3) above, respectively), and you must also include a list of the potential pollutants in your discharge.

If you cannot ascertain which measures to implement to avoid the likelihood of adverse effects, you must follow Step Five.

Step Five: *Determine if the Eligibility Requirements of Criteria D Can Be Met.*

Where adverse effects are likely and you are unable to avoid or eliminate the likelihood of adverse effects, you must contact the FWS and/or NMFS. However, you may still be eligible for MSGP coverage if any likely adverse effects can be addressed through meeting Criteria D as follows:

You have coordinated your activities with the appropriate Service office (see Criterion D). In the absence of any other conditions set forth in Step Four, you may still be able to

qualify for coverage under this MSGP if you coordinate with the FWS or NMFS and the Service provides a letter or memorandum concluding that permitting your stormwater discharges under the MSGP is consistent with the “not likely to adversely affect” determination for the MSGP. If you adopt measures to avoid or eliminate adverse effects, per the Service’s requirements or recommendations, you must abide by those measures for the duration of your coverage under the MSGP. Any such measures must be described in the Stormwater Pollution Prevention Plan and are enforceable MSGP conditions and/or conditions for meeting the eligibility criteria in Part 1.1.4.5.

You must comply with any terms and conditions imposed under the eligibility requirements to ensure that your stormwater discharges, discharge-related activities, and allowable non-stormwater discharges are protective of listed species and/or critical habitat. See Part 2.3 of the permit. If the eligibility requirements cannot be met, and maintained, then you are not eligible for coverage under this MSGP. In these instances, you may consider applying to EPA for an individual permit.

E.2 Eligibility Criterion

As required by Part 1.1.4.5, you must meet one or more of the following six criteria (A-F) to be eligible for coverage under the permit for your stormwater discharge, discharge-related activities, and allowable non-stormwater discharges:

- Criterion A. No federally-listed threatened or endangered species or their designated critical habitat are likely to occur in the “action area”; or
- Criterion B. Consultation between a Federal agency and the U.S. Fish and Wildlife Service and/or the National Marine Fisheries Service (together, the “Services”) under section 7 of the ESA has been concluded. Consultations can be either formal or informal, and would have occurred only as a result of a separate federal action (e.g., during application for an individual wastewater discharge permit or the issuance of a wetlands dredge and fill permit).

The consultation must have addressed the effects of your facility’s stormwater discharges, allowable non-stormwater discharges, and stormwater discharge-related activities on federally-listed threatened or endangered species and federally-designated critical habitat, and must have resulted in either:

- i. a biological opinion finding no jeopardy to federally-listed species or destruction/adverse modification of federally-designated critical habitat; or
- ii. written concurrence from the Service(s) with a finding that the facility’s stormwater discharges associated with industrial activity, discharge-related activities and allowable non-stormwater discharges are not likely to adversely affect federally-listed species or federally-designated critical habitat; or

- Criterion C. Your industrial activities are authorized through the issuance of a permit under section 10 of the ESA, and authorization addresses the effects of the stormwater discharges associated with industrial activity, discharge-related activities, and allowable non-stormwater discharges on federally-listed species and federally-designated critical habitat; or
- Criterion D. Coordination between you and the U.S. Fish and Wildlife Service and/or the National Marine Fisheries Service has been concluded. The coordination must have addressed the effects of the facility's stormwater discharges associated with industrial activity, discharge-related activities, and allowable non-stormwater discharges on federally-listed threatened or endangered species and federally-designated critical habitat. The result of the coordination must be a written statement from the Service concluding that authorizing your stormwater discharges, discharge-related activities, and allowable non-stormwater discharges is consistent with the determination that the issuance of the MSGP is not likely to adversely affect federally-listed threatened or endangered species and federally-designated critical habitat. Any conditions or prerequisites deemed necessary to achieve consistency with the "not likely to adversely effect" determination become eligibility conditions for MSGP coverage, and permit requirements under Part 2.3; or
- Criterion E. Authorizing your stormwater discharges associated with industrial activity, discharge-related activities, and allowable non-stormwater discharges is consistent with the determination that the issuance of the MSGP is not likely to adversely affect any federally-listed endangered and threatened ("listed") species or designated critical habitat ("critical habitat"). To support your determination that you meet Criterion E, you must provide supporting documentation for your determination.
- i. If you are an existing discharger, you must provide the following information with your completed Notice of Intent (NOI) form: (1) a list of the federally-listed threatened or endangered species or their designated critical habitat that are likely to occur in the "action area"; (2) a list of the pollutant parameters for which you have ever exceeded the benchmark or applicable effluent limitations guideline, or for which you have ever been found to have caused or contributed to an exceedance of an applicable water quality standard or to have violated a State or Tribal water quality requirement (Part 9); and (3) your rationale supporting your determination that you meet Criterion E, including appropriate measures to be undertaken to avoid or eliminate the likelihood of adverse effects.
 - ii. If you are a new discharger, you must provide the following information with your completed NOI form: (1) a list of the federally-listed threatened or endangered species or their designated critical habitat that are likely to occur in the "action area"; (2) a list of the potential pollutants in your discharge; and (3) your rationale supporting your determination that you meet Criterion E, including

appropriate measures to be undertaken to avoid or eliminate the likelihood of adverse effects; or

- Criterion F. The facility's stormwater discharges associated with industrial activity, discharge-related activities, and allowable non-stormwater discharges were already addressed in another operator's valid certification of eligibility that included the industrial activities and there is no reason to believe that federally-listed species or federally-designated critical habitat not considered in the prior certification may be present or located in the "action area". To certify eligibility under this criterion there must be no lapse of coverage in the other operator's certification. By certifying eligibility under this criterion, you agree to comply with any measures or controls upon which the other operator's certification was based. You must comply with any applicable terms, conditions, or other requirements developed in the process of meeting the eligibility requirements of the criteria in this section to remain eligible for coverage under this permit. Documentation must be kept with your SWPPP. If your certification is based on another operator's certification under Criterion E, that certification is valid only if you have documentation showing that the other operator had certified under Criterion E, and you provide EPA with the relevant supporting information required of existing dischargers in Criterion E (above, under subparagraph (i)) in your NOI form.

Appendix F
Procedures Relating to Historic Properties Preservation

Appendix F – Procedures Relating to Historic Properties Preservation

Section 106 of the National Historic Preservation Act (NHPA) requires Federal agencies to take into account the effects of Federal “undertakings” on historic properties that are either listed on, or eligible for listing on, the National Register of Historic Places. The term Federal “undertaking” is defined in the NHPA regulations to include a project, activity, or program of a Federal agency including those carried out by or on behalf of a Federal agency, those carried out with Federal financial assistance, and those requiring a Federal permit, license or approval. See 36 CFR 800.16(y). Historic properties are defined in the NHPA regulations to include prehistoric or historic districts, sites, buildings, structures, or objects that are included in, or are eligible for inclusion in, the National Register of Historic Places. This term includes artifacts, records, and remains that are related to and located within such properties. See 36 CFR 800.16(1).

EPA’s issuance of the Multi-Sector General Permit is a Federal undertaking within the meaning of the NHPA regulations. To address any issues relating to historic properties in connection with issuance of the permit, EPA has included criteria for applicants to certify that potential impacts of their covered activities on historic properties have been appropriately considered and addressed. Although individual applications for coverage under the general permit do not constitute separate Federal undertakings, the screening criteria and certifications provide an appropriate site-specific means of addressing historic property issues in connection with EPA’s issuance of the permit. Applicants seeking coverage under the MSGP are thus required to make certain certifications regarding the potential effects of their stormwater discharge, allowable non-stormwater discharge, and discharge-related activities on properties listed or eligible for listing on the National Register of Historic Places.

You must meet one or more of the four criteria (A-D), which are also included in Part 1.1.4.6, to be eligible for coverage under this permit.

- Criterion A. Your stormwater discharges and allowable non-stormwater discharges do not have the potential to have an effect on historic properties and you are not constructing or installing new stormwater control measures on your site that cause subsurface disturbance; or
- Criterion B. Your discharge-related activities (i.e., construction and/or installation of stormwater control measures that involve subsurface disturbance) will not affect historic properties; or
- Criterion C. Your stormwater discharges, allowable non-stormwater discharges, and discharge-related activities have the potential to have an effect on historic properties, and you have obtained and are in compliance with a written agreement with the State Historic Preservation Officer (SHPO), Tribal Historic Preservation Officer (THPO), or other tribal representative regarding measures to mitigate or prevent any adverse effects on historic properties, and you have either (1) obtained and are in compliance with a written agreement that outlines all such measures, or (2) been unable to reach agreement on such measures; or

Criterion D. You have contacted the State Historic Preservation Officer, Tribal Historic Preservation Officer, or other tribal representative and EPA in writing informing them that you have the potential to have an effect on historic properties and you did not receive a response from the SHPO, THPO, or tribal representative within 30 days of receiving your letter.

If you have been unable to reach agreement with a SHPO, THPO, or other tribal representative regarding appropriate measures to mitigate or prevent adverse effects, EPA may notify you of additional measures you must implement in order to be eligible for coverage under this permit.

Activities with No Potential to Have an Effect on Historic Properties

A determination that a Federal undertaking has no potential to have an effect on historic properties fulfills an agency's obligations under the NHPA. EPA has reason to believe that the vast majority of activities authorized under the MSGP have no potential to have effects on historic properties. The purpose of this permit is to control pollutants that may be transported in stormwater runoff from industrial facilities. EPA does not anticipate effects on historic properties from the pollutants in the stormwater and allowable non-stormwater discharges from these industrial facilities. Thus, to the extent EPA's issuance of this general permit authorizes discharges of such constituents, confined to existing stormwater channels or natural drainage areas; the permitting action does not have the potential to cause effects on historic properties.

In addition, the overwhelming majority of sources covered under this permit will be facilities that are seeking renewal of previous permit coverage. These existing dischargers should have already addressed NHPA issues in the 2000 MSGP as they were required to certify that they were either not affecting historic properties or they had obtained written agreement from the applicable State Historic Preservation Officer (SHPO) or Tribal Historic Preservation Officer (THPO) regarding methods of mitigating potential impacts. Both existing and new dischargers must follow the historic property screening procedures to determine their eligibility. EPA is not aware of any impacts on historic properties from activities covered under the 2000 MSGP, or, for that matter, any need for a written agreement. Therefore, to the extent this permit authorizes renewal of prior coverage without relevant changes in operations, it has no potential to have an effect on historic properties.

Activities with Potential to Have an Effect on Historic Properties

EPA believes this permit may have some potential to have an effect on historic properties where permittees construct and/or install stormwater control measures that involve subsurface disturbance and impact less than one (1) acre of land to comply with this permit. (Ground disturbances of one (1) acre or more require coverage under a different permit, the Construction General Permit.) Where you have to disturb the land through the construction and/or installation of control measures, there is a possibility that artifacts, records, or remains associated with historic properties could be impacted. Therefore, if you are establishing new or altering existing control measures to manage your stormwater that will involve subsurface ground disturbance of less than one (1) acre, you will need to ensure (1) that historic properties will not be impacted by

your activities or (2) that you have consulted with the appropriate SHPO, THPO, or other tribal representative regarding measures that would mitigate or prevent any adverse effects on historic properties.

Examples of Control Measures Which Involve Subsurface Disturbance

EPA reviewed typical control measures currently employed to determine which practices involve some level of earth disturbance. The types of control measures that are presumptively expected to cause subsurface ground disturbance include:

- Dikes
- Berms
- Catch Basins
- Ponds
- Ditches
- Trenches
- Culverts
- Land manipulation: contouring, sloping, and grading
- Channels
- Perimeter Drains
- Swales

EPA cautions dischargers that this list is non-inclusive. Other control measures that involve earth disturbing activities that are not on this list must also be examined for the potential to affect historic properties.

Historic Property Screening Process

You should follow the following screening process in order to certify your compliance with historic property eligibility requirements under this permit (see Part 1.1.4.6). The following four steps describe how applicants can meet the permit eligibility criteria for protection of historic properties under this permit:

Step One: *Are you an existing facility that is reapplying for certification under the 2008 MSGP?*

If you are an existing facility you should have already addressed NHPA issues. To gain coverage under the 2000 MSGP you were required to certify that you were either not affecting historic properties or had obtained written agreement from the relevant SHPO or THPO regarding methods of mitigating potential impacts. As long as you are not constructing or installing any new stormwater control measures then you have met eligibility Criterion A of the MSGP. After you submit your NOI, there is a 30-day waiting period during which the SHPO, THPO, or other tribal representative may review your NOI. The SHPO, THPO, or other tribal representative may request that EPA hold up authorization based on concerns about potential adverse impacts to historic properties. EPA will evaluate any such request and notify you if any additional measures to address adverse impacts to historic properties are necessary.

If you are an existing facility and will construct or install stormwater control measures that require subsurface disturbance of less than one (1) acre then you should proceed to Step Three. (Note: Construction activities disturbing one (1) acre or more are not eligible for coverage under this permit.)

If you are a new facility then you should proceed to Step Two.

Step Two: *Are you constructing or installing any stormwater control measures that require subsurface disturbance of less than one (1) acre?*

If, as part of your coverage under this permit, you are not building or installing control measures on your site that cause less than one (1) acre of subsurface disturbance, then your discharge-related activities do not have the potential to have an effect on historic properties. You have no further obligations relating to historic properties. You have met eligibility Criterion A of the MSGP. After you submit your NOI, there is a 30-day waiting period during which the SHPO, THPO, or other tribal representative may review your NOI. The SHPO, THPO, or other tribal representative may request that EPA hold up authorization based on concerns about potential adverse impacts to historic properties. EPA will evaluate any such request and notify you if any additional measures to address adverse impacts to historic properties are necessary.

If the answer to the Step Two question is yes, then you should proceed to Step Three.

Step Three: *Have prior earth disturbances determined that historic properties do not exist, or have prior disturbances precluded the existence of historic properties?*

If previous construction either revealed the absence of historic properties or prior disturbances preclude the existence of historic properties, then you have no further obligations relating to historic properties. You have met eligibility Criterion B of the MSGP. After you submit your NOI, there is a 30-day waiting period during which the SHPO, THPO, or other tribal representative may review your NOI. The SHPO, THPO, or other tribal representative may request that EPA hold up authorization based on concerns about potential adverse impacts to historic properties. EPA will evaluate any such request and notify you if any additional measures to address adverse impacts to historic properties are necessary.

If the answer to the Step Three question is no, then you should proceed to Step Four.

Step Four: *Contact the appropriate historic preservation authorities*

Where you are building and/or installing control measures affecting less than one (1) acre of land to control stormwater or allowable non-stormwater discharges associated with this permit, and the answer to Step Three is no, then you should contact the relevant SHPO, THPO, or other tribal representative to determine the likelihood that artifacts, records, or remains are potentially present on your site. This may involve examining local records to determine if historic artifacts have been found in nearby areas, as well as limited surface and subsurface examination carried out by qualified professionals.

If through this process it is determined that such historic properties potentially exist and may be impacted by your construction or installation of control measures, you should contact the relevant SHPO, THPO, or tribal representative in writing and request to discuss mitigation or prevention of any adverse effects. The letter should describe your facility, the nature and location of subsurface disturbance activities that are contemplated, any known or suspected historic properties in the area, and any anticipated effects on such properties. The letter should state that if the SHPO, THPO, or tribal representative does not respond within 30 days of receiving your letter, you may submit your NOI without further consultation. EPA encourages applicants to contact the appropriate authorities as soon as possible in the event of a potential adverse effect to an historic property.

If the SHPO, THPO, or tribal representative sent you a response within 30 days of receiving your letter and you enter into, and comply with, a written agreement with the SHPO, THPO, or other tribal representative regarding how to address any adverse impacts on historic properties, you have met eligibility Criterion C. In this case, you should retain a copy of the written agreement consistent with Part 5.1.6.2 of the MSGP. After you submit your NOI, there is a 30-day waiting period during which the SHPO, THPO, or other tribal representative may review your NOI. The SHPO, THPO, or other tribal representative may request that EPA delay authorization based on concerns about potential adverse impacts to historic properties. However, EPA would generally accept any written agreement as fully addressing such concerns unless new information was brought to the Agency's attention that was not considered in your previous discussions with the SHPO, THPO or other tribal representative.

If you receive a response within 30 days after the SHPO, THPO, or tribal representative received your letter and you consult with the SHPO, THPO or tribal representative regarding adverse impacts to historic properties and measures to mitigate them but an agreement cannot be reached between you and the SHPO, THPO, or other tribal representative, you have still met the eligibility for Criterion C. In this case you should include in your SWPPP a brief description of potential effects to historic properties, the consultation process, any measures you will adopt to address the potential adverse impacts, and any significant remaining disagreements between you and the SHPO, THPO or other tribal representative. After you submit your NOI, there is a 30-day waiting period during which the SHPO, THPO, or other tribal representative may review your NOI. The SHPO, THPO, or other tribal representative may request that EPA delay authorization based on concerns about potential adverse impacts to historic properties. EPA will evaluate any such request and notify you if any additional measures to address adverse impacts to historic properties are necessary.

If you have contacted the SHPO, THPO, or tribal representative in writing regarding your potential to have an effect on historic properties and the SHPO, THPO, or tribal representative did not respond within 30 days of receiving your letter, you have met eligibility Criterion D. You are advised to get a receipt from the post office or other carrier confirming the date on which your letter was received. In this case, you should submit a copy of your letter notifying the SHPO, THPO or tribal representative of potential impacts with your NOI. After you submit your NOI, there is a 30-day waiting period during which the SHPO, THPO, or other tribal representative may review your NOI. The SHPO, THPO, or other tribal representative may

request that EPA hold up authorization based on concerns about potential adverse impacts to historic properties. EPA will evaluate any such request and notify you if any additional measures to address adverse impacts to historic properties are necessary.

Addresses for State Historic Preservation Officers and Tribal Historic Preservation Officers may be found on the Advisory Council on Historic Preservation's website (www.achp.gov/programs.html). In instances where a Tribe does not have a Tribal Historic Preservation Officer, you should contact the appropriate Tribal government office when responding to this permit eligibility condition.

**Appendix G
Notice of Intent (NOI) Form**

Appendix G –Notice of Intent (NOI) Form

To obtain coverage under this permit, you must submit a Notice of Intent (NOI). You must submit an NOI using either (1) EPA's Electronic Notice of Intent (eNOI) system, available at www.epa.gov/npdes/eNOI, or (2) file a paper copy of the NOI, a copy of which follows.

D. Discharge information

1. Does your facility discharge stormwater into a Municipal Separate Storm Sewer System (MS4)? YES NO

If yes, name of MS4 operator: _____

2. Receiving Waters and Wetlands (**Note:** If additional space is needed for this question, fill out Attachment 1.)

a. What is the name(s) of your receiving water(s) that receive stormwater directly and/or through an MS4? If your receiving water is impaired then identify the name of the impaired segment, if applicable, in parentheses following the receiving water name.	b. Are any of your discharges directly into any segment of an "impaired" water?	If you answered yes to question D.2.b, then answer the following three questions:		
		b.1. What pollutant(s) are causing the impairment?	b.2. Are the pollutant(s) causing the impairment present in your discharge?	b.3. Has a TMDL been completed for the pollutant(s) causing the impairment?
	<input type="checkbox"/> YES <input type="checkbox"/> NO		<input type="checkbox"/> YES <input type="checkbox"/> NO	<input type="checkbox"/> YES <input type="checkbox"/> NO
	<input type="checkbox"/> YES <input type="checkbox"/> NO		<input type="checkbox"/> YES <input type="checkbox"/> NO	<input type="checkbox"/> YES <input type="checkbox"/> NO
	<input type="checkbox"/> YES <input type="checkbox"/> NO		<input type="checkbox"/> YES <input type="checkbox"/> NO	<input type="checkbox"/> YES <input type="checkbox"/> NO
	<input type="checkbox"/> YES <input type="checkbox"/> NO		<input type="checkbox"/> YES <input type="checkbox"/> NO	<input type="checkbox"/> YES <input type="checkbox"/> NO
	<input type="checkbox"/> YES <input type="checkbox"/> NO		<input type="checkbox"/> YES <input type="checkbox"/> NO	<input type="checkbox"/> YES <input type="checkbox"/> NO
	<input type="checkbox"/> YES <input type="checkbox"/> NO		<input type="checkbox"/> YES <input type="checkbox"/> NO	<input type="checkbox"/> YES <input type="checkbox"/> NO
	<input type="checkbox"/> YES <input type="checkbox"/> NO		<input type="checkbox"/> YES <input type="checkbox"/> NO	<input type="checkbox"/> YES <input type="checkbox"/> NO
	<input type="checkbox"/> YES <input type="checkbox"/> NO		<input type="checkbox"/> YES <input type="checkbox"/> NO	<input type="checkbox"/> YES <input type="checkbox"/> NO
	<input type="checkbox"/> YES <input type="checkbox"/> NO		<input type="checkbox"/> YES <input type="checkbox"/> NO	<input type="checkbox"/> YES <input type="checkbox"/> NO
	<input type="checkbox"/> YES <input type="checkbox"/> NO		<input type="checkbox"/> YES <input type="checkbox"/> NO	<input type="checkbox"/> YES <input type="checkbox"/> NO
	<input type="checkbox"/> YES <input type="checkbox"/> NO		<input type="checkbox"/> YES <input type="checkbox"/> NO	<input type="checkbox"/> YES <input type="checkbox"/> NO
	<input type="checkbox"/> YES <input type="checkbox"/> NO		<input type="checkbox"/> YES <input type="checkbox"/> NO	<input type="checkbox"/> YES <input type="checkbox"/> NO
	<input type="checkbox"/> YES <input type="checkbox"/> NO		<input type="checkbox"/> YES <input type="checkbox"/> NO	<input type="checkbox"/> YES <input type="checkbox"/> NO

3. Water Quality Standards (for new dischargers only)

- a. Are any of your discharges into any portion of a receiving water designated by the state or tribal authority under its antidegradation policy as a Tier 2 (or Tier 2.5) water (water quality exceeds levels necessary to support propagation of fish, shellfish, and wildlife and recreation in and on the water)? YES NO
- b. Has the receiving water(s) been designated by the state or tribal authority under its antidegradation policy as a Tier 3 water (Outstanding Natural Resource Water)? YES NO

4. Federal Effluent Limitation Guidelines and Sector-Specific Requirements

- a. Are you requesting permit coverage for any stormwater discharges subject to effluent limitation guidelines? YES NO
- b. If yes, which effluent limitation guidelines apply to your stormwater discharges?

40 CFR Part/Subpart	Eligible Discharges	Affected MSGP Sector	Check if Applicable
Part 411, Subpart C	Runoff from material storage piles at cement manufacturing facilities	E	<input type="checkbox"/>
Part 418 Subpart A	Runoff from phosphate fertilizer manufacturing facilities that comes into contact with any raw materials, finished product, by-products or waste products (SIC 2874)	C	<input type="checkbox"/>
Part 423	Coal pile runoff at steam electric generating facilities	O	<input type="checkbox"/>
Part 429, Subpart I	Discharges resulting from spray down or intentional wetting of logs at wet deck storage areas	A	<input type="checkbox"/>
Part 436, Subpart B, C, or D	Mine dewatering discharges at crushed stone mines, construction sand and gravel mines, or industrial sand mines	J	<input type="checkbox"/>
Part 443, Subpart A	Runoff from asphalt emulsion facilities	D	<input type="checkbox"/>
Part 445, Subparts A & B	Runoff from hazardous waste and non-hazardous waste landfills	K, L	<input type="checkbox"/>

c. If you are a Sector S (Air Transportation) facility, do you anticipate using more than 100,000 gallons of glycol-based deicing/anti-icing chemicals and/or 100 tons or more of urea on an average annual basis? YES NO

5. Identify the 4-digit Standard Industrial Classification (SIC) code or 2-letter Activity Code that best represents the products produced or services rendered for which your facility is primarily engaged, as defined in MSGP:

Primary SIC Code: OR Primary Activity Code

6. Identify the applicable sector(s) and subsector(s) of industrial activity, including co-located industrial activity, for which you are requesting permit coverage:

- a. Sector Subsector
- b. Sector Subsector
- c. Sector Subsector
- d. Sector Subsector
- e. Sector Subsector
- f. Sector Subsector

7.a. Is your site presently inactive and unstaffed? YES NO

b1. If yes, is your site expected to be inactive and unstaffed for the entire permit term? YES NO

b2. If you select "no" in 7.b1 above, then indicate the length of time that you expect your facility to be inactive and unstaffed _____

Instructions for Completing the Notice of Intent for Stormwater Discharges Associated with INDUSTRIAL ACTIVITY under the Multi-Sector General Permit (MSGP)

NOI Submittal Deadlines/Discharge Authorization Dates		
Category	NOI Deadline	Discharge Authorization Date ¹
Existing Dischargers - in operation as of October 30, 2005 and authorized for coverage under MSGP 2000.	No later than January 5, 2009.	30 days after EPA posts your NOI. Your authorization under the MSGP 2000 is automatically continued until you have been granted coverage under this permit or an alternative permit, or coverage is otherwise terminated.
New Dischargers or New Sources - have commenced discharging between October 30, 2005 and January 5, 2009.	As soon as possible but no later than January 5, 2009.	30 days after EPA posts your NOI.
New Dischargers or New Sources - commence discharging after January 5, 2009.	A minimum of 60 days prior to commencing operation of the facility, or a minimum of 30 days if your SWPPP is posted on the Internet during this period and the Internet address (i.e., URL) to your SWPPP is provided on the NOI form.	If you post your SWPPP on the Internet, 30 days after EPA posts your NOI. Otherwise, 60 days after EPA posts your NOI.
New Owner/Operator of Existing Discharger - transfer of ownership and/or operation of a facility whose discharge is authorized under this permit	A minimum of 30 days prior to date that the transfer will take place to the new owner/operator.	30 days after EPA posts your NOI.
Other Eligible Dischargers - in operation prior to October 30, 2005 but not covered under the MSGP 2000 or another NPDES permit.	Immediately, to minimize the time discharges from the facility will continue to be unauthorized.	If you post your SWPPP on the Internet, 30 days after EPA posts your NOI. Otherwise, 60 days after EPA posts your NOI.

¹ Based on a review of your NOI or other information, EPA may delay your authorization for further review, notify you that additional effluent limitations are necessary, or may deny coverage under this permit and require submission of an application for an individual NPDES permit, as detailed in MSGP Part 1.6. In these instances, EPA will notify you in writing of the delay or the request for submission of an individual NPDES permit application. EPA will post these NOIs on its website at www.epa.gov/npdes/enoi.

Who Must File a Notice of Intent with EPA?

Under section 402(p) of the Clean Water Act (CWA) and regulations at 40 CFR Part 122, stormwater discharges associated with industrial activity are prohibited to waters of the United States unless authorized under a National Pollutant Discharge Elimination System (NPDES) permit. You can obtain coverage under the MSGP by submitting a completed NOI if you operate a facility:

- that is located in a jurisdiction where EPA is the permitting authority, listed in Appendix C of the MSGP,
- that discharges stormwater associated with industrial activities, identified in Appendix D of the MSGP,
- that meets the eligibility requirements in Part 1.1 of the permit,
- that develops a stormwater pollution prevention plan (SWPPP) in accordance with Part 5 of the MSGP; and
- that installs and implements control measures in accordance with Part 2 to meet numeric and non-numeric effluent limits.

If you are unsure if you need an NPDES stormwater permit, contact your EPA or State NPDES stormwater permit program. Contacts are listed at www.epa.gov/npdes/stormwatercontacts.

One NOI must be submitted for each facility or site for which you are seeking permit coverage. You do not need to submit separate NOIs for each type of industrial activity present at your facility, provided your SWPPP covers all activities.

When to File the NOI Form

Do not file your NOI until you have obtained and thoroughly read a copy of the MSGP. A copy of the MSGP is located on the EPA website (www.epa.gov/npdes/stormwater/msgp). The MSGP describes procedures to ensure your eligibility, prepare your SWPPP, install and implement appropriate stormwater control measures, and complete the NOI form questions – all of which must be done before you sign the NOI certification statement attesting to the

accuracy and completeness of your NOI. You will also need a copy of the MSGP once you have obtained coverage so that you can comply with the implementation requirements of the permit.

Where to File the NOI Form

EPA encourages you to complete the NOI form electronically via the Internet. EPA's Electronic Notice of Intent System (eNOI) can be found at www.epa.gov/npdes/enoi. Filing electronically is the fastest way to obtain permit coverage and help ensure that your NOI is complete. If you choose not to file electronically, you must send the NOI to one of the addresses listed below.

NOIs sent regular mail:

Stormwater Notice Processing Center (4203M)
USEPA
1200 Pennsylvania Avenue, NW
Washington, DC 20460

NOIs sent overnight/express mail:

Stormwater Notice Processing Center
EPA East Building, Rm. 7420
1201 Constitution Avenue, NW
Washington, DC 20004
202-564-9545

If you have questions, please contact EPA's Stormwater Notice Processing Center toll free at (866) 352-7755.

- If you file a paper NOI, please submit the original with a signature in ink – Do Not Send Copies. Also, faxed copies will not be accepted.
- Your SWPPP does not need to be submitted for review unless specifically requested by EPA or as otherwise required in Part 9 of the MSGP (State, Territory, and Tribal requirements). You must keep a copy of your SWPPP on-site or otherwise make it available to facility personnel responsible for implementing provisions of the permit.

Completing the NOI Form

To complete this form, type or print in uppercase letters in the appropriate areas only. Please make sure you complete all questions. Make sure you make a photocopy for your records before you send the completed original form to the address above. You may also use this paper form as a checklist for the information you will need when filing an NOI electronically via EPA's eNOI system.

Section A. Permit Number

Appendix C of the MSGP 2008 contains a list of geographic areas covered by the permit. If your facility is located in one of the listed areas, include the appropriate permit number in this section. (For example, if your facility is located in Massachusetts, and not on Indian Lands, you would write MAR050000 in this space.) If your facility is located in an area not covered by the MSGP, please contact your EPA Region, state or territorial NPDES stormwater coordinator (see www.epa.gov/npdes/stormwatercontacts for a list of contacts).

Section B. Facility Operator Information

1. Provide the legal name of the person, firm, public organization or any other public entity that operates the facility described in this application. An operator of a facility is a legal entity that controls the operation of the facility.
2. Provide the Employer Identification Number (EIN from the Internal Revenue Service (IRS)), commonly referred to as your taxpayer ID number. If the operator does not have an EIN, enter "NA" in the space provided.
3. Provide the operator's mailing address, telephone number, fax number (optional), and email address. Correspondence will be sent to this address.

Section C. Facility Information

1. Enter the facility's official or legal name. Unless the name of your facility has changed, please use the same name provided on prior NOIs or permit applications. You can use EPA's NOI Search website (www.epa.gov/npdes/noisearch) to view your previous NOI.
2. Indicate if industrial stormwater discharges from your facility were previously covered by an NPDES permit.
 - 2a. If your facility was covered by EPA's MSGP-2000, please include the tracking number that you received in your confirmation letter or email from EPA's Stormwater Notice Processing Center. You can find the tracking number assigned to your previous NOI on EPA's NOI Search website (www.epa.gov/npdes/noisearch).
 - 2b.1. If your facility was not previously covered by an NPDES permit and discharged industrial stormwater, then indicate if it was in operation before October 30, 2005 and not covered under the MSGP 2000. If you select "yes" to this question then you have a 30 day waiting period before you are authorized to discharge.
 - 2b.2. If you select "no" in C.2.b.1, then indicate if your facility discharged stormwater between October 30, 2005 and January 5, 2009. If you select "yes" to this

question then you have a 30 day waiting period before you are authorized to discharge. If you select "no" to this question and you post your SWPPP on the Internet and provide EPA the URL in E.2, then you have a 30 day waiting period before you are authorized to discharge. If you select "no" to this question, but do not post your SWPPP on the Internet and therefore do not answer E.2, then you have a 60 day waiting period before you are authorized to discharge.

- 3.a-e. Enter the street address, including city, state, zip code, county or similar government subdivision of the actual physical location of the facility. Do not use a P.O. Box.
- 3.f.g. Provide the facility latitude and longitude in one of three formats: (1) degrees, minutes, seconds; (2) degrees, minutes, decimal; or (3) degrees decimal. You can obtain your facility's latitude and longitude through Global Positioning System (GPS) receivers, U.S. Geological Survey (USGS) quadrangle or topographic maps, and EPA's web-based siting-tools, among other methods. Refer to www.epa.gov/npdes/stormwater/msgp for guidance on the use of these methods. For consistency, EPA requests you take measurements from the location of your facility's stormwater outfall. Outfalls are locations where the stormwater exits the facility, including pipes, ditches, swales, and other structures that transport stormwater. If there is more than one outfall present, measure at the primary outfall (i.e., the outfall with the largest volume of stormwater discharge associated with industrial activity).
- 3.h. Identify the data source that you used to determine the facility latitude and longitude. If you did not use a USGS quadrangle or topographic map, the EPA website, or GPS receivers, then select "Other" and write the method used on the line provided. If you used a USGS quadrangle or topographic map, write the map scale on the line provided. Scale should be identified on the map.
4. Enter the estimated area of industrial activity at your site exposed to stormwater, in acres.
5. Indicate if the facility is considered a "federal facility" - Federal facilities include any buildings, installations, structures, land, public works, equipment, aircraft, vessels, and other vehicles and property, owned or leased by the federal government.
6. Indicate whether the facility is located in Indian Country, and, if so, provide the name of the reservation, if applicable.

Section D. Discharge Information

1. Indicate whether stormwater from your site will be discharged into a municipal separate storm sewer system (MS4). An MS4 is a conveyance or system of conveyances, including roads with drainage systems, municipal streets, catch basins, storm drains, curbs and gutters, ditches and man-made channels, owned or operated by a state, city, town, borough, county, parish, district, association or other public body, used to collect or convey stormwater. If you check "Yes" then identify the name of the MS4 operator on the line provided. If you are uncertain of the MS4 operator, contact your local government for that information. MS4s are different than combined sewers, which are designed to convey both stormwater and sanitary wastewater. Discharges to combined sewers do not require an NPDES permit but may be subject to other CWA requirements (contact the combined sewer operator for more information).
2. Enter information regarding your discharge. If additional space is needed fill out Attachment 1.
- 2a. Indicate in column "a" of the table the name(s) of the receiving water(s) into which stormwater from your facility will discharge. Also provide in parentheses the name of the impaired water (and segment, if applicable) into which your stormwater is discharged. If you identified more than one receiving water for your facility, indicate the first receiving water and complete question 2b and 2.b.1-3 (if applicable), before entering the next receiving water. The EPA's Water Locator Tool can help you identify the closest receiving water to your facility (www.epa.gov/npdes/msgp). Your receiving water may be a lake, stream, river, ocean, wetland or other waterbody, and may or may not be located adjacent to your facility. Your stormwater may discharge directly to the receiving water or indirectly via a storm sewer system, an open drain or ditch, or other conveyance structure. Do NOT list a man-made conveyance, such as a storm sewer system, as your receiving water. Indicate the first receiving water your stormwater discharge enters. For example, if your discharge enters a storm sewer system, that empties into Trout Creek, which flows into Pine River, your receiving water is Trout Creek, because it is the first waterbody your discharge will reach. Similarly, a discharge into a ditch that feeds Spring Creek should be identified as "Spring Creek" since the ditch is a manmade conveyance. If you discharge into a municipal separate storm sewer system (MS4), you must identify the waterbody into which that portion of the storm sewer discharges. That information should be readily available from the operator of the MS4.
- 2b. Indicate in column "b" of the table whether you discharge directly to an impaired water (lake, stream segment, estuary, etc), listed as "impaired" under section 303(d) of the Clean Water Act. Each state water quality agency maintains a list of waters that are impaired. Most state agencies publish these lists online. The EPA's Water Locator Tool may also help you identify if the nearest receiving water is impaired (www.epa.gov/npdes/msgp). If you discharge into a stream

segment that is upstream of a listed impaired water but which is not itself on the State's impaired waters list, answer "no" to this question. In this case, requirements in the MSGP for discharges into impaired waters do not apply to you, unless notified otherwise by EPA.

Answer the following three questions only if you answered "Yes" to D.2.b:

- 2b1. Provide the pollutant(s) listed as causing the impairment in the water identified in D.2.b.1 above. Enter each pollutant individually on a separate row in the table.
- 2b2. Out of the pollutant(s) that you identified in D.2.b.1 above, indicate which pollutant(s) you believe will be present in your discharge. If you do not expect the pollutant(s) to be in your discharge, then select "no."
- 2b3. Indicate the pollutant(s) that have a Total Maximum Daily Load (TMDL) for the impaired stream segment that you identified in D.2.b.2 above. Check with your state water quality agency for lists of waters with approved or established TMDLs. See www.epa.gov/npdes/msgp for more information.
3. Water Quality Standards
 - 3a. If you selected "no" in C.2 indicating that stormwater discharges from your facility have not been previously covered under an NPDES permit, then you are considered a new discharger and must answer this question; otherwise you are considered an existing discharger and may skip this question. State water quality agencies are responsible for setting water quality standards for waters within the state's boundaries. Check EPA's website (www.epa.gov/npdes/msgp) to determine if the water(s) that you discharge into are designated as a "Tier 2 (or Tier 2.5) water" (See Appendix A of the MSGP 2008 for definitions of "Tier 2 water" and "Tier 2.5 water"). If you discharge into these waters, EPA may impose additional permit conditions to ensure that you do not violate the State's antidegradation policy.
 - 3.b. Identify whether your receiving water is designated as a Tier 3 waterbody. Go to www.epa.gov/npdes/msgp for a list of Tier 3 waterbodies. Note that new discharges into designated Tier 3 waters are not eligible for coverage under the MSGP 2008.
 4. Federal Effluent Limitation Guidelines and Sector-Specific Requirements
 - 4.a-b. Depending on your industrial activities, your facility may be subject to effluent limitation guidelines which include additional effluent limits and monitoring requirements for your facility. Please review these requirements, described in Part 2.1.3 of the MSGP, and check any appropriate boxes on the NOI form.
 - 4.c. For Sector S facilities (Air Transportation), indicate whether you anticipate that the entire airport facility will use more than 100,000 gallons of glycol-based deicing/anti-icing chemicals and/or 100 tons or more of urea on an average annual basis. If so, additional effluent limits and monitoring conditions apply to your discharge (see Part 8 Sector S of the MSGP 2008).
 5. List the four-digit Standard Industrial Classification (SIC) code and/or two character activity code that best describes the primary industrial activities performed by your facility under which you are required to obtain permit coverage. Your primary industrial activity includes any activities performed on-site which are (1) identified by the facility's one SIC code for which the facility is primarily engaged; and (2) included in the narrative descriptions of 40 CFR 122.26(b)(14)(i), (iv), (v), (vi), (vii), and (ix). See Appendix D of the MSGP for a complete list of SIC codes and activities codes.
 6. If your site has co-located industrial activities that are not identified as your primary industrial activity, identify the sector and subsector codes that describe these other industrial activities. For a complete list of sector and subsector codes, see Appendix D of the MSGP.
 - 7.a-b. Indicate whether your facility is currently inactive and unstaffed. If so then indicate whether your facility will be inactive and unstaffed for the entire permit term, or if not, specify the specific length of time in units of days, weeks, months, or years (e.g. 3 months) that you expect the facility to be inactive and unstaffed.

Section E. Facility Contact Information and SWPPP Location

- 1.a-c. Identify the name, telephone number, and email address of the person who will serve as a contact for EPA on issues related to stormwater management at your facility. This person should be able to answer questions related to stormwater discharges, the SWPPP, and other issues related to stormwater permit coverage, or have immediate access to individuals with that knowledge. This person does not have to be the facility operator, but should have intimate knowledge of stormwater management activities at the facility.
2. If you are making your Stormwater Pollution Prevention Plan publicly available on a website provide the appropriate Internet URL address. (Please note that by posting your SWPPP on the web, you may qualify for a shortened authorization waiting period. See Table 1-2 of the MSGP for more information.)

Section F. Endangered Species Protection

1. Based on the instruction provided in Appendix E of the MSGP 2008, indicate which permit criterion (A,B,C,D,E, or F) listed in Part 1.1.4.5 you are using to satisfy your eligibility obligations for protection of endangered and threatened species, and designated critical habitat.

- 2.a. If you select criterion E (not likely to adversely affect), list those federally-listed endangered or threatened species and any federally-listed designated critical habitat expected to exist in proximity to your facility.
- 2.b List the pollutants that you expect to be present in your stormwater discharge. Include any pollutants that you may have included in D.2.b.3 above.
- 2.c If you selected "yes" in C.2 then you are considered an existing discharger and must answer all the questions in F.2.c.1--5; otherwise you are considered a new discharger and may skip the questions under F.2.c. If you are an existing discharger who was previously covered under the MSGP 2000, indicate whether you have any previous effluent monitoring data.
- 2.c.1-2. If you select "No," to F.2.c then indicate why you don't have any data. Also indicate if you have any other data characterizing pollutants in your stormwater discharge.
- 2.c.3. If you select "Yes," to F.2.c then indicate whether you exceeded any benchmark.
- 2.c.4 Indicate whether you have exceeded any applicable effluent limitation guideline, or caused or contributed to an exceedance of state or tribal water quality requirement(s).
- 2.c.5. If you select "Yes" to F.2.c.3.and/or F.2.c.4 then indicate the pollutant parameters for which you exceeded the benchmark, applicable effluent limitation guideline, or State or Tribal water quality requirement(s).
- 2.d. Attach your supporting rationale for your determination of the applicability of Criterion E for your facility (applies to both new and existing dischargers). Your documentation should address species and habitat listed in F.2.a and the potential effects of pollutants listed in F.2.b on the listed species and habitat. This should include consideration of any available data characterizing pollutants in your stormwater discharge, or in the discharge of similar facilities if data for you facility is not available, that may be of concern to listed species.
3. If you select Criterion F (already addressed in another operator's valid certification), provide the tracking number that the operator received in their confirmation letter or email from EPA's NOI Processing Center (see Appendix E). You can find the tracking number assigned to your previous NOI on EPA's NOI Search website (www.epa.gov/npdes/noisearch). An example where criterion F may apply includes airports where several individual airlines have applied for coverage under the MSGP, and the entire airport also has applied for or obtained coverage. If the airport has already certified under Appendix E, and that certification addresses any potential impacts from the individual airlines, then the airlines may reference the airport's permit tracking number.

Section G. Historic Preservation

Based on the instruction provided in Appendix F of the MSGP 2008, indicate which permit criterion (A, B, C, or D) listed in Part 1.1.4.6 of the MSGP you used to satisfy your eligibility obligations for protection of historic properties.

Section H. Certification

Certification statement and signature (see Section B.11 of Appendix B of the MSGP for more information). Enter certifier's printed name, title and email address. Sign and date the form. (CAUTION: An unsigned or undated NOI form will prevent the granting of permit coverage.) Federal statutes provide for severe penalties for submitting false information on this application form. Federal regulations require this application to be signed as follows:

For a corporation: by a responsible corporate officer, which means:

- (i) president, secretary, treasurer, or vice-president of the corporation in charge of a principal business function, or any other person who performs similar policy or decision making functions for the corporation, or
- (ii) the manager of one or more manufacturing, production, or operating facilities, provided the manager is authorized to make management decisions which govern the operation of the regulated facility including having the explicit or implicit duty of making major capital investment recommendations, and initiating and directing other comprehensive measures to assure long term environmental compliance with environmental laws and regulations; the manager can ensure that the necessary systems are established or actions taken to gather complete and accurate information for permit application requirements; and where authority to sign documents has been assigned or delegated to the manager in accordance with corporate procedures;

For a partnership or sole proprietorship: by a general partner or the proprietor; or

For a municipal, State, Federal, or other public facility: by either a principal executive or ranking elected official.

If the NOI was prepared by someone other than the certifier (for example, if the NOI was prepared by the facility SWPPP contact or a consultant for the certifier's signature), include the name, organization, phone number and email address of the NOI preparer.

Paperwork Reduction Act Notice

Public reporting burden for this certification is estimated to average 3.7 hours per certification, including time for reviewing instructions, searching existing data sources, gathering and maintaining the data needed, and completing and reviewing the collection of information. Burden means the total time, effort, or financial resources expended by persons to generate, maintain, retain, or disclose to provide

information to or for a Federal agency. This includes the time needed to review instructions; develop, acquire, install, and utilize technology and systems for the purposes of collecting, validating, and verifying information, processing and maintaining information, and disclosing and providing information; adjust the existing ways to comply with any previously applicable instructions and requirements; train personnel to be able to respond to a collection of information; search data sources; complete and review the collection of information; and transmit or otherwise disclose the information. An agency may not conduct or sponsor, and a person is not required to respond to, a collection of information unless it displays a currently valid OMB control number. Send comments regarding the burden estimate, any other aspect of the collection of information, or suggestions for improving this form, including any suggestions which may increase or reduce this burden to: Director, Office of Environmental Information Services, Collection Services Division (2823), USEPA, 1200 Pennsylvania Avenue, NW, Washington, DC 20460. Include the OMB control number of this form on any correspondence. Do not send the completed NOI form to this address.

**Appendix H
Notice of Termination (NOT) Form**

Appendix H – Notice of Termination (NOT) Form

To terminate coverage under this permit, you must submit a Notice of Termination (NOT). You must either (1) terminate coverage using EPA's online eNOI system, available at www.epa.gov/npdes/eNOI or (2) file a paper copy of the NOT, a copy of which follows.

Instructions for Completing the Notice of Termination for Stormwater Discharges Associated with INDUSTRIAL ACTIVITY under the Multi-Sector General Permit (MSGP)

Who May File Notice of Termination (NOT) Form

Permittees currently covered by EPA's NPDES Stormwater Multi-Sector General Permit may submit a Notice of Termination (NOT) form. You must submit an NOT within 30 days after one or more of the following conditions have been met:

- a new owner or operator has assumed responsibility for the facility; or
- you have ceased operations at the facility and there are not or no longer will be discharges of stormwater associated with industrial activity from the facility, and you have already implemented necessary sediment and erosion controls as required by Part 2.1.2.5;
- you are a Sector G, H, or J facility and you have met the applicable termination requirements; or
- you have obtained coverage under an individual or alternative general permit for all discharges required to be covered by an NPDES permit.

See the MSGP Part 1.4 for more information.

Where to File NOT form

EPA encourages you to complete the NOT form online, via the Internet. The Electronic Notice of Intent System (eNOI) is found at www.epa.gov/npdes/eNOI. If you cannot access the electronic system, you must send the NOT to the address listed below.

NOTs sent regular mail:
Stormwater Notice of Termination (4203M)
USEPA
1200 Pennsylvania Avenue, NW
Washington, D.C. 20460

NOTs sent overnight/express
Stormwater Notice of Termination
US EPA East Building, Rm 7420
1201 Constitution Avenue, NW
Washington, D.C. 20004
(202) 564-9545

Completing the Form

To complete this form, type or print in uppercase letters in the appropriate areas only. Please make sure you complete all questions. Make sure you make a photocopy for your records before you send the completed original form to the address above. Please use ink when you sign the original document – DO NOT send copies. If you have any questions about this form, you may call the EPA's Stormwater Notice Processing Center at (866) 352-7755.

Section A. Permit Information

1. Enter the NPDES tracking number assigned by EPA's Stormwater Notice Processing Center to the facility. If you do not know the tracking number, you can find the tracking number assigned to your previous NOI on EPA's NOI Search website (www.epa.gov/npdes/noisearch).
2. Indicate your reason for submitting this Notice of Termination by checking the appropriate box (see MSGP Part 1.4 for more information).

Section B. Facility Operator Information

1. Give the legal name of the person, firm, public organization, or any other entity that operates the facility described in this application. The operator of the facility is the legal entity which controls the facility's operation, rather than the plant or site manager. Do not use a colloquial name.

2-3. Enter the facility operator's IRS Employer Identification Number (also known as the tax payer ID number). Enter the complete mailing address, email address and telephone number of the operator. This address will be used for any future correspondence between EPA and the facility operator.

Section C. Facility Information

1-2. Enter the facility's official or legal name and complete address, including city, county or similar government subdivision, state, and ZIP code.

Section D. Certification

Certification statement and signature (see Section B.11 of Appendix B of the MSGP for more information). Enter certifier's printed name, title and email address. Sign and date the form. Federal statutes provide for severe penalties for submitting false information on this application form. Federal regulations require this application to be signed as follows:

For a corporation: by a responsible corporate officer, which means: (i) president, secretary, treasurer, or vice-president of the corporation in charge of the principal business function, or any other person who performs similar policy or decision making functions, or (ii) the manager of one or more manufacturing, production, or operating facilities employing more than 250 persons or having gross annual sales or expenditures exceeding \$25 million (in second-quarter 1980 dollars), if authority to sign documents has been assigned or delegated to the manager in accordance with corporate procedures;

For a partnership or sole proprietorship: by a general partner or the proprietor; or

For a municipality, State, Federal, or other facility: by either a principal executive officer or ranking elected official.

Paperwork Reduction Act Notice

Public reporting burden for this application is estimated to average 0.5 hours per application, including time for reviewing instructions, searching existing data sources, gathering and maintaining the data needed, and completing and reviewing the collection of information. Send comments regarding the burden estimate, any other aspect of the collection of information, or suggestions for improving this form, including any suggestions which may increase or reduce this burden to: Director, Office of Environmental Information Services, Collection Services Division (2823), USEPA, 1200 Pennsylvania Avenue, NW, Washington, DC 20460. Include the OMB control number of this form on any correspondence. Do not send the completed NOT form to this address.

**Appendix I
Annual Reporting Form**

NPDES Permit Tracking No.:

Grid for NPDES Permit Tracking No.



UNITED STATES ENVIRONMENTAL PROTECTION AGENCY
WASHINGTON, DC 20460

Annual Reporting Form

A. GENERAL INFORMATION

1. Facility Name: [Grid]

2. NPDES Permit Tracking No.: [Grid]

3. Facility Physical Address:

a. Street: [Grid]

b. City: [Grid] c. State: [Grid] d. Zip Code: [Grid] - [Grid]

4. Lead Inspectors Name: [Grid] Title: [Grid]

Additional Inspectors Name(s): [Grid] [Grid]

5. Contact Person: [Grid] Title: [Grid]

Phone: [Grid] - [Grid] - [Grid] Ext. [Grid] E-mail: [Grid]

6. Inspection Date: [Grid] / [Grid] / [Grid]

B. GENERAL INSPECTION FINDINGS

1. As part of this comprehensive site inspection, did you inspect all potential pollutant sources, including areas where industrial activity may be exposed to stormwater?
 YES NO
 If NO, describe why not:

NOTE: Complete Section C of this form for each industrial activity area inspected and included in your SWPPP or as newly identified in B.2 or B.3 below where pollutants may be exposed to stormwater.

2. Did this inspection identify any stormwater or non-stormwater outfalls not previously identified in your SWPPP? YES NO

If YES, for each location, describe the sources of those stormwater and non-stormwater discharges and any associated control measures in place:

--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--

3. Did this inspection identify any sources of stormwater or non-stormwater discharges not previously identified in your SWPPP? YES NO

If YES, describe these sources of stormwater or non-stormwater pollutants expected to be present in these discharges, and any control measures in place:

4. Did you review stormwater monitoring data as part of this inspection to identify potential pollutant hot spots? YES NO NA, no monitoring performed

If YES, summarize the findings of that review and describe any additional inspection activities resulting from this review:

5. Describe any evidence of pollutants entering the drainage system or discharging to surface waters, and the condition of and around outfalls, including flow dissipation measures to prevent scouring:

6. Have you taken or do you plan to take any corrective actions, as specified in Part 3 of the permit, since your last annual report submission (or since you received authorization to discharge under this permit if this is your first annual report), including any corrective actions identified as a result of this annual comprehensive site inspection?

YES NO

If YES, how many conditions requiring review for correction action as specified in Parts 3.1 and 3.2 were addressed by these corrective actions?

--	--	--

NOTE: Complete the attached Corrective Action Form (Section D) for each condition identified, including any conditions identified as a result of this comprehensive stormwater inspection.

--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--

C. INDUSTRIAL ACTIVITY AREA SPECIFIC FINDINGS

Complete one block for each industrial activity area where pollutants may be exposed to stormwater. Copy this page for additional industrial activity areas.

In reviewing each area, you should consider:

- Industrial materials, residue, or trash that may have or could come into contact with stormwater;
- Leaks or spills from industrial equipment, drums, tanks, and other containers;
- Offsite tracking of industrial or waste materials from areas of no exposure to exposed areas; and
- Tracking or blowing of raw, final, or waste materials from areas of no exposure to exposed areas.

INDUSTRIAL ACTIVITY AREA _____:

1. Brief Description:

2. Are any control measures in need of maintenance or repair? YES NO
3. Have any control measures failed and require replacement? YES NO
4. Are any additional/revised control measures necessary in this area? YES NO

If YES to any of these three questions, provide a description of the problem: (Any necessary corrective actions should be described on the attached Corrective Action Form)

INDUSTRIAL ACTIVITY AREA _____:

1. Brief Description:

2. Are any control measures in need of maintenance or repair? YES NO
3. Have any control measures failed and require replacement? YES NO
4. Are any additional/revised c necessary in this area? YES NO

If YES to any of these three questions, provide a description of the problem: (Any necessary corrective actions should be described on the attached Corrective Action Form)

INDUSTRIAL ACTIVITY AREA _____:

Brief Description:

2. Are any control measures in need of maintenance or repair? YES NO
3. Have any control measures failed and require replacement? YES NO
4. Are any additional/revised BMPs necessary in this area? YES NO

If YES to any of these three questions, provide a description of the problem: (Any necessary corrective actions should be described on the attached Corrective Action Form)

--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--

NOTE: Copy this page and attach additional pages as necessary

INDUSTRIAL ACTIVITY AREA _____:

1. Brief Description:

2. Are any control measures in need of maintenance or repair? YES NO

3. Have any control measures failed and require replacement? YES NO

4. Are any additional/revi sed BMPs necessary in this area? YES NO

If YES to any of these three questions, provide a description of the problem: (Any necessary corrective actions should be described on the attached Corrective Action Form)

INDUSTRIAL ACTIVITY AREA _____:

1. Brief Description:

2. Are any control measures in need of maintenance or repair? YES NO

3. Have any control measures failed and require replacement? YES NO

4. Are any additional/revi sed BMPs necessary in this area? YES NO

If YES to any of these three questions, provide a description of the problem: (Any necessary corrective actions should be described on the attached Corrective Action Form)

INDUSTRIAL ACTIVITY AREA _____:

1. Brief Description:

2. Are any control measures in need of maintenance or repair? YES NO

3. Have any control measures failed and require replacement? YES NO

4. Are any additional/revi sed BMPs necessary in this area? YES NO

If YES to any of these three questions, provide a description of the problem: (Any necessary corrective actions should be described on the attached Corrective Action Form)

--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--

D. CORRECTIVE ACTIONS

Complete this page for each specific condition requiring a corrective action or a review determining that no corrective action is needed. Copy this page for additional corrective actions or reviews.

Include both corrective actions that have been initiated or completed since the last annual report, and future corrective actions needed to address problems identified in this comprehensive stormwater inspection. Include an update on any outstanding corrective actions that had not been completed at the time of your previous annual report.

1. Corrective Action # of for this reporting period.

2. Is this corrective action:

- An update on a corrective action from a previous annual report; or
- A new corrective action?

3. Identify the condition(s) triggering the need for this review:

- Unauthorized release or discharge
- Numeric effluent limitation exceedance
- Control measures inadequate to meet applicable water quality standards
- Control measures inadequate to meet non-numeric effluent limitations
- Control measures not properly operated or maintained
- Change in facility operations necessitated change in control measures
- Average benchmark value exceedance
- Other (describe): _____

4. Briefly describe the nature of the problem identified:

5. Date problem identified: / /

6. How problem was identified:

- Comprehensive site inspection
- Quarterly visual assessment
- Routine facility inspection
- Benchmark monitoring
- Notification by EPA or State or local authorities
- Other (describe): _____

7. Description of corrective action(s) taken or to be taken to eliminate or further investigate the problem (e.g., describe modifications or repairs to control measures, analyses to be conducted, etc.) or if no modifications are needed, basis for that determination:

8. Did/will this corrective action require modification of your SWPPP? YES NO

9. Date corrective action initiated: / /

10. Date correction action completed: / / or expected to be completed: / /

11. If corrective action not yet completed, provide the status of corrective action at the time of the comprehensive site inspection and describe any remaining steps (including timeframes associated with each step) necessary to complete corrective action:

Appendix J
Calculating Hardness in Receiving Waters for Hardness Dependent Metals

Appendix J. Calculating Hardness in Receiving Waters for Hardness Dependent Metals

Overview

EPA adjusted the benchmarks for six hardness-dependent metals (i.e., cadmium, copper, lead, nickel, silver, and zinc) to further ensure compliance with water quality standards and provide additional protection for endangered species and their critical habitat. For any sectors required to conduct benchmark samples for a hardness-dependent metal, EPA includes ‘hardness ranges’ from which benchmark values are determined. To determine which hardness range to use, you must collect data on the hardness of your receiving water(s). Once the site-specific hardness data have been collected, the corresponding benchmark value for each metal is determined by comparing where the hardness data fall within 25 mg/L ranges, as shown in Table 1.

Table 1. Hardness Ranges to Be Used to Determine Benchmark Values for Cadmium, Copper, Lead, Nickel, Silver, and Zinc.

All Units mg/L	Benchmark Values (mg/L, total)					
	Cadmium	Copper	Lead	Nickel	Silver	Zinc
0-25 mg/L	0.0005	0.0038	0.014	0.15	0.0007	0.04
25-50 mg/L	0.0008	0.0056	0.023	0.20	0.0007	0.05
50-75 mg/L	0.0013	0.0090	0.045	0.32	0.0017	0.08
75-100 mg/L	0.0018	0.0123	0.069	0.42	0.0030	0.11
100-125 mg/L	0.0023	0.0156	0.095	0.52	0.0046	0.13
125-150 mg/L	0.0029	0.0189	0.122	0.61	0.0065	0.16
150-175 mg/L	0.0034	0.0221	0.151	0.71	0.0087	0.18
175-200 mg/L	0.0039	0.0253	0.182	0.80	0.0112	0.20
200-225 mg/L	0.0045	0.0285	0.213	0.89	0.0138	0.23
225-250 mg/L	0.0050	0.0316	0.246	0.98	0.0168	0.25
250+ mg/L	0.0053	0.0332	0.262	1.02	0.0183	0.26

How to Determine Hardness for Hardness-Dependent Parameters.

You may select one of three methods to determine hardness, including; individual grab sampling, grab sampling by a group of operators which discharge to the same receiving water, or using third-party data. Regardless of the method used, you are responsible for documenting the procedures used for determining hardness values. Once the hardness value is established, you are required to include this information in your first benchmark report submitted to EPA so that the Agency can make appropriate comparisons between your benchmark monitoring results and the corresponding benchmark. You must retain all report and monitoring data in accordance with Part 7.5 of the permit. The three method options for determining hardness are detailed in the following sections.

(1) Permittee Samples for Receiving Stream Hardness

This method involves collecting samples in the receiving water and submitting these to a laboratory for analysis. If you elect to sample your receiving water(s) and submit samples for

analysis, hardness must be determined from the closest intermittent or perennial stream downstream of your point of discharge. The sample can be collected during either dry or wet weather. Collection of the sample during wet weather is more representative of conditions during stormwater discharges; however, collection of in-stream samples during wet weather events may be impracticable or present safety issues.

Hardness must be sampled and analyzed using approved methods as described in 40 CFR Part 136 (Guidelines Establishing Test Procedures for the Analysis of Pollutants).

(2) Group Monitoring for Receiving Stream Hardness

You can be part of a group of permittees discharging to the same receiving waters and collect samples that are representative of the hardness values for all members of the group. In this scenario, hardness of the receiving water must be determined using 40 CFR Part 136 procedures and the results shared by group members. To use the same results, hardness measurements must be taken on a stream reach within a reasonable distance of the discharge points of each of the group members.

(3) Collection of Third-Party Hardness Data

You can submit receiving stream hardness data collected by a third party provided the results are collected consistent with the approved 40 CFR Part 136 methods. These data may come from a local water utility, previously conducted stream reports, TMDLs, peer reviewed literature, other government publications, or data previously collected by the permittee. Data should be less than 10 years old.

Water quality data for many of the nation's surface waters are available on-line or by contacting EPA or a state environmental agency. EPA's data system STORET, short for STOrage and RETrieval, is a repository for receiving water quality, biological, and physical data and is used by state environmental agencies, EPA and other federal agencies, universities, private citizens, and many others. Similarly, state environmental agencies and the U.S. Geological Service (USGS) also have water quality data available that, in some instances, can be accessed online. "Legacy STORET" codes for hardness include: 259 hardness, carbonate; 260 hardness, noncarbonated; and 261 calcium + magnesium, while more recent, "Modern STORET" data codes include: 00900 hardness, 00901 carbonate hardness, and 00902 noncarbonate hardness; or the discrete measurements of calcium (00915) and magnesium (00925) can be used to calculate hardness. Hardness data historically has been reported as "carbonate," "noncarbonate," or "Ca + Mg." If these are unavailable, then individual results for calcium (Ca) and magnesium (Mg) may be used to calculate hardness using the following equation:

$$\text{mg/L CaCO}_3 = 2.497 (\text{Ca mg/L}) + 4.118 (\text{Mg mg/L})$$

When interpreting the data for carbonate and non-carbonate hardness, note that total hardness is equivalent to the sum of carbonate and noncarbonate hardness if both forms are reported. If only carbonate hardness is reported, it is more than likely that noncarbonate hardness is absent and the total hardness is equivalent to the available carbonate hardness.

**Appendix K
No Exposure Certification Form**



Submission of this No Exposure Certification constitutes notice that the entity identified in Section A does not require permit authorization for its stormwater discharges associated with industrial activity in the State identified in Section B under EPA's Stormwater Multi Sector General Permit due to the existence of a condition of no exposure.

A condition of no exposure exists at an industrial facility when all industrial materials and activities are protected by a storm resistant shelter to prevent exposure to rain, snow, snowmelt, and/or runoff. Industrial materials or activities include, but are not limited to, material handling equipment or activities, industrial machinery, raw materials, intermediate products, by-products, final products, or waste products. Material handling activities include the storage, loading and unloading, transportation, or conveyance of any raw material, intermediate product, final product or waste product. A storm resistant shelter is not required for the following industrial materials and activities:

- drums, barrels, tanks, and similar containers that are tightly sealed, provided those containers are not deteriorated and do not leak. "Sealed" means banded or otherwise secured and without operational taps or valves;
- adequately maintained vehicles used in material handling; and
- final products, other than products that would be mobilized in stormwater discharges (e.g., rock salt).

A No Exposure Certification must be provided for each facility qualifying for the no exposure exclusion. In addition, the exclusion from NPDES permitting is available on a facility-wide basis only, not for individual outfalls. If any industrial activities or materials are or will be exposed to precipitation, the facility is not eligible for the no exposure exclusion.

By signing and submitting this No Exposure Certification form, the entity in Section A is certifying that a condition of no exposure exists at its facility or site, and is obligated to comply with the terms and conditions of 40 CFR 122.26(g).

ALL INFORMATION MUST BE PROVIDED ON THIS FORM.

Detailed instructions for completing this form and obtaining the no exposure exclusion are provided on pages 3 and 4.

A. Facility Operator Information

1. Name: 2. Phone: - -

3. Email:

4. Mailing Address: a. Street

b. City: c. State d. Zip Code: -

B. Facility/Site Location Information

1. Facility Name:

2. a. Street Address:

b. City: c. County:

d. State: e. Zip Code: -

3. Is the facility located on Indian Lands? YES NO

4. Is this a Federal facility? YES NO

5. a. Latitude: ° ' " b. Longitude: ° ' "

6. a. Was the facility or site previously covered under an NPDES stormwater permit? YES NO

b. If yes, enter NPDES permit number or tracking number: _____

7. SIC/Activity Codes: Primary: Secondary (if applicable):

8. Total size of site associated with industrial activity: _____ acres

9. a. Have you paved or roofed over a formerly exposed, pervious area in order to qualify for the no exposure exclusion? YES NO

b. If yes, please indicate approximately how much area was paved or roofed over. Completing this question does not disqualify you for the no exposure exclusion. However, your permitting authority may use this information in considering whether stormwater discharges from your site are likely to have an adverse impact on water quality, in which case you could be required to obtain permit coverage.

Less than one acre One to five acres More than five acres

C. Exposure Checklist

Are any of the following materials or activities exposed to precipitation, now or in the foreseeable future?
 (Please check either "Yes" or "No" in the appropriate box.) **If you answer "Yes" to any of these questions (1) through (11), you are not eligible for the no exposure exclusion.**

	Yes	No
1. Using, storing or cleaning industrial machinery or equipment, and areas where residuals from using, storing or cleaning industrial machinery or equipment remain and are exposed to stormwater	<input type="checkbox"/>	<input type="checkbox"/>
2. Materials or residuals on the ground or in stormwater inlets from spills/leaks	<input type="checkbox"/>	<input type="checkbox"/>
3. Materials or products from past industrial activity	<input type="checkbox"/>	<input type="checkbox"/>
4. Material handling equipment (except adequately maintained vehicles)	<input type="checkbox"/>	<input type="checkbox"/>
5. Materials or products during loading/unloading or transporting activities	<input type="checkbox"/>	<input type="checkbox"/>
6. Materials or products stored outdoors (except final products intended for outside use [e.g., new cars] where exposure to stormwater does not result in the discharge of pollutants)	<input type="checkbox"/>	<input type="checkbox"/>
7. Materials contained in open, deteriorated or leaking storage drums, barrels, tanks, and similar containers	<input type="checkbox"/>	<input type="checkbox"/>
8. Materials or products handled/stored on roads or railways owned or maintained by the discharger	<input type="checkbox"/>	<input type="checkbox"/>
9. Waste material (except waste in covered, non leaking containers [e.g., dumpsters])	<input type="checkbox"/>	<input type="checkbox"/>
10. Application or disposal of process wastewater (unless otherwise permitted)	<input type="checkbox"/>	<input type="checkbox"/>
11. Particulate matter or visible deposits of residuals from roof stacks and/or vents not otherwise regulated (i.e., under an air quality control permit) and evident in the stormwater outflow	<input type="checkbox"/>	<input type="checkbox"/>

D. Certification Statement

I certify under penalty of law that I have read and understand the eligibility requirements for claiming a condition of "no exposure" and obtaining an exclusion from NPDES stormwater permitting.

I certify under penalty of law that there are no discharges of stormwater contaminated by exposure to industrial activities or materials from the industrial facility or site identified in this document (except as allowed under 40 CFR 122.26(g)(2)).

I understand that I am obligated to submit a no exposure certification form once every five years to the NPDES permitting authority and, if requested, to the operator of the local municipal separate storm sewer system (MS4) into which the facility discharges (where applicable). I understand that I must allow the NPDES permitting authority, or MS4 operator where the discharge is into the local MS4, to perform inspections to confirm the condition of no exposure and to make such inspection reports publicly available upon request. I understand that I must obtain coverage under an NPDES permit prior to any point source discharge of stormwater from the facility.

Additionally, I certify under penalty of law that this document and all attachments were prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gathered and evaluated the information submitted. Based on my inquiry of the person or persons who manage the system, or those persons directly responsible for gathering the information, the information submitted is to the best of my knowledge and belief true, accurate and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations.

Print Name:

Print Title:

Signature: _____

Date: / /
 Mo Day Year

Email:

Instructions for the NO EXPOSURE CERTIFICATION for Exclusion from NPDES Stormwater Permitting

Who May File a No Exposure Certification

Federal law at 40 CFR Part 122.26 prohibits point source discharges of stormwater associated with industrial activity to waters of the U.S. without a National Pollutant Discharge Elimination System (NPDES) permit. However, NPDES permit coverage is not required for discharges of stormwater associated with industrial activities identified at 40CFR 122.26(b)(14)(i)-(ix) and (xi) if the discharger can certify that a condition of "no exposure" exists at the industrial facility or site.

Stormwater discharges from construction activities identified in 40 CFR 122.26(b)(14)(x) and (b)(15) are not eligible for the no exposure exclusion.

Obtaining and Maintaining the No Exposure Exclusion

This form is used to certify that a condition of no exposure exists at the industrial facility or site described herein. This certification is only applicable in jurisdictions where EPA is the NPDES permitting authority and must be re-submitted at least once every five years.

The industrial facility operator must maintain a condition of no exposure at its facility or site in order for the no exposure exclusion to remain applicable. If conditions change resulting in the exposure of materials and activities to stormwater, the facility operator must obtain coverage under an NPDES stormwater permit immediately.

Where to File the No Exposure Certification Form

No Exposure Forms sent regular mail: Forms sent overnight/express:

SW No Exposure Certification (4203M) USEPA 1200 Pennsylvania Avenue, NW Washington, D.C. 20460	SW No Exposure Certification US EPA East Building, Rm. 7420 1201 Constitution Avenue, NW Washington, D.C. 20004 (202) 564-9545
---	--

Completing the Form

You must type or print, using uppercase letters, in appropriate areas only. Enter only one character per space (i.e., between the marks). Abbreviate if necessary to stay within the number of characters allowed for each item. Use one space for breaks between words. One form must be completed for each facility or site for which you are seeking to certify a condition of no exposure. Additional guidance on completing this form can be accessed at EPA's website: www.epa.gov/npdes/stormwater. Please make sure you have addressed all applicable questions and have made a photocopy for your records before sending the completed form to the above address.

Section A. Facility Operator Information

1. Provide the legal name of the person, firm, public organization, or any other entity that operates the facility or site described in this certification. The name of the operator may or may not be the same as the name of the facility. The operator is the legal entity that controls the facility's operation, rather than the plant or site manager.
2. Provide the telephone number of the facility operator.
3. Provide the email address of the facility operator.
4. Provide the mailing address of the operator (P.O. Box numbers may be used). Include the city, state, and zip code. All correspondence will be sent to this address.

Section B. Facility/Site Location Information

1. Enter the official or legal name of the facility or site.
2. Enter the complete street address (if no street address exists, provide a geographic description [e.g., Intersection of Routes 9 and 55]), city, county, state, and zip code. Do not use a P.O. Box number.
3. Indicate whether the facility is located on Indian Lands.
4. Indicate whether the industrial facility is operated by a department or agency of the Federal Government (see also Section 313 of the Clean Water Act).
5. Enter the latitude and longitude of the approximate center of the facility or site in degrees/minutes/seconds. Latitude and longitude can be obtained from United States Geological Survey (USGS) quadrangle or topographic maps, by calling 1-(888) ASK-USGS, or by accessing the Census Bureau at: www.census.gov/cgi-bin/gazetteer

Latitude and longitude for a facility in decimal form must be converted to degrees (°), minutes ('), and seconds (") for proper entry on the certification form. To convert decimal latitude or longitude to degrees/minutes/seconds, follow the steps in the following example.

Example: Convert decimal latitude 45.1234567 to degrees (°), minutes ('), and seconds (").

- a) The numbers to the left of the decimal point are the degrees: 45°.
 - b) To obtain minutes, multiply the first four numbers to the right of the decimal point by 0.006: $1234 \times 0.006 = 7.404$.
 - c) The numbers to the left of the decimal point in the result obtained in (b) are the minutes: 7'.
 - d) To obtain seconds, multiply the remaining three numbers to the right of the decimal from the result obtained in (b) by 0.06: $404 \times 0.06 = 24.24$. Since the numbers to the right of the decimal point are not used, the result is 24".
 - e) The conversion for 45.1234567 = 45° 7' 24".
6. Indicate whether the facility was previously covered under an NPDES stormwater permit. If so, include the permit number or permit tracking number.
 7. Enter the 4-digit SIC code which identifies the facility's primary activity and second 4-digit SIC code identifying the facility's secondary activity, if applicable. SIC codes can be obtained from the Standard Industrial Classification Manual, 1987.
 8. Enter the total size of the site associated with industrial activity in acres. Acreage may be determined by dividing square footage by 43,560, as demonstrated in the following example.
Example: Convert 54,450 ft² to acres
Divide 54,450 ft² by 43,560 square feet per acre:
 $54,450 \text{ ft}^2 \div 43,560 \text{ ft}^2/\text{acre} = 1.25 \text{ acres}$.
 9. Check "Yes" or "No" as appropriate to indicate whether you have paved or roofed over a formerly exposed, pervious area (i.e., lawn, meadow, dirt or gravel road/parking lot) in order to qualify for no exposure. If yes, also indicate approximately how much area was paved or roofed over and is now impervious area.

Instructions for the NO EXPOSURE CERTIFICATION for Exclusion from NPDES Stormwater Permitting

Section C. Exposure Checklist

Check "Yes" or "No" as appropriate to describe the exposure condition at your facility. If you answer "Yes" to **ANY** of the questions (1) through (11) in this section, a potential for exposure exists at your site and you cannot certify to a condition of no exposure. You must obtain (or already have) coverage under an NPDES stormwater permit. After obtaining permit coverage, you can institute modifications to eliminate the potential for a discharge of stormwater exposed to industrial activity, and then certify to a condition of no exposure.

Section D. Certification Statement

Federal statutes provide for severe penalties for submitting false information on this application form. Federal regulations require this application to be signed as follows:

For a corporation: by a responsible corporate officer, which means:

- (i) president, secretary, treasurer, or vice-president of the corporation in charge of a principal business function, or any other person who performs similar policy or decision making functions for the corporation, or
- (ii) the manager of one or more manufacturing, production, or operating facilities, provided the manager is authorized to make management decisions which govern the operation of the regulated facility including having the explicit or implicit duty of making major capital investment recommendations, and initiating and directing other comprehensive measures to assure long term environmental compliance with environmental laws and regulations; the manager can ensure that the necessary systems are established or actions taken to gather complete and accurate information for permit

application requirements; and where authority to sign documents has been assigned or delegated to the manager in accordance with corporate procedures;

For a partnership or sole proprietorship: by a general partner or the proprietor, or

For a municipal, State, Federal, or other public facility: by either a principal executive or ranking elected official.

Paperwork Reduction Act Notice

Public reporting burden for this certification is estimated to average 1.0 hour per certification, including time for reviewing instructions, searching existing data sources, gathering and maintaining the data needed, and completing and reviewing the collection of information. Burden means the total time, effort, or financial resources expended by persons to generate, maintain, retain, or disclose to provide information to or for a Federal agency. This includes the time needed to review instructions; develop, acquire, install, and utilize technology and systems for the purposes of collecting, validating, and verifying information, processing and maintaining information, and disclosing and providing information; adjust the existing ways to comply with any previously applicable instructions and requirements; train personnel to be able to respond to a collection of information; search data sources; complete and review the collection of information; and transmit or otherwise disclose the information. An agency may not conduct or sponsor, and a person is not required to respond to, a collection of information unless it displays a currently valid OMB control number. Send comments regarding the burden estimate, any other aspect of the collection of information, or suggestions for improving this form, including any suggestions which may increase or reduce this burden to: Director, OPPE Regulatory Information Division (2137), USEPA, 401 M Street, SW, Washington, D.C. 20460. Include the OMB control number of this form on any correspondence. Do not send the completed No Exposure Certification form to this address.



NOTICE OF INTENT (NOI) FOR STORMWATER DISCHARGES ASSOCIATED WITH
INDUSTRIAL ACTIVITY UNDER THE NPDES MULTI-SECTOR GENERAL PERMIT

Submission of this completed Notice of Intent (NOI) constitutes notice that the operator identified in Section B of this form requests authorization to discharge pollutants to waters of the United States from the facility or site identified in Section C under EPA's NPDES Stormwater Multi-Sector General Permit (MSGP) for industrial stormwater. Submission of this NOI constitutes your notice to EPA that the facility identified in Section C of this form meets the eligibility conditions of Part 1.1 of the MSGP. Please read and make sure you comply with all eligibility requirements, including the requirement to prepare a stormwater pollution prevention plan. Refer to the instructions at the end of this form to complete your NOI.

A. Permit Number: NHR050000 (see Appendix C of the MSGP for the list of eligible permit numbers) Tracking Number (EPA Use Only): NHR05BM27

B. Facility Operator Information

1. Name: CITY OF PORTSMOUTH
2. IRS Employer Identification Number (EIN): 02 - 6000714
3. Mailing Address:
a. Street: 1 JUNKINS AVENUE
b. City: PORTSMOUTH c. State: NH d. Zip Code: 03801
e. Phone: 603 - 431 - 2000 f. Fax (optional): _____ g. E-mail: _____

C. Facility Information

1. Facility Name: RECYCLING CENTER
2. Have stormwater discharges from your site been covered previously under an NPDES permit? YES NO
a. If yes, provide the Tracking Number if you had coverage under EPA's MSGP 2000 or the NPDES permit number if you had coverage under an EPA individual permit. NHR05A817
b.1 If no, was your facility in operation and discharging stormwater prior to October 30, 2005? YES NO
b.2 If no to C.2.b.1, did your facility commence discharging after October 30, 2005 and before January 5, 2009? YES NO
3. Location Address:
a. Street: 680 PEVERLY HILL RD
b. City: PORTSMOUTH
c. County or similar government subdivision: ROCKINGHAM d. State: NH e. Zip Code: 03801
f. Latitude: (use any one of the three formats) 1. 43° 03' 00" N (degrees, minutes, seconds) 2. _____° _____' _____" N (degrees, minutes, decimal) 3. _____° _____' N (degrees decimal)
g. Longitude: (use any of these 3 formats) 1. 70° 46' 48" W (degrees, minutes, seconds) 2. _____° _____' _____" W (degrees, minutes, decimal) 3. _____° _____' W (degrees decimal)
h. Lat/Long Data Source: USGS topographic map EPA web site GPS Other: GIS
If you used a USGS topographic map, what was the scale? _____
4. Estimated area of industrial activity at your site exposed to stormwater: 8.3 (acres)
5. Is this a federal facility? YES NO
6. Is your facility located on Indian Country lands? YES NO
If yes, name of reservation, or if not part of a reservation, put "Not Applicable:" _____

D. Discharge information

1. Does your facility discharge stormwater into a Municipal Separate Storm Sewer System (MS4)? YES NO

If yes, name of MS4 operator: City of Portsmouth

2. Receiving Waters and Wetlands (Note: If additional space is needed for this question, fill out Attachment 1.)

a. What is the name(s) of your receiving water(s) that receive stormwater directly and/or through an MS4? If your receiving water is impaired then identify the name of the impaired segment, if applicable, in parentheses following the receiving water name.	b. Are any of your discharges directly into any segment of an "impaired" water? <input type="checkbox"/> YES <input type="checkbox"/> NO	If you answered yes to question D.2.b, then answer the following three questions:		
		b.1. What pollutant(s) are causing the impairment?	b.2. Are the pollutant(s) causing the impairment present in your discharge?	b.3. Has a TMDL been completed for the pollutant(s) causing the impairment?
	<input type="checkbox"/> YES <input type="checkbox"/> NO		<input type="checkbox"/> YES <input type="checkbox"/> NO	<input type="checkbox"/> YES <input type="checkbox"/> NO
	<input type="checkbox"/> YES <input type="checkbox"/> NO		<input type="checkbox"/> YES <input type="checkbox"/> NO	<input type="checkbox"/> YES <input type="checkbox"/> NO
	<input type="checkbox"/> YES <input type="checkbox"/> NO		<input type="checkbox"/> YES <input type="checkbox"/> NO	<input type="checkbox"/> YES <input type="checkbox"/> NO
	<input type="checkbox"/> YES <input type="checkbox"/> NO		<input type="checkbox"/> YES <input type="checkbox"/> NO	<input type="checkbox"/> YES <input type="checkbox"/> NO
	<input type="checkbox"/> YES <input type="checkbox"/> NO		<input type="checkbox"/> YES <input type="checkbox"/> NO	<input type="checkbox"/> YES <input type="checkbox"/> NO
	<input type="checkbox"/> YES <input type="checkbox"/> NO		<input type="checkbox"/> YES <input type="checkbox"/> NO	<input type="checkbox"/> YES <input type="checkbox"/> NO
	<input type="checkbox"/> YES <input type="checkbox"/> NO		<input type="checkbox"/> YES <input type="checkbox"/> NO	<input type="checkbox"/> YES <input type="checkbox"/> NO
	<input type="checkbox"/> YES <input type="checkbox"/> NO		<input type="checkbox"/> YES <input type="checkbox"/> NO	<input type="checkbox"/> YES <input type="checkbox"/> NO
	<input type="checkbox"/> YES <input type="checkbox"/> NO		<input type="checkbox"/> YES <input type="checkbox"/> NO	<input type="checkbox"/> YES <input type="checkbox"/> NO
	<input type="checkbox"/> YES <input type="checkbox"/> NO		<input type="checkbox"/> YES <input type="checkbox"/> NO	<input type="checkbox"/> YES <input type="checkbox"/> NO
	<input type="checkbox"/> YES <input type="checkbox"/> NO		<input type="checkbox"/> YES <input type="checkbox"/> NO	<input type="checkbox"/> YES <input type="checkbox"/> NO
	<input type="checkbox"/> YES <input type="checkbox"/> NO		<input type="checkbox"/> YES <input type="checkbox"/> NO	<input type="checkbox"/> YES <input type="checkbox"/> NO
	<input type="checkbox"/> YES <input type="checkbox"/> NO		<input type="checkbox"/> YES <input type="checkbox"/> NO	<input type="checkbox"/> YES <input type="checkbox"/> NO
	<input type="checkbox"/> YES <input type="checkbox"/> NO		<input type="checkbox"/> YES <input type="checkbox"/> NO	<input type="checkbox"/> YES <input type="checkbox"/> NO
	<input type="checkbox"/> YES <input type="checkbox"/> NO		<input type="checkbox"/> YES <input type="checkbox"/> NO	<input type="checkbox"/> YES <input type="checkbox"/> NO

3. Water Quality Standards (for new dischargers only)

- a. Are any of your discharges into any portion of a receiving water designated by the state or tribal authority under its antidegradation policy as a Tier 2 (or Tier 2.5) water (water quality exceeds levels necessary to support propagation of fish, shellfish, and wildlife and recreation in and on the water)? YES NO
- b. Has the receiving water(s) been designated by the state or tribal authority under its antidegradation policy as a Tier 3 water (Outstanding Natural Resource Water)? YES NO

4. Federal Effluent Limitation Guidelines and Sector-Specific Requirements

- a. Are you requesting permit coverage for any stormwater discharges subject to effluent limitation guidelines? YES NO
- b. If yes, which effluent limitation guidelines apply to your stormwater discharges?

40 CFR Part/Subpart	Eligible Discharges	Affected MSGP Sector	Check if Applicable
Part 411, Subpart C	Runoff from material storage piles at cement manufacturing facilities	E	<input type="checkbox"/>
Part 418 Subpart A	Runoff from phosphate fertilizer manufacturing facilities that comes into contact with any raw materials, finished product, by-products or waste products (SIC 2874)	C	<input type="checkbox"/>
Part 423	Coal pile runoff at steam electric generating facilities	O	<input type="checkbox"/>
Part 429, Subpart I	Discharges resulting from spray down or intentional wetting of logs at wet deck storage areas	A	<input type="checkbox"/>
Part 436, Subpart B, C, or D	Mine dewatering discharges at crushed stone mines, construction sand and gravel mines, or industrial sand mines	J	<input type="checkbox"/>
Part 443, Subpart A	Runoff from asphalt emulsion facilities	D	<input type="checkbox"/>
Part 445, Subparts A & B	Runoff from hazardous waste and non-hazardous waste landfills	K, L	<input type="checkbox"/>

c. If you are a Sector S (Air Transportation) facility, do you anticipate using more than 100,000 gallons of glycol-based deicing/anti-icing chemicals and/or 100 tons or more of urea on an average annual basis? YES NO

5. Identify the 4-digit Standard Industrial Classification (SIC) code or 2-letter Activity Code that best represents the products produced or services rendered for which your facility is primarily engaged, as defined in MSGP:

Primary SIC Code: 5093 OR Primary Activity Code

6. Identify the applicable sector(s) and subsector(s) of industrial activity, including co-located industrial activity, for which you are requesting permit coverage:

- a. Sector N Subsector 2 b. Sector P Subsector 1 c. Sector P Subsector 1
- d. Sector Subsector e. Sector Subsector f. Sector Subsector

7.a. Is your site presently inactive and unstaffed? YES NO

b1. If yes, is your site expected to be inactive and unstaffed for the entire permit term? YES NO

b2. If you select "no" in 7.b1 above, then indicate the length of time that you expect your facility to be inactive and unstaffed _____

E. Stormwater Pollution Prevention Plan (SWPPP) Contact Information

1a. SWPPP Contact Name: S i l k e P s u l a
b. Phone: 603 - 766 - 1454 Ext. c. E-mail: spsula@pw.cityofportsmouth.com
2. URL of SWPPP (if applicable): _____

F. Endangered Species Protection

1. Using the instructions in Appendix E of the MSGP, under which criterion listed in Part 1.1.4.5 are you eligible for coverage under this permit?
 A B C D E F
2. If you select criterion E from Part 1.1.4.5:
a. What federally-listed species or federally-designated critical habitat are in your "action area?" _____
b. List the pollutants expected to be present in your discharge _____
c. If you are an existing discharger, do you have effluent monitoring data from EPA's MSGP 2000, or another previous NPDES permit? YES NO
c.1 If no, why not? No monitoring required for my sector Inactive/unstaffed site Other _____
c.2 Do you have any other data characterizing pollutants in your stormwater (describe)? _____
c.3 If you have benchmark monitoring data, did you exceed any of the applicable benchmarks? YES NO
c.4 Did you exceed any applicable effluent limitation guideline or cause or contribute to an exceedance of a State or Tribal water quality standard? YES NO
c.5 If you answered "yes" to either question F.2.c.3 or F.2.c.4 above, for what pollutant(s)? _____
d. Attach documentation supporting criterion E eligibility. Documentation should address species and habitat listed in F.2.a and the potential effects of pollutants listed in F.2.b (including any monitoring data for these pollutants) on the listed species and habitat.
3. If you select criterion F from Part 1.1.4.5, provide the operator's NPDES Tracking Number under which you are certifying eligibility:

G. Historic Preservation

Using the instructions in Appendix F of the MSGP, under which criterion listed in Part 1.1.4.6 are you eligible for coverage under this permit?
 A B C D

H. Certifier Name and Title

I certify under penalty of law that I meet the eligibility conditions of this permit and that this document and all attachments were prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gather and evaluate the information submitted. Based on my inquiry of the person or persons who manage the system, or those persons directly responsible for gathering the information, I certify that the information submitted is, to the best of my knowledge and belief, true, accurate, and complete. I certify that I am aware that there are significant penalties for submitting false information, including the possibility of fines and imprisonment for knowing violations.

Print Name: S T E V E N F . P A R K I N S O N
Title: D i r e c t o r P u b l i c W o r k s
Signature: STEVEN F. PARKINSON Date: 010209
E-mail: SPARKINS@PW.CITYOFPORTSMOUTH.COM

NOI Preparer (Complete if NOI was prepared by someone other than the certifier)

Prepared by: _____
Organization: _____
Phone: _____ - _____ - _____ Ext. _____ E-mail: _____

Instructions for Completing the Notice of Intent for Stormwater Discharges Associated with INDUSTRIAL ACTIVITY under the Multi-Sector General Permit (MSGP)

NOI Submittal Deadlines/Discharge Authorization Dates		
Category	NOI Deadline	Discharge Authorization Date ¹
Existing Dischargers - in operation as of October 30, 2005 and authorized for coverage under MSGP 2000.	No later than January 5, 2009.	30 days after EPA posts your NOI. Your authorization under the MSGP 2000 is automatically continued until you have been granted coverage under this permit or an alternative permit, or coverage is otherwise terminated.
New Dischargers or New Sources - have commenced discharging between October 30, 2005 and January 5, 2009.	As soon as possible but no later than January 5, 2009.	30 days after EPA posts your NOI.
New Dischargers or New Sources - commence discharging after January 5, 2009.	A minimum of 60 days prior to commencing operation of the facility, or a minimum of 30 days if your SWPPP is posted on the Internet during this period and the Internet address (i.e., URL) to your SWPPP is provided on the NOI form.	If you post your SWPPP on the Internet, 30 days after EPA posts your NOI. Otherwise, 60 days after EPA posts your NOI.
New Owner/Operator of Existing Discharger - transfer of ownership and/or operation of a facility whose discharge is authorized under this permit	A minimum of 30 days prior to date that the transfer will take place to the new owner/operator.	30 days after EPA posts your NOI.
Other Eligible Dischargers - in operation prior to October 30, 2005 but not covered under the MSGP 2000 or another NPDES permit.	Immediately, to minimize the time discharges from the facility will continue to be unauthorized.	If you post your SWPPP on the Internet, 30 days after EPA posts your NOI. Otherwise, 60 days after EPA posts your NOI.

¹ Based on a review of your NOI or other information, EPA may delay your authorization for further review, notify you that additional effluent limitations are necessary, or may deny coverage under this permit and require submission of an application for an individual NPDES permit, as detailed in MSGP Part 1.6. In these instances, EPA will notify you in writing of the delay or the request for submission of an individual NPDES permit application. EPA will post these NOIs on its website at www.epa.gov/npdes/enoi.

Who Must File a Notice of Intent with EPA?

Under section 402(p) of the Clean Water Act (CWA) and regulations at 40 CFR Part 122, stormwater discharges associated with industrial activity are prohibited to waters of the United States unless authorized under a National Pollutant Discharge Elimination System (NPDES) permit. You can obtain coverage under the MSGP by submitting a completed NOI if you operate a facility:

- that is located in a jurisdiction where EPA is the permitting authority, listed in Appendix C of the MSGP,
- that discharges stormwater associated with industrial activities, identified in Appendix D of the MSGP,
- that meets the eligibility requirements in Part 1.1 of the permit,
- that develops a stormwater pollution prevention plan (SWPPP) in accordance with Part 5 of the MSGP; and
- that installs and implements control measures in accordance with Part 2 to meet numeric and non-numeric effluent limits.

If you are unsure if you need an NPDES stormwater permit, contact your EPA or State NPDES stormwater permit program. Contacts are listed at www.epa.gov/npdes/stormwatercontacts.

One NOI must be submitted for each facility or site for which you are seeking permit coverage. You do not need to submit separate NOIs for each type of industrial activity present at your facility, provided your SWPPP covers all activities.

When to File the NOI Form

Do not file your NOI until you have obtained and thoroughly read a copy of the MSGP. A copy of the MSGP is located on the EPA website (www.epa.gov/npdes/stormwater/msgp). The MSGP describes procedures to ensure your eligibility, prepare your SWPPP, install and implement appropriate stormwater control measures, and complete the NOI form questions – all of which must be done before you sign the NOI certification statement attesting to the

accuracy and completeness of your NOI. You will also need a copy of the MSGP once you have obtained coverage so that you can comply with the implementation requirements of the permit.

Where to File the NOI Form

EPA encourages you to complete the NOI form electronically via the Internet. EPA's Electronic Notice of Intent System (eNOI) can be found at www.epa.gov/npdes/enoi. Filing electronically is the fastest way to obtain permit coverage and help ensure that your NOI is complete. If you choose not to file electronically, you must send the NOI to one of the addresses listed below.

NOIs sent regular mail:
Stormwater Notice Processing Center (4203M)
USEPA
1200 Pennsylvania Avenue, NW
Washington, DC 20460

NOIs sent overnight/express mail:
Stormwater Notice Processing Center
EPA East Building, Rm. 7420
1201 Constitution Avenue, NW
Washington, DC 20004
202-564-9545

If you have questions, please contact EPA's Stormwater Notice Processing Center toll free at (866) 352-7755.

- If you file a paper NOI, please submit the original with a signature in ink – Do Not Send Copies. Also, faxed copies will not be accepted.
- Your SWPPP does not need to be submitted for review unless specifically requested by EPA or as otherwise required in Part 9 of the MSGP (State, Territory, and Tribal requirements). You must keep a copy of your SWPPP on-site or otherwise make it available to facility personnel responsible for implementing provisions of the permit.

Completing the NOI Form

To complete this form, type or print in uppercase letters in the appropriate areas only. Please make sure you complete all questions. Make sure you make a photocopy for your records before you send the completed original form to the address above. You may also use this paper form as a checklist for the information you will need when filing an NOI electronically via EPA's eNOI system.

Section A. Permit Number

Appendix C of the MSGP 2008 contains a list of geographic areas covered by the permit. If your facility is located in one of the listed areas, include the appropriate permit number in this section. (For example, if you facility is located in Massachusetts, and not on Indian Lands, you would write MAR050000 in this space.) If your facility is located in an area not covered by the MSGP, please contact your EPA Region, state or territorial NPDES stormwater coordinator (see www.epa.gov/npdes/stormwatercontacts for a list of contacts).

Section B. Facility Operator Information

1. Provide the legal name of the person, firm, public organization or any other public entity that operates the facility described in this application. An operator of a facility is a legal entity that controls the operation of the facility.
2. Provide the Employer Identification Number (EIN from the Internal Revenue Service (IRS)), commonly referred to as your taxpayer ID number. If the operator does not have an EIN, enter "NA" in the space provided.
3. Provide the operator's mailing address, telephone number, fax number (optional), and email address. Correspondence will be sent to this address.

Section C. Facility Information

1. Enter the facility's official or legal name. Unless the name of your facility has changed, please use the same name provided on prior NOIs or permit applications. You can use EPA's NOI Search website (www.epa.gov/npdes/noisearch) to view your previous NOI.
2. Indicate if industrial stormwater discharges from your facility were previously covered by an NPDES permit.
 - 2a. If your facility was covered by EPA's MSGP-2000, please include the tracking number that you received in your confirmation letter or email from EPA's Stormwater Notice Processing Center. You can find the tracking number assigned to your previous NOI on EPA's NOI Search website (www.epa.gov/npdes/noisearch).
 - 2b1. If your facility was not previously covered by an NPDES permit and discharged industrial stormwater, then indicate if it was in operation before October 30, 2005 and not covered under the MSGP 2000. If you select "yes" to this question then you have a 30 day waiting period before you are authorized to discharge.
 - 2b2. If you select "no" in C.2.b.1, then indicate if your facility discharged stormwater between October 30, 2005 and January 5, 2009. If you select "yes" to this

question then you have a 30 day waiting period before you are authorized to discharge. If you select "no" to this question and you post your SWPPP on the Internet and provide EPA the URL in E.2, then you have a 30 day waiting period before you are authorized to discharge. If you select "no" to this question, but do not post your SWPPP on the Internet and therefore do not answer E.2, then you have a 60 day waiting period before you are authorized to discharge.

- 3.a-e. Enter the street address, including city, state, zip code, county or similar government subdivision of the actual physical location of the facility. Do not use a P.O. Box.
- 3.f.g. Provide the facility latitude and longitude in one of three formats: (1) degrees, minutes, seconds; (2) degrees, minutes, decimal; or (3) degrees decimal. You can obtain your facility's latitude and longitude through Global Positioning System (GPS) receivers, U.S. Geological Survey (USGS) quadrangle or topographic maps, and EPA's web-based siting-tools, among other methods. Refer to www.epa.gov/npdes/stormwater/msgp for guidance on the use of these methods. For consistency, EPA requests you take measurements from the location of your facility's stormwater outfall. Outfalls are locations where the stormwater exits the facility, including pipes, ditches, swales, and other structures that transport stormwater. If there is more than one outfall present, measure at the primary outfall (i.e., the outfall with the largest volume of stormwater discharge associated with industrial activity).
- 3.h. Identify the data source that you used to determine the facility latitude and longitude. If you did not use a USGS quadrangle or topographic map, the EPA website, or GPS receivers, then select "Other" and write the method used on the line provided. If you used a USGS quadrangle or topographic map, write the map scale on the line provided. Scale should be identified on the map.
4. Enter the estimated area of industrial activity at your site exposed to stormwater, in acres.
5. Indicate if the facility is considered a "federal facility" - Federal facilities include any buildings, installations, structures, land, public works, equipment, aircraft, vessels, and other vehicles and property, owned or leased by the federal government.
6. Indicate whether the facility is located in Indian Country, and, if so, provide the name of the reservation, if applicable.

Section D. Discharge Information

1. Indicate whether stormwater from your site will be discharged into a municipal separate storm sewer system (MS4). An MS4 is a conveyance or system of conveyances, including roads with drainage systems, municipal streets, catch basins, storm drains, curbs and gutters, ditches and man-made channels, owned or operated by a state, city, town, borough, county, parish, district, association or other public body, used to collect or convey stormwater. If you check "Yes" then identify the name of the MS4 operator on the line provided. If you are uncertain of the MS4 operator, contact your local government for that information. MS4s are different than combined sewers, which are designed to convey both stormwater and sanitary wastewater. Discharges to combined sewers do not require an NPDES permit but may be subject to other CWA requirements (contact the combined sewer operator for more information).
2. Enter information regarding your discharge. If additional space is needed fill out Attachment 1.
- 2a. Indicate in column "a" of the table the name(s) of the receiving water(s) into which stormwater from your facility will discharge. Also provide in parentheses the name of the impaired water (and segment, if applicable) into which your stormwater is discharged. If you identified more than one receiving water for your facility, indicate the first receiving water and complete question 2b and 2.b.1-3 (if applicable), before entering the next receiving water. The EPA's Water Locator Tool can help you identify the closest receiving water to your facility (www.epa.gov/npdes/msgp). Your receiving water may be a lake, stream, river, ocean, wetland or other waterbody, and may or may not be located adjacent to your facility. Your stormwater may discharge directly to the receiving water or indirectly via a storm sewer system, an open drain or ditch, or other conveyance structure. Do NOT list a man-made conveyance, such as a storm sewer system, as your receiving water. Indicate the first receiving water your stormwater discharge enters. For example, if your discharge enters a storm sewer system, that empties into Trout Creek, which flows into Pine River, your receiving water is Trout Creek, because it is the first waterbody your discharge will reach. Similarly, a discharge into a ditch that feeds Spring Creek should be identified as "Spring Creek" since the ditch is a manmade conveyance. If you discharge into a municipal separate storm sewer system (MS4), you must identify the waterbody into which that portion of the storm sewer discharges. That information should be readily available from the operator of the MS4.
- 2b. Indicate in column "b" of the table whether you discharge directly to an impaired water (lake, stream segment, estuary, etc), listed as "impaired" under section 303(d) of the Clean Water Act. Each state water quality agency maintains a list of waters that are impaired. Most state agencies publish these lists online. The EPA's Water Locator Tool may also help you identify if the nearest receiving water is impaired (www.epa.gov/npdes/msgp). If you discharge into a stream

segment that is upstream of a listed impaired water but which is not itself on the State's impaired waters list, answer "no" to this question. In this case, requirements in the MSGP for discharges into impaired waters do not apply to you, unless notified otherwise by EPA.

Answer the following three questions only if you answered "Yes" to D.2.b:

- 2b1. Provide the pollutant(s) listed as causing the impairment in the water identified in D.2.b.1 above. Enter each pollutant individually on a separate row in the table.
- 2b2. Out of the pollutant(s) that you identified in D.2.b.1 above, indicate which pollutant(s) you believe will be present in your discharge. If you do not expect the pollutant(s) to be in your discharge, then select "no."
- 2b3. Indicate the pollutant(s) that have a Total Maximum Daily Load (TMDL) for the impaired stream segment that you identified in D.2.b.2 above. Check with your state water quality agency for lists of waters with approved or established TMDLs. See www.epa.gov/npdes/msgp for more information.
3. Water Quality Standards
- 3a. If you selected "no" in C.2 indicating that stormwater discharges from your facility have not been previously covered under an NPDES permit, then you are considered a new discharger and must answer this question; otherwise you are considered an existing discharger and may skip this question. State water quality agencies are responsible for setting water quality standards for waters within the state's boundaries. Check EPA's website (www.epa.gov/npdes/msgp) to determine if the water(s) that you discharge into are designated as a "Tier 2 (or Tier 2.5) water" (See Appendix A of the MSGP 2008 for definitions of "Tier 2 water" and "Tier 2.5 water"). If you discharge into these waters, EPA may impose additional permit conditions to ensure that you do not violate the State's anti-degradation policy.
- 3.b. Identify whether your receiving water is designated as a Tier 3 waterbody. Go to www.epa.gov/npdes/msgp for a list of Tier 3 waterbodies. Note that new discharges into designated Tier 3 waters are not eligible for coverage under the MSGP 2008.
4. Federal Effluent Limitation Guidelines and Sector-Specific Requirements
- 4.a-b. Depending on your industrial activities, your facility may be subject to effluent limitation guidelines which include additional effluent limits and monitoring requirements for your facility. Please review these requirements, described in Part 2.1.3 of the MSGP, and check any appropriate boxes on the NOI form.
- 4.c. For Sector S facilities (Air Transportation), indicate whether you anticipate that the entire airport facility will use more than 100,000 gallons of glycol-based deicing/anti-icing chemicals and/or 100 tons or more of urea on an average annual basis. If so, additional effluent limits and monitoring conditions apply to your discharge (see Part 8 Sector S of the MSGP 2008).
5. List the four-digit Standard Industrial Classification (SIC) code and/or two character activity code that best describes the primary industrial activities performed by your facility under which you are required to obtain permit coverage. Your primary industrial activity includes any activities performed on-site which are (1) identified by the facility's one SIC code for which the facility is primarily engaged; and (2) included in the narrative descriptions of 40 CFR 122.26(b)(14)(i), (iv), (v), or (vii), and (ix). See Appendix D of the MSGP for a complete list of SIC codes and activities codes.
6. If your site has co-located industrial activities that are not identified as your primary industrial activity, identify the sector and subsector codes that describe these other industrial activities. For a complete list of sector and subsector codes, see Appendix D of the MSGP.
- 7.a-b. Indicate whether your facility is currently inactive and unstaffed. If so then indicate whether your facility will be inactive and unstaffed for the entire permit term, or if not, specify the specific length of time in units of days, weeks, months, or years (e.g. 3 months) that you expect the facility to be inactive and unstaffed.

Section E. Facility Contact Information and SWPPP Location

- 1.a-c. Identify the name, telephone number, and email address of the person who will serve as a contact for EPA on issues related to stormwater management at your facility. This person should be able to answer questions related to stormwater discharges, the SWPPP, and other issues related to stormwater permit coverage, or have immediate access to individuals with that knowledge. This person does not have to be the facility operator, but should have intimate knowledge of stormwater management activities at the facility.
2. If you are making your Stormwater Pollution Prevention Plan publicly available on a website provide the appropriate Internet URL address. (Please note that by posting your SWPPP on the web, you may qualify for a shortened authorization waiting period. See Table 1-2 of the MSGP for more information.)

Section F. Endangered Species Protection

1. Based on the instruction provided in Appendix E of the MSGP 2008, indicate which permit criterion (A,B,C,D,E, or F) listed in Part 1.1.4.5 you are using to satisfy your eligibility obligations for protection of endangered and threatened species, and designated critical habitat.

- 2.a. If you select criterion E (not likely to adversely affect), list those federally-listed endangered or threatened species and any federally-listed designated critical habitat expected to exist in proximity to your facility.
- 2.b. List the pollutants that you expect to be present in your stormwater discharge. Include any pollutants that you may have included in D.2.b.3 above.
- 2.c. If you selected "yes" in C.2 then you are considered an existing discharger and must answer all the questions in F.2.c.1--5; otherwise you are considered a new discharger and may skip the questions under F.2.c. If you are an existing discharger who was previously covered under the MSGP 2000, indicate whether you have any previous effluent monitoring data.
- 2.c.1-2. If you select "No," to F.2.c then indicate why you don't have any data. Also indicate if you have any other data characterizing pollutants in your stormwater discharge.
- 2.c.3. If you select "Yes," to F.2.c then indicate whether you exceeded any benchmark.
- 2.c.4. Indicate whether you have exceeded any applicable effluent limitation guideline, or caused or contributed to an exceedance of state or tribal water quality requirement(s).
- 2.c.5. If you select "Yes" to F.2.c.3 and/or F.2.c.4 then indicate the pollutant parameters for which you exceeded the benchmark, applicable effluent limitation guideline, or State or Tribal water quality requirement(s).
- 2.d. Attach your supporting rationale for your determination of the applicability of Criterion E for your facility (applies to both new and existing dischargers). Your documentation should address species and habitat listed in F.2.a and the potential effects of pollutants listed in F.2.b on the listed species and habitat. This should include consideration of any available data characterizing pollutants in your stormwater discharge, or in the discharge of similar facilities if data for you facility is not available, that may be of concern to listed species.
3. If you select Criterion F (already addressed in another operator's valid certification), provide the tracking number that the operator received in their confirmation letter or email from EPA's NOI Processing Center (see Appendix E). You can find the tracking number assigned to your previous NOI on EPA's NOI Search website (www.epa.gov/npdes/noisearch). An example where criterion F may apply includes airports where several individual airlines have applied for coverage under the MSGP, and the entire airport also has applied for or obtained coverage. If the airport has already certified under Appendix E, and that certification addresses any potential impacts from the individual airlines, then the airlines may reference the airport's permit tracking number.

Section G. Historic Preservation

Based on the instruction provided in Appendix F of the MSGP 2008, indicate which permit criterion (A, B, C, or D) listed in Part 1.1.4.6 of the MSGP you used to satisfy your eligibility obligations for protection of historic properties.

Section H. Certification

Certification statement and signature (see Section B.11 of Appendix B of the MSGP for more information). Enter certifier's printed name, title and email address. Sign and date the form. (CAUTION: An unsigned or undated NOI form will prevent the granting of permit coverage.) Federal statutes provide for severe penalties for submitting false information on this application form. Federal regulations require this application to be signed as follows:

For a corporation: by a responsible corporate officer, which means:

- (i) president, secretary, treasurer, or vice-president of the corporation in charge of a principal business function, or any other person who performs similar policy or decision making functions for the corporation, or
- (ii) the manager of one or more manufacturing, production, or operating facilities, provided the manager is authorized to make management decisions which govern the operation of the regulated facility including having the explicit or implicit duty of making major capital investment recommendations, and initiating and directing other comprehensive measures to assure long term environmental compliance with environmental laws and regulations; the manager can ensure that the necessary systems are established or actions taken to gather complete and accurate information for permit application requirements; and where authority to sign documents has been assigned or delegated to the manager in accordance with corporate procedures;

For a partnership or sole proprietorship: by a general partner or the proprietor; or

For a municipal, State, Federal, or other public facility: by either a principal executive or ranking elected official.

If the NOI was prepared by someone other than the certifier (for example, if the NOI was prepared by the facility SWPPP contact or a consultant for the certifier's signature), include the name, organization, phone number and email address of the NOI preparer.

Paperwork Reduction Act Notice

Public reporting burden for this certification is estimated to average 3.7 hours per certification, including time for reviewing instructions, searching existing data sources, gathering and maintaining the data needed, and completing and reviewing the collection of information. Burden means the total time, effort, or financial resources expended by persons to generate, maintain, retain, or disclose to provide

information to or for a Federal agency. This includes the time needed to review instructions; develop, acquire, install, and utilize technology and systems for the purposes of collecting, validating, and verifying information, processing and maintaining information, and disclosing and providing information; adjust the existing ways to comply with any previously applicable instructions and requirements; train personnel to be able to respond to a collection of information; search data sources; complete and review the collection of information; and transmit or otherwise disclose the information. An agency may not conduct or sponsor, and a person is not required to respond to, a collection of information unless it displays a currently valid OMB control number. Send comments regarding the burden estimate, any other aspect of the collection of information, or suggestions for improving this form, including any suggestions which may increase or reduce this burden to: Director, Office of Environmental Information Services, Collection Services Division (2823), USEPA, 1200 Pennsylvania Avenue, NW, Washington, DC 20460. Include the OMB control number of this form on any correspondence. Do not send the completed NOI form to this address.

MSGP MONITORING REQUIREMENTS



U.S. ENVIRONMENTAL PROTECTION AGENCY
(EPA)
NATIONAL POLLUTANT DISCHARGE ELIMINATION
SYSTEM (NPDES)
EPA NOI Processing Center



Company: CITY OF PORTSMOUTH
ATTN: STEVEN F. PARKINSON
1 Junkins Avenue
Portsmouth, NH 03801

Facility: RECYCLING CENTER
680 Peverly Hill Rd
Portsmouth, NH 03801

Based on the information you provided in your NOI, you are subject to monitoring and subsequent reporting requirements. A summary of your monitoring requirements are provided below. Remember to review Part 9 of the MSGP 2007 to determine if you have additional state or tribal requirements (www.epa.gov/npdes/msgp). You may view and download monitoring guidance, including A Stormwater Sampling Guide for Industrial Facilities, at <http://www.epa.gov/npdes/msgp>. You may also now submit your monitoring results using the EPA's eReporting system at http://cdx.epa.gov/epa_home.asp.

You are also required to submit an annual report to EPA (see Part 7.2 of the MSGP). This report will contain the findings from your comprehensive site inspection, including a discussion of any corrective actions required during the reporting period. You will also need to submit an Exceedance Report to EPA if follow-up monitoring exceeds your effluent limitation guideline-based effluent limits (see Part 7.3), as well as any additional reports required under this permit (see Part 7.4).

Sector: P-Land Transportation and Warehousing

Effluent Limitations Requirements		
Parameter	Value	Unit

Sector: N-Scrap Recycling Facilities

Benchmark Requirements			
Parameter	Value	Unit	Reporting Period/Type
Total Suspended Solids (TSS)	100.0	mg/L	

Sector: N-Scrap Recycling Facilities

Effluent Limitations Requirements		
Parameter	Value	Unit

Silke Psula

From: NOI Call Center [no_reply@epa.gov]
Sent: Sunday, February 01, 2009 12:02 PM
To: Steve Parkinson; Silke Psula
Subject: [BULK] NOI Waiting Period End Confirmation

Importance: Low

Company: City of Portsmouth
ATTN: Steven F. Parkinson
1 Junkins Avenue,
Portsmouth, New Hampshire 03801

Facility: Recycling Center
680 Peverly Hill Rd,
Portsmouth, New Hampshire 03801

TRACKING NUMBER: NHR05BM27

This email acknowledges that a complete Notice of Intent (NOI) form seeking coverage under EPA's Industrial Multi-Sector General Permit (MSGP) is now active. Your NOI was completed and submitted on 01/02/2009. Coverage under this permit began at the conclusion of your 30 DAY waiting period on 02/01/2009, unless otherwise notified by EPA.

For tracking purposes, the following number has been assigned to your Notice of Intent Form: NHR05BM27. Attached to this email, you will find an electronic copy of your completed NOI which should be posted at your site.

As stated above, this email acknowledges receipt of a complete Notice of Intent. However, it is not an EPA determination of the validity of the information you provided. Your eligibility for coverage under this Permit is based on the validity of the certification you provided. Your electronic signature on this form certifies that you have read, understood, and are implementing all of the applicable requirements. An important aspect of this certification requires that you have correctly determined whether you are eligible for coverage under this permit.

As you know, the MSGP requires you to have developed and begun implementing a Stormwater Pollution Prevention Plan (SWPPP). It also outlines important inspection and record keeping requirements. You must also comply with any additional location-specific requirements applicable to your state or tribal area. A copy of the MSGP must be kept with your SWPPP. An electronic copy of the MSGP and additional guidance materials can be viewed and downloaded at <http://www.epa.gov/npdes/stormwater>.

If you have general questions regarding the stormwater program or your responsibilities under the MSGP, please call:

EPA Region 1
Regional Contact Name: Thelma Murphy Regional Contact Phone: (617) 918-1615

If you have questions about your form, please call the EPA NOI Processing Center at 1-866-352-7755 (toll free) or send an inquiry via the online form at <http://www.epa.gov/npdes/stormwater/noicontact>.

If you have difficulty accessing CDX, please contact the CDX Help Desk at: (888) 890-1995.

You can return to the eNOI system using the following link at any time <https://cdx.epa.gov/SSL/cdx/login.asp>.

EPA NOI Processing Center
Operated by Avanti Corporation
1200 Pennsylvania Ave., NW
Mail Code: 4203M
Washington, DC 20460
1-866-352-7755

Silke Psula - [BULK] NOI Waiting Period Begin Confirmation

From: NOI Call Center
To: ,
Date: 1/2/2009 11:53 AM
Subject: [BULK] NOI Waiting Period Begin Confirmation
Attachments:

Company: City of Portsmouth
ATTN: Steven F. Parkinson
1 Junkins Avenue,
Portsmouth, New Hampshire 03801

Facility: Recycling Center
680 Peeverly Hill Rd,
Portsmouth, New Hampshire 03801
TRACKING NUMBER: NHR05BM27

This email acknowledges that you have submitted a complete Notice of Intent (NOI) form seeking coverage under EPA's Industrial Multi-Sector General Permit (MSGP). Your NOI was completed and submitted on 01/02/2009. Coverage under this permit will begin at the conclusion of your 30 DAY waiting period on 02/01/2009, unless otherwise notified by EPA.

As stated above, this email acknowledges receipt of a complete Notice of Intent. However, it is not an EPA determination of the validity of the information you provided. Your eligibility for coverage under this Permit is based on the validity of the certification you provided. Your electronic signature on this form certifies that you have read, understood, and are implementing all of the applicable requirements. An important aspect of this certification requires that you have correctly determined whether you are eligible for coverage under this permit.

As you know, the MSGP requires you to have developed and begun implementing a Stormwater Pollution Prevention Plan (SWPPP). It also outlines important inspection and record keeping requirements. You must also comply with any additional location-specific requirements applicable to your state or tribal area. A copy of the MSGP must be kept with your SWPPP. An electronic copy of the MSGP can be found at <http://www.epa.gov/npdes/stormwater/enoi>. Additional guidance materials can be viewed and downloaded at <http://www.epa.gov/npdes/stormwater/msgp>.

If you have general questions regarding the stormwater program or your responsibilities under the MSGP, please call:

EPA Region 1

Regional Contact Name: Thelma Murphy Regional Contact Phone: (617) 918-1615

If you have questions about your form, please call the EPA NOI Processing Center at 1-866-352-7755 (toll free) or send an inquiry via the online form at <http://www.epa.gov/npdes/noicontact>.

If you have difficulty accessing CDX, please contact the CDX Help Desk at: (888) 890-1995.

You can return to the eNOI system using the following link at any time
<https://cdx.epa.gov/SSL/cdx/login.asp>.

EPA NOI Processing Center
Operated by Avanti Corporation
1200 Pennsylvania Ave., NW
Mail Code: 4203M
Washington, DC 20460
1-866-352-7755



U.S. ENVIRONMENTAL PROTECTION
AGENCY (EPA)
NATIONAL POLLUTANT DISCHARGE
ELIMINATION SYSTEM (NPDES)
EPA's NOI PROCESSING CENTER



01/02/2009

Company: CITY OF PORTSMOUTH
ATTN: STEVEN F. PARKINSON
1 Junkins Avenue
Portsmouth, NH 03801
Permit Number: NHR05BM27

Facility: RECYCLING CENTER
680 Peverly Hill Rd
Portsmouth, NH 03801

This email/letter acknowledges that you have submitted a complete Notice of Intent form to be covered under the NPDES General Permit for Stormwater Discharges for Multi-Sector General Permit Activity (Multi-Sector General Permit). Coverage under this permit begins at the conclusion of your thirty-day waiting period, on 02/01/2009.

As stated above, this letter acknowledges receipt of a complete Notice of Intent. However, it is not an EPA determination of the validity of the information you provided. Your eligibility for coverage under the Permit is based on the validity of the certification you provided. Your signature on the Notice of Intent certifies that you have read, understood, and are implementing all of the applicable requirements. An important aspect of this certification requires that you correctly determine whether you are eligible for coverage under this permit.

As you know, the Multi-Sector General Permit requires you to have developed and begun implementing a Stormwater Pollution Prevention Plan (SWPPP) and outlines important inspection and record keeping requirements. You must also comply with any additional location-specific requirements applicable to your state or tribal area. A copy of the Multi-Sector General Permit must be kept with your SWPPP. An electronic copy of the Permit and additional guidance materials can be viewed and downloaded at www.epa.gov/npdes/stormwater.

For tracking purposes, the following number has been assigned to your Notice of Intent Form:
NHR05BM27.

If you have general questions regarding the stormwater program or your responsibilities under the Multi-Sector General Permit, please call

EPA Region 1

Thelma Murphy (617) 918-1615

If you have questions about your Notice of Intent form, please call the EPA NOI Processing Center at 1-866-352-7755 (toll free) or send an inquiry via the online form at <http://www.epa.gov/npdes/noicontact>.

Next time, you can use the eNOI system (<[a href="http://www.epa.gov/npdes">http://www.epa.gov/npdes](http://www.epa.gov/npdes)) to apply for a Notice of Intent.

EPA NOI Processing Center
Operated by Avanti Corporation
1200 Pennsylvania Ave., NW
Mail Code: 4203M
Washington, DC 20460
1-866-352-7755

Silke Psula - NOI Ready for Certification

From: NOI Call Center
To: ,
Date: 12/23/2008 11:52 AM
Subject: NOI Ready for Certification

Company: City of Portsmouth
ATTN: Steve F. Parkinson
1 Junkins Avenue,
Portsmouth, New Hampshire 03801

Facility: Recycling Center
680 Peverly Hill Rd,
Portsmouth, New Hampshire 03801

TRACKING NUMBER: NHR05BM27

On 12/23/2008, Silke Psula saved a draft Notice of Intent (NOI) form, referenced above, seeking coverage under EPA's Industrial Multi-Sector General Permit (MSGP). It is now ready for your review and certification (certification is done via an electronic signature).

Your electronic signature on this Notice of Intent form certifies that you have read, understood, and are implementing all of the applicable requirements outlined in the Permit. Among other things, the Permit requires that you have developed and begun implementing a Stormwater Pollution Prevention Plan (SWPPP). Please do not electronically sign this form until you have verified that all of the conditions of this Permit have been met. An electronic copy of the MSGP can be found at <http://www.epa.gov/npdes/stormwater/enoi>. Additional guidance materials can be found at <http://www.epa.gov/npdes/stormwater/msgp>.

If you do not certify this NOI by 03/23/2009 it will be deleted from the system. To complete this form, please log into the eNOI system https://cdx.epa.gov/SSL/cdx/epa_home.asp.

Remember that permit coverage will not begin until the NOI is complete, certified, and the waiting period has expired. If you have general questions regarding the stormwater program or your responsibilities under the MSGP, please call:

EPA Region 1

Regional Contact Name: Thelma Murphy Regional Contact Phone: (617) 918-1615

If you have questions about your form, please call the EPA NOI Processing Center at 1-866-352-7755 (toll free) or send an inquiry via the online form at <http://www.epa.gov/npdes/noicontact>.

If you have difficulty accessing CDX, please contact the CDX Help Desk at: (888) 890-1995.

EPA NOI Processing Center
Operated by Avanti Corporation
1200 Pennsylvania Ave., NW
Mail Code: 4203M
Washington, DC 20460



Electronic Notice of Intent

Online Stormwater Application

[HOME](#)
[HELP](#)
[PROFILE](#)
[LOGOUT](#)

Multi-Sector General Permit Notice of Intent to Discharge

Form Confirm

Industrial Multi-Sector General Permit Confirmation

Please confirm that all of the information on your NOI is correct. If the information is correct, please print this page for your records. Then click the "Send to Certifying Official" button to go forward. You will be carbon copied (cc'ed) on the email that your specified certifying official receives.

State:	NH
Project Located on Indian Land?	No
Is this industrial facility a federal facility?	No
General Permit Number you are seeking coverage under:	NHR050000
Permit Tracking Number:	NHR05BM27

Operator Information

Operator/Company Name:	City of Portsmouth
IRS EIN:	026000714
Street:	1 Junkins Avenue
City/State/ZIP:	Portsmouth NH 03801
Phone:	603-431-2000
Fax:	
Email:	spsula@pw.cityofportsmouth.com

Project/Site Information

Facility Name: Recycling Center
Facility Address: 680 Peverly Hill Rd
County: Rockingham
City/State/ZIP: Portsmouth NH 03801

Latitude and Longitude

Degrees/Minutes/Seconds (Latitude): 43 ° 03 ' 00 " N
Degrees/Minutes/Seconds (Longitude): 70 ° 46 ' 48 " W
Latitude/Longitude Method: Other
Other Method: GIS
The distance between your facility and the location determined by the Latitude/Longitude provided: 0.4 miles

Discharge of Stormwater

Have stormwater discharges from your site been covered previously under an NPDES permit? Yes
Tracking/permit Number: NHR05A817
Estimated area of industrial activity at your site exposed to stormwater : 8.3 (acres)
Does your facility discharge stormwater into a Municipal separate storm sewer system (MS4)? Yes
MS4 Operator Name: City of Portsmouth

Federal Effluent Limitation Guidelines and Sector-Specific Requirements

Are you requesting coverage under the MSGP for any stormwater discharges subject to effluent limitations ? No
If you are a Sector S (Air Transportation) facility, do you anticipate using more than 100,000 gallons of glycol-based deicing/anti-icing chemicals and/or 100 tons or more of urea on an average annual basis? No
Is your site inactive and unstaffed? No

Standard Industrial Classification (SIC) Code Information

Standard Industrial Classification (SIC) Code: 5093 - Scrap Recycling and Waste Recycling Facilities except Source-Separated Recycling;

Source-separated Recycling Facility

Sector/Subsector Information

Sector(s) and Subsector(s):

- N Scrap Recycling Facilities**
- N.1 Scrap Recycling and Waste Recycling Facilities except Source-Separated Recycling
- N.2 Source-separated Recycling Facility
- P Land Transportation and Warehousing**
- P.1 Bus charter service, except local; Courier Services, Except by Air; Farm product warehousing and storage; General warehousing and storage; Intercity and Rural Bus Transportation; Local Trucking With Storage; Local Trucking Without Storage; Local and suburban transit; Local bus charter service; Local passenger transportation, n.e.c.; Petroleum Bulk Stations and Terminals; Railroad Switching and Terminal Establishments; Railroad Transportation; Refrigerated warehousing and storage; School Buses; Special warehousing and storage, n.e.c.; Taxicabs; Terminal and Joint Terminal Maintenance Facilities for Motor Freight Transportation; Terminal and Service Facilities for Motor Vehicle Passenger Transportation; Trucking, Except Local; United States Postal Service

Stormwater Pollution Prevention Plan Information

SWPPP Contact Name: Silke Psula
How can the SWPPP Contact be Reached?
Telephone Number: 603-766-1454
SWPPP E-mail: spsula@pw.cityofportsmouth.com

Endangered Species Protection

ESA Criterion:
 Criterion D.
 Coordination between the operator and the U.S. Fish and Wildlife Service and/or the National Marine Fisheries Service has been concluded. The coordination must have addressed the effects of the facility's stormwater discharges associated with industrial activity, discharge-related activities, and allowable non-stormwater discharges on federally-listed threatened or endangered species and federally-designated critical habitat. The result of the coordination must be a written statement from the Service concluding that permitting your stormwater discharges, discharge-related activities, and allowable non-stormwater discharges is not likely to adversely affect federally-listed threatened or endangered species and federally-designated critical habitat. Any conditions or prerequisites deemed necessary to achieve consistency with the "not likely to adversely effect" determination become eligibility conditions for MSGP coverage.

Historic Preservation Information

Historic Preservation:

Criterion B - Historic properties are identified in the path of your facility's stormwater and allowable non-stormwater discharges or where construction activities are planned to install BMPs to control such discharges, and it is determined that there is the potential to adversely affect the property, but you have obtained and complied with a written agreement with the appropriate State or Tribal Historic Preservation Officer that outlines measures you will follow to mitigate or prevent those adverse effects.

Send to Certifying Official

 EPA U.S. Environmental Protection Agency



U.S. ENVIRONMENTAL PROTECTION AGENCY (EPA)
NATIONAL POLLUTANT DISCHARGE ELIMINATION SYSTEM (NPDES)
STORM WATER NOTICE OF INTENT CENTER

OPERATOR:
CITY OF PORTSMOUTH
1 JUNKINS AVENUE
PORTSMOUTH, NH
03801

FACILITY
PUBLIC WORKS FACILITY
680 PEVERLY HILL ROAD
PORTSMOUTH, NH
03801

Dear Operator:

04/03/2003

This letter acknowledges that you have submitted a complete Notice of Intent form to be covered under the *NPDES Storm Water Multi-Sector General Permit for Industrial Activities* issued by EPA on October 30, 2000 (Federal Register – 65 FR 64746). Please note that this letter is not the permit. The permit provides for authorization to discharge based on submission of a *valid* and *complete* Notice of Intent. **If you met the eligibility requirements, coverage begins 48 hours after the postmark date of your Notice of Intent.** Your Notice of Intent was postmarked on 3/7/2003

As stated above, this letter acknowledges receipt of a *complete* Notice of Intent. However, it is not an EPA determination of the *validity* of the information you provided. Your eligibility for coverage under the Permit is based on the validity of the certification you provided. Your signature on the Notice of Intent certifies that you have read, understood, and are implementing all of the applicable requirements. An important aspect of this certification requires that you correctly determine whether you are eligible for coverage under this permit.

As you know, the Multi-Sector General Permit requires you to have developed and begun implementing a Storm Water Pollution Prevention Plan (SWPPP) and outlines important inspection and recordkeeping requirements. You must also comply with any additional location-specific requirements applicable to your state or tribal area. A copy of the Multi-Sector General Permit must be kept with your SWPPP. An electronic copy of the Permit and additional guidance materials can be viewed and downloaded at www.epa.gov/npdes/stormwater.

For tracking purposes, the following number has been assigned to your Notice of Intent Form:

NHR05A817

If you have general questions regarding the storm water program or your responsibilities under the Multi-Sector General Permit, please call **Thelma Murphy**, the Region 01 Storm Water Program contact, at (617) 918-1615. If you have questions about your Notice of Intent form, please call the EPA NOI Processing Center at 1 (866) 352-7755 (toll free) or send an inquiry via the online form at <http://www.epa.gov/npdes/noicontact>.

Sincerely,

EPA NOI Processing Center
Operated by CTGi
1200 Pennsylvania Ave. NW
Mail Code: 4203M
Washington, DC 20460
1-866-352-7755



Notice of Intent for Storm Water Discharges Associated with INDUSTRIAL ACTIVITY Under the Multi-sector NPDES General Permit

Submission of this completed Notice of Intent (NOI) constitutes notice that the entity in Section B intends to be authorized to discharge pollutants to waters of the United States, from the facility or site identified in Section C, under EPA's Storm Water Multi-sector General Permit (MSGP). Submission of the NOI also constitutes notice that the party identified in Section B of this form has read, understands, and meets the eligibility conditions of Part I of the MSGP; agrees to comply with all applicable terms and conditions of the MSGP; understands that continued authorization under the MSGP is contingent on maintaining eligibility for coverage, and that implementation of the permittee's pollution prevention plan is required two days after a complete NOI is mailed. In order to be granted coverage, all information required on this form must be completed. Please read and make sure you comply with all permit requirements, including the requirement to prepare and implement a storm water pollution prevention plan.

A. Permit Selection

If new, enter generic permit, otherwise enter previous permit: NH05

New Permit Number(EPA Use Only)

R05

B. Facility Operator Information

1. Name: CITY OF PORTSMOUTH 2. Phone: 6034311201010
3. Mailing Address: a. Street or P.O. Box: 1 JUNKINS AVENUE
b. City: PORTSMOUTH c. State: NH d. Zip Code: 03801

C. Facility/Site Information

1. Facility/Site Name: PUBLIC WORKS FACILITY
2. Location Address: a. Street: 680 PEVERLY HILL ROAD
b. City: PORTSMOUTH c. County: ROCKINGHAM
d. State: NH e. Zip Code: 03801 f. Latitude: 43°03'00" g. Longitude: 70°46'48"
3. If you are filing as a co-permittee, enter storm water general permit number:
4.a. Permit Applicant: Federal State Tribal Private Other public entity
b. Is the facility located on Indian Country Lands? Yes No
5. Does the facility discharge storm water into:
a. Receiving water(s)? Yes No If yes, name(s) of receiving water(s):
b. A municipal separate storm sewer system (MS4)? Yes No
If yes, name of the MS4 operator: CITY OF PORTSMOUTH
6. The 4-digit Standard Industrial Classification (SIC) codes or the 2-letter Activity Codes that best represent the principal products produced or services rendered by your facility and major co-located activities:
Primary: 5093 Secondary (if applicable):

7. Applicable sector(s) of industrial activity, as designated in Part 1.2.1 of the MSGP, that include associated discharges that you seek to have covered under this permit (choose up to three):

- Sector A Sector F Sector K Sector P Sector U Sector Z
Sector B Sector G Sector L Sector Q Sector V Sector AA
Sector C Sector H Sector M Sector R Sector W Sector AB
Sector D Sector I Sector N Sector S Sector X Sector AC
Sector E Sector J Sector O Sector T Sector Y Sector AD

8. Additional Facility/Site Requirements:

a. Based on the instructions provided in Addendum A of the MSGP, have the eligibility criteria for "listed species" and critical habitat been met? Yes No
b. Based on the instructions provided in Addendum B of the MSGP, have the eligibility criteria for protection of historic properties been met? Yes No

D. Certification

Do you certify under penalty of law that this document and all attachments were prepared under your direction or supervision in accordance with a system designed to assure that qualified personnel properly gather and evaluate the information submitted? Based on your inquiry of the person or persons who manage the system, or those persons directly responsible for gathering the information, do you certify that the information submitted is, to the best of your knowledge and belief, true, accurate, and complete? Do you certify that you are aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations?

Print Name: JOHN P. BOHEIN

Signature: [Handwritten Signature]

Date: 030703

Instructions for Completing the Notice of Intent for Storm Water Discharges Associated with INDUSTRIAL ACTIVITY Under the Multi-sector General Permit

Who Must File a Notice of Intent?

Under the provisions of section 402(p) of the Clean Water Act (CWA) and regulations at 40 CFR Part 122, Federal law prohibits "point source" discharges of storm water associated with industrial activity to waters of the U.S. without a National Pollutant Discharge Elimination System (NPDES) permit. If you operate a facility which is described in Part 1.2.1. of the Multi-sector General Permit (MSGP) or if you have been designated as needing permit coverage for your storm water discharges by your NPDES permitting authority, and you meet the eligibility requirements in Part 1 of the permit, you may satisfy your CWA obligation for permit coverage by submitting a completed NOI to obtain coverage under the MSGP. If you have questions about whether you need a permit under the NPDES Storm Water Program, contact your NPDES permitting authority (i.e., your EPA Regional storm water coordinator or your State water pollution control agency).

One NOI must be submitted for each facility or site for which you are seeking permit coverage. Only one NOI need be submitted to apply for coverage for all of your activities at each facility (e.g., you do not need to submit a separate NOI for each type of industrial activity located at a facility or industrial complex, provided your storm water pollution prevention plan covers each area for which you are an operator). Finally, the NOI must be submitted in accordance with the deadlines established in Part 2.1 of the MSGP.

When to file the NOI Form

DO NOT FILE THE NOI UNTIL YOU HAVE OBTAINED A COPY OF THE MULTI-SECTOR GENERAL PERMIT. You will need it to determine your eligibility, prepare your storm water pollution prevention plan, and correctly answer all questions on the NOI form — all of which must be done before you can sign the certification statement on the NOI in good faith (and without risk of committing perjury).

If you have a new facility or are the new operator of an existing facility, this form must be postmarked at least 48 hours before you need permit coverage. If your facility was covered under the 1995 Multi-sector General Permit or if you are currently operating without a permit, see Part 2.1 of the MSGP for your deadlines. CAUTION: You must allow enough lead time to gather the information necessary to complete the NOI (especially that related to determining eligibility with regards to endangered species and historic properties) and prepare the pollution prevention plan required by Part 4 of the MSGP prior to submitting your NOI.

Where to file the NOI Form (NOI Processing Center's Toll Free Number: (866) 352-7755) Do not send Storm Water Pollution Prevention Plans (SWPPPs) to these addresses.

NOIs sent regular mail:

Storm Water Notice of Intent (4203M)
USEPA
1200 Pennsylvania Avenue, NW
Washington, DC 20460

NOIs sent overnight/express:

Storm Water Notice of Intent
EPA East Building, Rm. 7329
1201 Constitution Avenue, NW
Washington, DC 20004

(For overnight/express delivery of NOIs, add the phone number (202) 564-9537)

NOTE: While not currently available, EPA is exploring the possibility of offering the option to complete the NOI form electronically online via the Internet. If this option does become available, directions will be posted on EPA's web site. To check on the availability of the alternative Online NOI, please visit <http://www.epa.gov/npdes/stormwater>. If the Online NOI is not available, you must file the NOI at the above address.

If your facility discharges through a municipal separate storm sewer system (MS4) that is permitted as a medium or large MS4 under the NPDES Storm Water Program, you must also submit a signed copy of the NOI to the operator of that MS4, in accordance with the deadlines established in Part 2.1 of the permit.

Completing the NOI Form

To complete this form, type or print, using uppercase letters, in the appropriate areas only. Please place each character between the marks (abbreviate if necessary to stay within the number of characters allowed for each item). Use one space for breaks between words. Please make sure you have addressed all applicable questions and have made a photocopy for your records before sending the completed form to the address above. Please submit original document with signature in ink—DO NOT send copies.

Section A. Permit Selection

If your facility was previously covered by the MSGP 1995 Permit, and you are transferring to the October 29, 2000 version of the MSGP (MSGP 2000), then you must indicate the MSGP 1995 permit number assigned to you by the Storm Water Notice of Intent Center.

If your facility was not previously covered by the MSGP 1995 Permit, and you are applying for new coverage under the MSGP 2000 Permit, you must indicate the "generic" permit number covering your facility area. You will find your generic permit number in the MSGP 2000 Permit, Federal Register, Vol. 65, No. 210, Monday, October 30, 2000, on pages 64802-64803. (As an example, the generic permit number for an industrial site in Puerto Rico would be PRR05****.) The MSGP 2000 Permit is available online at: http://cfpub.epa.gov/npdes/stormwater/mssp.cfm?program_id=6.

Section B. Facility Operator Information

1. Provide the legal name of the person, partnership, co-partnership, firm, company, corporation, association, joint stock company, trust, estate, governmental entity, or other legal entity that operates the facility or site described in this application. The name of the operator may or may not be the same as the name of the facility. The responsible party is the legal entity that controls the facility's operation, rather than the plant or site manager.
2. Provide the telephone number of the facility operator.
3. Provide the mailing address of the facility operator. Include the street address or P.O. Box, city, state, and zip code. All correspondence regarding the permit will be sent to this address, not the facility address in Section C.
4. Indicate the legal status of the facility operator as a Federal, State, Tribal private, or other public entity (other than Federal or State). This refers only to the operator, not the owner or the

land the facility or site is located upon.

Section C. Facility/Site Information

1. Enter the official or legal name of the facility or site.
2. Enter the complete street address (if no street address exists, provide a geographic description [e.g., Intersection of Routes 9 and 55]), city, county, state, and zip code. Do not use a P.O. Box. Enter the latitude and longitude of the approximate center of the facility or site in degrees/minutes/seconds. Latitude and longitude can be obtained from U.S. Geological Survey (USGS) quadrangle or topographic maps, by using a GPS unit, by calling 1-(888) ASK-USGS, by searching for your facility's address on several commercial "map" sites on the Internet, or by accessing the the Census Bureau Internet site: <http://www.census.gov/cgi-bin/gazetteer>.
3. If you are filing as a co-permittee and a storm water general permit number has been issued to the co-permittee, enter the number in the space provided.
4. Indicate whether the facility is located on Indian Country lands (e.g., a federally recognized reservation, etc.).
5. Indicate whether the facility or site discharges storm water into a receiving water(s) and/or a municipal separate storm sewer system (MS4). Enter the name(s) of the closest receiving water(s) and/or the MS4 (An MS4 is defined as a conveyance or system of conveyances (including roads with drainage systems, municipal streets, catch basins, curbs, gutters, ditches, man-made channels, or storm drains) that is owned or operated by a state, city, town, borough, county, parish, district, association, or other public body and is designed or used for collecting or conveying storm water.)
6. List your primary and secondary four 4-digit Standard Industrial Classification (SIC) codes or 2-character Activity Codes that best describe the principal products or services provided at the facility or site identified in Section C of this application. For industrial activities defined in 40 CFR 122.26(b)(1)(i)-(ix) and (xi) that do not have SIC codes that accurately describe the principal products produced or services provided, use the following 2-character Activity Codes: HZ = Hazardous waste treatment, storage, or disposal facilities, including those that are operating under interim status or a permit under subtitle C of RCRA [40 CFR 122.26(b)(1)(v)]; LF = Landfills, land application sites, and open dumps that receive or have received any industrial wastes, including those that are subject to regulation under subtitle D of RCRA [40 CFR 122.26(b)(1)(v)]; SE = Steam electric power generating facilities, including coal handling sites [40 CFR 122.26(b)(1)(vii)]; TW = Treatment works treating domestic sewage or any other sewage sludge or wastewater treatment device or system, used in the storage, treatment, recycling, and reclamation of municipal or domestic sewage [40 CFR 122.26(b)(1)(ix)]; or Alternatively, if your facility or site was specifically designated by your NPDES permitting authority (EPA), enter "AD."

Section D. Certification

Certification statement and signature. (CAUTION: An unsigned or undated NOI form will prevent the granting of permit coverage.) Federal statutes provide for severe penalties for submitting false information on this application form. Federal regulations require this application to be signed as follows:

For a corporation: by a responsible corporate officer, which means:

- (i) president, secretary, treasurer, or vice-president of the corporation in charge of a principal business function, or any other person who performs similar policy or decision making functions for the corporation, or
- (ii) the manager of one or more manufacturing, production, or operating facilities, provided the manager is authorized to make management decisions which govern the operation of the regulated facility including having the explicit or implicit duty of making major capital investment recommendations, and initiating and directing other comprehensive measures to assure long term environmental compliance with environmental laws and regulations; the manager can ensure that the necessary systems are established or actions taken to gather complete and accurate information for permit application requirements; and where authority to sign documents has been assigned or delegated to the manager in accordance with corporate procedures;

For a partnership or sole proprietorship: by a general partner or the proprietor; or
For a municipal, State, Federal, or other public facility: by either a principal executive or ranking elected official.

Paperwork Reduction Act Notice

Public reporting burden for this certification is estimated to average 3.7 hours per certification, including time for reviewing instructions, searching existing data sources, gathering and maintaining the data needed, and completing and reviewing the collection of information. Burden means the total time, effort, or financial resources expended by persons to generate, maintain, retain, or disclose to provide information to or for a Federal agency. This includes the time needed to review instructions; develop, acquire, install, and utilize technology and systems for the purposes of collecting, validating, and verifying information, processing and maintaining information, and disclosing and providing information; adjust the existing ways to comply with any previously applicable instructions and requirements; train personnel to be able to respond to a collection of information; search data sources; complete and review the collection of information; and transmit or otherwise disclose the information. An agency may not conduct or sponsor, and a person is not required to respond to, a collection of information unless it displays a currently valid OMB control number. Send comments regarding the burden estimate, any other aspect of the collection of information, or suggestions for improving this form, including any suggestions which may increase or reduce this burden to: Director, Office of Environmental Information Services, Collection Services Division (2823), USEPA, 1200 Pennsylvania Avenue, NW, Washington, DC 20460. Include the OMB control number of this form on any correspondence. Do not send the completed NOI form to this address.